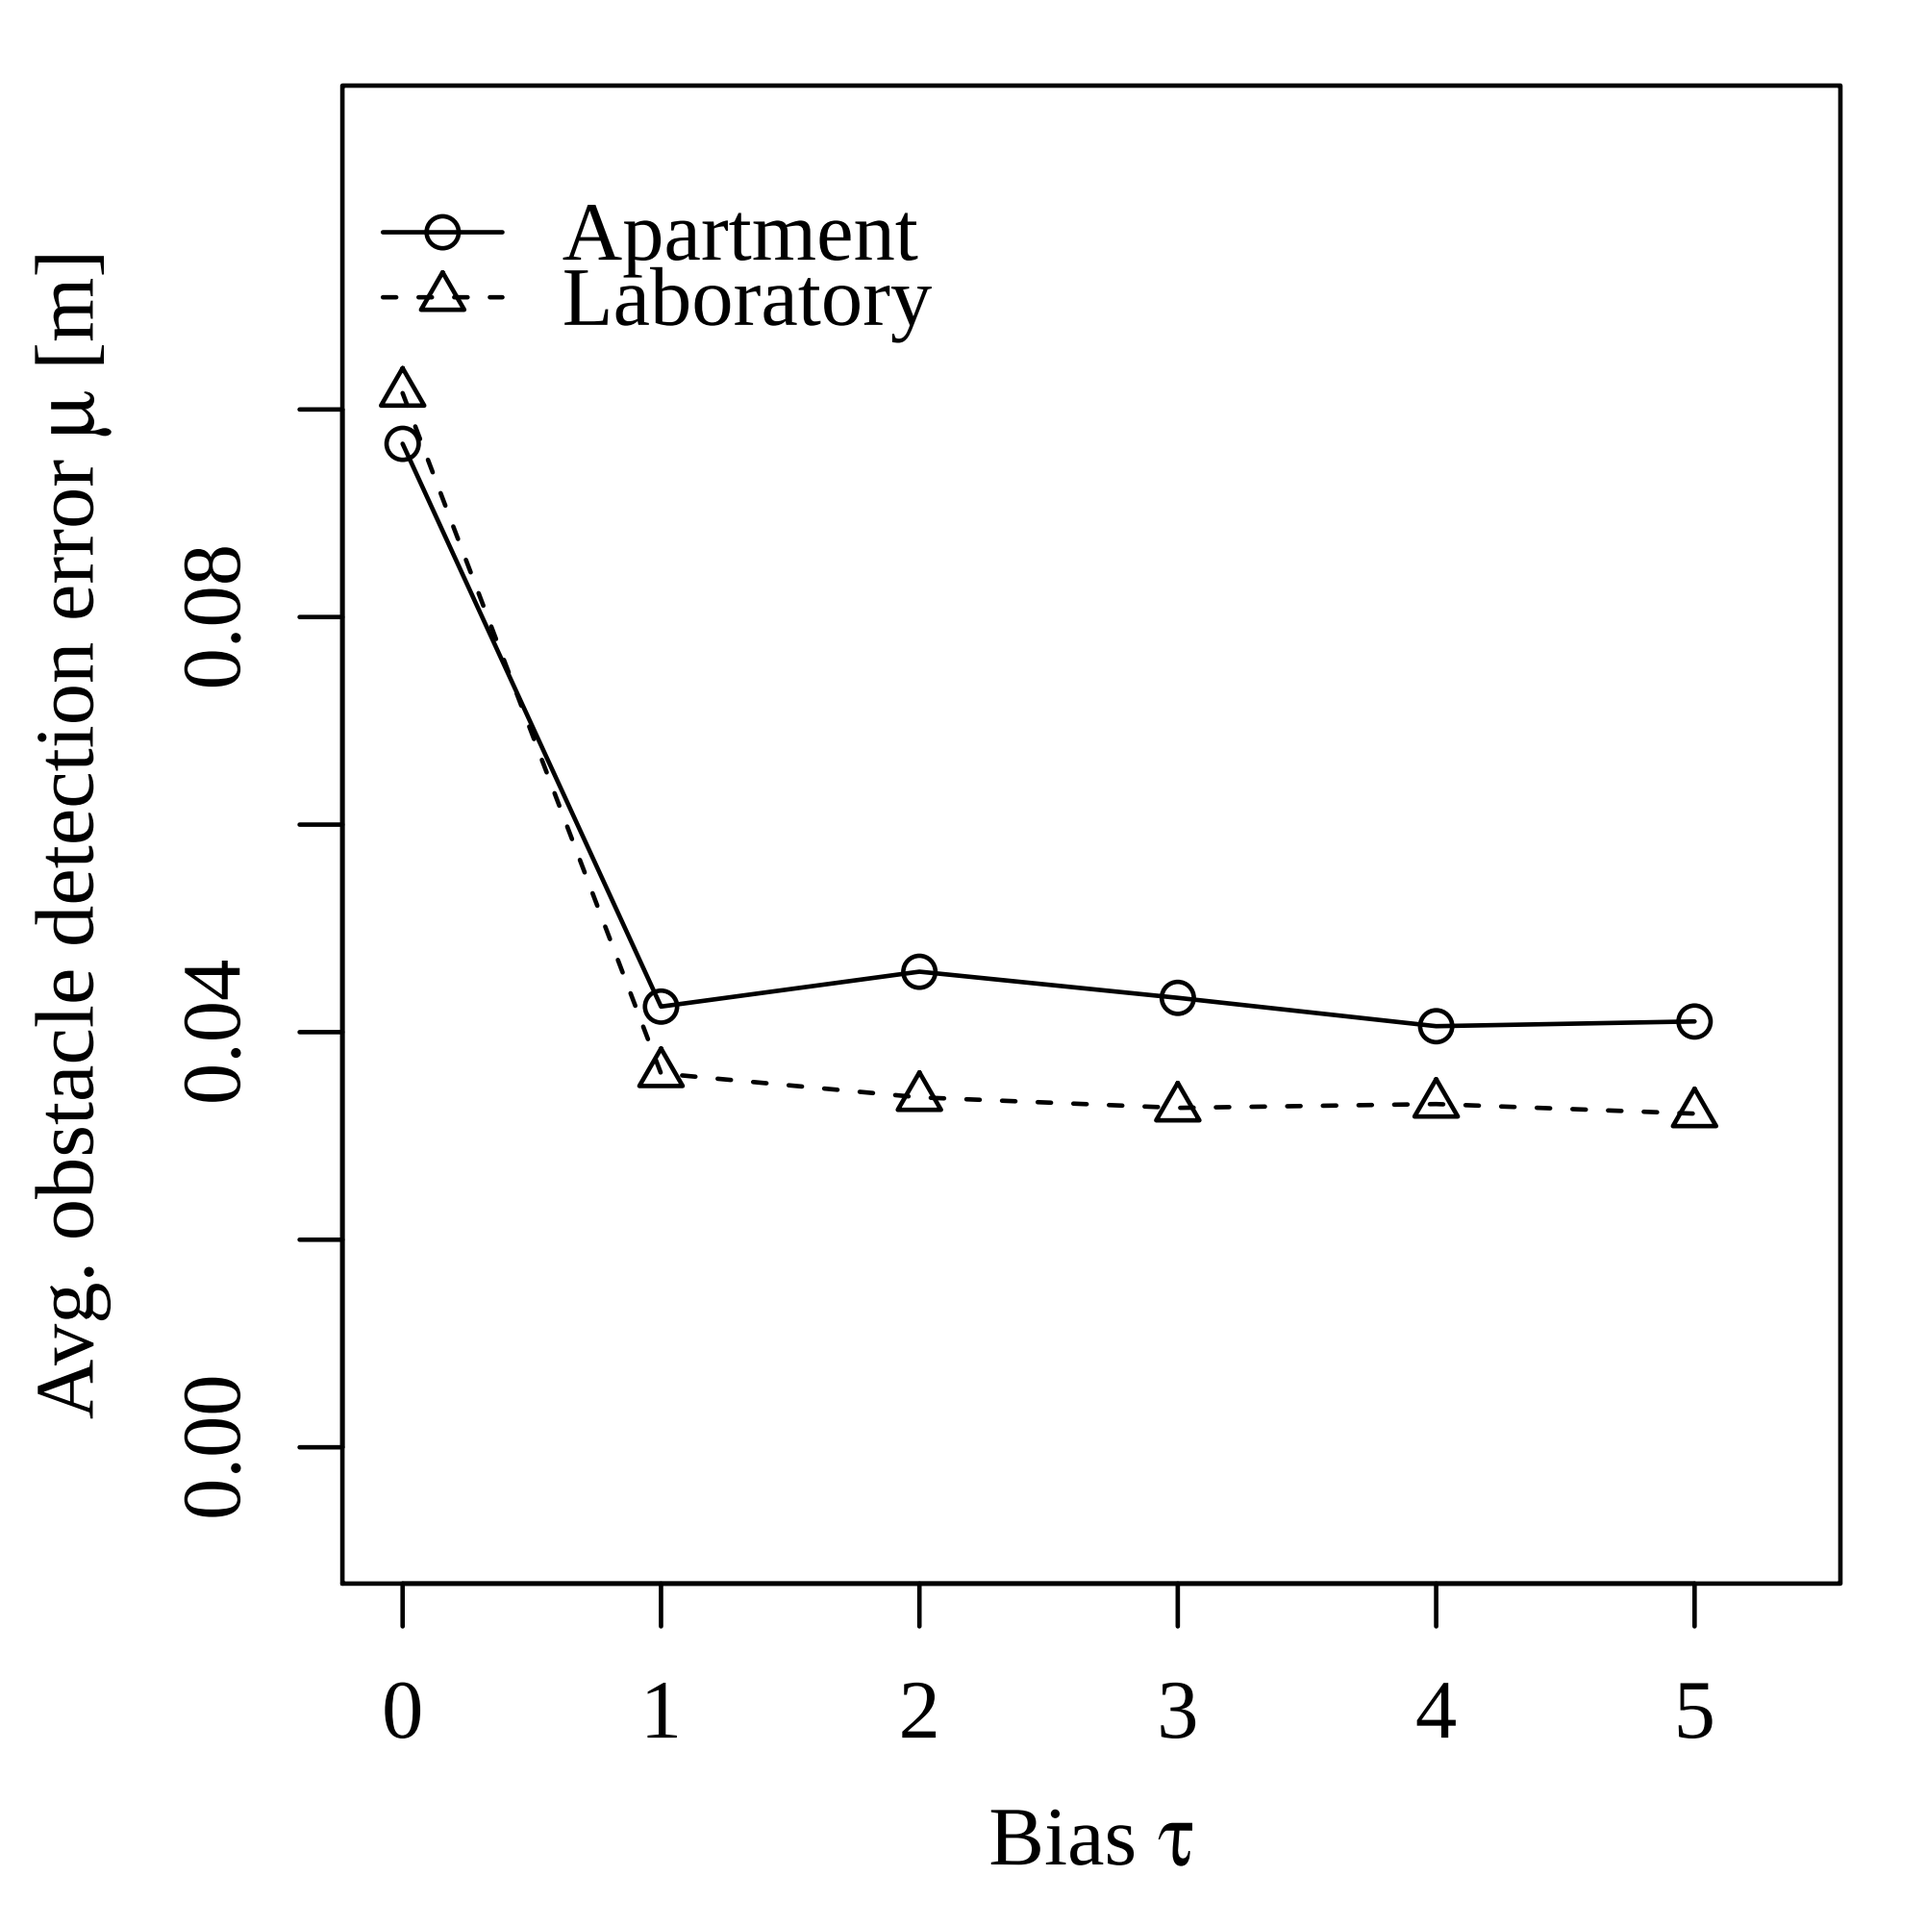
Apartment
Laboratory
Avg. obstacle detection error μ [m]
0.00
0.04
0.08
0
1
2
3
4
5
Bias τ