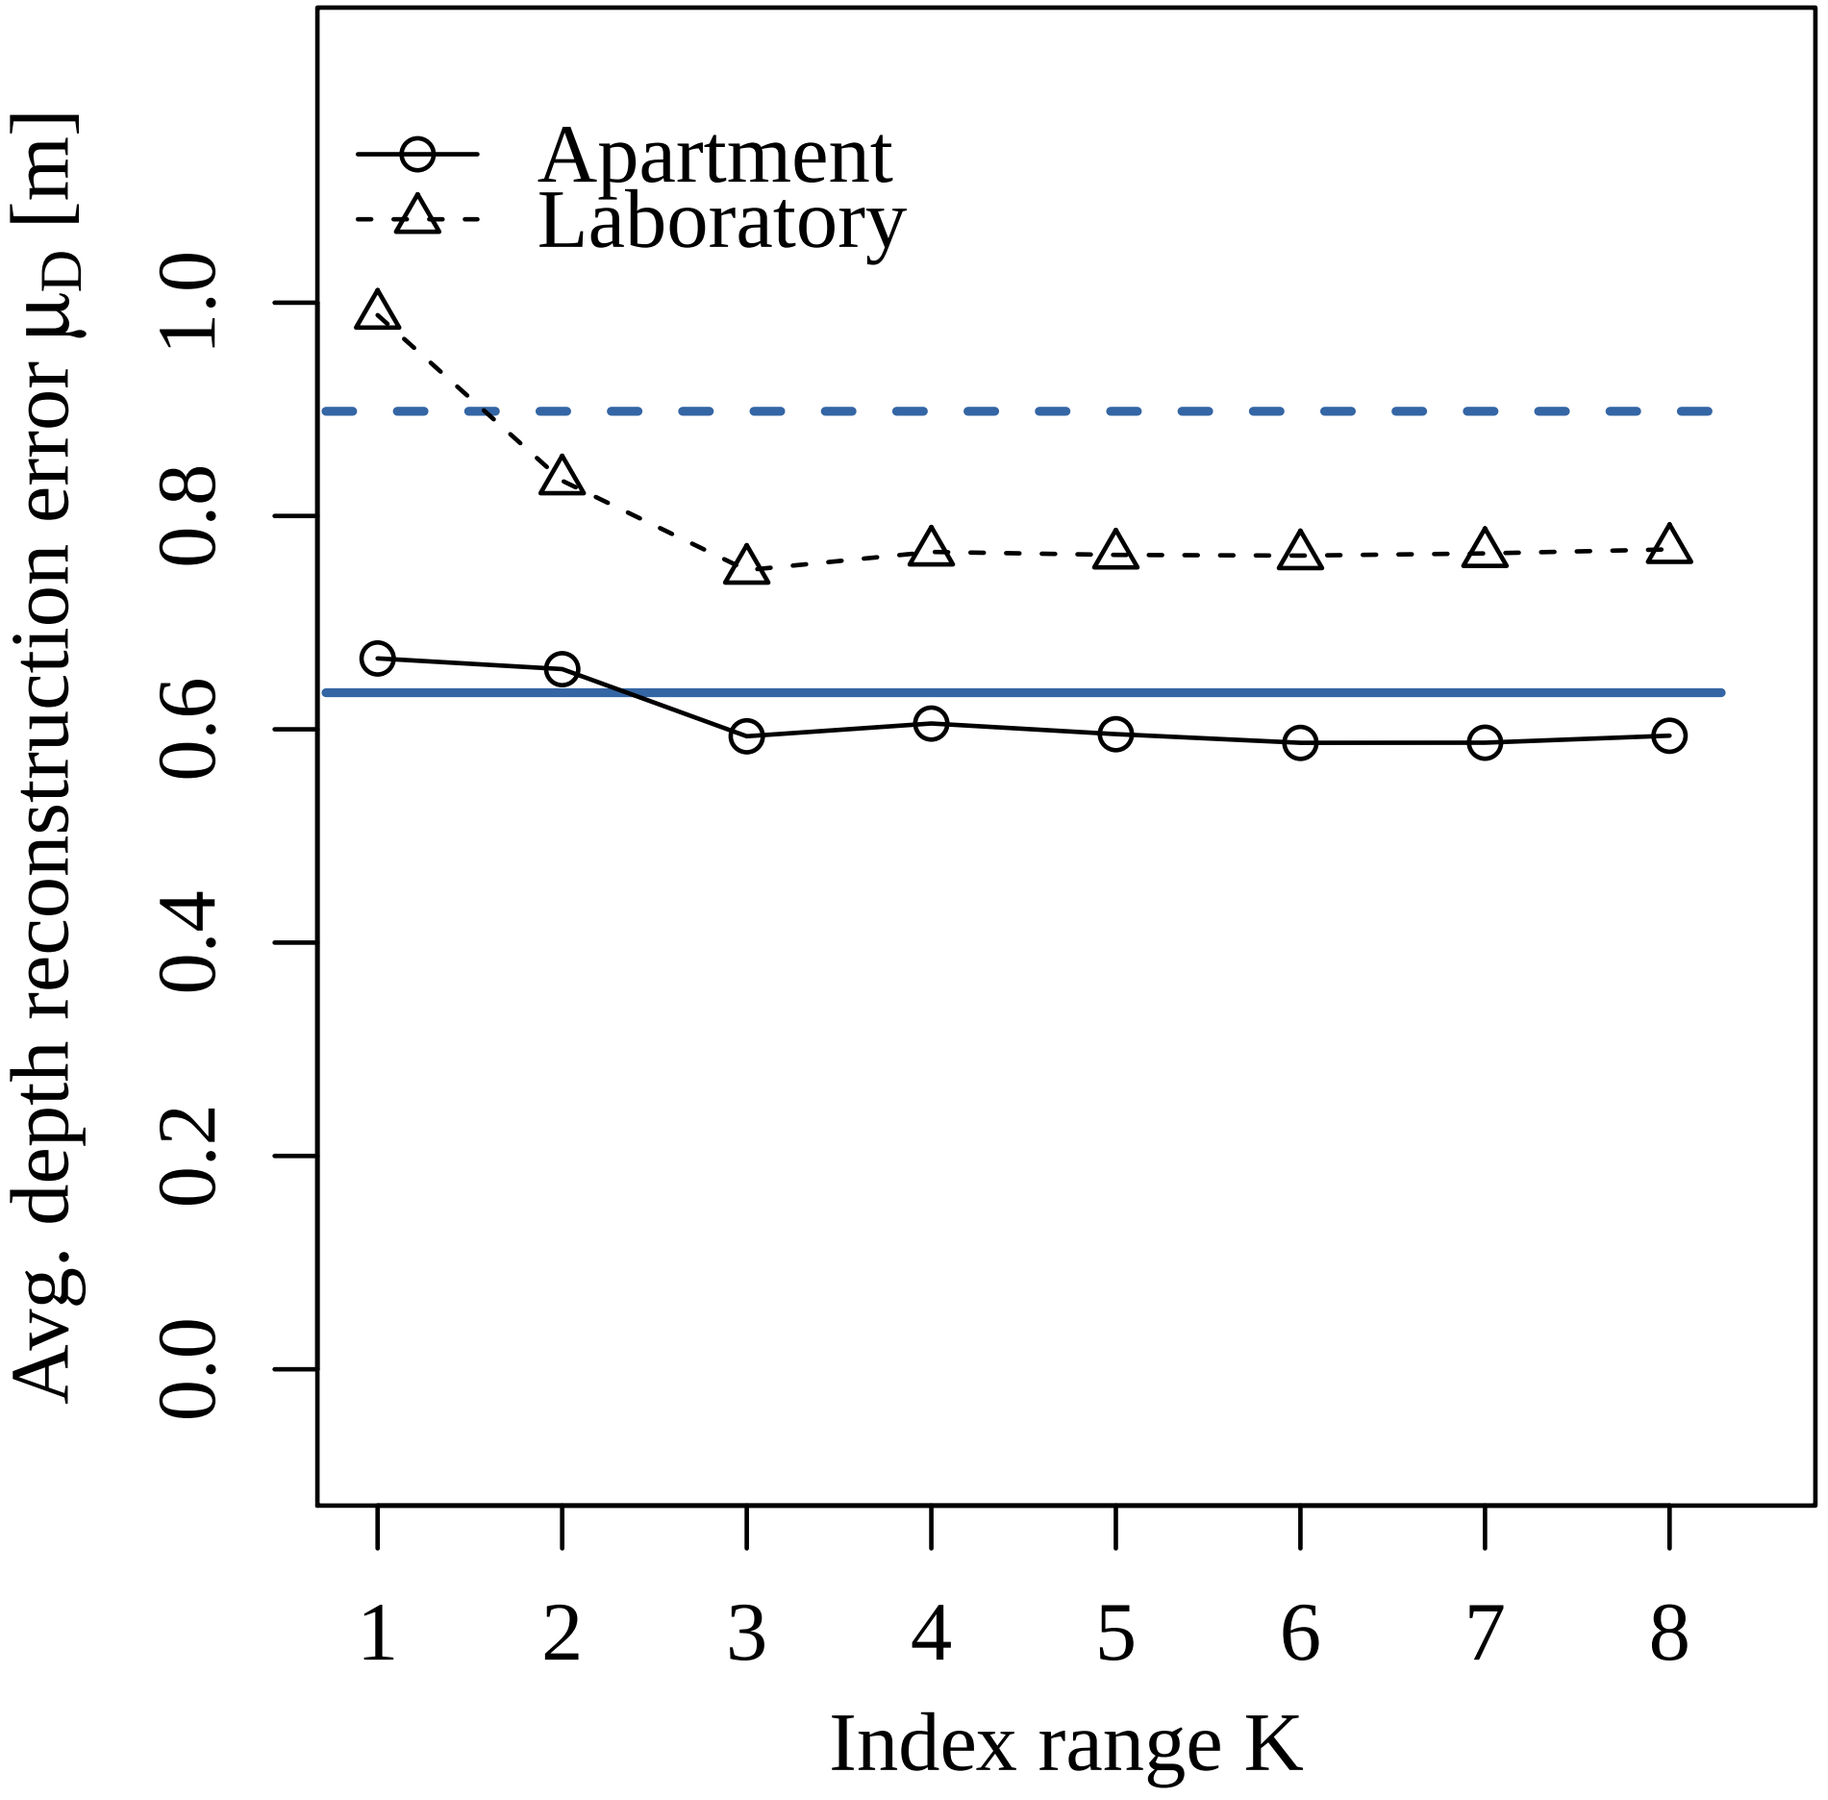
Apartment
Laboratory
Avg. depth reconstruction error μ_D [m]
0.0
0.2
0.4
0.6
0.8
1.0
1
2
3
4
5
6
7
8
Index range K