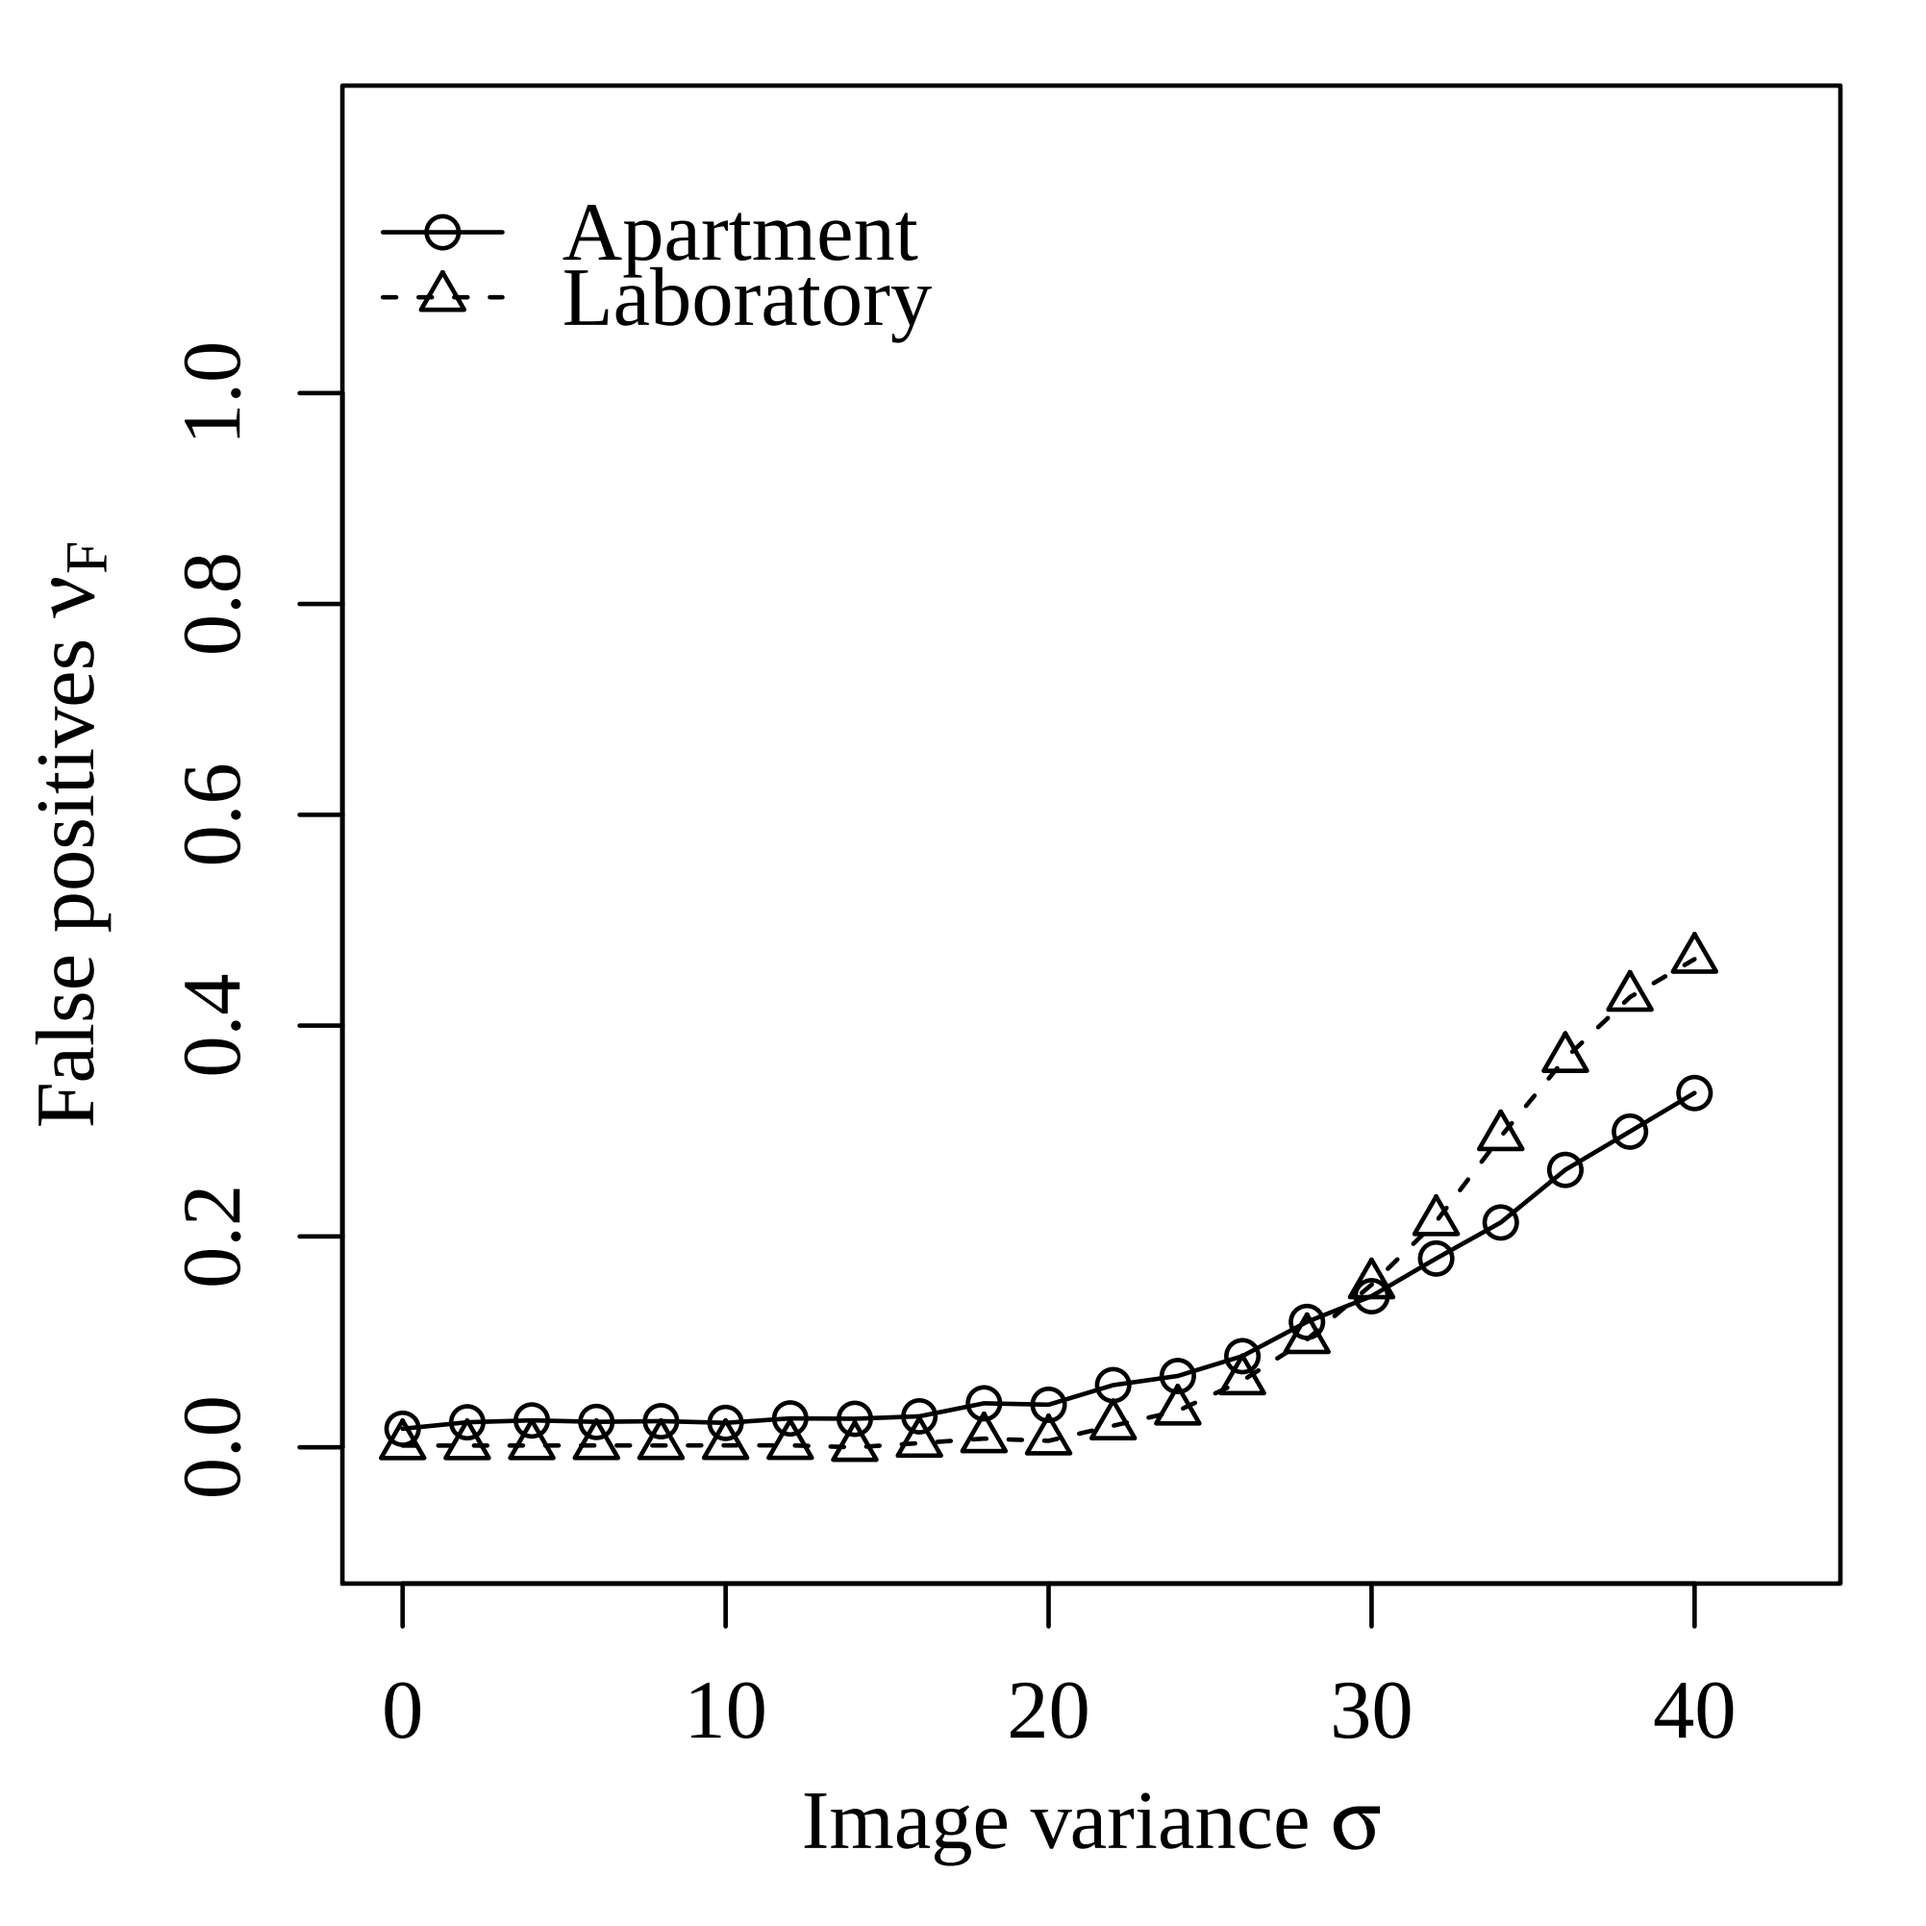
Apartment
Laboratory
False positives ν_F
0.0
0.2
0.4
0.6
0.8
1.0
0
10
20
30
40
Image variance σ