


Distribution of pulse rise times, Sep 2017 batch 503, channel 1, sensor: W4-S215

Number (N)

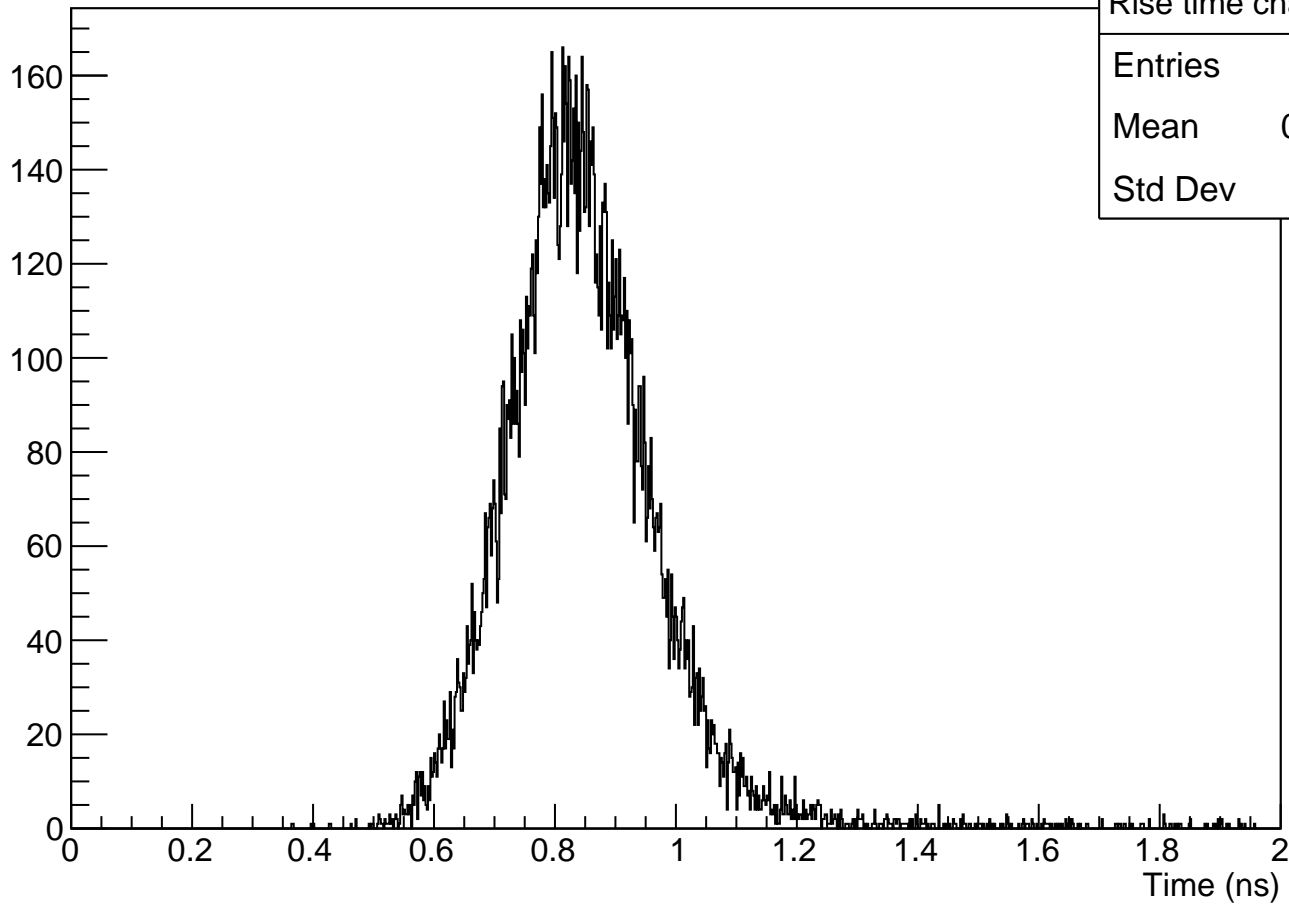

Rise time channel 1

Entries 19896

Mean 0.8475

Std Dev 0.135