


Distribution of pulse rise times, Sep 2017 batch 101, channel 1, sensor: 50D-GBGR2

Number of entries (N)

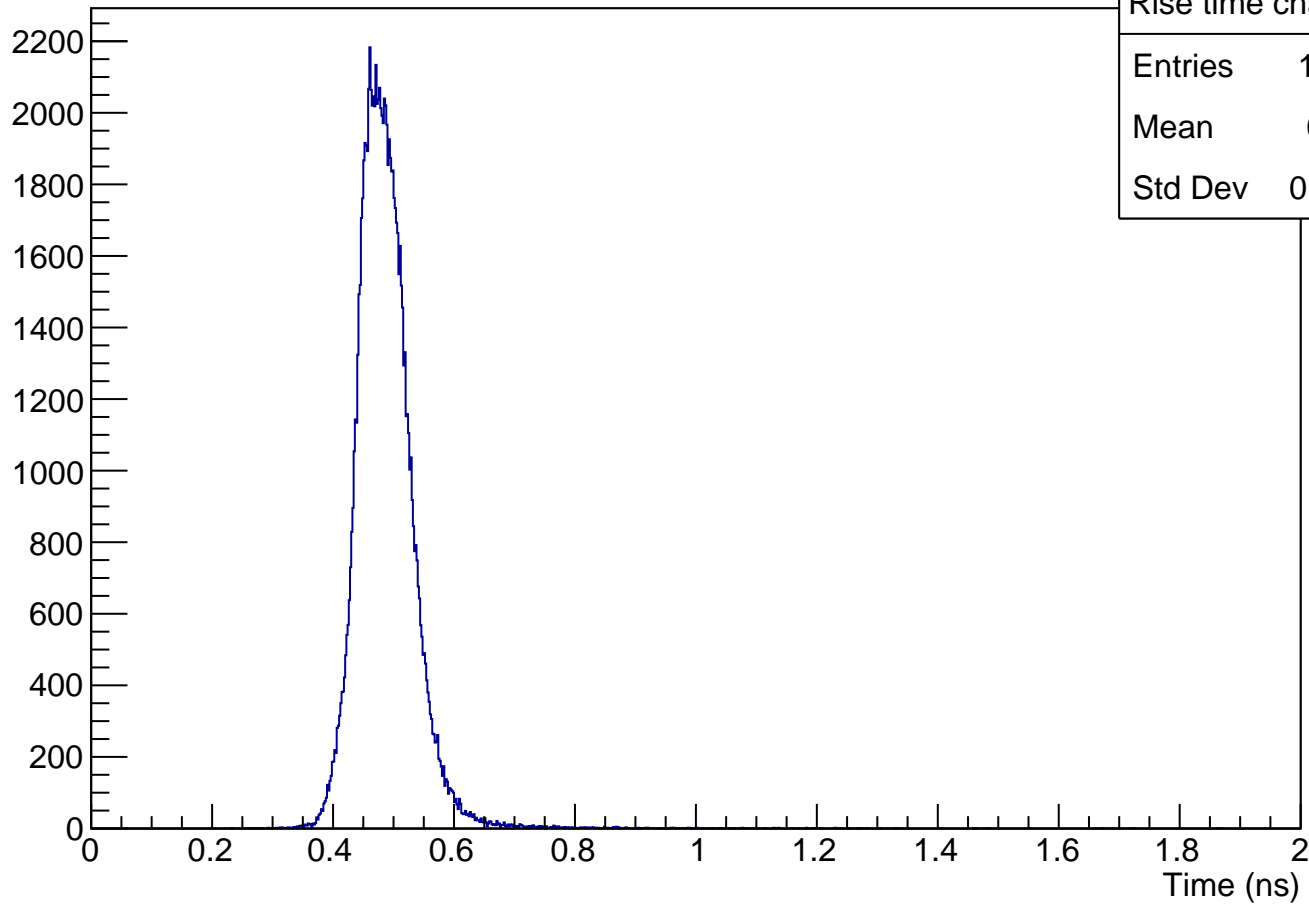

Rise time channel 1

Entries 105399

Mean 0.4868

Std Dev 0.04915