PJPC PADJAM	TAPCO | تاپکو | شرکت تجهیز ارک پارسیان	**JAM ABS & RUBBERS PLANT (BANDAR ASSALUYEH)**	Tecnimont / Eni Polimeri Europa
		General Arrangment Drawing	
Contract No.: PPJPC-1400-18		**Contractor Doc. No.: J-80-TAP-ME-DWG-1040-6901-012-06**	**Page: 1 of 3**
TCM Project no. : 3151			
		VENDOR Doc. No.: TAP-940724-GAD-ME-012-06	

- AT FIRST, PID DOCUMENT SHALL BE FINALISED.
- DETAIL OF ITEMS 37,38, 39 SHALL BE COMPLETED.
RATING OF FLANGE AND VALVE SHALL BE SPECIFIED.
DATA SHEET OF PCV AND PG SHALL BE ADDED TO INSTRUMENT DATA SHEET.
- NORTH OF PLANT(INSTALLATION ORIENTATION) SHALL BE ADDED TO DWG.

ng

Purchase Order: PPJPC-1400-18	Item:
Vendor: TAPCO Company	Equipment: ACRILONITRILE VENT FAN

- TITLE BAR FOR DOC STATUS SHALL BE ADDED.

ENG.	STATUS	DEPARTMENT	DATE
N.NIAZI	CO	PM	2026/08/26

Comment status code:

AP	Approved and released for Manufacture	NC	NC - No Comments
CO	Not Approved	AC	AC - Approved with Comments
RE	RE - Rejected		

IMPORTANT: Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods or materials developed or selected by the supplier and does not relieve supplier from full compliance with contractual obligation.


Rev	Date	Class	Status	TCM Prepared	TCM Checked	TCM Approved	JSC Prepared	JSC Checked	JSC Approved
6	23.Aug.2026	A	IFA	M.H.	M.M.	M.H.R.			
5	10.Jun.2026	A	IFA	M.H.	M.M.	M.H.R.			
4	18.Jan.2023	A	IFA	M.GH.	M.S.	R.B.			
3	22.Feb.2022	A	IFA	M.GH.	M.S.	R.B.			
2	16.Jan.2022	A	IFA	T.E.	M.S.	R.B.			
1	01.Dec.2021	A	IFA	T.E.	M.S.	R.B.			
0	19.Sep.2021	A	IFA	N.A.	M.S.	R.B.			


		JAM ABS & RUBBERS PLANT (BANDAR ASSALUYEH)	
		General Arrangment Drawing	
Contract No.: PPJPC-1400-18		Contractor Doc. No.: J-80-TAP-ME-DWG-1040-6901-012-06	Page: 2 of 3
TCM Project no. : 3151			
		VENDOR Doc. No.: TAP-940724-GAD-ME-012-06	

REVISION INDEX

PAGE	REVISION									PAGE	REVISION							PAGE	REVISION					
	2	3	4	5	6	7	8	9	10		11	12	13	14	15	16	17		0	1	2	3	4	5
1	X	X	X	X	X																			
2	X	X	X	X	X																			
3	X	X	X	X	X																			
4																								
5																								
6																								
7																								
8																								
9																								
10																								
11																								
12																								

Appendix						
Att. 1						
Att. 2						
Att. 3						
Att. 4						
Att. 5						

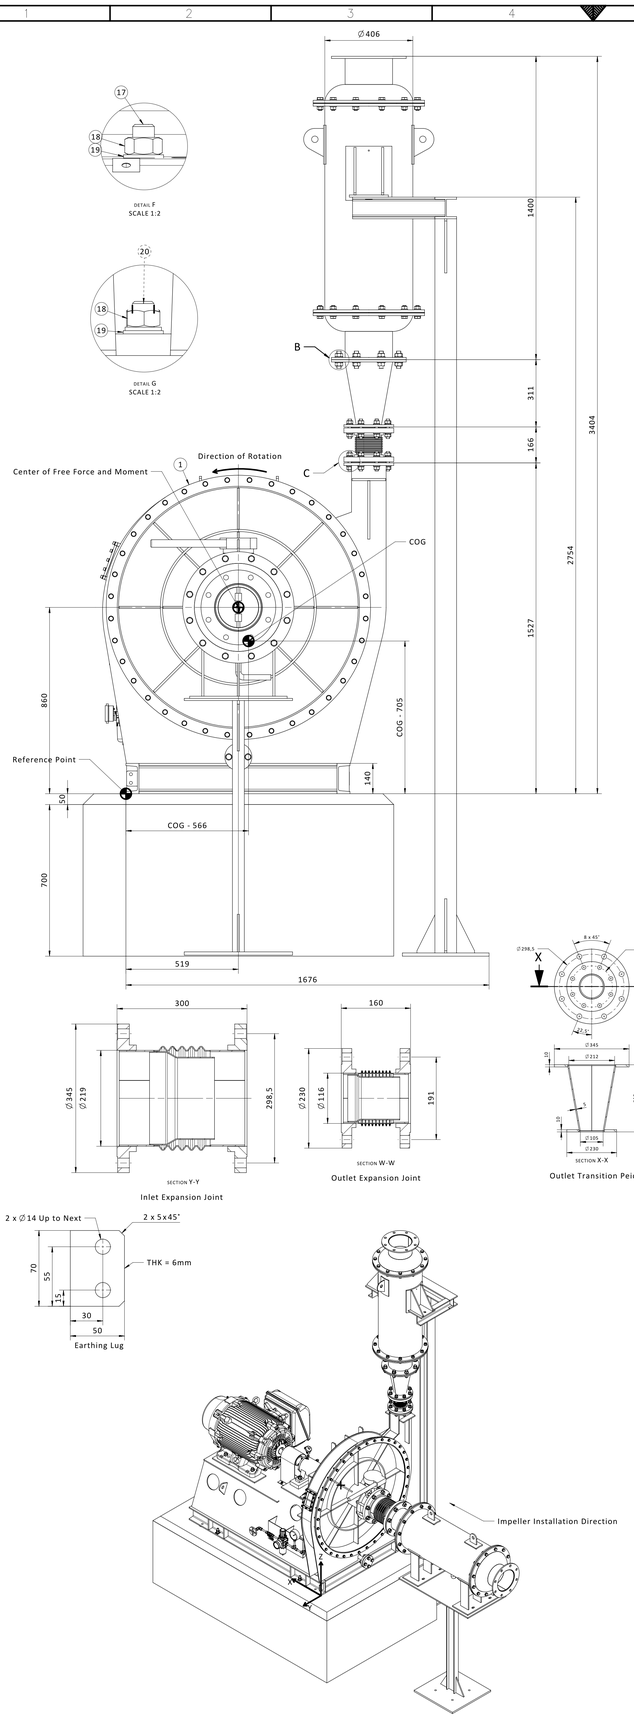

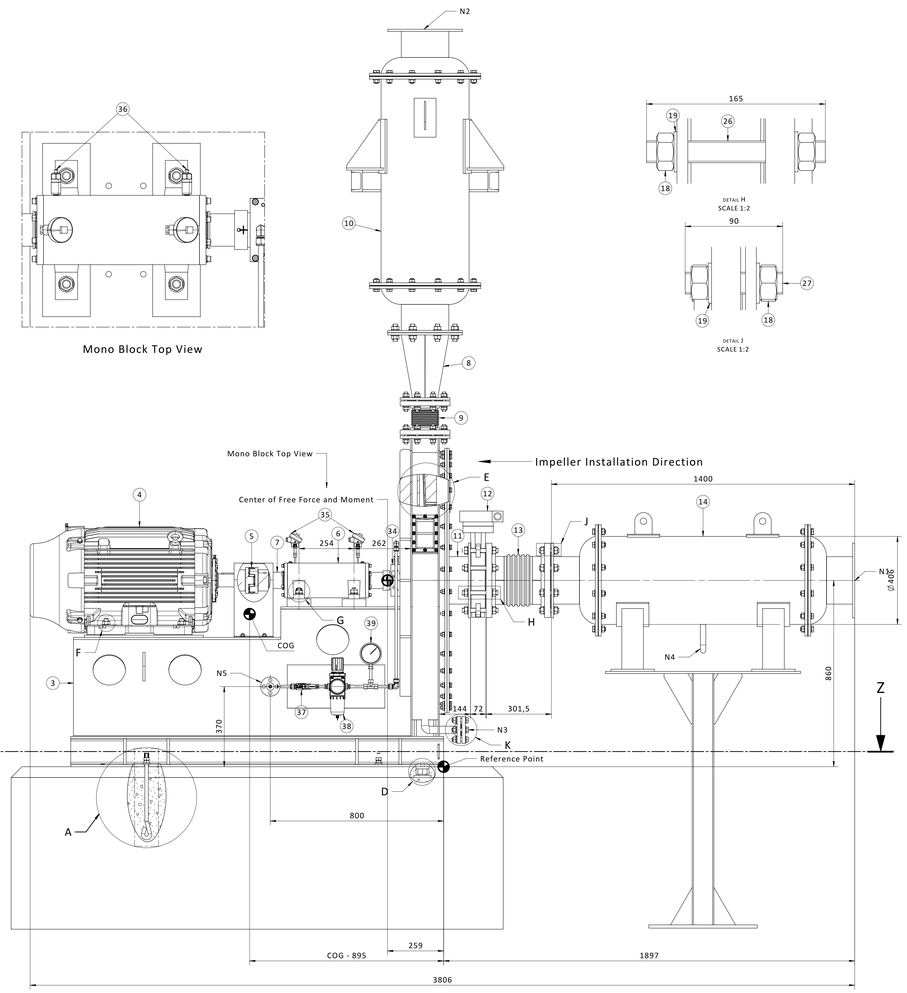



Item	Description	QTY	Unit	Weight (kg)	Material
39	Pressure Gauge	1	PC	0.23	-
38	PCV	1	PC	0.56	-
37	Ball Valve 1/2"	1	PC	0.3759	SS 316
36	Vibration Transmitter	2	PCS	-	-
35	Temperature Transmitter	2	PCS	-	-
34	Seal	1	PC	2.7	SS 316
33	Flange - Slip on 1"	1	PC	1,341	ASME B16.5
32	Spring Washer A16	4	PCS	0,008	DIN 128 - Dichromate coating
31	Hexagon Screw M16 x 65	4	PCS	0,141	DIN 933 - Dichromate coating 8.8
30	Washer A16	40	PCS	0,011	DIN 126 - Dichromate coating
29	Hexagon Nut M16	36	PCS	0,033	DIN 934 - Dichromate coating
28	STUD DIN976 M16 x 90	16	PCS	0.1417	DIN 976 - Dichromate coating 8.8
27	STUD DIN976 M20 x 90	8	PCS	0,221	DIN 126 - Dichromate coating
26	STUD DIN976 M20 x 165	8	PCS	0,4059	DIN 934 - Dichromate coating
25	STUD DIN976 M20 x 80	8	PCS	0,197	DIN 976 - Dichromate coating 8.8
24	Spring Washer A12	36	PCS	0,0036	DIN 128 - Dichromate coating
23	Washer A12	72	PCS	0,0061	DIN 126 - Dichromate coating
22	Hexagon Nut M12	36	PCS	0.0155	DIN 934 - Dichromate coating
21	Hexagon Screw M12 x 45	36	PCS	0,058	DIN 933 - Dichromate coating 8.8
20	Hexagon Screw M20 x 2.5 x 95	4	PCS	0.305945	DIN 933 - Dichromate coating 8.8
19	Washer A20	64	PCS	0.0171	DIN 126 - Dichromate coating
18	Hexagon Nut M20	56	PCS	0.059	DIN 934 - Dichromate coating
17	Hexagon Screw M20 x 2.5 x 100	4	PCS	0,318	DIN 933 - Dichromate coating 8.8
16	LEVELING JACKSCREW	4	PCS	1.12	-
15	ANCHOR BOLT	4	PCS	0.7272	DIN-529-M 16 x 400 x 8.8
14	Inlet Silencer	1	PC	173,32	ASTM-A285 GRADE C
13	Inlet Expansion Joint	1	PC	30,09	ASTM-A240 TP304
12	Butterfly Valve - 8"	1	PC	35,55	ASTM-A285 GRADE C
11	Inlet Pipe	1	PC	9,68	ASTM-A285 GRADE C
10	Outlet Silencer	1	PC	155,7	ASTM-A285 GRADE C
9	Outlet Expansion Joint	1	PC	12.4805	ASTM-A240 TP304
8	Outlet Transition Piece	1	PC	12,41	ASTM-A285 GRADE C
7	Shaft	1	PC	28,01	CK 45
6	Mono Block	1	PC	31,32	GG
5	Flexible Jaw Coupling	1	PC	6,97	ROTEX® - 55
4	Electrical Drive	1	PC	545	-
3	Pedestal & Skid	1	PC	467,21	ST 37
2	Impeller	1	PC	96,83	ASTM - A572 GRADE 50
1	Casing	1	PC	298,35	ASTM-A285 GRADE C
0	Total Assembly	1	PC	2446	-

NOTES


1- All dimensions are in millimeter
2- General tolerance:
Iso 2768-m for machined components;
Iso 13920-AE for Impellers;
Iso 13920-BF for general welded construction;
Iso 2768-f for Shafts and Hubs.
3- This document is refered to fan package
4- Anchor bolts supply by TAPCO.
5- It calculated with balancing quality Grade 941 N.
6- The admissible residual unbalance based on acceptance criteria in conformity with API 673 is 63S N.
7- when the dynamic load is reaching the maximum calculated value, the vibration speed of foundation allows 3mm/s or less inside the 20% speed of spindle speed.
8- All the weights are in the"weight of main components table".
Total weight : 2446 kg


LEGEND

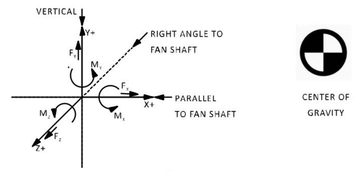






REFERENCE DRAWINGS	DWG. No.
Fan Data Sheet	J-80-TAP-ME-DSH-1040-6901-013
Coupling Data Sheet and Drawing	J-80-TAP-ME-DWG-1040-6901-015
Cross sectional drawing	J-80-TAP-ME-DWG-1040-6901-021
Damper& silencer drawing & BOM	J-80-TAP-ME-DWG-1040-6901-022
Motor Data Sheet	J-80-TAP-EL-DSH-1040-6901-024
Motor Outline Drawings	J-80-TAP-EL-DWG-1040-6901-025
P & ID	J-80-TAP-PR-PID-1040-6901-044




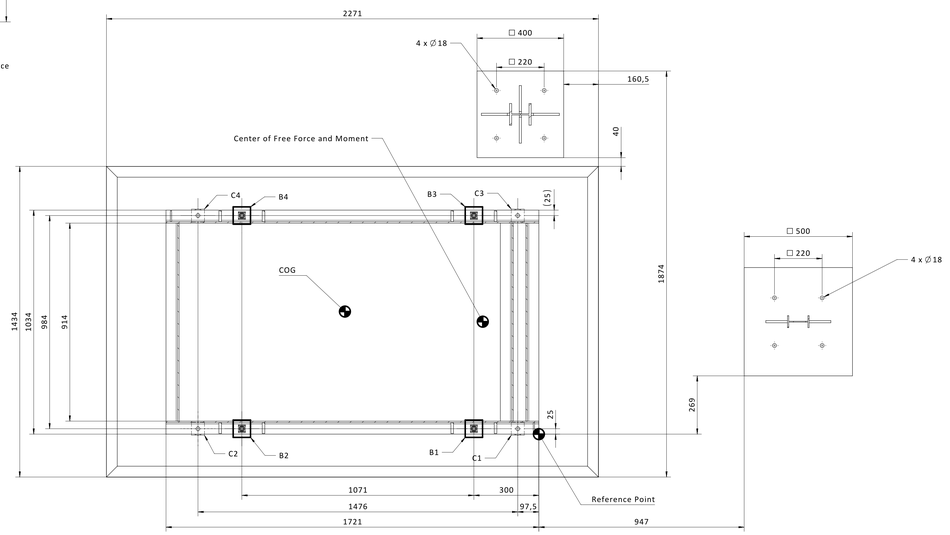













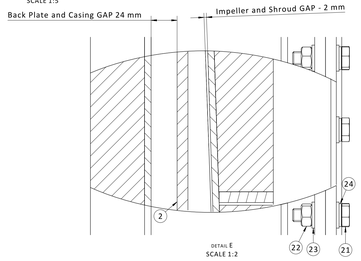

Static Load (N)		
X	Y	Z
-	-	14803

Center of free force and moment (mm)		
X	Y	Z
259	-519	860

Center of Gravity (mm)		
X	Y	Z
895	-566	705

Electrical Drive	
Power	55 kW
Speed of rotation	2970 rpm
Voltage	400 V

Nozzle Table									
No.	Description	Size	Design STD	Volume Flow Rate		1233 m3/h			
N1	Suction	8"	ASME B16.5	Pressure Rise		180-201-231 mbar			
N2	Discharge	8"	ASME B16.5	Force (kN)					
N3	Drain	1"	ASME B16.5			B1	B2	B3	B4
N4	Inlet Silencer Drain	1/2"	ASME B16.5	Static	F Axial	-5.294	-5.294	-5.472	-5.472
N5	Nitrogen Purge	1/2"	ASME B16.5	Dynamic	F Axial	±0.136	±0.136	±0.136	±0.136

Status Code	Eng.	Dept.	Date

Comment status code:

AP	Approved and released for Manufacture	NC	No Comments
CO	Not Approved	AC	Approved with Comments
RE	Rejected		

IMPORTANT: Permission to proceed does not constitute acceptance or approval of design details, calculations, analyses, test methods or materials developed or selected by the supplier and does not relieve supplier from full compliance with contractual obligation.

VENDOR:

TAPCO | تاپکو | شرکت تجهیز گرگ پارسیان

SPACE FOR VENDOR INFORMATION

Rev.	Date	Class	Purpose of Issue	Prepared by	Checked by	Approved by
06	26.Aug.23	A	IFA	M.H.	M.M	MH.R
05	26.Jun.10	A	IFA	M.H.	M.M	MH.R
04	23.Jan.18	A	IFA	M.GH.	M.S.	R.B.
03	22.Feb.22	A	IFA	M.GH.	M.S.	R.B.
02	22.Jan.16	A	IFA	T.E.	M.S.	R.B.
01	21.Dec.01	A	IFA	T.E.	M.S.	R.B.
00	21.Sep.19	A	IFA	N.A.	M.S.	R.B.

OWNER:

PJPC PADJAM POLYMER DEVELOPMENT CO.

PROJECT: JAM ABS & RUBBERS PLANT (BANDAR ASSALUYEH)

CONTRACTOR: Tecnimont | Eni Polimeri Europa

Contract No:	PPJPC-1400-18
TCM Project No:	3151
Doc No.	J-80-TAP-ME-DWG-1040-6901-012-06
TCM Doc No.	TAP-940724-GAD-MF-012-06

DRAWING TITLE: General Arrangment Drawing

Rev.	Size.	Scale.	Sheet No.
06	A0	1:10	3 of 3