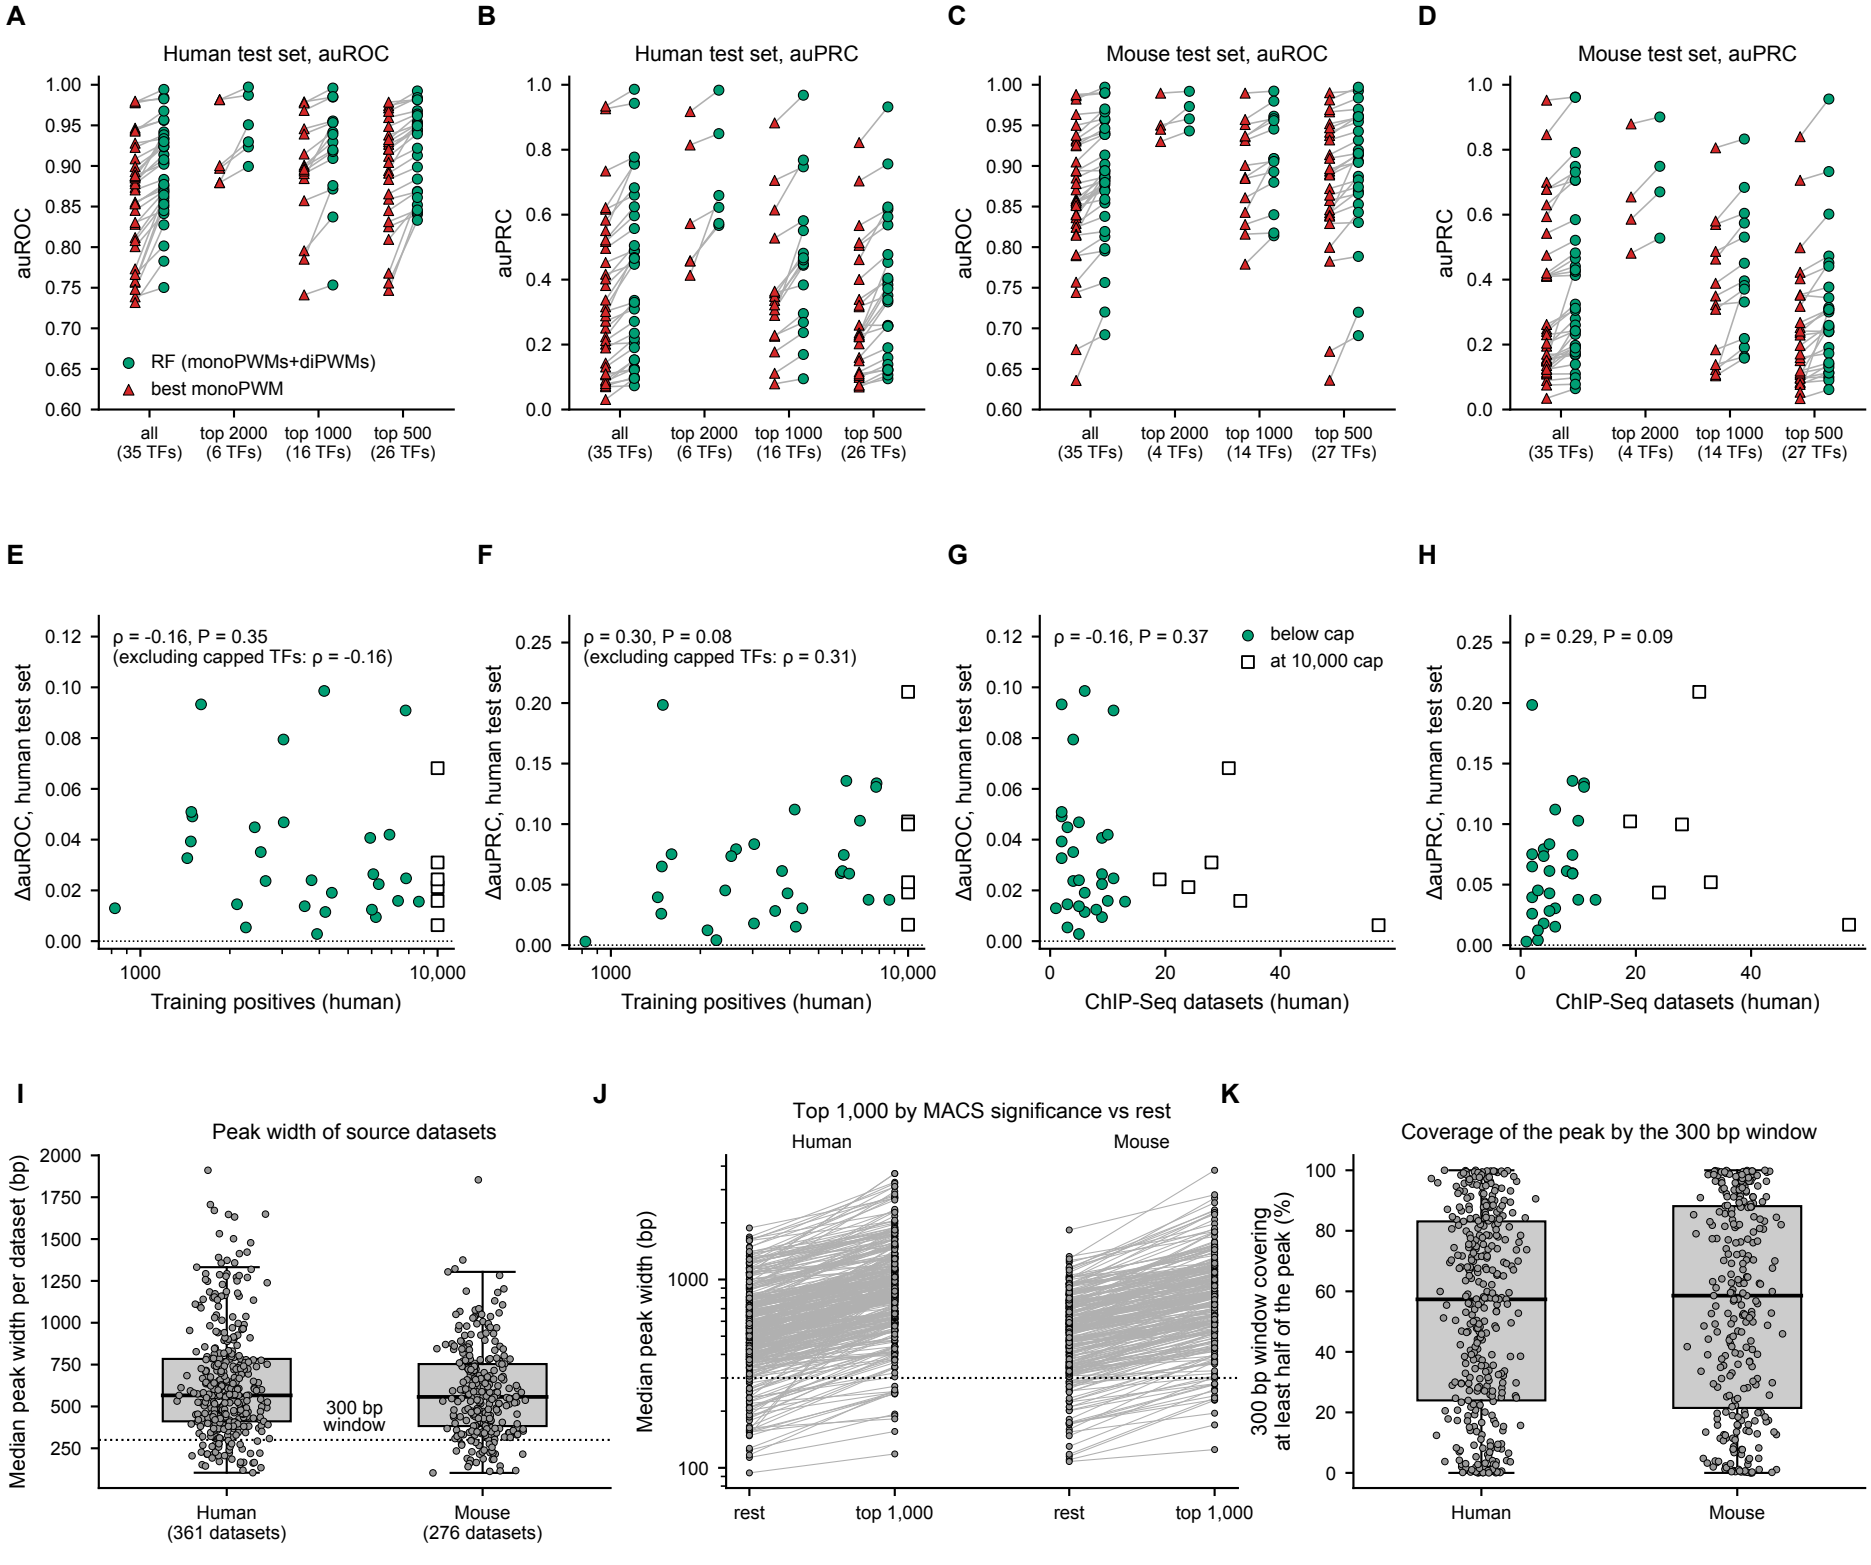

A
Human test set, auROC
auROC
RF (monoPWMs+diPWMs)
best monoPWM
all (35 TFs)
top 2000 (6 TFs)
top 1000 (16 TFs)
top 500 (26 TFs)
B
Human test set, auPRC
auPRC
C
Mouse test set, auROC
top 2000 (4 TFs)
top 1000 (14 TFs)
top 500 (27 TFs)
D
Mouse test set, auPRC
E
ΔauROC, human test set
ρ = -0.16, P = 0.35
(excluding capped TFs: ρ = -0.16)
Training positives (human)
F
ΔauPRC, human test set
ρ = 0.30, P = 0.08
(excluding capped TFs: ρ = 0.31)
G
ρ = -0.16, P = 0.37
below cap
at 10,000 cap
ChIP-Seq datasets (human)
H
ρ = 0.29, P = 0.09
I
Peak width of source datasets
Median peak width per dataset (bp)
300 bp window
Human (361 datasets)
Mouse (276 datasets)
J
Top 1,000 by MACS significance vs rest
Human
Mouse
Median peak width (bp)
rest
top 1,000
K
Coverage of the peak by the 300 bp window
300 bp window covering at least half of the peak (%)