


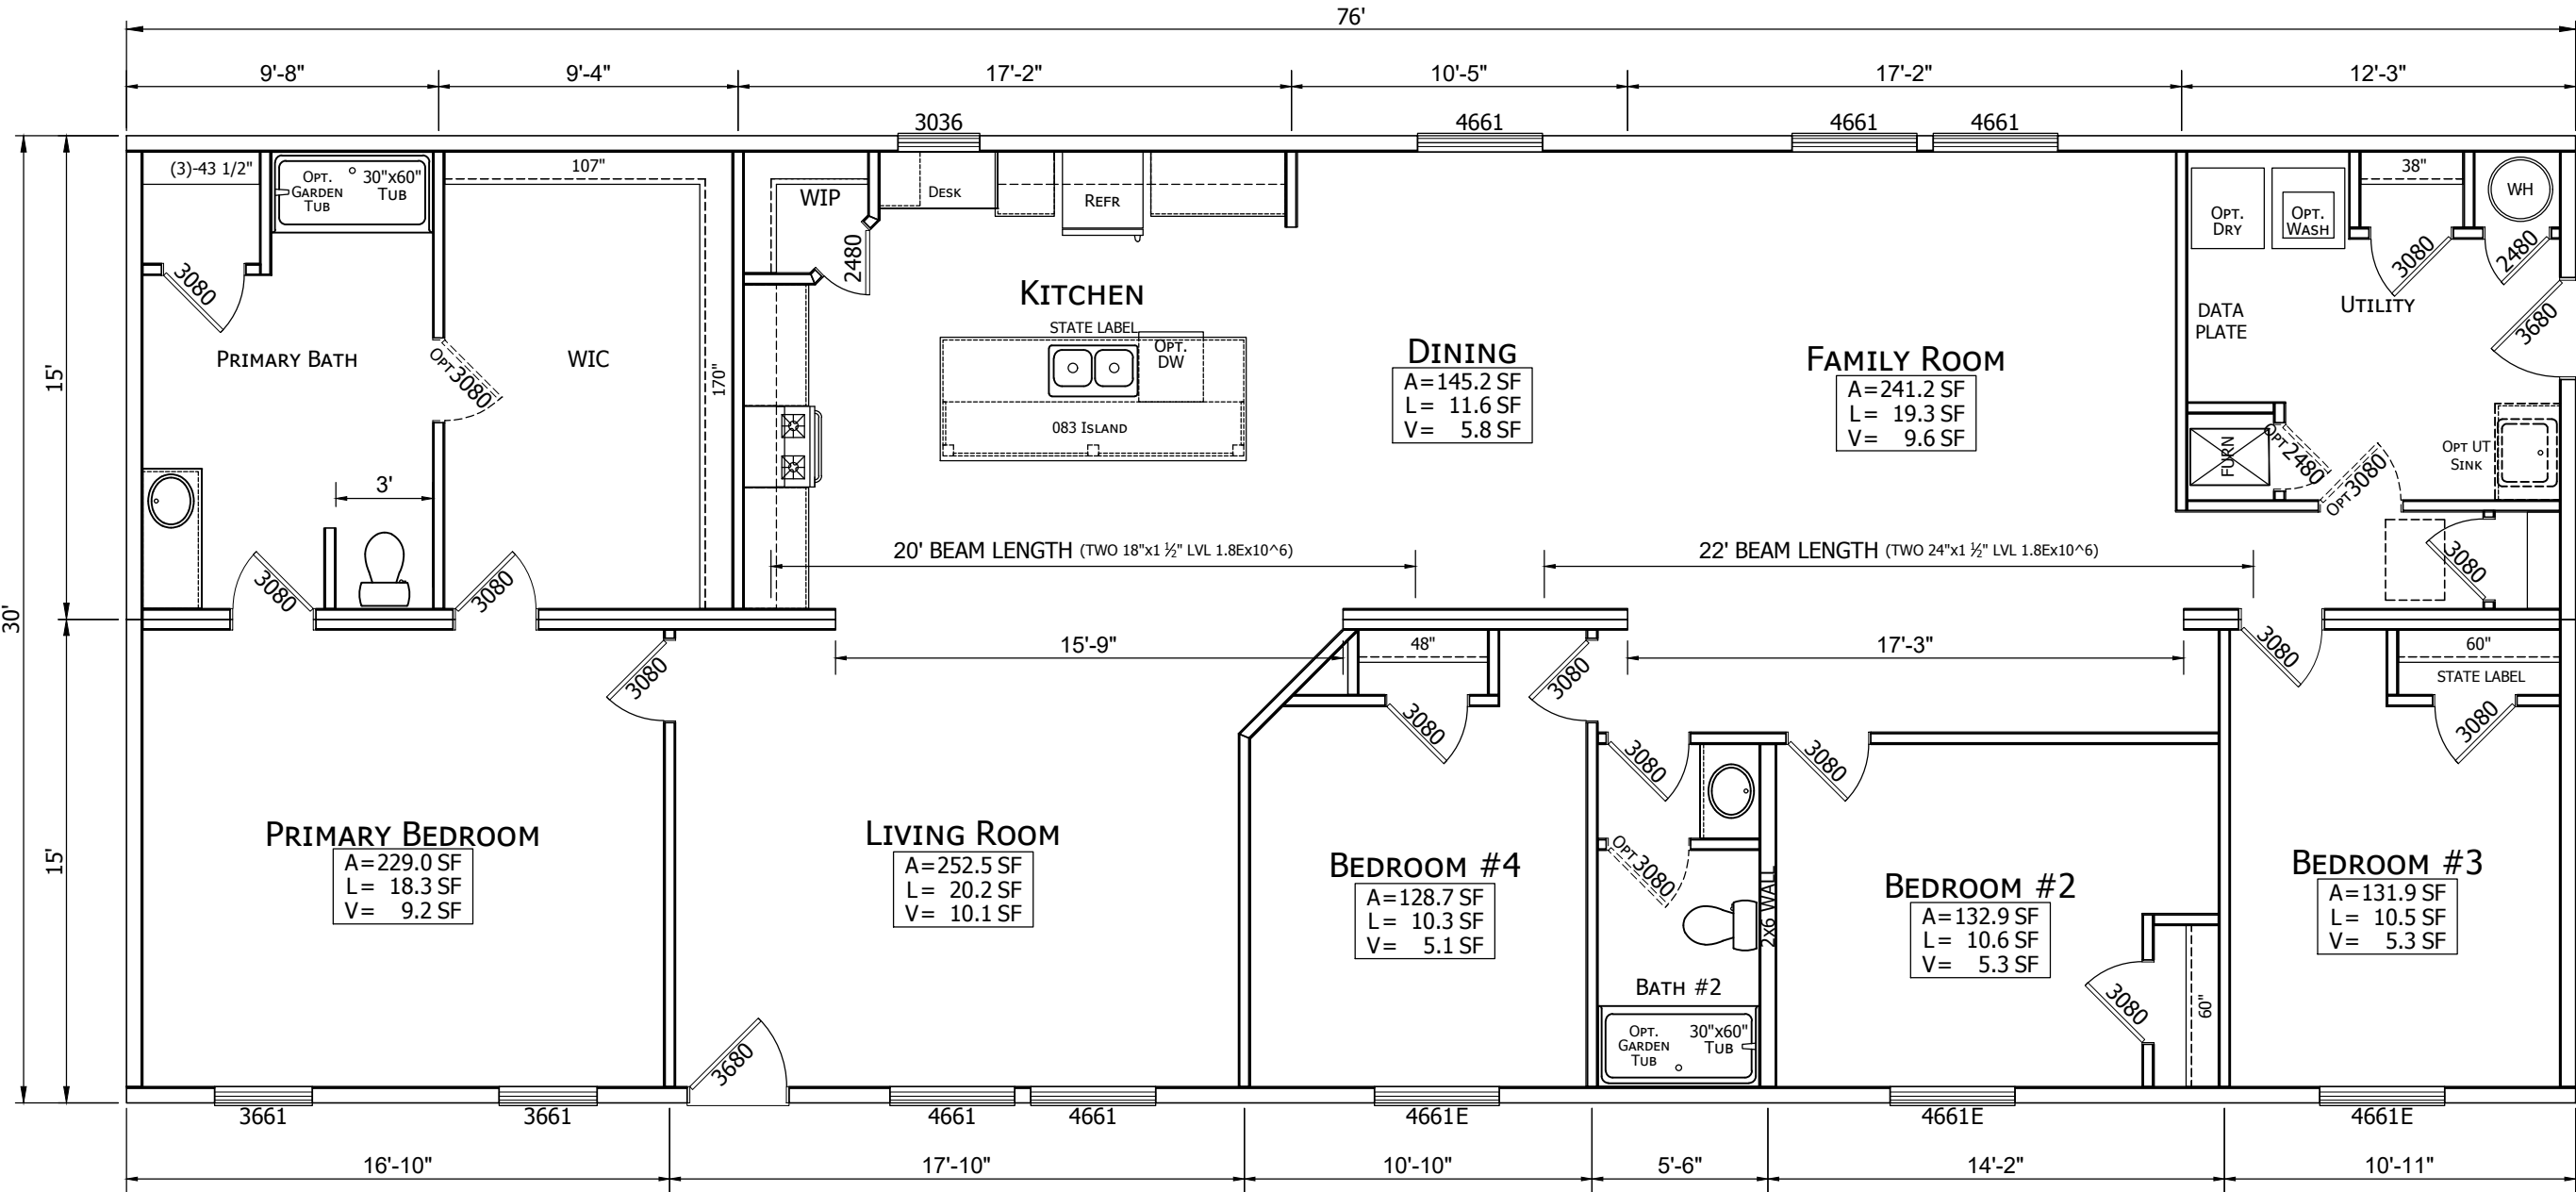

3-2x6 #2 SPF HEADERS ABOVE OPENINGS UP TO 5'-11"
3-2x8 #2 SPF HEADERS ABOVE ALL OPENINGS UP TO 7'-6".

GENERAL NOTES:

- 1. ALL INTERIOR WALLS 2x4 UNLESS MARKED OTHERWISE.
- 2. ALL EXTERIOR WALLS 2x6 UNLESS MARKED OTHERWISE.
- 3. HALL WIDTH A MINIMUM OF 36" FINISHED.

4. FOR GENERAL ALTERNATES SEE PAGES G 2.9 AND G 5.0.

- 5. WINDOWS SHOWN TO MEET 8% LIGHT AND 4% VENT.
- 6. ALL PENETRATIONS THRU CEILING AND FLOOR TO BE FIRESTOPPED.
- 7. STATE INSIGNIAS ARE TO PLACED WHERE STATE LABEL LOCATIONS ARE CALLED OUT. THEY MAY VARY FROM WHERE SHOWN TO MEET STATE REQUIREMENTS.

* GAS LINES (IF REQUIRED) TO BE PROVIDED, SIZED, AND INSTALLED ON SITE BY OTHERS IN ACCORDANCE WITH PREVAILING CODE.

* WARM AIR DUCTS N/A WITH THIS MODEL. ON-SITE BY OTHERS

* DESIGNATES FIELD WORK

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"


TITLE:
FLOOR PLAN

FILENAME: 112APB-3276M42179


WAS 3280 201

SHEET:
AP-101


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

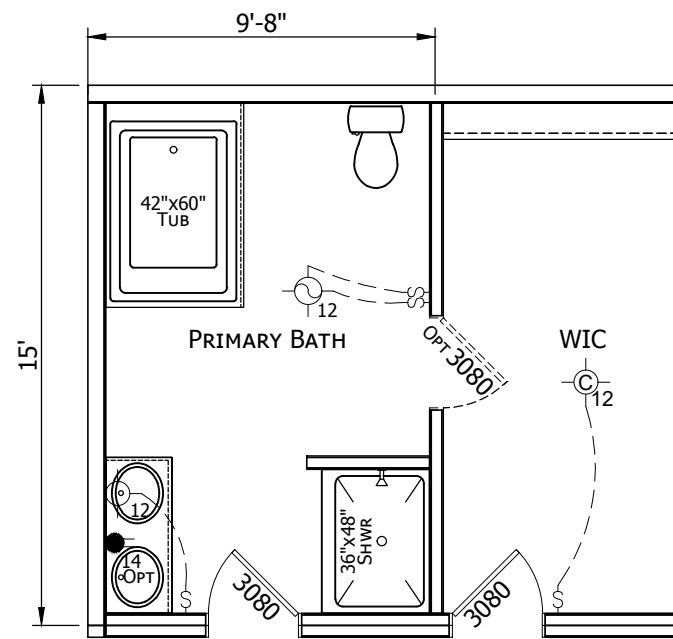


OPTIONAL PRIMARY BATH #1

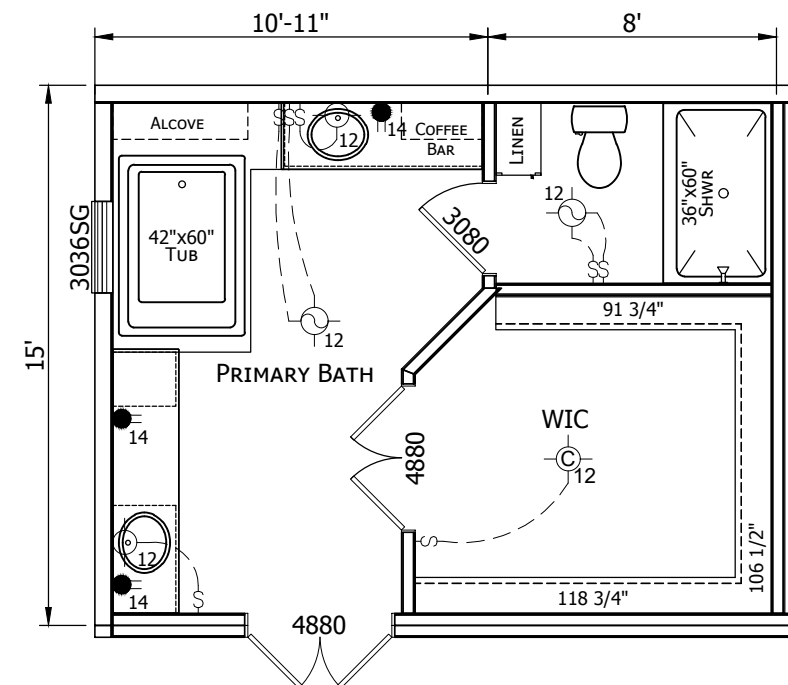


OPTIONAL PRIMARY BATH #2

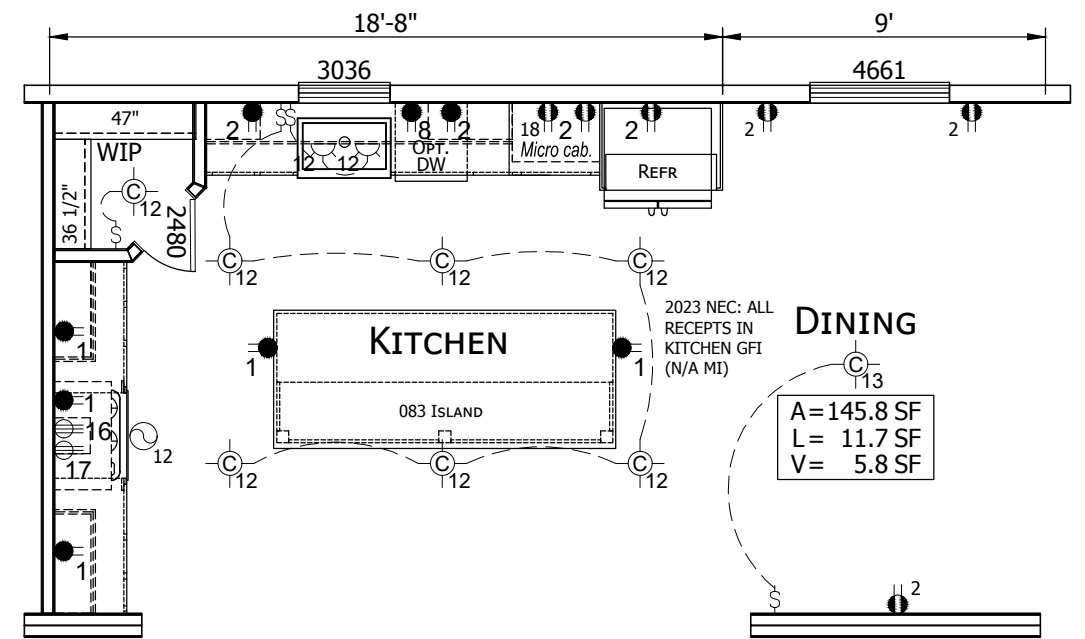


OPTIONAL ULTIMATE KITCHEN 2

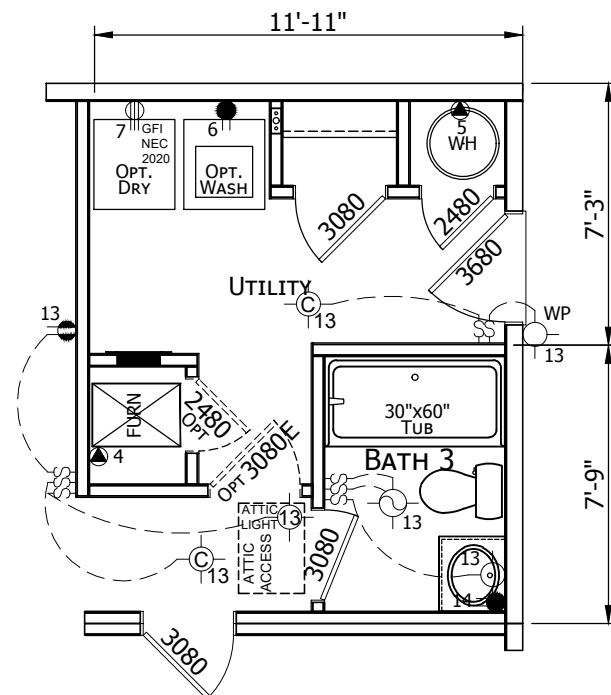

OPTIONAL BATH #3

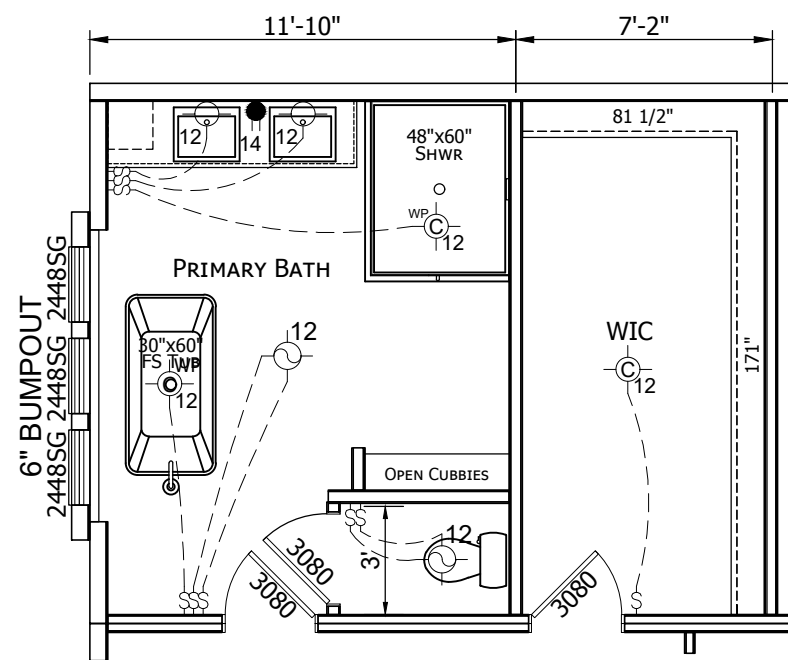

OPTIONAL RADIANT SPA BATH

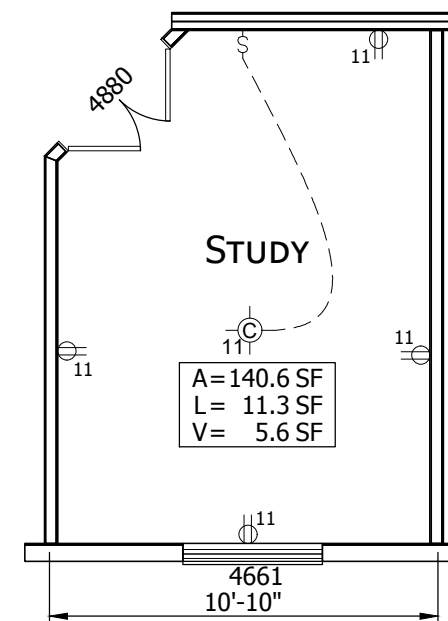

OPTIONAL STUDY

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

1 REPLACED OVAL TUB(S)

3-12-25 AJG

PROJECT:

112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:

FLOOR PLAN OPTIONS


FILENAME: 112APB-3276M42179

WAS 3280 201


SHEET:

AP-102


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2025 BY CHAMPION

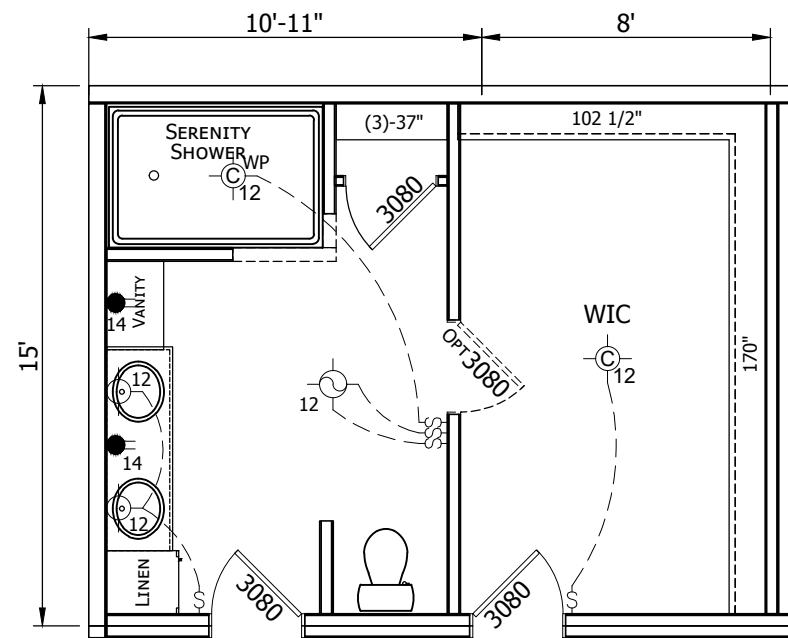


OPTIONAL SERENITY BATH #1

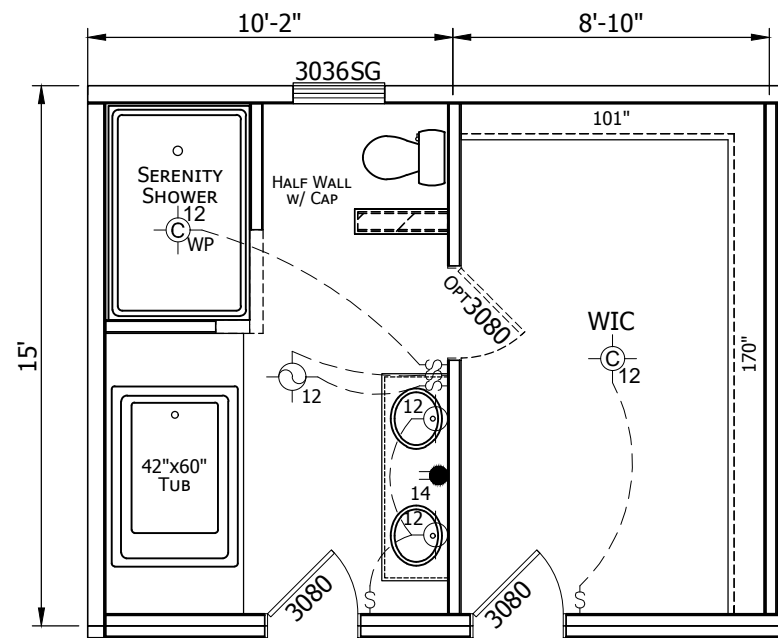


OPTIONAL SERENITY BATH #2

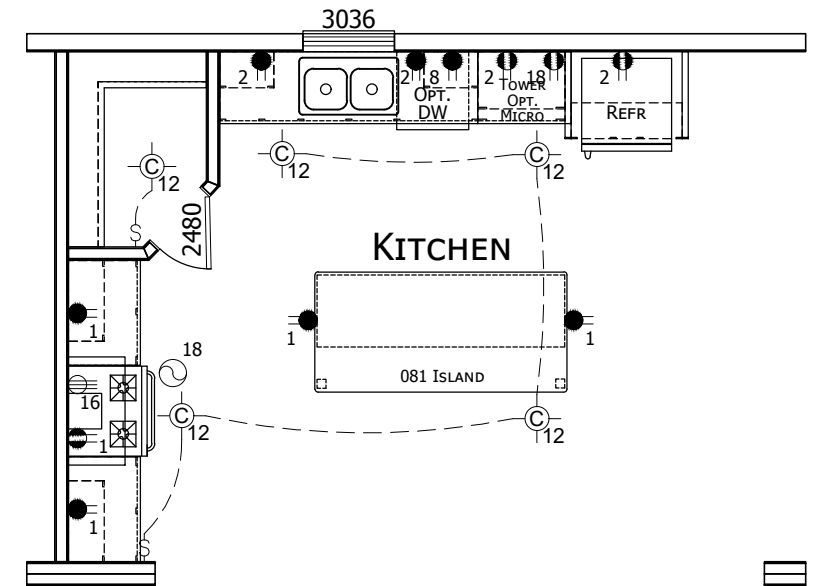


OPTIONAL SUMMIT KITCHEN
AVAILABLE W/ OPT. STONE COUNTERTOPS

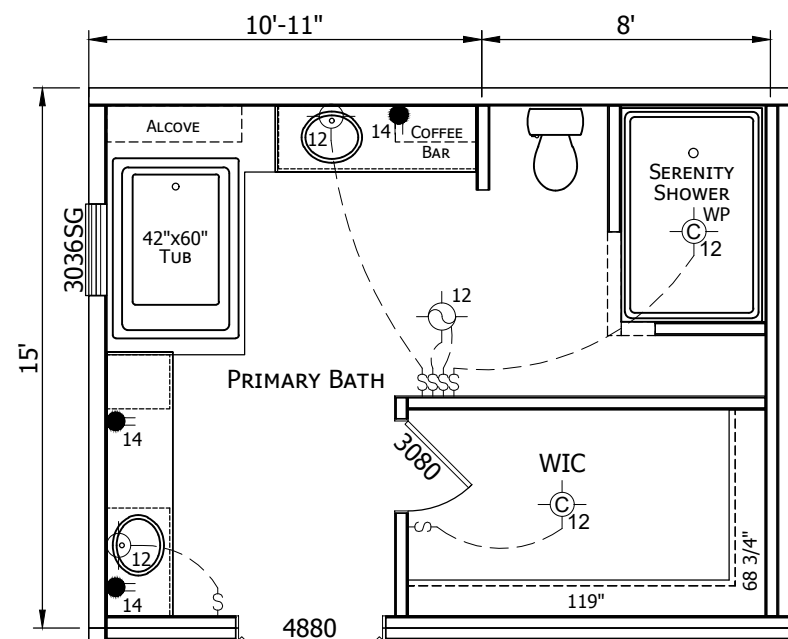

OPTIONAL SERENITY BATH #3

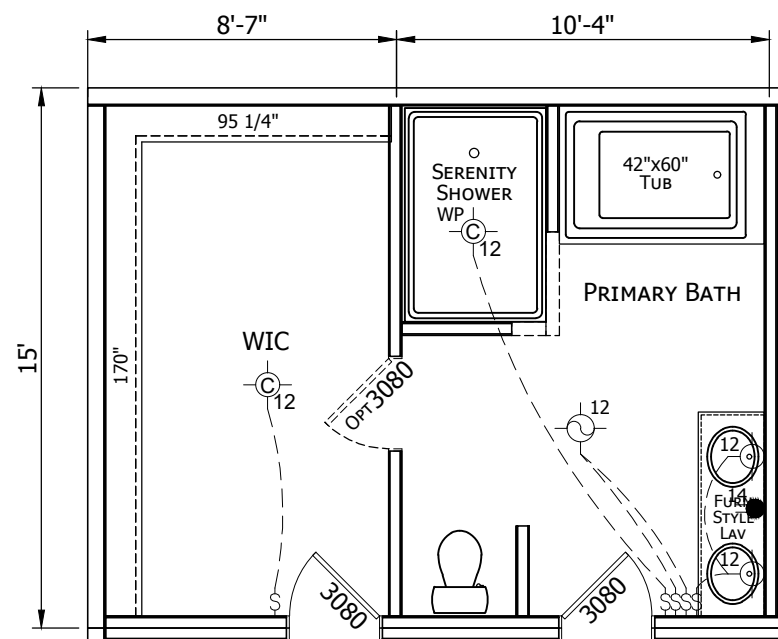

OPTIONAL SERENITY BATH #4

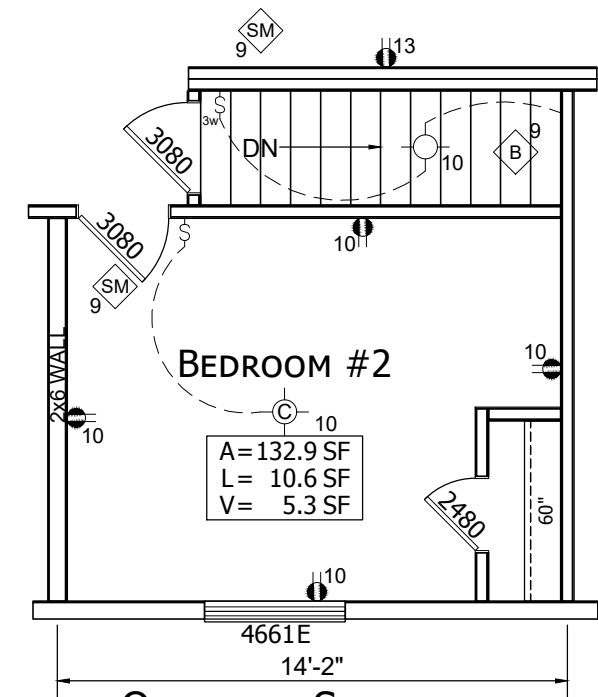

OPTIONAL STAIRWELL

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

1 REPLACED OVAL TUB(S)

3-12-25 AJG

PROJECT:

112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:

FLOOR PLAN OPTIONS


FILENAME: 112APB-3276M42179

WAS 3280 201

SHEET:

AP-103

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2025 BY CHAMPION

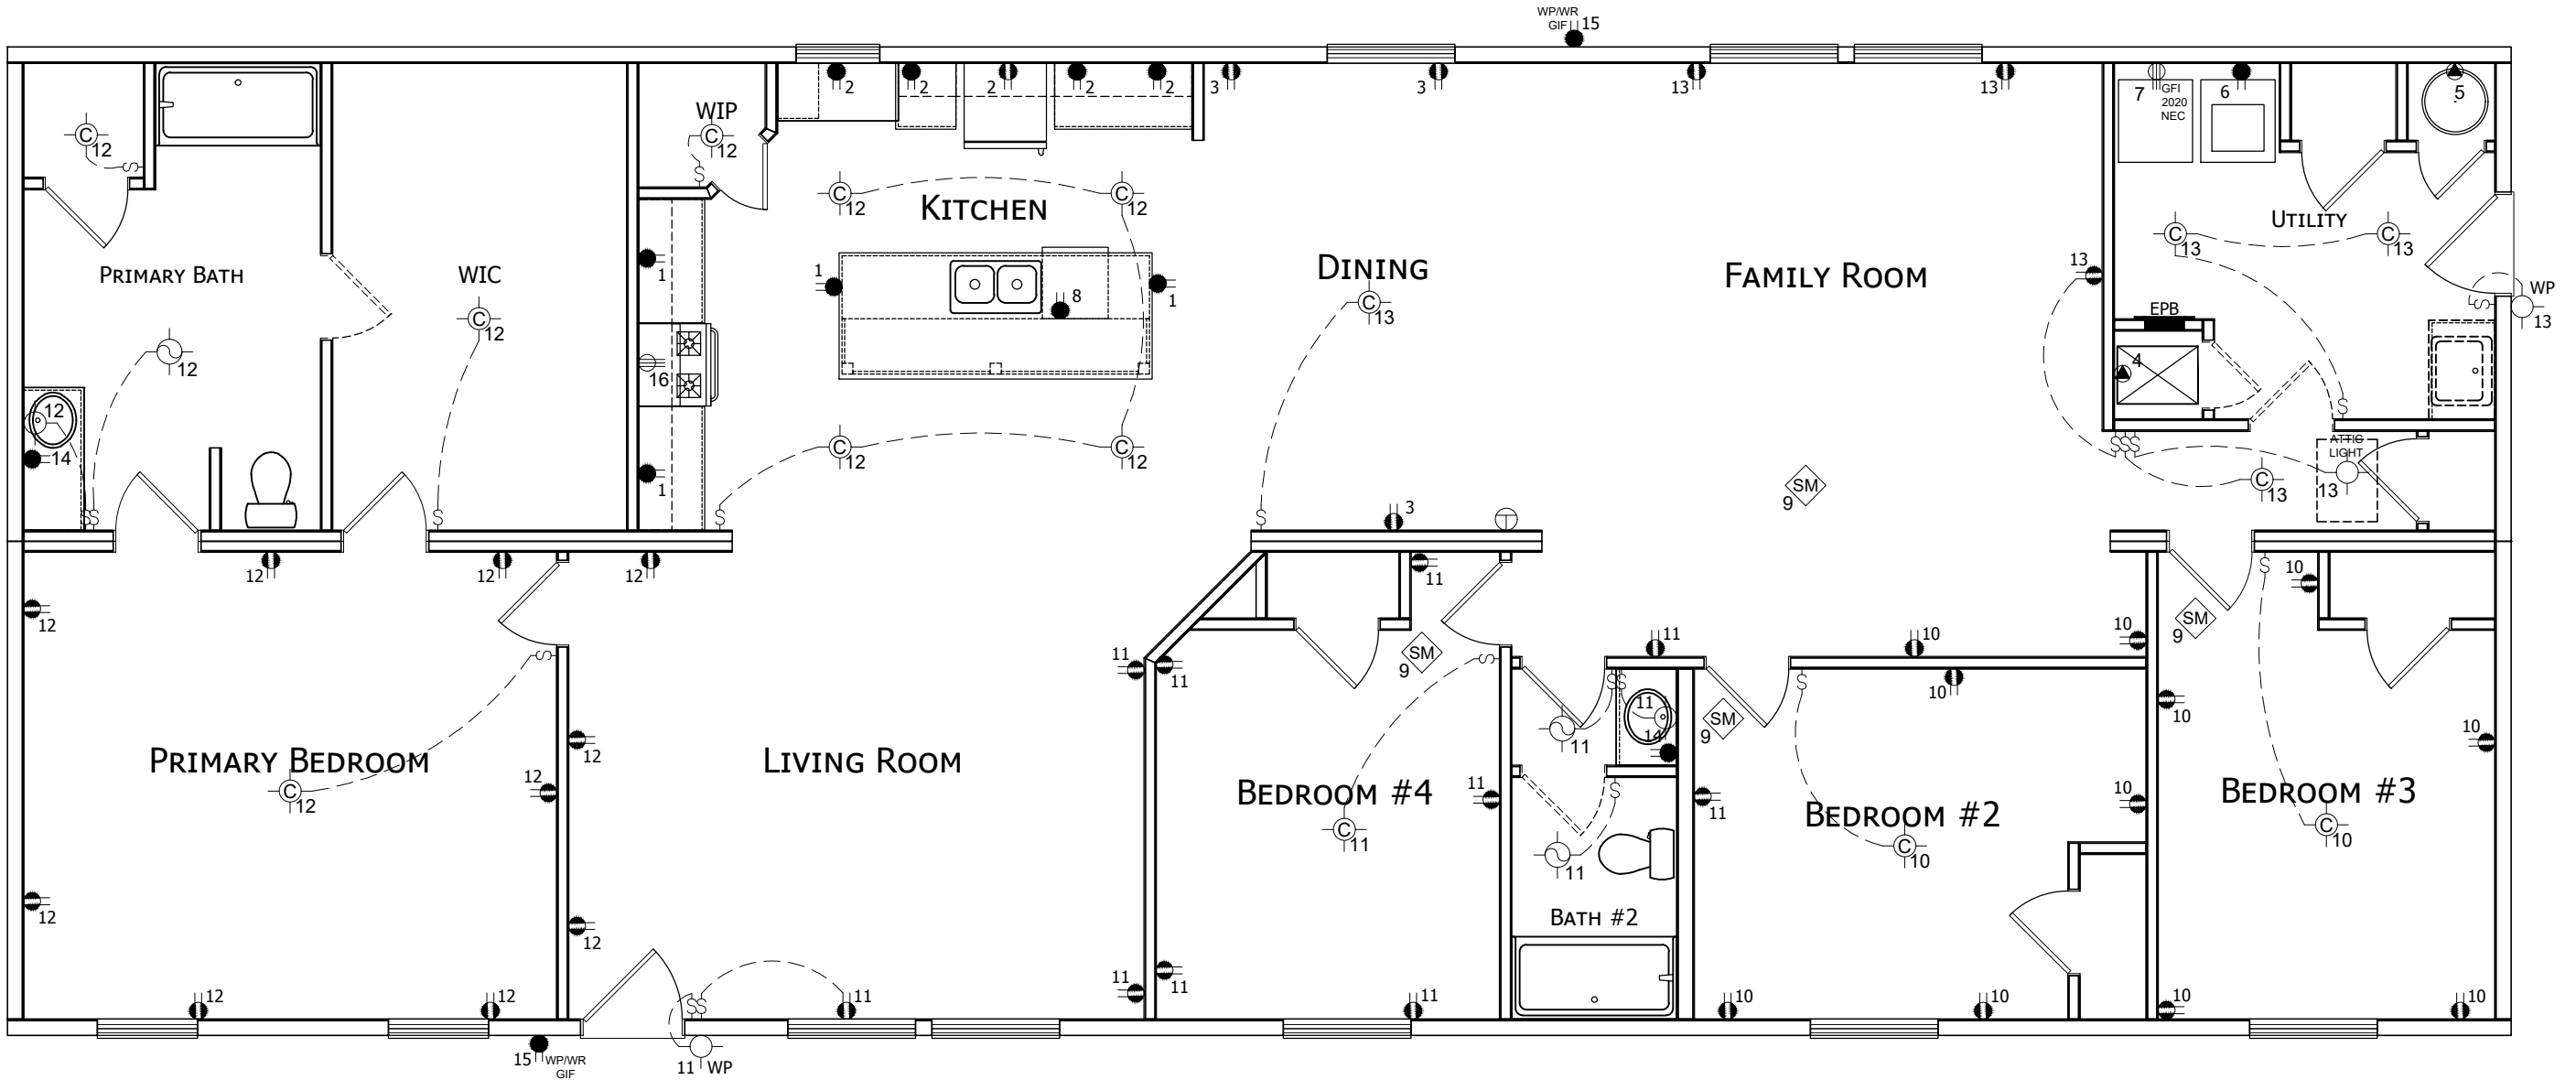

ELECTRICAL LEGEND

RECEPTACLE 120 VOLT - 20 AMP	THERMOSTAT	VENT FAN WITH LIGHT	SINGLE POLE SWITCH (3W DENOTES 3-WAY)
RECEPTACLE 120 VOLT - 20 AMP G.F.I. PROTECTED	COMBINATION SMOKE ALARM & CARBON MONOXIDE ALARM	VENT FAN	JUNCTION BOX
240 VOLT RECEPTACLE	SMOKE & C.O. ALARM BASEMENT APPLICATION	CEILING LIGHT	SPECIAL PURPOSE CONNECTION
MAIN PANEL		WALL LIGHT	COMMUNICATION JACK / PHONE JACK

NOTE:

- SEE PAGE EL 1.0 FOR MORE INFORMATION
- THE ONLY 15 & 20 AMP RECEPTACLES EXEMPT FROM AFCI ARE ON CIRCUITS 14, 15 & 25
- ALL EXTERIOR RECEPTACLES ARE WEATHER RESISTANT (WR) AND INSTALLED IN A WEATHER PROOF EXTRA DUTY ENCLOSURE.
- PER NEC 210.52E RECEPTACLES ARE REQUIRED W/ IN THE PERIMETER OF PORCHES, PATIOS DECKS, BALCONIES AND STOOPS OF ANY SIZE.
- PER 2023 NEC, PROVISIONS FOR FUTURE RECEPTACLE ONLY MADE IN ISLANDS AND PENINSULAS

NOTE:

PER 230.67 2020 NEC, SERVICE SUPPLY SURGE PROTECTIVE DEVICES ON SITE BY OTHERS.


NOTE:

THERMOSTAT TO BE PROGRAMMABLE AND MEET THE REQUIREMENTS SET FORTH IN THE IECC SECTION 403.1.1.

NOTE:

PER 2021 IECC:

- ALL LIGHT FIXTURES TO BE CONTROLLED BY DIMMER SWITCHES EXCEPT: BATHROOMS, HALLWAYS, EXTERIOR LIGHTS, AND LIGHTING DESIGNED FOR SAFETY AND SECURITY
- EXTERIOR LIGHTING ON SITE BY OTHERS AND MAY NOT EXCEED 30 WATTS TOTAL

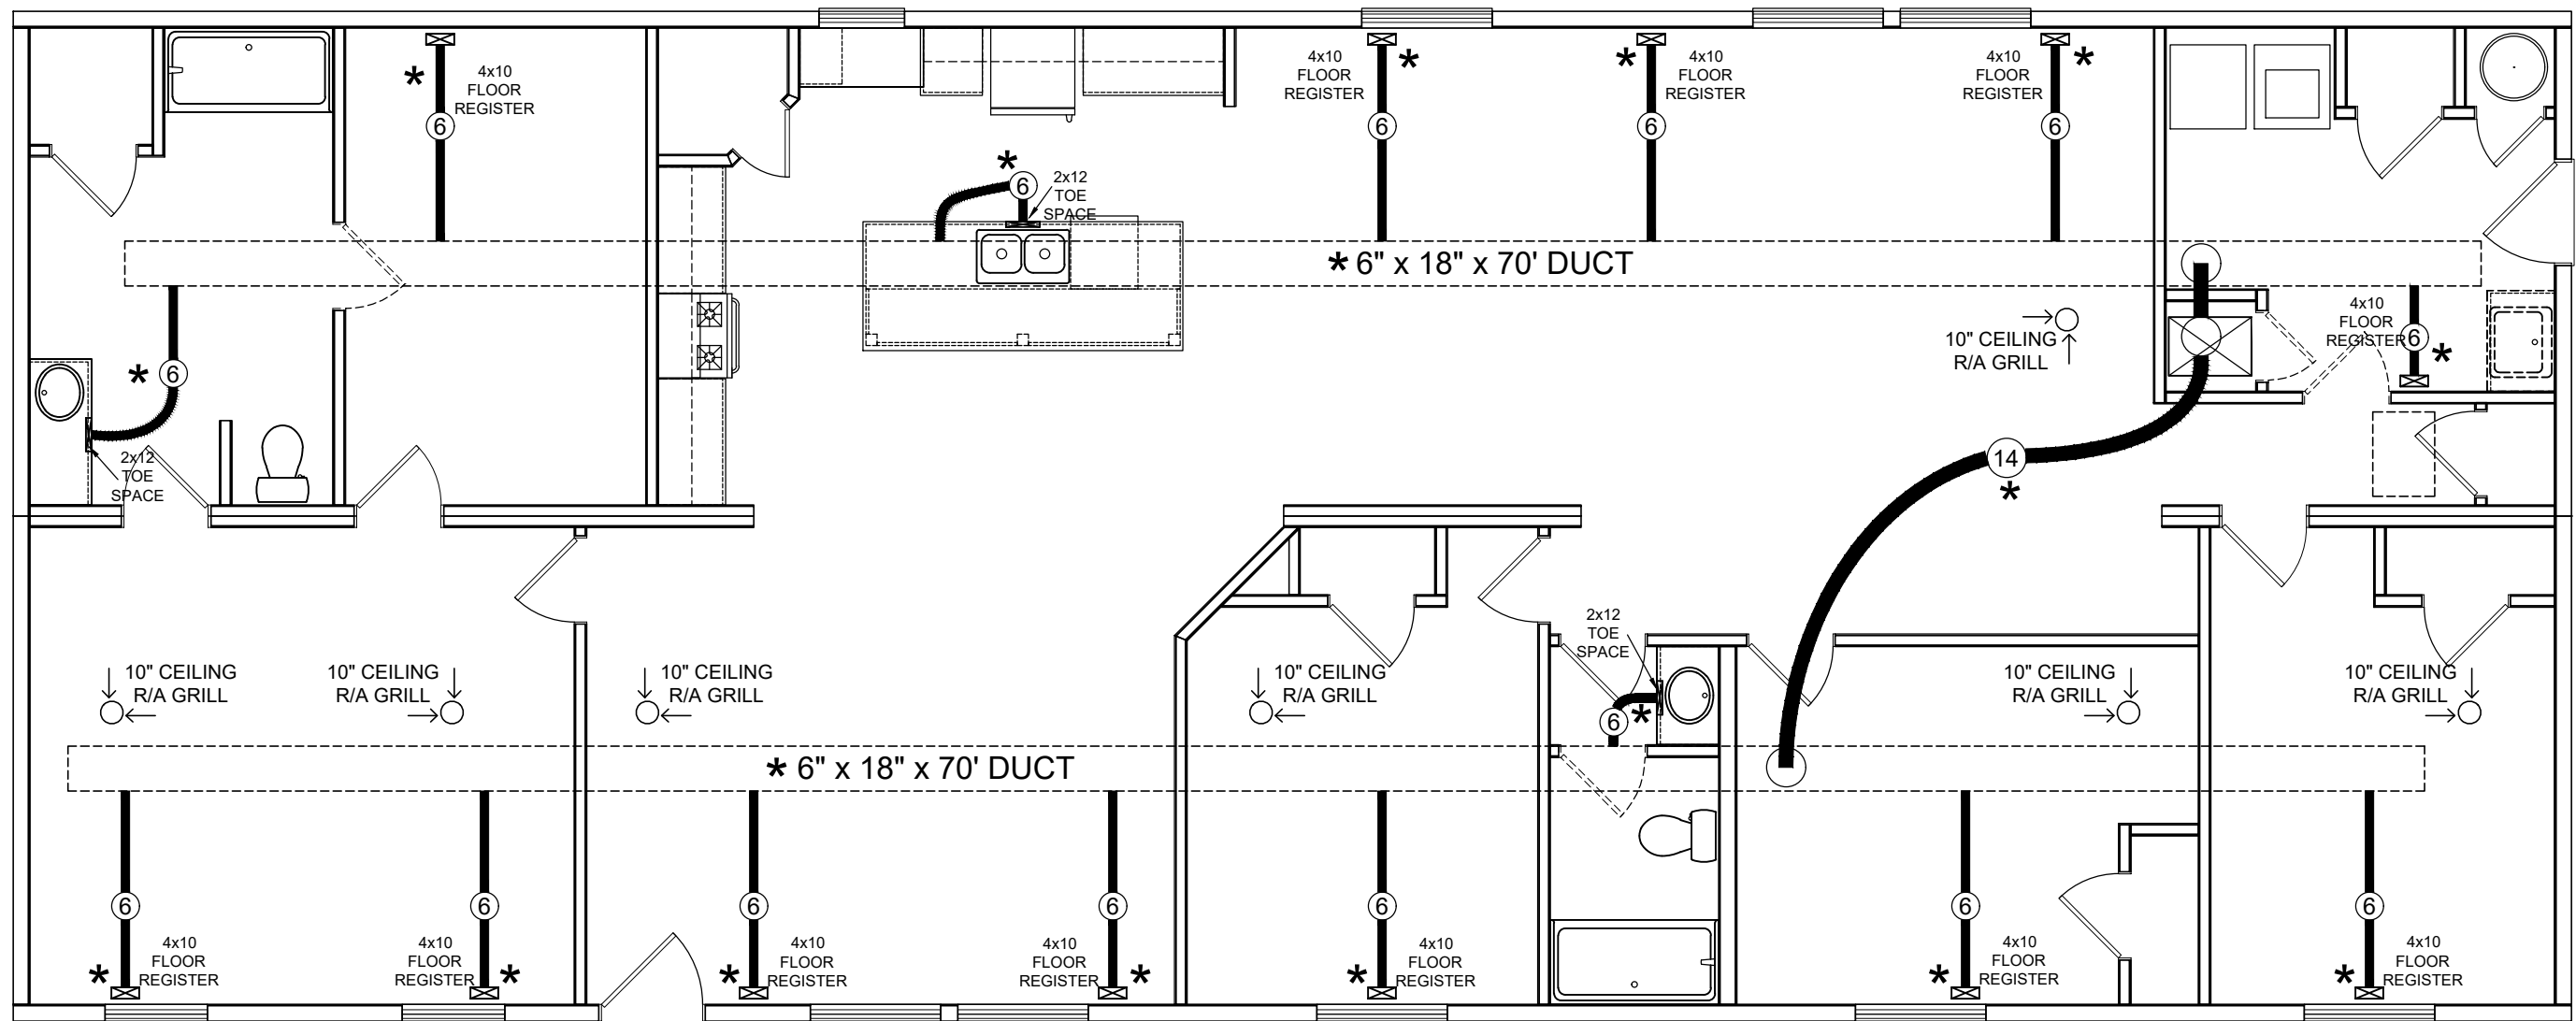

- SUPPLY AND RETURN AIR NOTES:
- 1. RETURN AIR SHALL NOT BE TAKEN FROM FURNACE / WATER HEATER ROOM IF EITHER ARE NOT SEALED COMBUSTION TYPE.
 - 2. FURNACE TO BE INSTALLED BY MANUFACTURER. SUPPLY AND RETURN DUCTS ARE TO BE INSTALLED BY THE MANUFACTURER.
 - 3. SUPPLY AIR DUCTS ARE TO BE INSTALLED IN THE FACTORY WITH THE EXCEPTION OF ANY DUCTWORK BELOW THE SILL PLATE WHICH WILL BE PROVIDED BY CHAMPION HOME BUILDERS AND INSTALLED ON SITE BY OTHERS.
 - 4. MODULE TO MODULE CONNECTIONS FOR THE RETURN AIR DUCT SYSTEM ARE TO BE DONE ON SITE BY OTHERS
 - 5. SUPPLY AND RETURN DUCTS ARE TO BE FIBERGLASS, INSULATED IN ACCORDANCE WITH THE LATEST IECC, SEE APPROVED RESCHECK. IT SHALL CONFORM TO SMACNA OR NAIMA FIBROUS DUCT CONSTRUCTION STANDARDS AND SHALL BE CONSTRUCTED OF MATERIALS WITH A FLAME SPREAD NOT GREATER THAN 200. BE OF DUCT CLASS 0 OR 1, BEAR A LISTING & LABEL PER UL 181, 181A OR 181B. COVERINGS AND LININGS SHALL HAVE A FLAME SPREAD INDEX NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX NOT MORE THAN 50 PER ASTM E 84. COVERINGS AND LININGS SHALL NOT FLAME, GLOW, SMOLDER OR SMOKE WHEN TESTED PER ASTM C411.
 - 6. ALL REGISTERS IN BATHROOMS TO BE IN A VERTICAL POSITION FROM THE FLOOR SURFACE.
 - 7. ALL REGISTERS AND DIFFUSERS WILL BE METAL.
 - 8. THE FURNACE SHALL HAVE CLEARANCES PER THE MANUFACTURER'S INSTRUCTIONS.
 - 9. SUPPLY, RETURN, AND EXHAUST DUCT INSULATION TO BE R-8 WHEN THEY ARE LOCATED OUTSIDE THE BUILDING THERMAL ENVELOPE.
 - 10. ALL DUCTWORK TO BE IN ACCORDANCE WITH NAIMA AH 116-2009 AND SMACNA-2010.
 - 11. AIR HANDLERS AND FILTER BOXES TO BE SEALED PER IECC R403.3.2. AIR HANDLERS TO HAVE A MAX AIR LEAKAGE OF 2%.
 - 12. DUCTS OUTSIDE THE THERMAL ENVELOPE TO BE ROUGH-IN TESTED IN ACCORDANCE WITH R 403.3.3 OR 403.3.4 (1).

- MECHANICAL NOTES:
- 1. 75 CFM - MECHANICAL VENTILATION IS ACCOMPLISHED BY PULLING FRESH AIR THROUGH THE RETURN AIR PLENUM IN THE ATTIC WITH A 6" FLEX DUCT INSULATED IN ACCORDANCE WITH THE IECC, RUN TO THE OUTSIDE WITH A GRAVITY DAMPER.
 - 2. THERMOSTAT TO BE LABELED "WHOLE HOUSE VENTILATION". FAN TO BE SET TO CONTINUOUS.
 - 3. MECHANICAL VENTILATION AIRFLOW TO BE TESTED ON SITE BY OTHERS.
 - 4. BATH EXHAUST FANS ARE UL LISTED AND LABELED; AND INSTALLED IN ACCORDANCE TO THEIR LISTINGS, AND MUST BE CAPABLE OF PRODUCING A CHANGE OF AIR EVERY 12 MINUTES. TERMINATIONS WILL BE TO THE OUTSIDE OF THE HOUSE EITHER THRU THE ROOF OR OUT THE EAVE SOFFIT. BATH VENT WILL NOT TERMINATE IN THE ATTIC.
 - 5. KITCHEN RANGE HOODS SHALL BE UL LISTED AND LABELED; AND INSTALLED IN ACCORDANCE TO THEIR LISTING.

TYPICAL APPLIANCES INSTALLED AT FACTORY:

FURNACE-
NORDYNE MODEL M3RL (GAS) OR ALT ELECTRIC

WATER HEATERS-
NORDYNE OR RHEEM (OR EQUAL)
40 GAL. ELECTRIC OR GAS

KITCHEN APPLIANCES-
GENERAL ELECTRIC (OR EQUAL) RANGES (12KVA), REFRIGERATOR, DISHWASHER
RANGE HOOD - VENTLINE MODEL PH SERIES (100 CFM) ALT. BROAN QS1 SERIES

BATH VENT-
VENTLINE MODEL 2270-50 (50 CFM) OR V2280-75 (75 CFM)

*** WARM AIR DUCTS N/A WITH THIS MODEL. ON-SITE BY OTHERS**

MODIFICATIONS

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:
MECHANICAL PLAN

FILENAME: 112APB-3276M42179

WAS 3280 201


SHEET:
A-ME

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

WATER SUPPLY
ALL PIPING 1/2" UNLESS NOTED
COLD ————— HOT

WATER SUPPLY - GENERAL NOTES
* DESIGNATES FIELD WORK

1. PIPING IS PEX WITH APPROVED FITTINGS. PEX SHALL MEET THE REQUIREMENTS OF ASTM F 876, AWWA C904, CSA B137.5.
2. PEX CONNECTIONS ARE MADE USING PLASTIC INSERT FITTINGS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
3. HORIZONTAL AND VERTICAL PIPING IS SUPPORTED AT 3' O.C.
4. DISCHARGE TUBES FROM RELIEF VALVES ARE RUN FULL SIZE TO OUTLET. VALVES ARE NOT PERMITTED IN RELIEF VALVE DISCHARGE PIPES.
5. MAIN INLET AND WATER HEATER INLET ARE INSTALLED WITH FULL OPEN VALVES.
6. ALL FIXTURES ARE CONNECTED WITH APPROVED SHUT-OFFS.
7. EXTERIOR FAUCETS SHALL BE PROTECTED BY AN APPROVED VACUUM BREAKER.
8. TUBS AND SHOWERS ARE EQUIPPED WITH CONTROL VALVES OF THE BALANCE TYPE, CAPABLE OF LIMITING WATER TEMPERATURE TO A HIGH OF 120 DEGREES.
9. DISHWASHERS, WASHER, AND ICE MAKERS ARE EQUIPPED WITH WATER HAMMER ARRESTORS. MECHANICAL ARRESTORS ARE USED ON QUICK CLOSING DEVICES AS REQUIRED BY THE RESPECTIVE CODE.
10. WATER HAMMER ARRESTORS MUST CONFORM TO ASSE 1010 AND BE INSTALLED IN ACCORDANCE WITH THEIR LISTING. ACCESS TO BE PROVIDED TO ALL ARRESTORS.
11. EXTERIOR FAUCET SHUT-OFF VALVES LOCATED IN EITHER THE CRAWLSPACE OR IN A BASEMENT, SHALL BE IDENTIFIED BY A SELF ADHESIVE LABEL OR A STRING TAG. THE LABEL SHALL READ, "SHUT-OFF FOR EXTERIOR FAUCET"
12. PIPING LOCATED IN CONCEALED AREAS, SUCH AS HOLES OR NOTCHES IN STUDS, JOIST, RAFTERS OR SIMILAR MEMBERS THAT HAVE THE POSSIBILITY OF BEING DAMAGED BY A NAIL OR SCREW AFTER INITIAL INSTALLATION SHALL BE PROTECTED BY A STEEL PLATE WITH A MINIMUM 1/16" THICKNESS.
13. ACCESS AT WHIRLPOOL TUB PUMP SHALL BE THRU A 12" x 12" MIN. OPENING. IF PUMP IS MORE THAN TWO FEET FROM THE ACCESS PANEL THE OPENING MUST BE 18" x 18" MINIMUM.
14. WHEN HOME IS PLACED ON UNHEATED FOUNDATIONS; ON-SITE PROVISIONS TO PREVENT FREEZING OF WATER SUPPLY AND DWV IS SUPPLIED AND INSTALLED BY OTHERS.
15. NO LUMBER MAY BE NOTCHED, BORED, OR CUT IN THE FIELD UNLESS IN ACCORDANCE WITH THE CODE AUTHORITY.
16. METAL PLATE CONNECTED TRUSSES MAY NOT BE NOTCHED, BORED OR CUIT IN THE FIELD EXCEPT AS DIRECTED BY A LICENSED PROFESSIONAL ENGINEER. OPEN JOISTS SHALL BE NOTCHED, BORED OR CUT IN THE FIELD EXCEPT IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
17. SHOWER AND TUB/SHOWER COMBOS SHALL HAVE A VALVE TEMPERATURE LIMITATION DEVICE THAT SHALL COMPLY TO ASSE 1016. TUB ONLY AND WHIRLPOOL TUBS SHALL COMPLY WITH ASSE 1070.
18. PREFABRICATED SHOWERS SHALL COMPLY WITH THE REQUIREMENTS OF ASME A112.19.2/CSA B 45.1 or CSA B 45.5 /APMO Z124.
19. PIPE LESS THAN 1 1/2" FROM FACE OF STUD SHALL BE PROTECTED WITH A MINIMUM 16 GAUGE SHIELD PLATES THAT EXTEND AT LEAST 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.
20. SHOWER SUPPLY RISERS ARE TO ANCHORED WITH SUPPORT DEVICES DESIGNED FOR THE SPECIFIC PIPE MATERIAL.
21. FAUCET AND FIXTURE FITTINGS SHALL CONFORM TO ASME A112.18.1 or CSA B125..
22. LAVATORIES SHALL CONFORM TO ASME A112.19.1/CSA B45.2, ASME A112.19.2/CSA B45.1,ASME A112.19.3/CSA B45.4 or CSA B45.5/IAPMO Z124.
23. TOILETS SHALL CONFORM TO ASME A112.19.2/CSA B45.1, ASME A112.19.3/ CSA B45.4 OR CSA B45.5/IAPMO Z124.
24. WATER HEATER RELIEF VALVE TO BE LISTED AND LABELED AS COMPLIANT WITH ANSI Z21.22.
25. HOT WATER SUPPLY LINES 3/4" OR LARGER TO BE INSULATED WITH R-3 INSULATION.

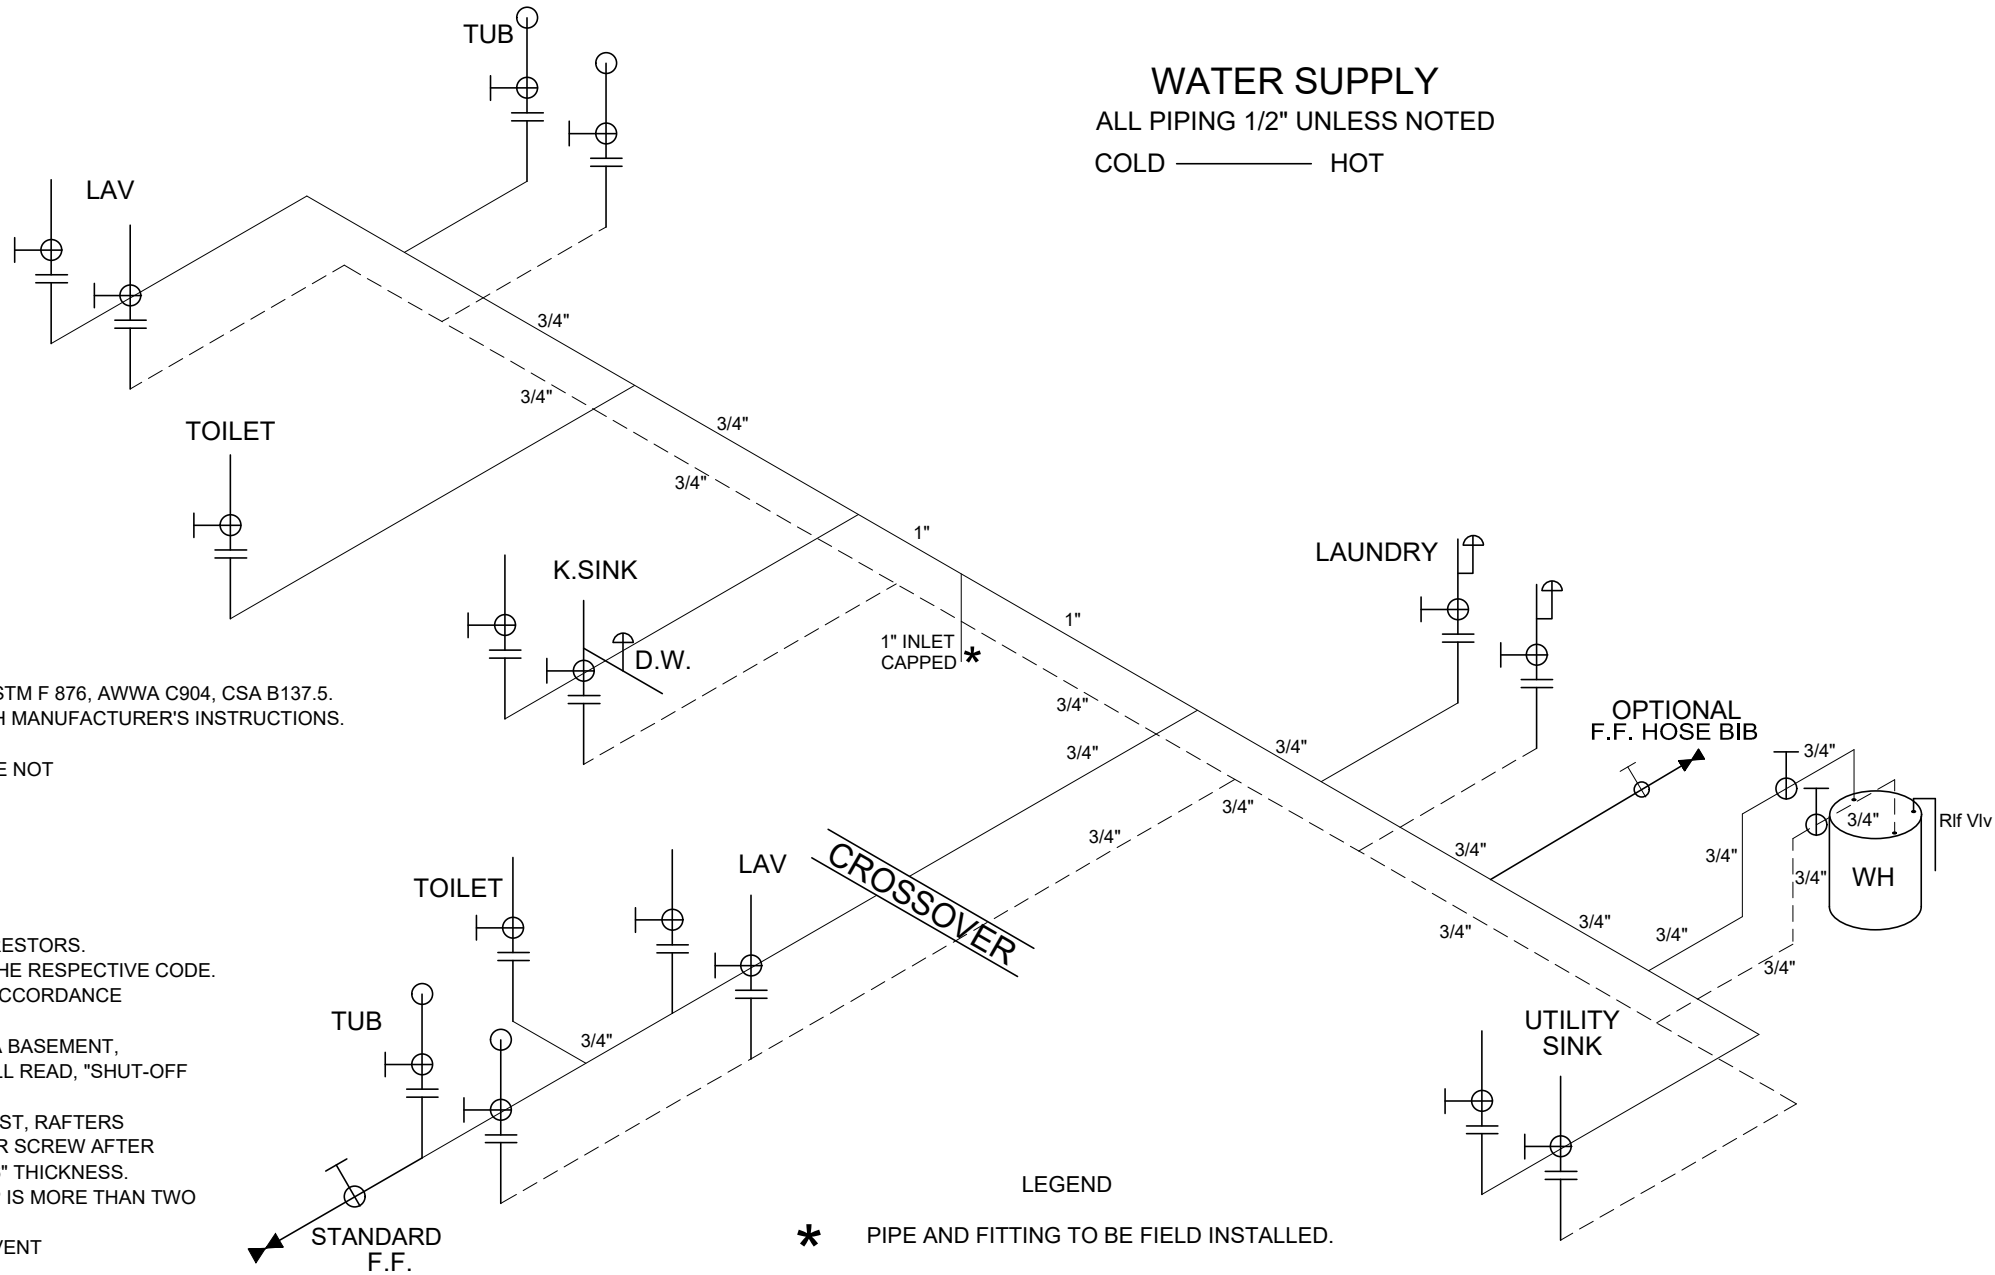

* PIPE AND FITTING TO BE FIELD INSTALLED.

○| FIXTURE SHUT-OFF.

⊥ TYPICAL WATER HAMMER.

▲ FULL OPEN VALVE.

○ PRESSURE BALANCE OR THERMOSTATIC VALVE, CAPABLE OF HIGH LIMIT TO 120 DEGREES. SHALL CONFORM TO ASSE 1070 FOR TUBS WITH NO SHOWER AND SHALL CONFORM TO ASSE 1016 FOR TUB/SHOWER COMBINATION

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:
WATER LINE PLAN

FILENAME: 112APB-3276M42179

WAS 3280 201

SHEET:
WP-101


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MASTER BATH OPTION #2

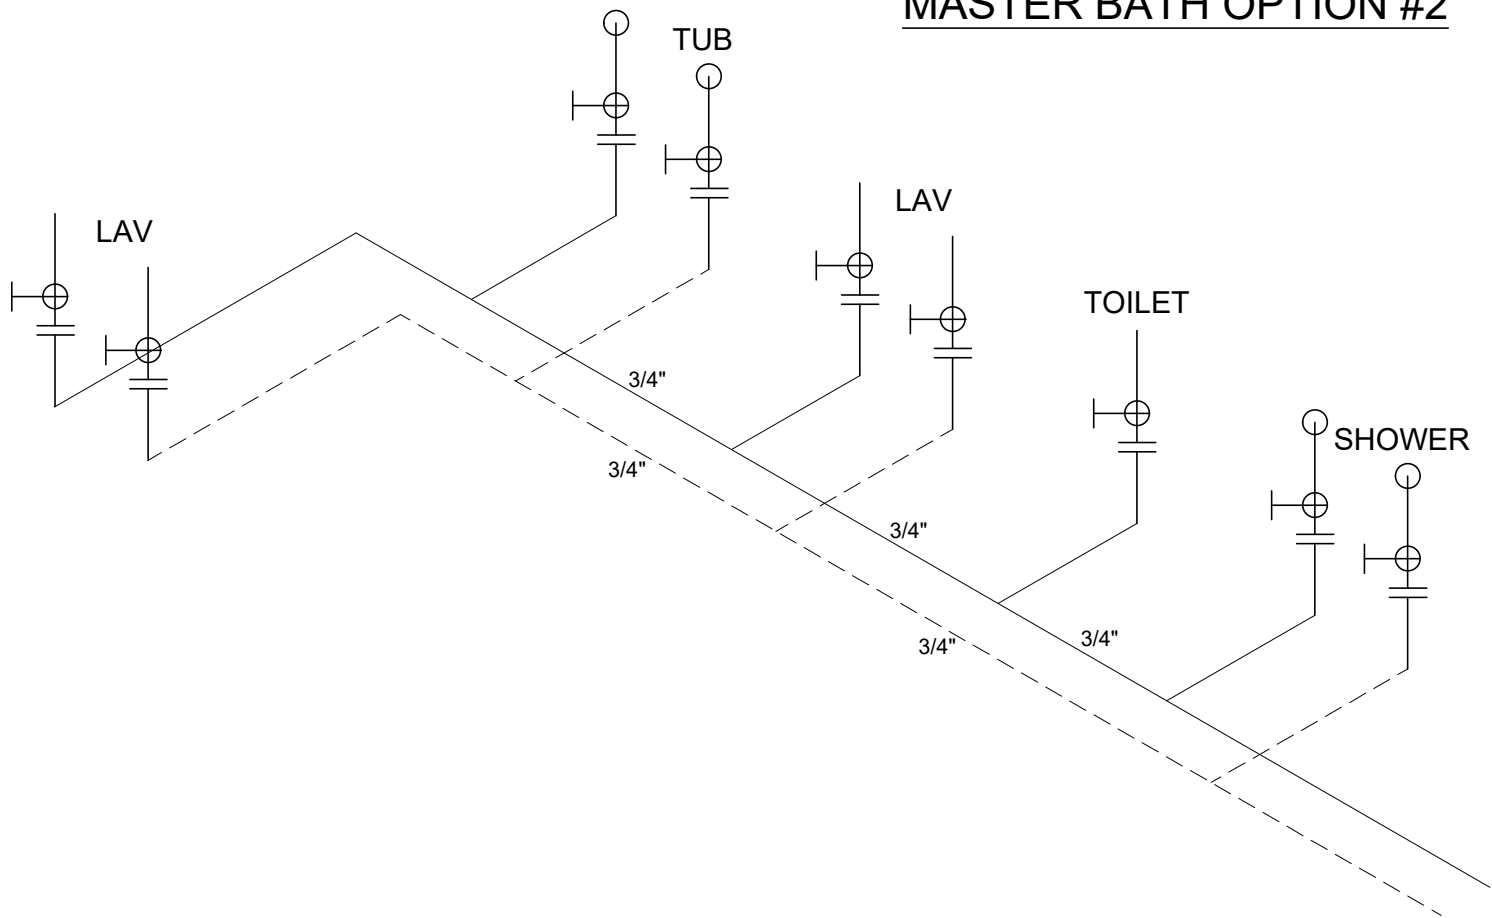


WATER SUPPLY

ALL PIPING 1/2" UNLESS NOTED

COLD ——— HOT

LEGEND

- * PIPE AND FITTING TO BE FIELD INSTALLED.
- | FIXTURE SHUT-OFF.
- ⌋ TYPICAL WATER HAMMER.
- ✕ FULL OPEN VALVE.
- PRESSURE BALANCE OR THERMOSTATIC VALVE, CAPABLE OF HIGH LIMIT TO 120 DEGREES. SHALL CONFORM TO ASSE 1070 FOR TUBS WITH NO SHOWER AND SHALL CONFORM TO ASSE 1016 FOR TUB/SHOWER COMBINATION

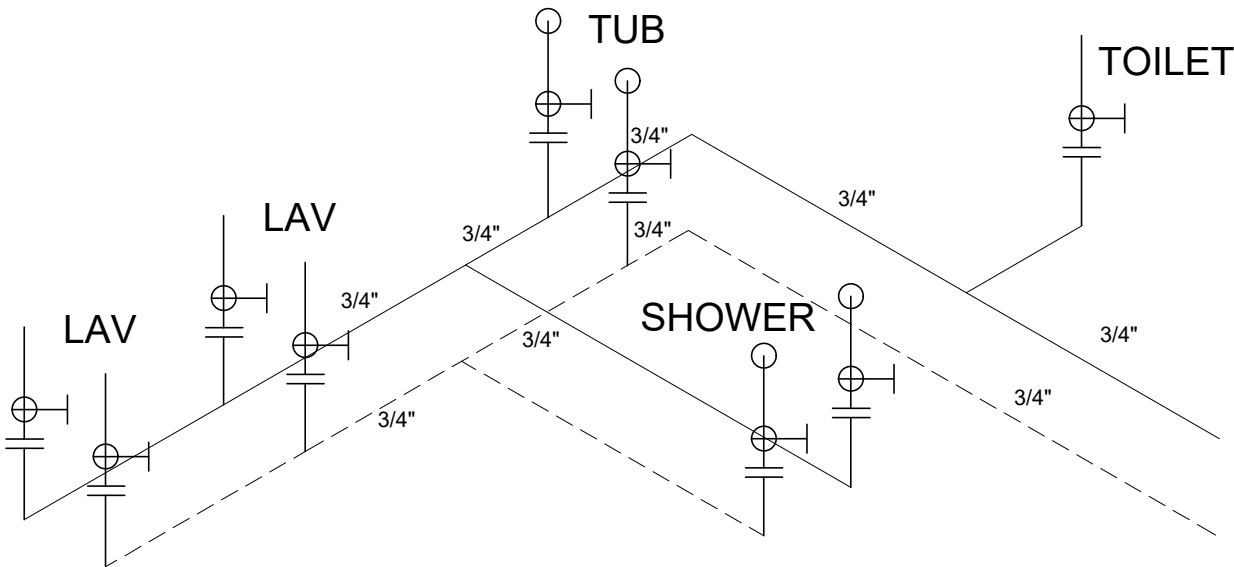

MASTER BATH OPTION #1

MODIFICATIONS

CHAMPION
MANUFACTURED BEAUTIFULLY™
308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT


DRAWN BY: A.GOULD
DATE: 05-15-24
SCALE: 3/16" = 1'-0"

TITLE:
WATER LINE PLAN
OPTIONS


FILENAME: 112APB-3276M42179
WAS 3280 201

SHEET:
WP-102

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

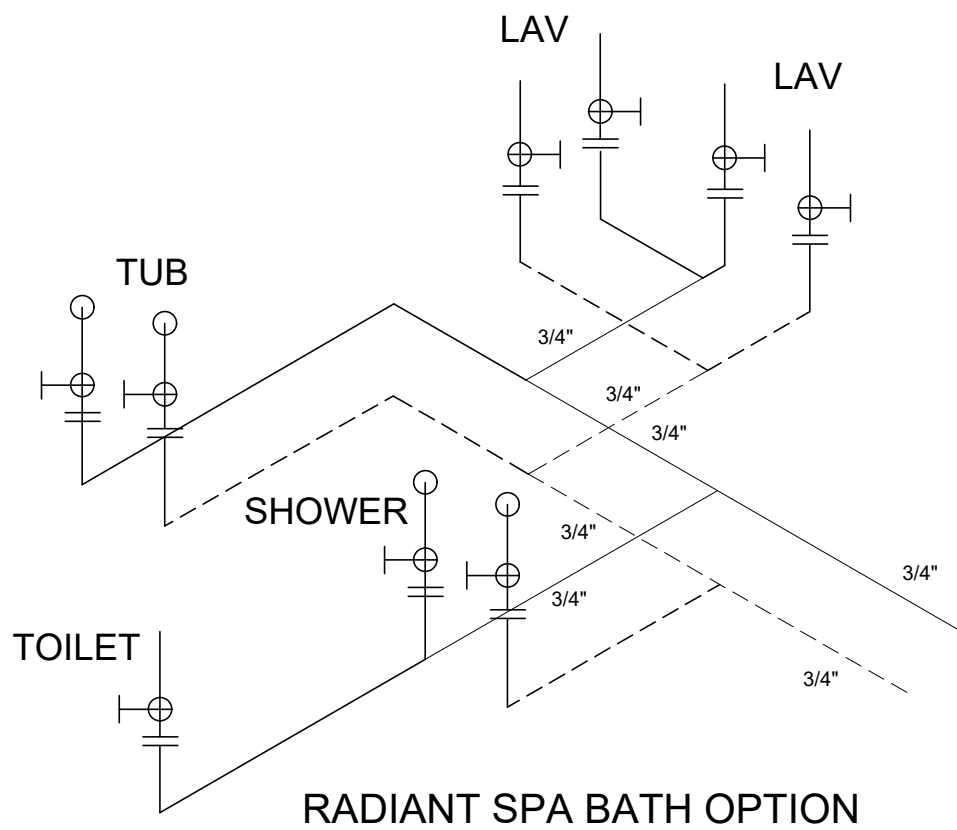

WATER SUPPLY
 ALL PIPING 1/2" UNLESS NOTED
 COLD ——— HOT

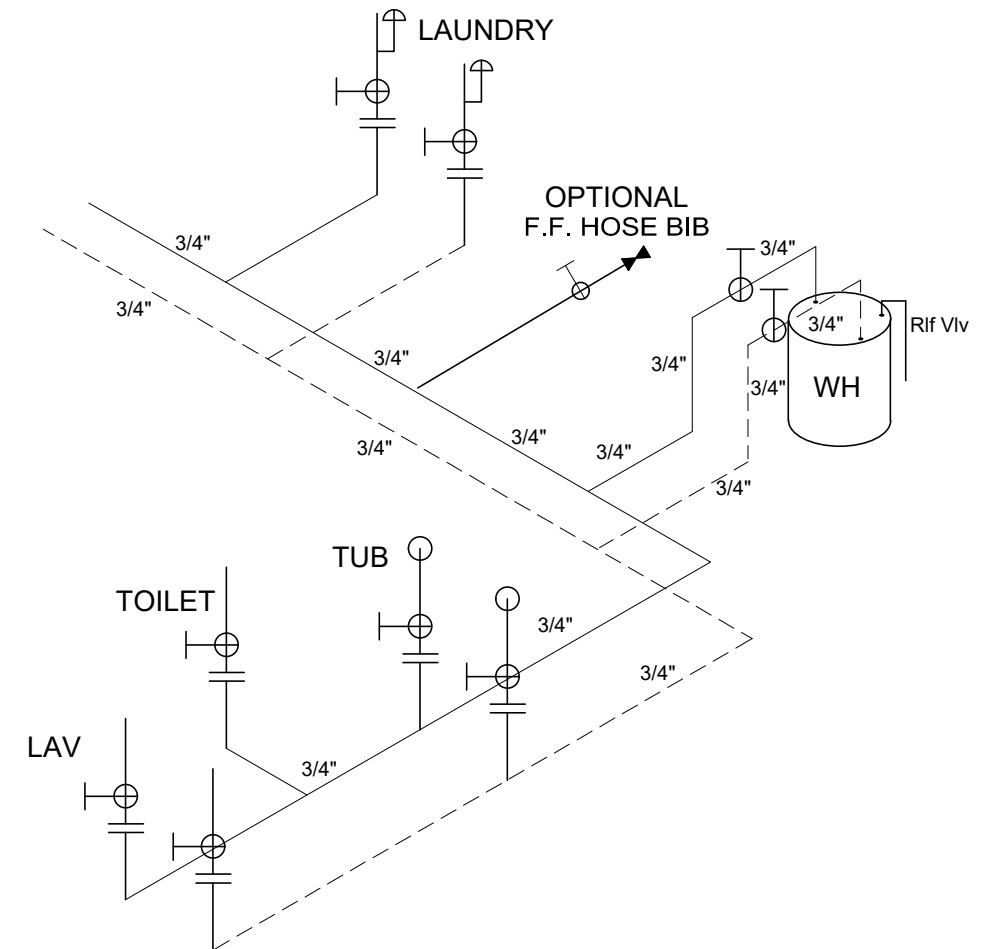

BATH 3 OPTION

LEGEND

- * PIPE AND FITTING TO BE FIELD INSTALLED.
- ⊕ FIXTURE SHUT-OFF.
- ⌋ TYPICAL WATER HAMMER.
- ⌋ FULL OPEN VALVE.
- PRESSURE BALANCE OR THERMOSTATIC VALVE, CAPABLE OF HIGH LIMIT TO 120 DEGREES. SHALL CONFORM TO ASSE 1070 FOR TUBS WITH NO SHOWER AND SHALL CONFORM TO ASSE 1016 FOR TUB/SHOWER COMBINATION

MODIFICATIONS

PROJECT:
 112APB-3276M42179
 76'-0" x 30'-0"
 4 BD 2 BT

DRAWN BY: A.GOULD
 DATE: 05-15-24
 SCALE: 3/16" = 1'-0"

TITLE:
 WATER LINE PLAN
 OPTIONS

FILENAME: 112APB-3276M42179
 WAS 3280 201

SHEET:
 WP-103


PROPRIETARY AND CONFIDENTIAL
 THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
 PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
 COPYRIGHT © 1976-2024 BY CHAMPION

CHAMPION


MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

SERENTIY BATH OPTION #1

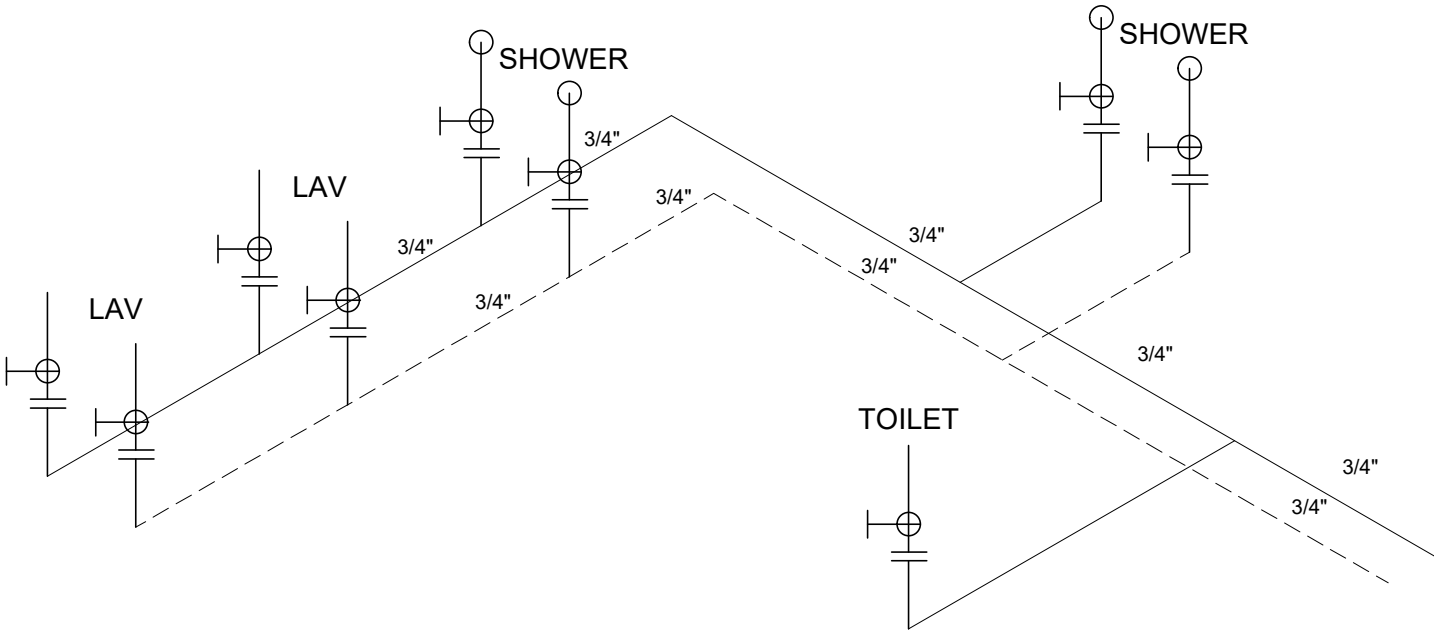

WATER SUPPLY
ALL PIPING 1/2" UNLESS NOTED
COLD ——— HOT

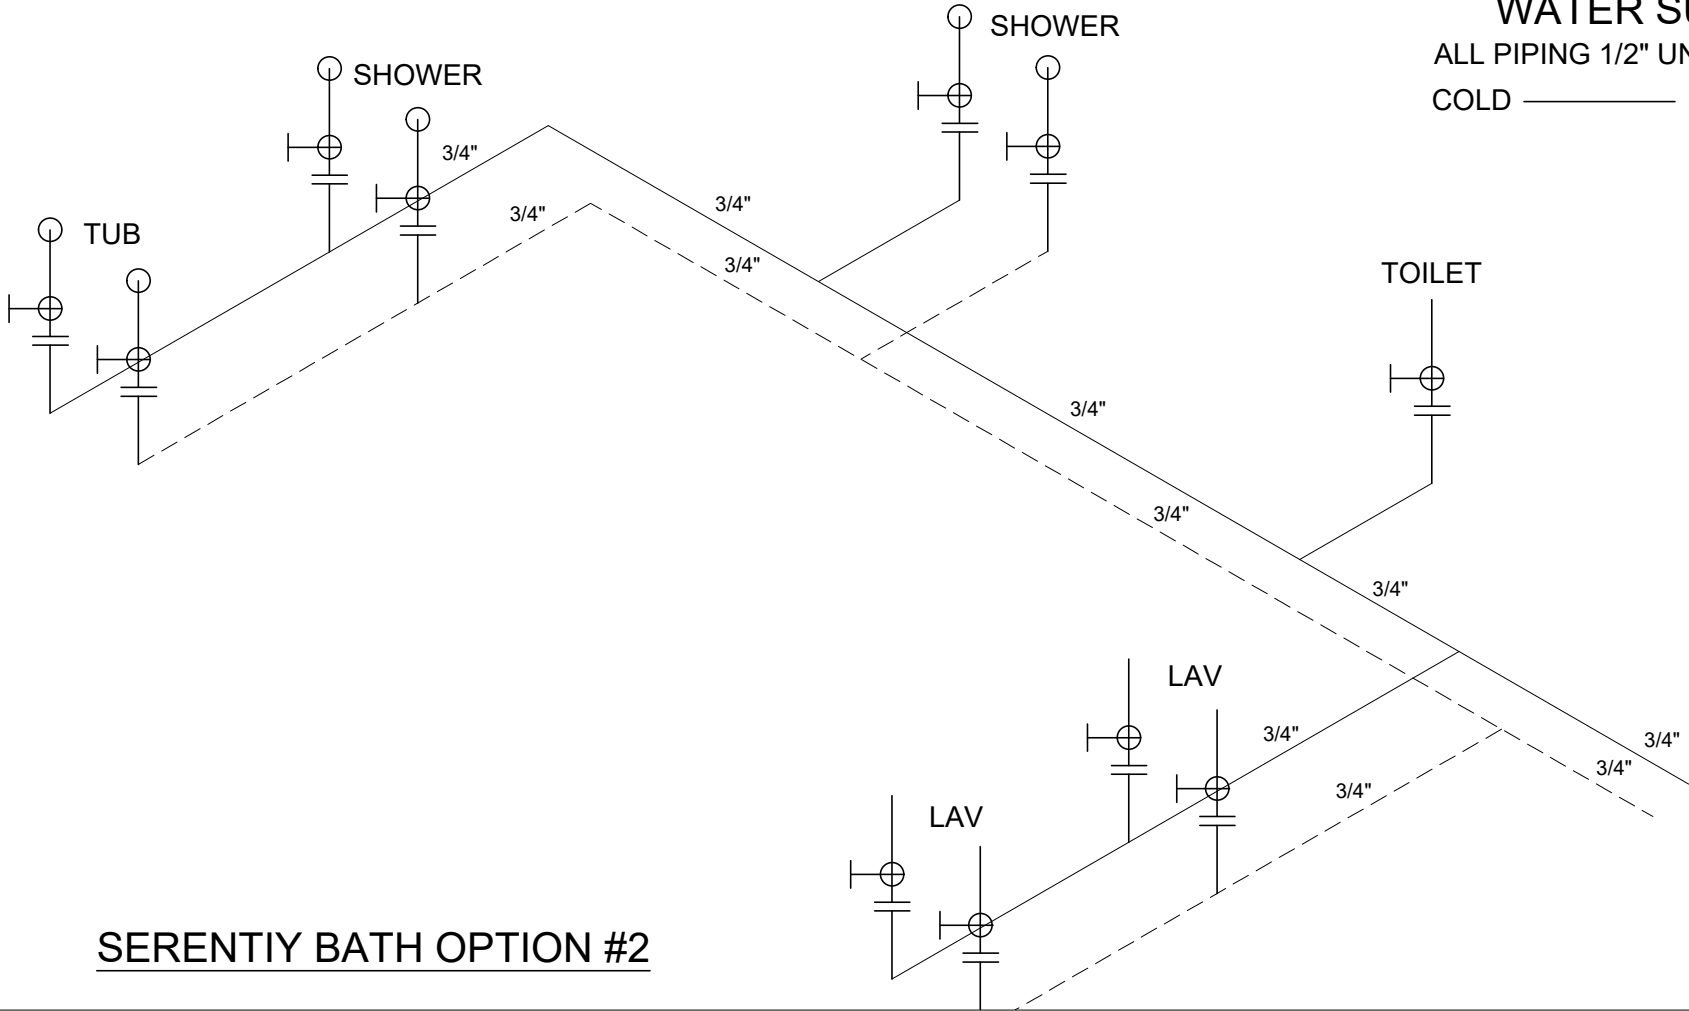

LEGEND


- * PIPE AND FITTING TO BE FIELD INSTALLED.
- ⊕ FIXTURE SHUT-OFF.
- ⌋ TYPICAL WATER HAMMER.
- ⌋ FULL OPEN VALVE.
- PRESSURE BALANCE OR THERMOSTATIC VALVE, CAPABLE OF HIGH LIMIT TO 120 DEGREES. SHALL CONFORM TO ASSE 1070 FOR TUBS WITH NO SHOWER AND SHALL CONFORM TO ASSE 1016 FOR TUB/SHOWER COMBINATION

SERENTIY BATH OPTION #2


MODIFICATIONS

CHAMPION MANUFACTURED BEAUTIFULLY™ 308 SHERIDAN DRIVE TOPEKA, IN 46571			MODIFICATIONS	PROJECT: 112APB-3276M42179 76'-0" x 30'-0" 4 BD 2 BT	TITLE: WATER LINE PLAN OPTIONS	SHEET: WP-104
				DRAWN BY: A.GOULD	FILENAME: 112APB-3276M42179	PROPRIETARY AND CONFIDENTIAL
				DATE: 05-15-24	WAS 3280 201	THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL. PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
				SCALE: 3/16" = 1'-0"		COPYRIGHT © 1976-2024 BY CHAMPION

SERENTIY BATH OPTION #3

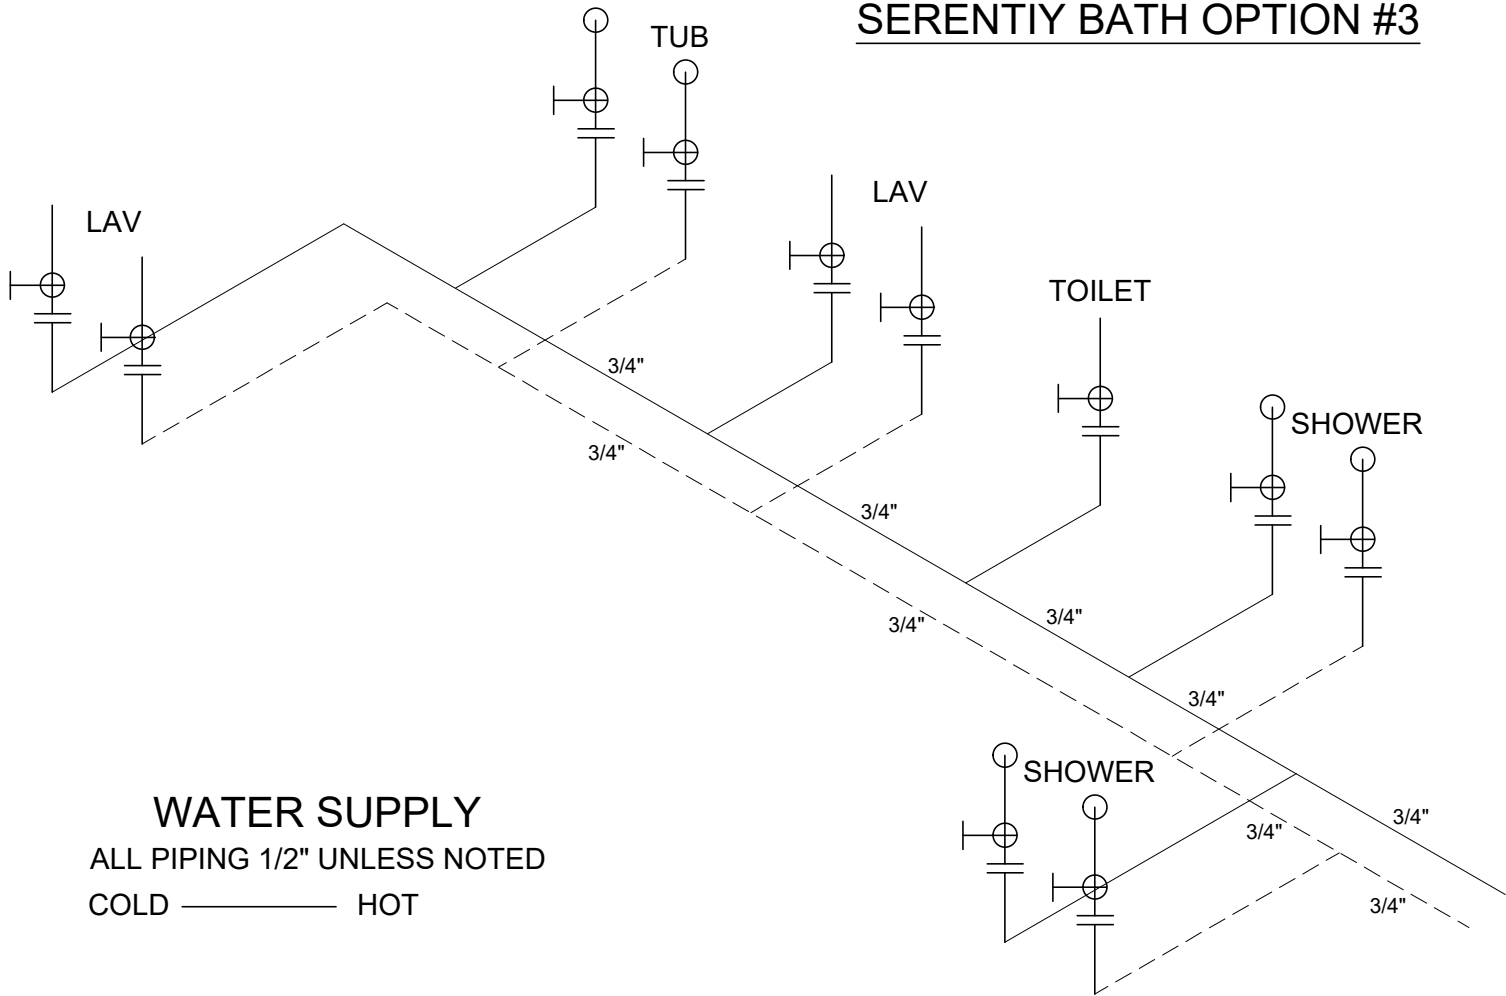

WATER SUPPLY
ALL PIPING 1/2" UNLESS NOTED
COLD ——— HOT

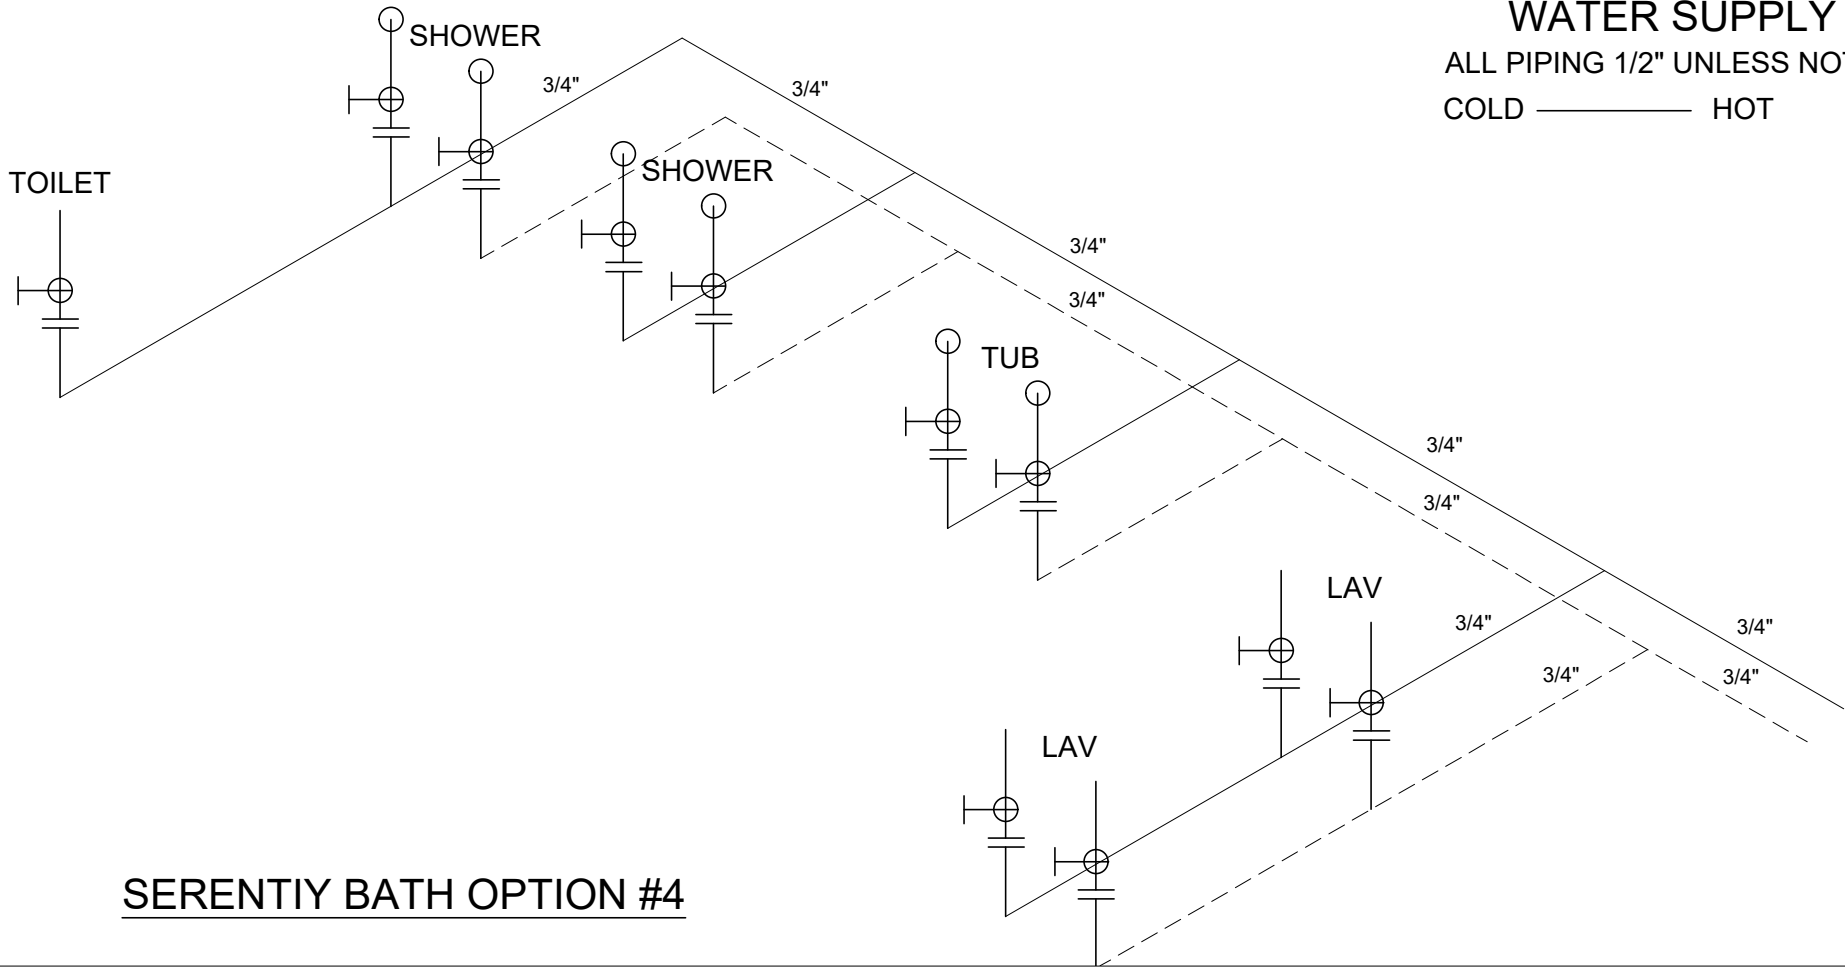

SERENTIY BATH OPTION #4


LEGEND

- * PIPE AND FITTING TO BE FIELD INSTALLED.
- | FIXTURE SHUT-OFF.
- ┐ TYPICAL WATER HAMMER.
- ⌵ FULL OPEN VALVE.
- PRESSURE BALANCE OR THERMOSTATIC VALVE, CAPABLE OF HIGH LIMIT TO 120 DEGREES. SHALL CONFORM TO ASSE 1070 FOR TUBS WITH NO SHOWER AND SHALL CONFORM TO ASSE 1016 FOR TUB/SHOWER COMBINATION

MODIFICATIONS

- * DESIGNATES FIELD WORK
SEE PAGE PB-2 FOR ADDITIONAL NOTES AND SCHEDULES.
1. PIPING IS PVC PER THE APPROVED JURISDICTION.
2. LONG TURN FITTINGS IN THE DRAINAGE SYSTEM AT ALL VERTICAL TO HORIZONTAL OR HORIZONTAL TO HORIZONTAL CONNECTIONS.
3. ALL TRAP ARMS CONNECTED TO VENTS THRU A SANITARY TEE.
4. ALL HORIZONTAL PIPING TO BE SUPPORTED AT 4' O.C.
5. ALL VENTS THRU ROOF SHALL BE 3" IN DIAMETER, 12" ABOVE AND 12" BELOW THE ROOF LINE.
- * 6. BELOW FLOOR PIPING AND FITTINGS TO BE SUPPLIED AND INSTALLED BY OTHERS ON-SITE.
- * 7. VENTS MAY BE CAPPED IN ATTIC AND NEED EXTENDED ON-SITE BY OTHERS.
- 8. IN CONCEALED LOCATIONS, WHERE PIPING IS INSTALLED THROUGH HOLES OR NOTCHES IN STUD, JOISTS, RAFTERS OR SIMILAR MEMBERS LESS THAN 1 1/2" FROM THE NEAREST EDGE OF THE MEMBER, THE PIPE SHALL BE PROTECTED BY SHIELD PLATES. PROTECTIVE SHIELD PLATES SHALL BE A MINIMUM OF 0.0575" THICK STEEL, SHALL COVER THE AREA OF THE PIPE WHERE THE MEMBER IS OR BORED AND SHALL EXTEND A MINIMUM OF 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.

WATER HEATER CONNECTION
TO DRAIN SYSTEM OR
TO EXTERIOR OF HOME AS
PER LOCAL CODES & INSTALLED
ON SITE BY OTHER

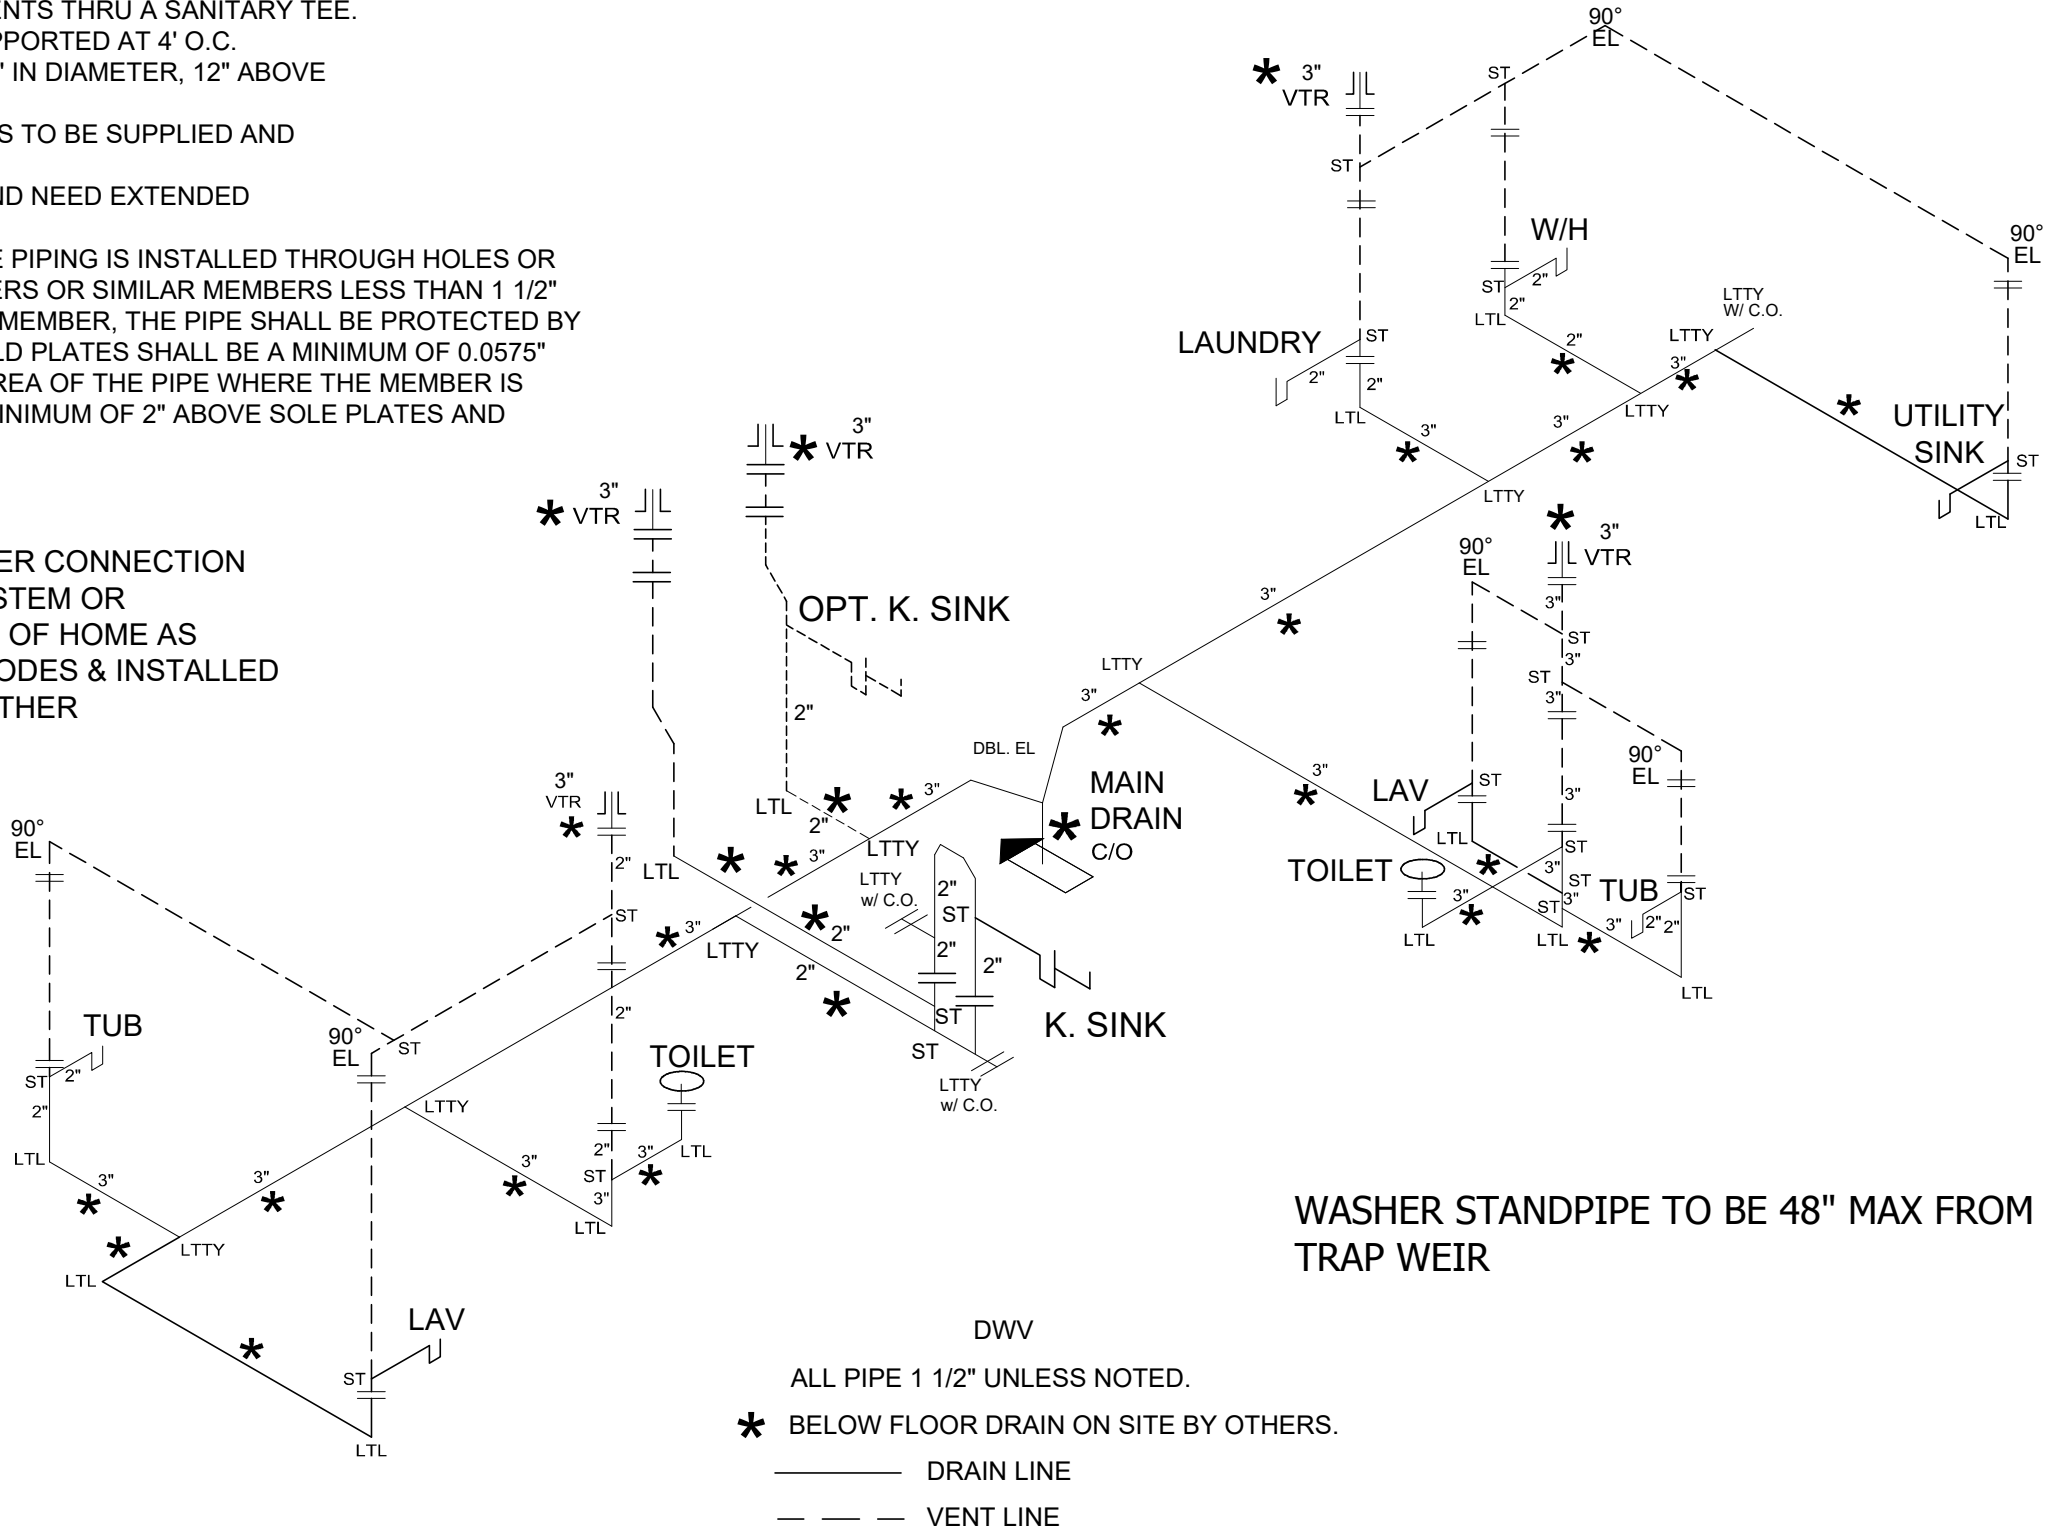

WATER HEATER CONNECTION
TO DRAIN SYSTEM OR
TO EXTERIOR OF HOME AS
PER LOCAL CODES & INSTALLED
ON SITE BY OTHER


DWV

ALL PIPE 1 1/2" UNLESS NOTED.


* BELOW FLOOR DRAIN ON SITE BY OTHERS.

———— DRAIN LINE
- - - - VENT LINE

MASTER BATH OPTION #2

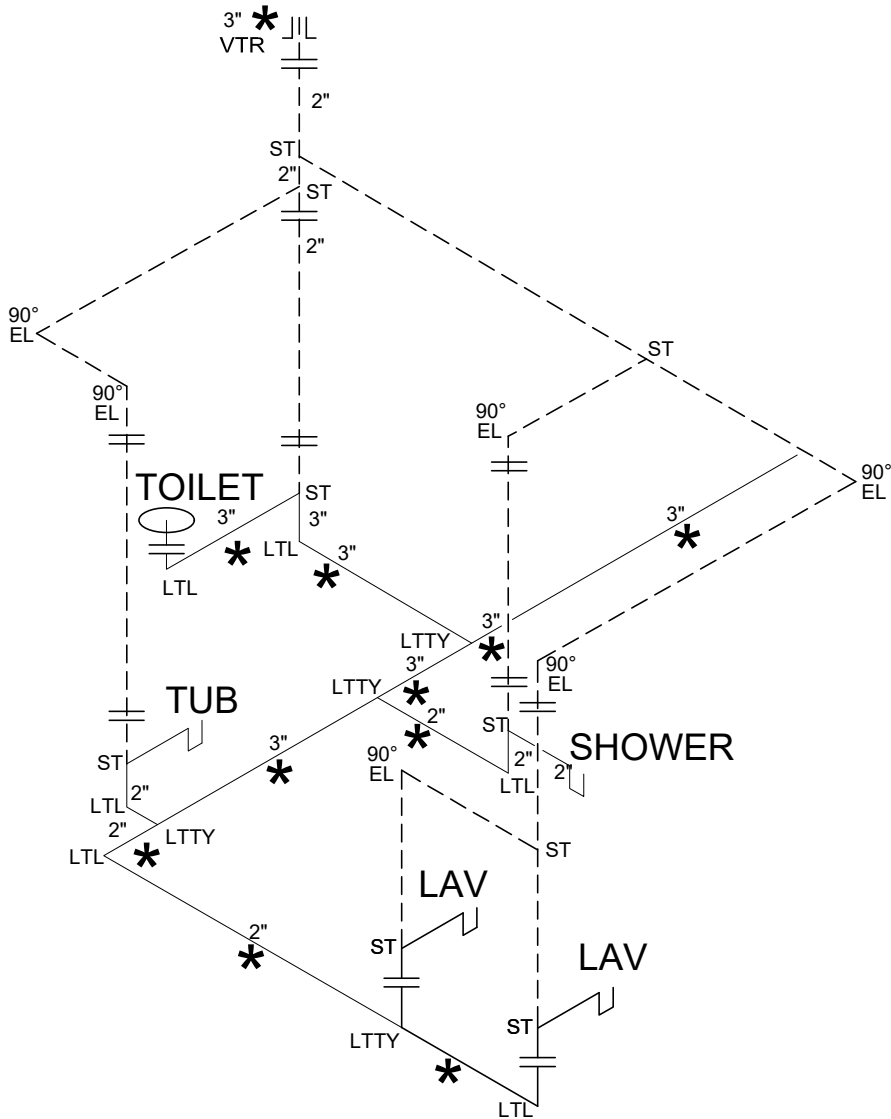

MASTER BATH OPTION #1

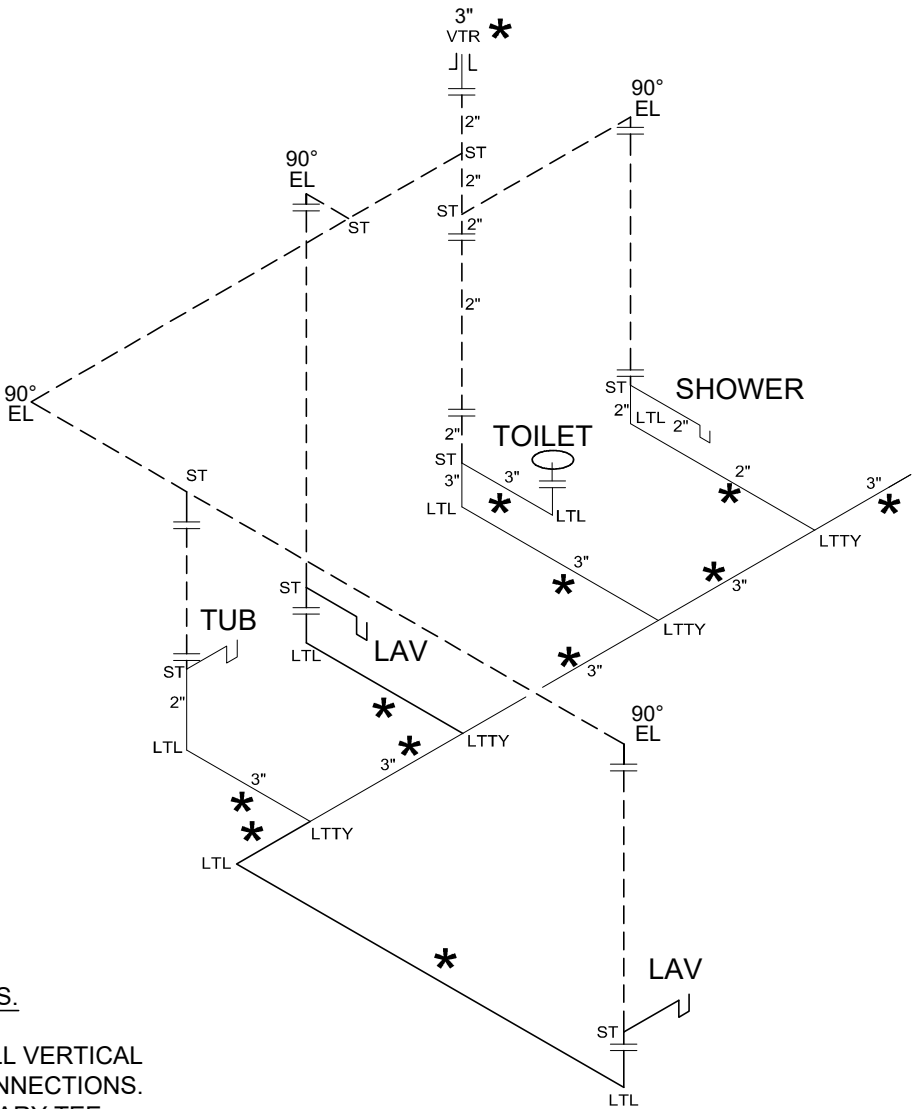

- * DESIGNATES FIELD WORK
SEE PAGE PB-2 FOR ADDITIONAL NOTES AND SCHEDULES.
- 1. PIPING IS PVC PER THE APPROVED JURISDICTION.
- 2. LONG TURN FITTINGS IN THE DRAINAGE SYSTEM AT ALL VERTICAL TO HORIZONTAL OR HORIZONTAL TO HORIZONTAL CONNECTIONS.
- 3. ALL TRAP ARMS CONNECTED TO VENTS THRU A SANITARY TEE.
- 4. ALL HORIZONTAL PIPING TO BE SUPPORTED AT 4' O.C.
- 5. ALL VENTS THRU ROOF SHALL BE 3" IN DIAMETER, 12" ABOVE AND 12" BELOW THE ROOF LINE.
- * 6. BELOW FLOOR PIPING AND FITTINGS TO BE SUPPLIED AND INSTALLED BY OTHERS ON-SITE.
- * 7. VENTS MAY BE CAPPED IN ATTIC AND NEED EXTENDED ON-SITE BY OTHERS.
- 8. IN CONCEALED LOCATIONS, WHERE PIPING IS INSTALLED THROUGH HOLES OR NOTCHES IN STUD, JOISTS, RAFTERS OR SIMILAR MEMBERS LESS THAN 1 1/2" FROM THE NEAREST EDGE OF THE MEMBER, THE PIPE SHALL BE PROTECTED BY SHIELD PLATES. PROTECTIVE SHIELD PLATES SHALL BE A MINIMUM OF 0.0575" THICK STEEL, SHALL COVER THE AREA OF THE PIPE WHERE THE MEMBER IS OR BORED AND SHALL EXTEND A MINIMUM OF 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.

MODIFICATIONS

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD
DATE: 05-15-24
SCALE: 3/16" = 1'-0"

TITLE:
PLUMBING PLAN
OPTIONS


FILENAME: 112APB-3276M42179
WAS 3280 201

SHEET:
PP-102


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

WATER HEATER CONNECTION
TO DRAIN SYSTEM OR
TO EXTERIOR OF HOME AS
PER LOCAL CODES & INSTALLED
ON SITE BY OTHER

DWV
ALL PIPE 1 1/2" UNLESS NOTED.
* BELOW FLOOR DRAIN ON SITE BY OTHERS.
————— DRAIN LINE
- - - - - VENT LINE

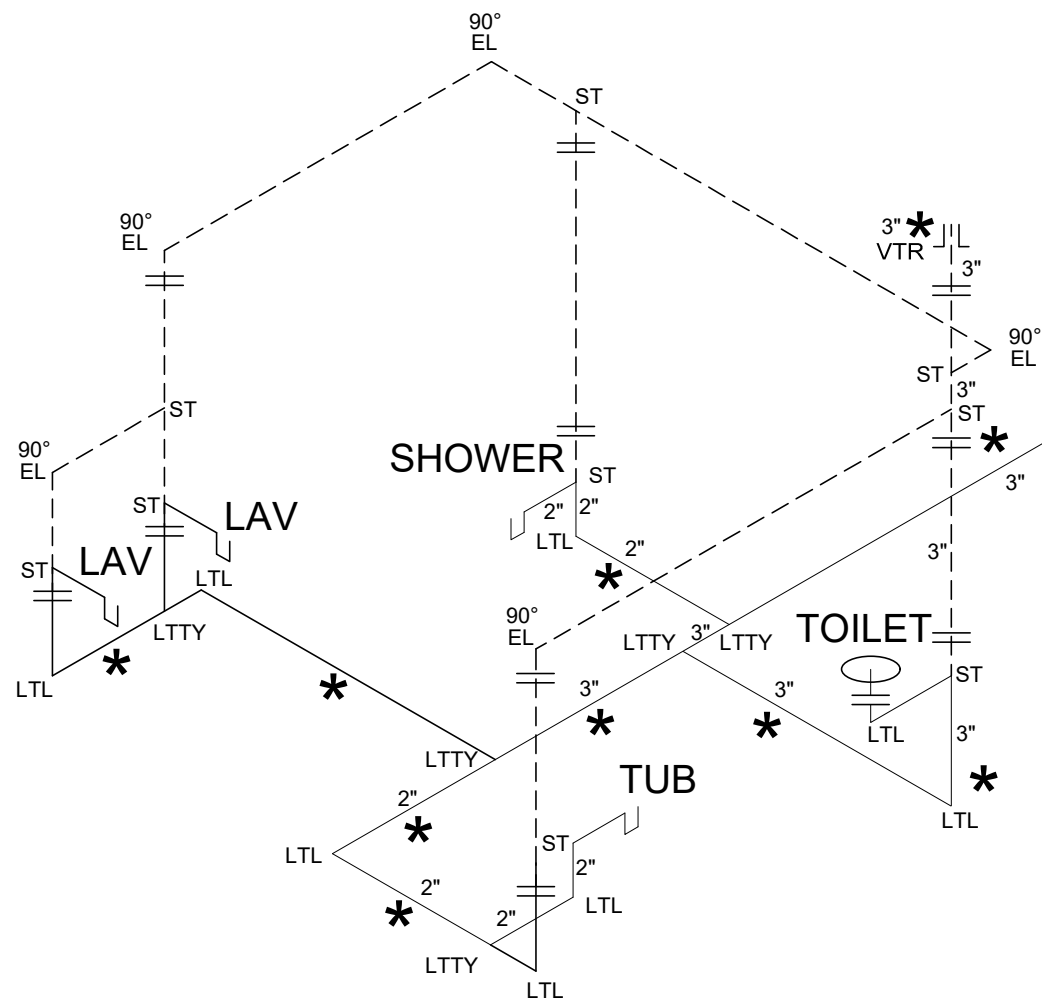

RADIANT SPA BATH OPTION

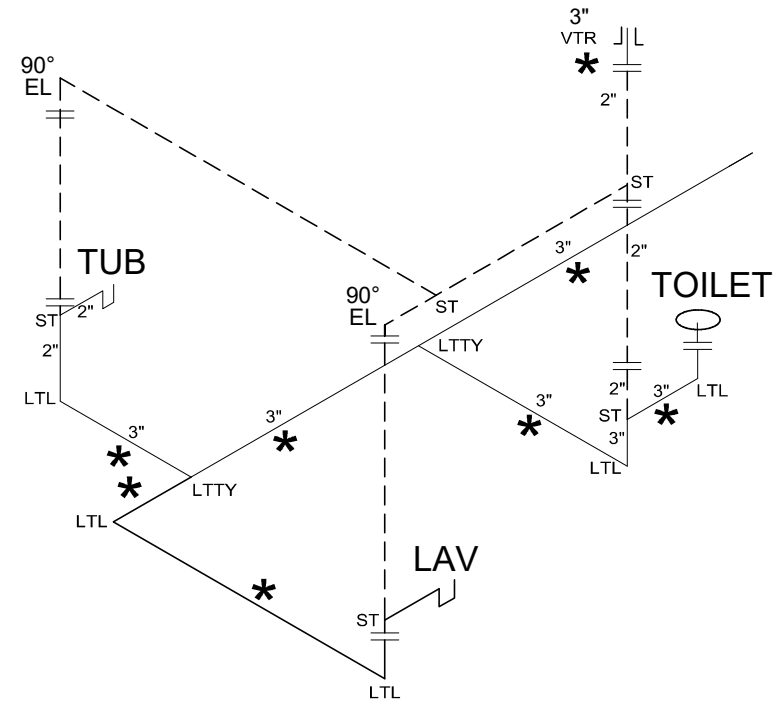

BATH 3 OPTION

- * DESIGNATES FIELD WORK
SEE PAGE PB-2 FOR ADDITIONAL NOTES AND SCHEDULES.
1. PIPING IS PVC PER THE APPROVED JURISDICTION.
2. LONG TURN FITTINGS IN THE DRAINAGE SYSTEM AT ALL VERTICAL TO HORIZONTAL OR HORIZONTAL TO HORIZONTAL CONNECTIONS.
3. ALL TRAP ARMS CONNECTED TO VENTS THRU A SANITARY TEE.
4. ALL HORIZONTAL PIPING TO BE SUPPORTED AT 4' O.C.
5. ALL VENTS THRU ROOF SHALL BE 3" IN DIAMETER, 12" ABOVE AND 12" BELOW THE ROOF LINE.
- * 6. BELOW FLOOR PIPING AND FITTINGS TO BE SUPPLIED AND INSTALLED BY OTHERS ON-SITE.
- * 7. VENTS MAY BE CAPPED IN ATTIC AND NEED EXTENDED ON-SITE BY OTHERS.
- 8. IN CONCEALED LOCATIONS, WHERE PIPING IS INSTALLED THROUGH HOLES OR NOTHCES IN STUD, JOISTS, RAFTERS OR SIMILAR MEMBERS LESS THAN 1 1/2" FROM THE NEAREST EDGE OF THE MEMBER, THE PIPE SHALL BE PROTECTED BY SHIELD PLATES. PROTECTIVE SHIELD PLATES SHALL BE A MINIMUM OF 0.0575" THICK STEEL, SHALL COVER THE AREA OF THE PIPE WHERE THE MEMBER IS OR BORED AND SHALL EXTEND A MINIMUM OF 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.

MODIFICATIONS

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD
DATE: 05-15-24
SCALE: 3/16" = 1'-0"

TITLE:
PLUMBING PLAN
OPTIONS

FILENAME: 112APB-3276M42179
WAS 3280 201

SHEET:
PP-103



PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

SERENTIY BATH OPTION #1

DWV
ALL PIPE 1 1/2" UNLESS NOTED.
* BELOW FLOOR DRAIN ON SITE BY OTHERS.
—— DRAIN LINE
- - - VENT LINE

WATER HEATER CONNECTION
TO DRAIN SYSTEM OR
TO EXTERIOR OF HOME AS
PER LOCAL CODES & INSTALLED
ON SITE BY OTHERS

- * DESIGNATES FIELD WORK
SEE PAGE PB-2 FOR ADDITIONAL NOTES AND SCHEDULES.
- 1. PIPING IS PVC PER THE APPROVED JURISDICTION.
- 2. LONG TURN FITTINGS IN THE DRAINAGE SYSTEM AT ALL VERTICAL TO HORIZONTAL OR HORIZONTAL TO HORIZONTAL CONNECTIONS.
- 3. ALL TRAP ARMS CONNECTED TO VENTS THRU A SANITARY TEE.
- 4. ALL HORIZONTAL PIPING TO BE SUPPORTED AT 4' O.C.
- 5. ALL VENTS THRU ROOF SHALL BE 3" IN DIAMETER, 12" ABOVE AND 12" BELOW THE ROOF LINE.
- * 6. BELOW FLOOR PIPING AND FITTINGS TO BE SUPPLIED AND INSTALLED BY OTHERS ON-SITE.
- * 7. VENTS MAY BE CAPPED IN ATTIC AND NEED EXTENDED ON-SITE BY OTHERS.
- 8. IN CONCEALED LOCATIONS, WHERE PIPING IS INSTALLED THROUGH HOLES OR NOTHCES IN STUD, JOISTS, RAFTERS OR SIMILAR MEMBERS LESS THAN 1 1/2" FROM THE NEAREST EDGE OF THE MEMBER, THE PIPE SHALL BE PROTECTED BY SHIELD PLATES. PROTECTIVE SHIELD PLATES SHALL BE A MINIMUM OF 0.0575" THICK STEEL, SHALL COVER THE AREA OF THE PIPE WHERE THE MEMBER IS OR BORED AND SHALL EXTEND A MINIMUM OF 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.

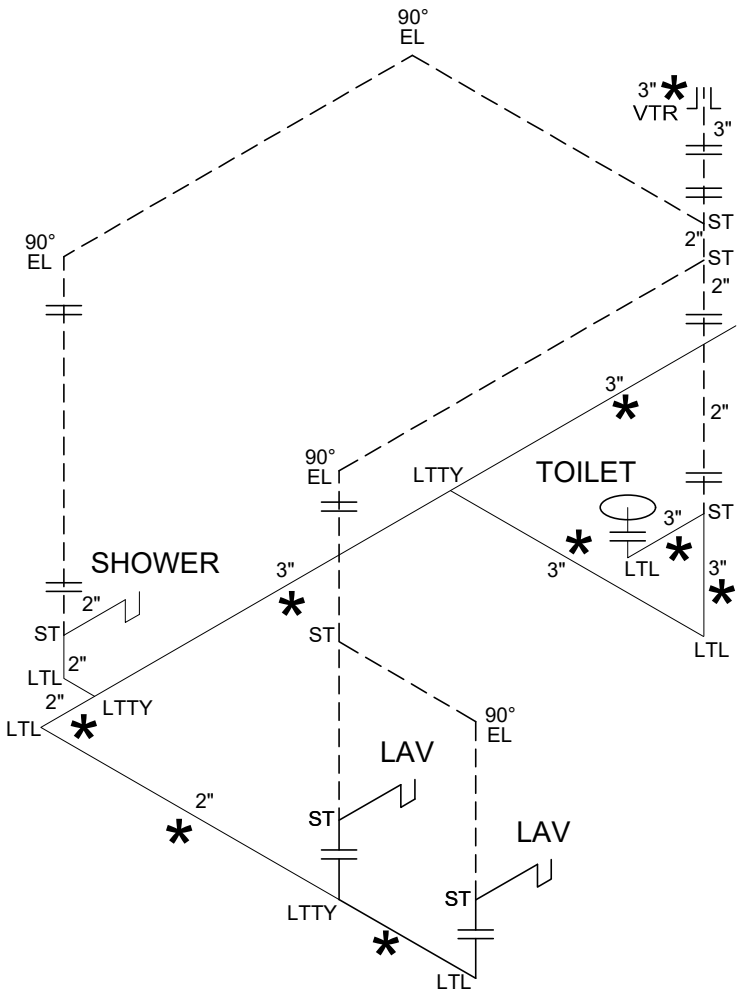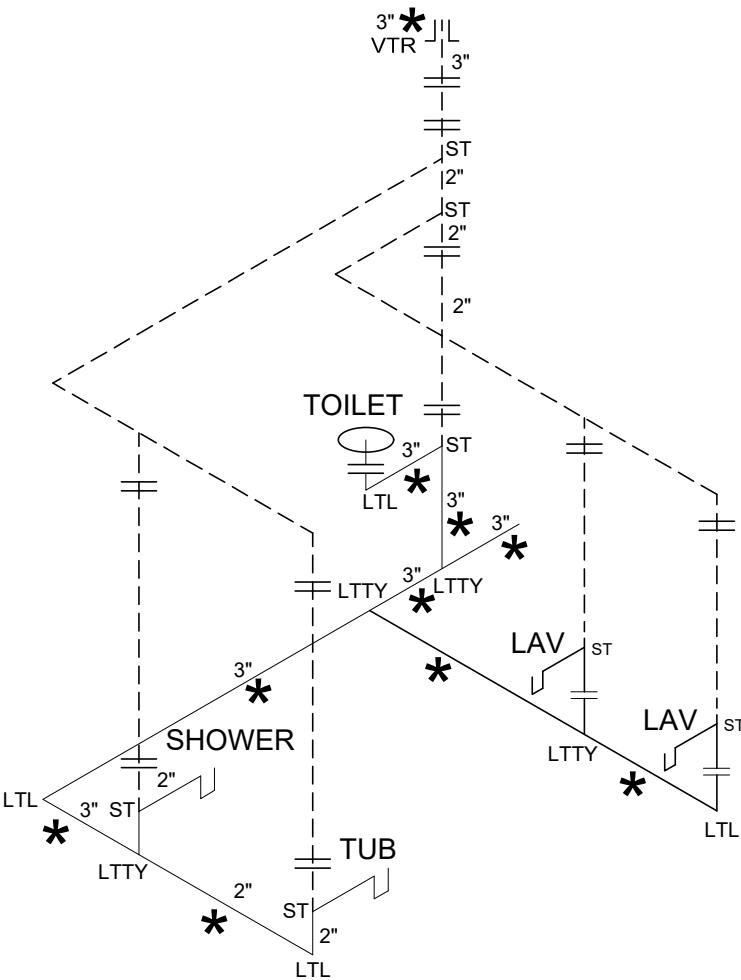

SERENTIY BATH OPTION #2

MODIFICATIONS

CHAMPION
MANUFACTURED BEAUTIFULLY™
308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT
DRAWN BY: A.GOULD
DATE: 05-15-24
SCALE: 3/16" = 1'-0"

TITLE:
PLUMBING PLAN
OPTIONS
FILENAME: 112APB-3276M42179
WAS 3280 201

SHEET:
PP-104

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

SERENTIY BATH OPTION #3

DWV

ALL PIPE 1 1/2" UNLESS NOTED.



* BELOW FLOOR DRAIN ON SITE BY OTHERS.

———— DRAIN LINE

- - - - VENT LINE

WATER HEATER CONNECTION
TO DRAIN SYSTEM OR
TO EXTERIOR OF HOME AS
PER LOCAL CODES & INSTALLED
ON SITE BY OTHERS

- * DESIGNATES FIELD WORK
SEE PAGE PB-2 FOR ADDITIONAL NOTES AND SCHEDULES.
- 1. PIPING IS PVC PER THE APPROVED JURISDICTION.
 - 2. LONG TURN FITTINGS IN THE DRAINAGE SYSTEM AT ALL VERTICAL TO HORIZONTAL OR HORIZONTAL TO HORIZONTAL CONNECTIONS.
 - 3. ALL TRAP ARMS CONNECTED TO VENTS THRU A SANITARY TEE.
 - 4. ALL HORIZONTAL PIPING TO BE SUPPORTED AT 4' O.C.
 - 5. ALL VENTS THRU ROOF SHALL BE 3" IN DIAMETER, 12" ABOVE AND 12" BELOW THE ROOF LINE.
 - * 6. BELOW FLOOR PIPING AND FITTINGS TO BE SUPPLIED AND INSTALLED BY OTHERS ON-SITE.
 - * 7. VENTS MAY BE CAPPED IN ATTIC AND NEED EXTENDED ON-SITE BY OTHERS.
 - 8. IN CONCEALED LOCATIONS, WHERE PIPING IS INSTALLED THROUGH HOLES OR NOTCHES IN STUD, JOISTS, RAFTERS OR SIMILAR MEMBERS LESS THAN 1 1/2" FROM THE NEAREST EDGE OF THE MEMBER, THE PIPE SHALL BE PROTECTED BY SHIELD PLATES. PROTECTIVE SHIELD PLATES SHALL BE A MINIMUM OF 0.0575" THICK STEEL, SHALL COVER THE AREA OF THE PIPE WHERE THE MEMBER IS OR BORED AND SHALL EXTEND A MINIMUM OF 2" ABOVE SOLE PLATES AND BELOW TOP PLATES.

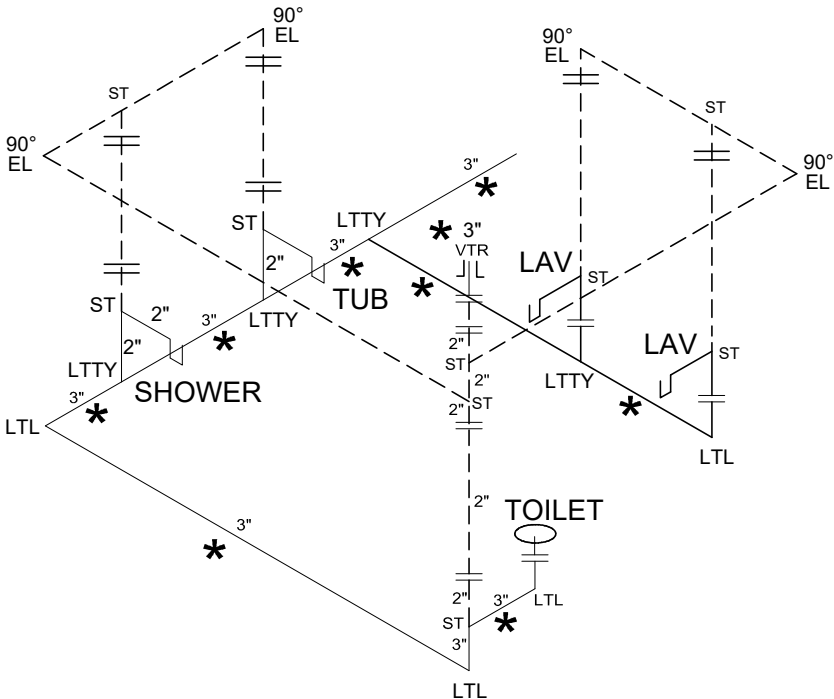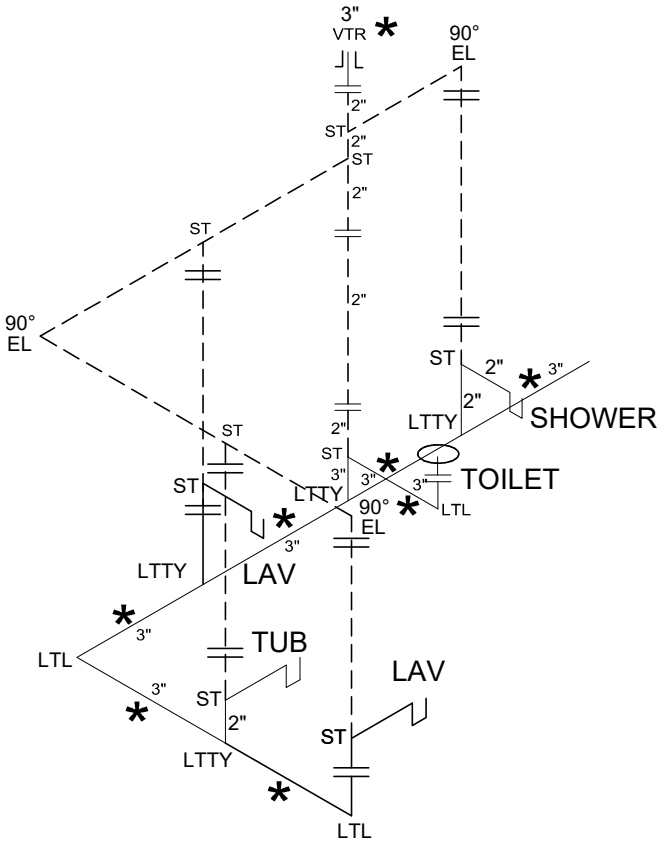

SERENTIY BATH OPTION #4

MODIFICATIONS

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:
PLUMBING PLAN
OPTIONS

FILENAME: 112APB-3276M42179

WAS 3280 201

SHEET:
PP-105


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

- GENERAL NOTES:
1. VINYL SHUTTERS SHOWN ARE STANDARD FRONT SIDE ONLY.
2. ALL WINDOWS SINGLE HUNG INSULATED LOW E.
3. SIDING IS VINYL LAP FACTORY APPLIED OVER 3/8" MIN OSB SHEATHING AND POLYETHYLENE FABRIC HOMEWRAP SHEATHING PAPER (PRIMEWRAP OR EQUAL) INSTALLED TO THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. (SIDING FOR ENDS IS SHIPPED LOOSE FOR FIELD INSTALLATION BY OTHERS.)
4. PERIMETER ROOF OVERHANG IS PERFORATED METAL OR VINYL SOFFIT WITH VENTILATION TO THE ATTIC SPACE.
5. SOME STANDARD AND OPTIONAL FEATURES ARE SHOWN.
6. ALL GUTTERS, DOWN SPOUTS, STEPS AND HANDRAILS BY OWNER.
7. FOUNDATION WINDOWS AND/OR VENTS NOT SHOWN.
8. THIS HOME HAS ATTIC VENTILATION OF NOT LESS THAN 1/150th OF THE ATTIC AREA.


✱ DESIGNATES FIELD WORK

SEAL TAB SHINGLES

12
5 7/12 OPT.

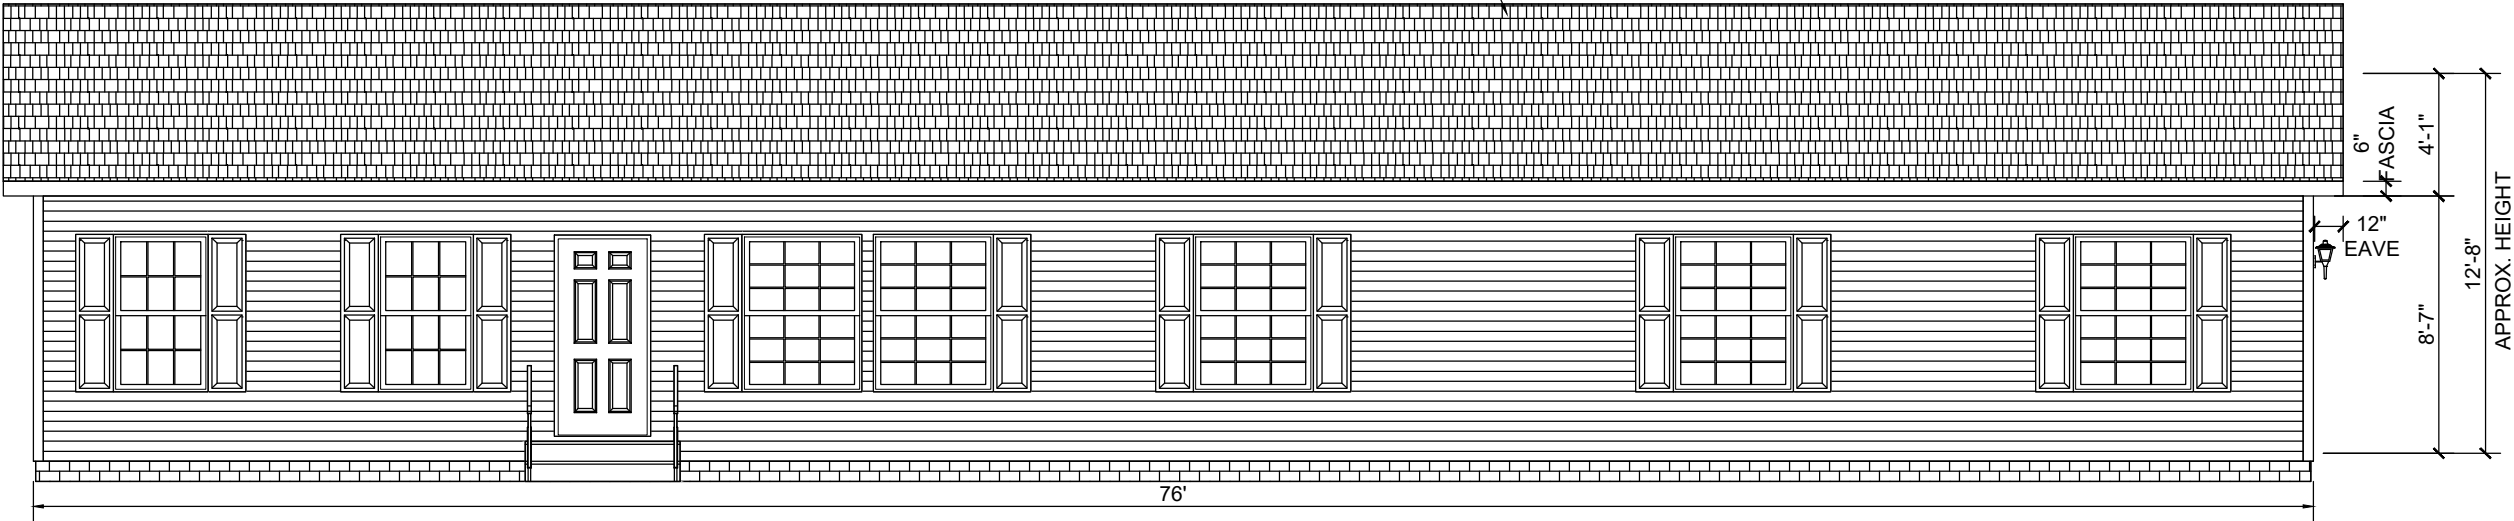

FRONT ELEVATION

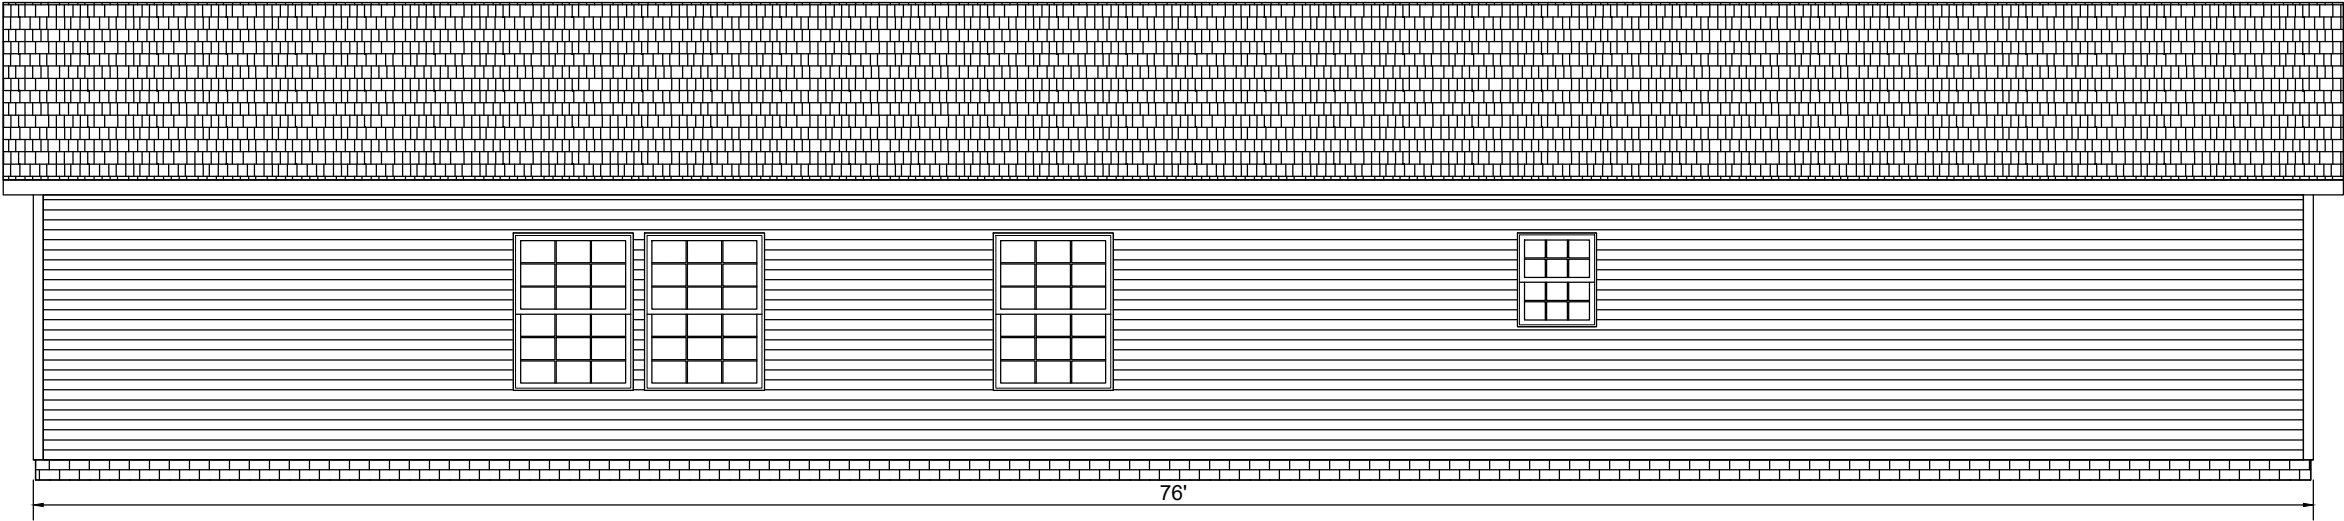

REAR ELEVATION

CHAMPION MANUFACTURED BEAUTIFULLY™ 308 SHERIDAN DRIVE TOPEKA, IN 46571		MODIFICATIONS	PROJECT: 112APB-3276M42179 76'-0" x 30'-0" 4 BD 2 BT	TITLE: ELEVATIONS	SHEET: EV-101
			DRAWN BY: A.GOULD DATE: 05-15-24 SCALE: 5/32" = 1'-0"	FILENAME: 112APB-3276M42179 WAS 3280 201	PROPRIETARY AND CONFIDENTIAL THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL. PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION. COPYRIGHT © 1976-2024 BY CHAMPION

- GENERAL NOTES:
1. VINYL SHUTTERS SHOWN ARE STANDARD FRONT SIDE ONLY.

2. ALL WINDOWS SINGLE HUNG INSULATED LOW E.

3. SIDING IS VINYL LAP FACTORY APPLIED OVER 3/8" MIN OSB SHEATHING AND POLYETHYLENE FABRIC HOMEWRAP SHEATHING PAPER (PRIMEWRAP OR EQUAL) INSTALLED TO THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. (SIDING FOR ENDS IS SHIPPED LOOSE FOR FIELD INSTALLATION BY OTHERS.)


4. PERIMETER ROOF OVERHANG IS PERFORATED METAL OR VINYL SOFFIT WITH VENTILATION TO THE ATTIC SPACE.

5. SOME STANDARD AND OPTIONAL FEATURES ARE SHOWN.


6. ALL GUTTERS, DOWN SPOUTS, STEPS AND HANDRAILS BY OWNER.

7. FOUNDATION WINDOWS AND/OR VENTS NOT SHOWN.

8. THIS HOME HAS ATTIC VENTILATION OF NOT LESS THAN 1/150th OF THE ATTIC AREA.

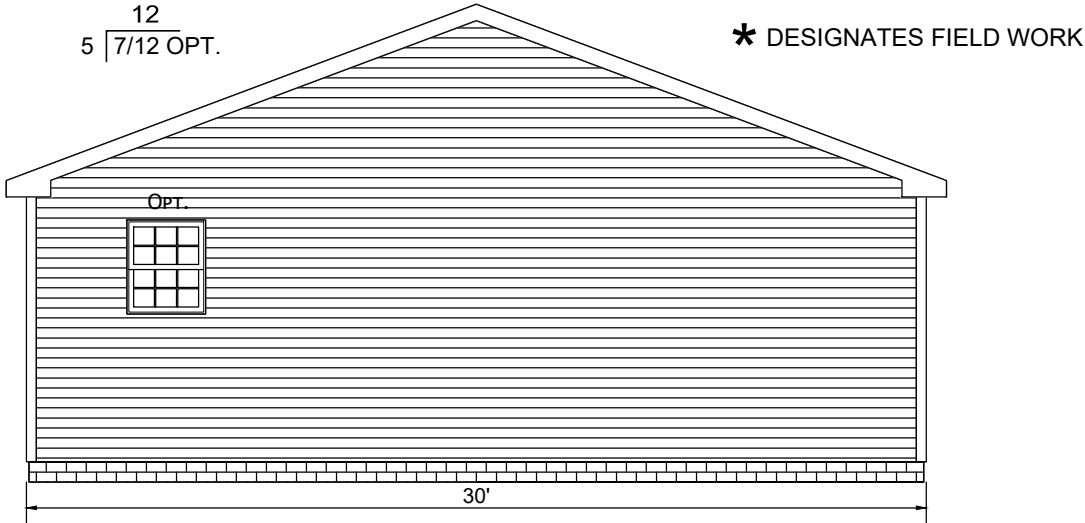

LEFT ELEVATION

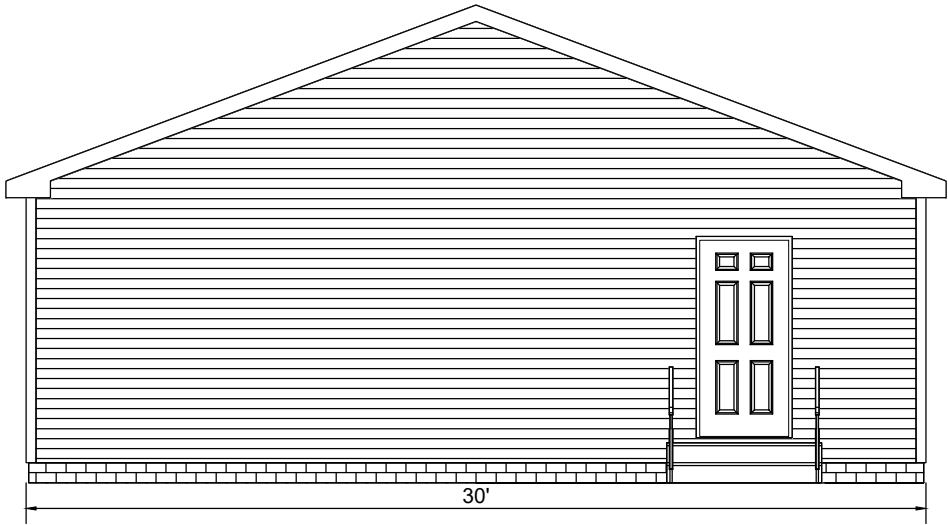

RIGHT ELEVATION

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

TITLE:
ELEVATIONS

SHEET:
EV-102

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

DRAWN BY: A.GOULD


DATE: 05-15-24

SCALE: 5/32" = 1'-0"

FILENAME: 112APB-3276M42179

WAS 3280 201

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

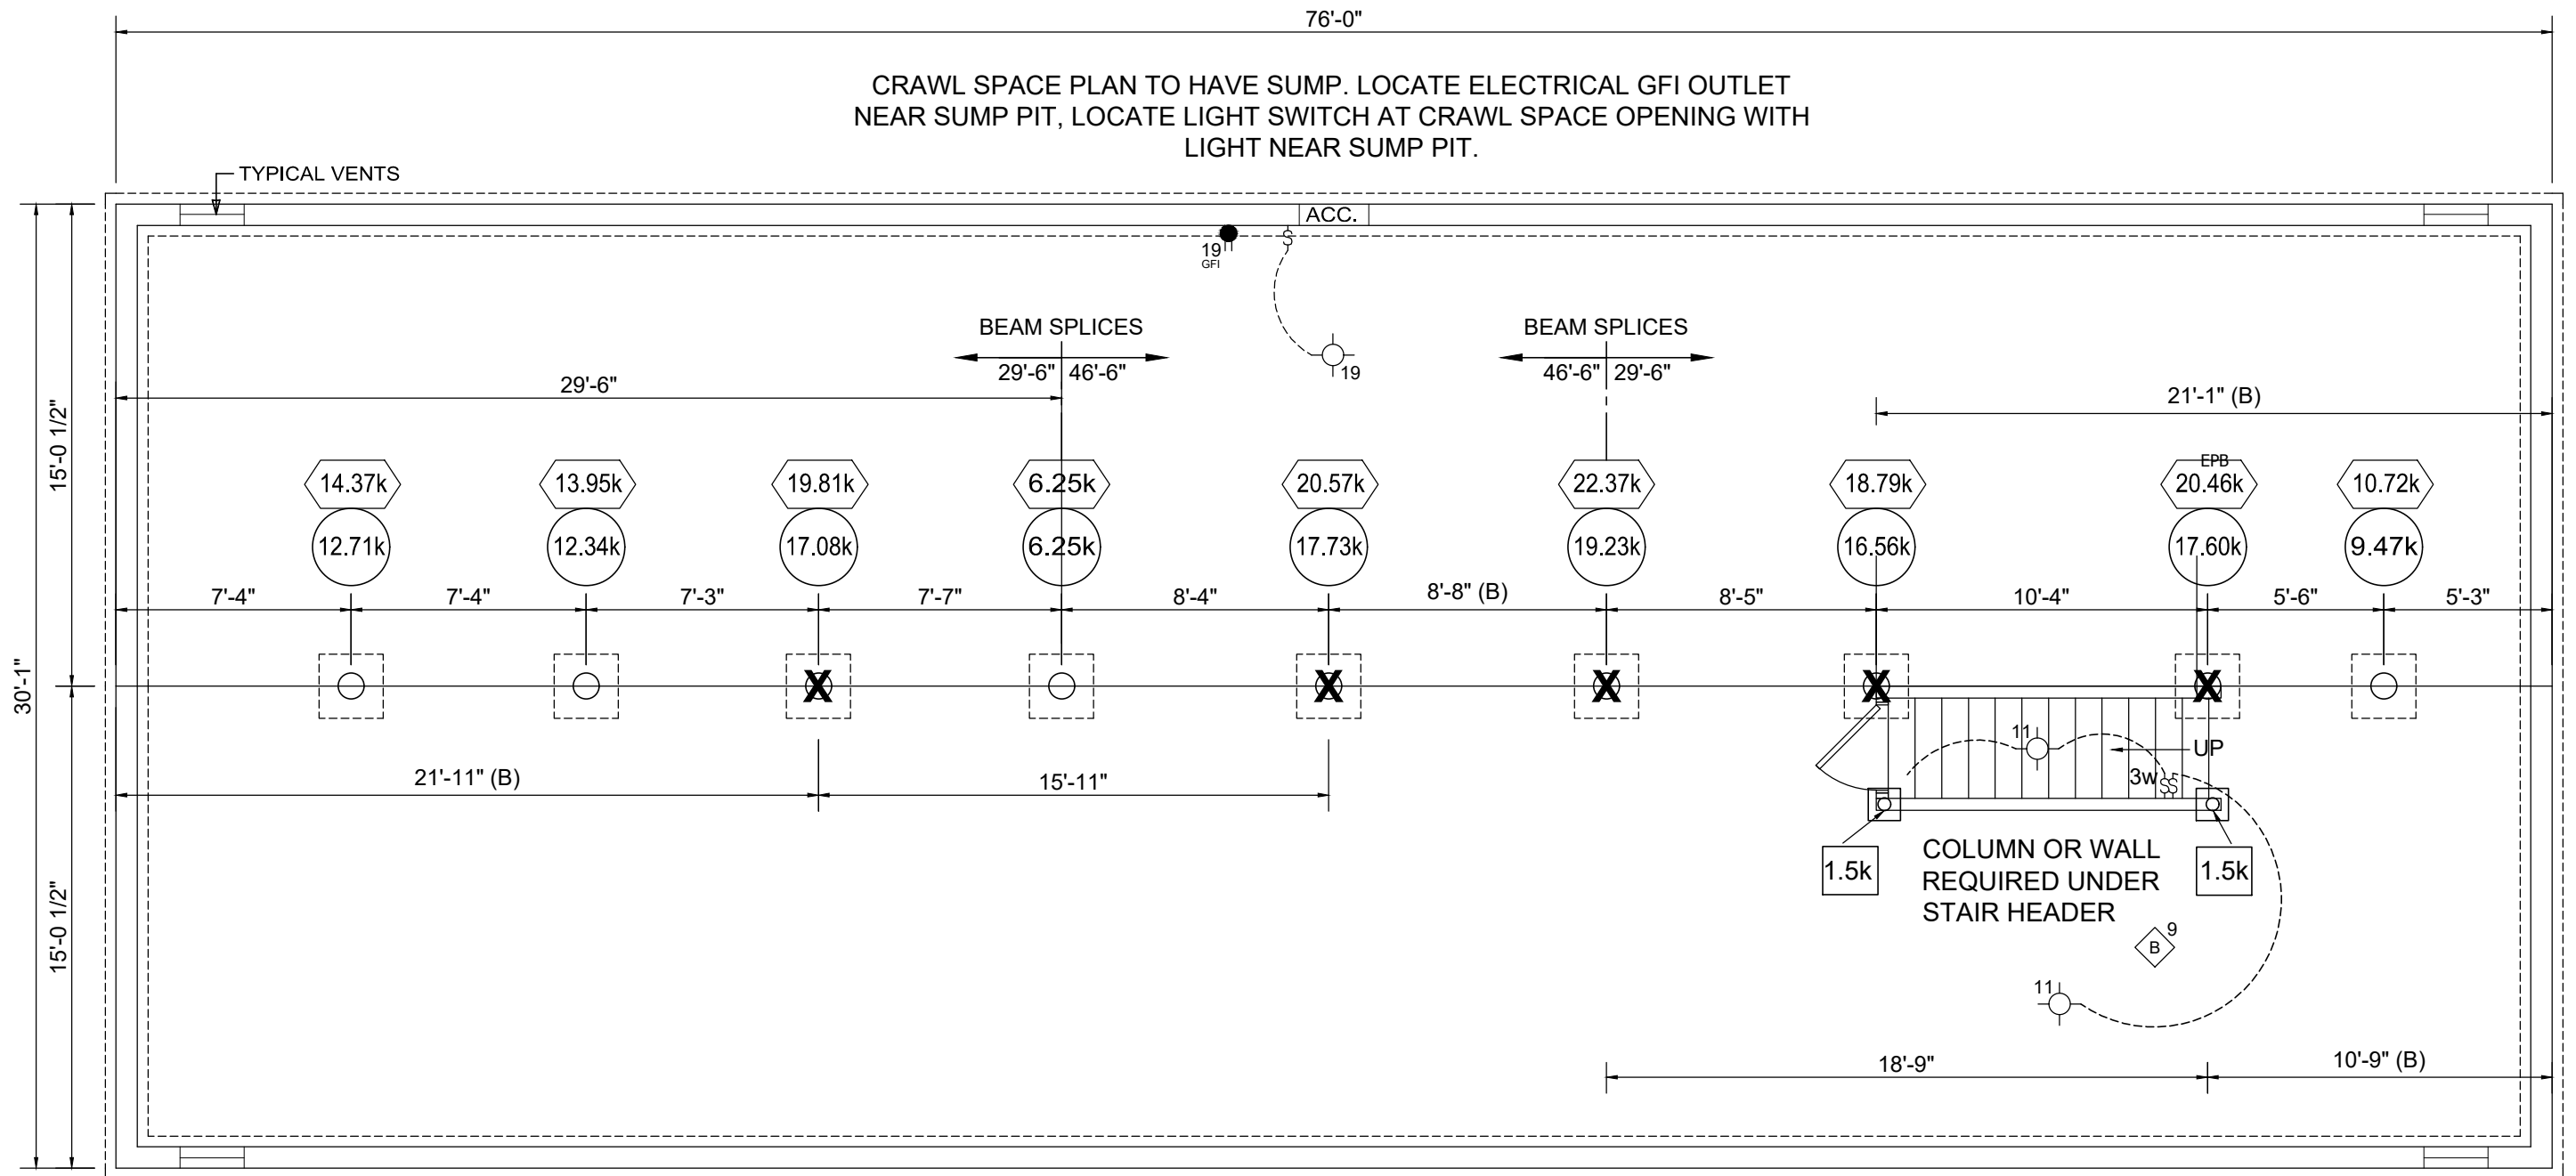

NOTES:


1. Splices in mating line girders shall be supported by column posts or I-beam.
2. Dealer/installer may use I-beam under mate wall to increase jack post spacing. Consult a local Professional Engineer.
3. Crawl space access minimum size to be 18" x 24" with removable cover.
4. Crawl space ventilation to equal 1/150th of the total area.
5. Continuous foundation support required at interior braced wall lines at intervals not exceeding 50 feet when located in Seismic Design Category D2.
6. For additional general electrical notes see page EL-1.0.
7. For additional general foundation notes see page G-4.0.

* All basements and every sleeping room shall have at least one operable emergency rescue or exterior door opening for emergency escape and rescue. A window shall have a sill height not more than 44 inches above the floor.
This is on-site work and not the responsibility of the manufacturer.

k = 70 PSF

k = 50 PSF

TYPICAL
ROOF LOADS

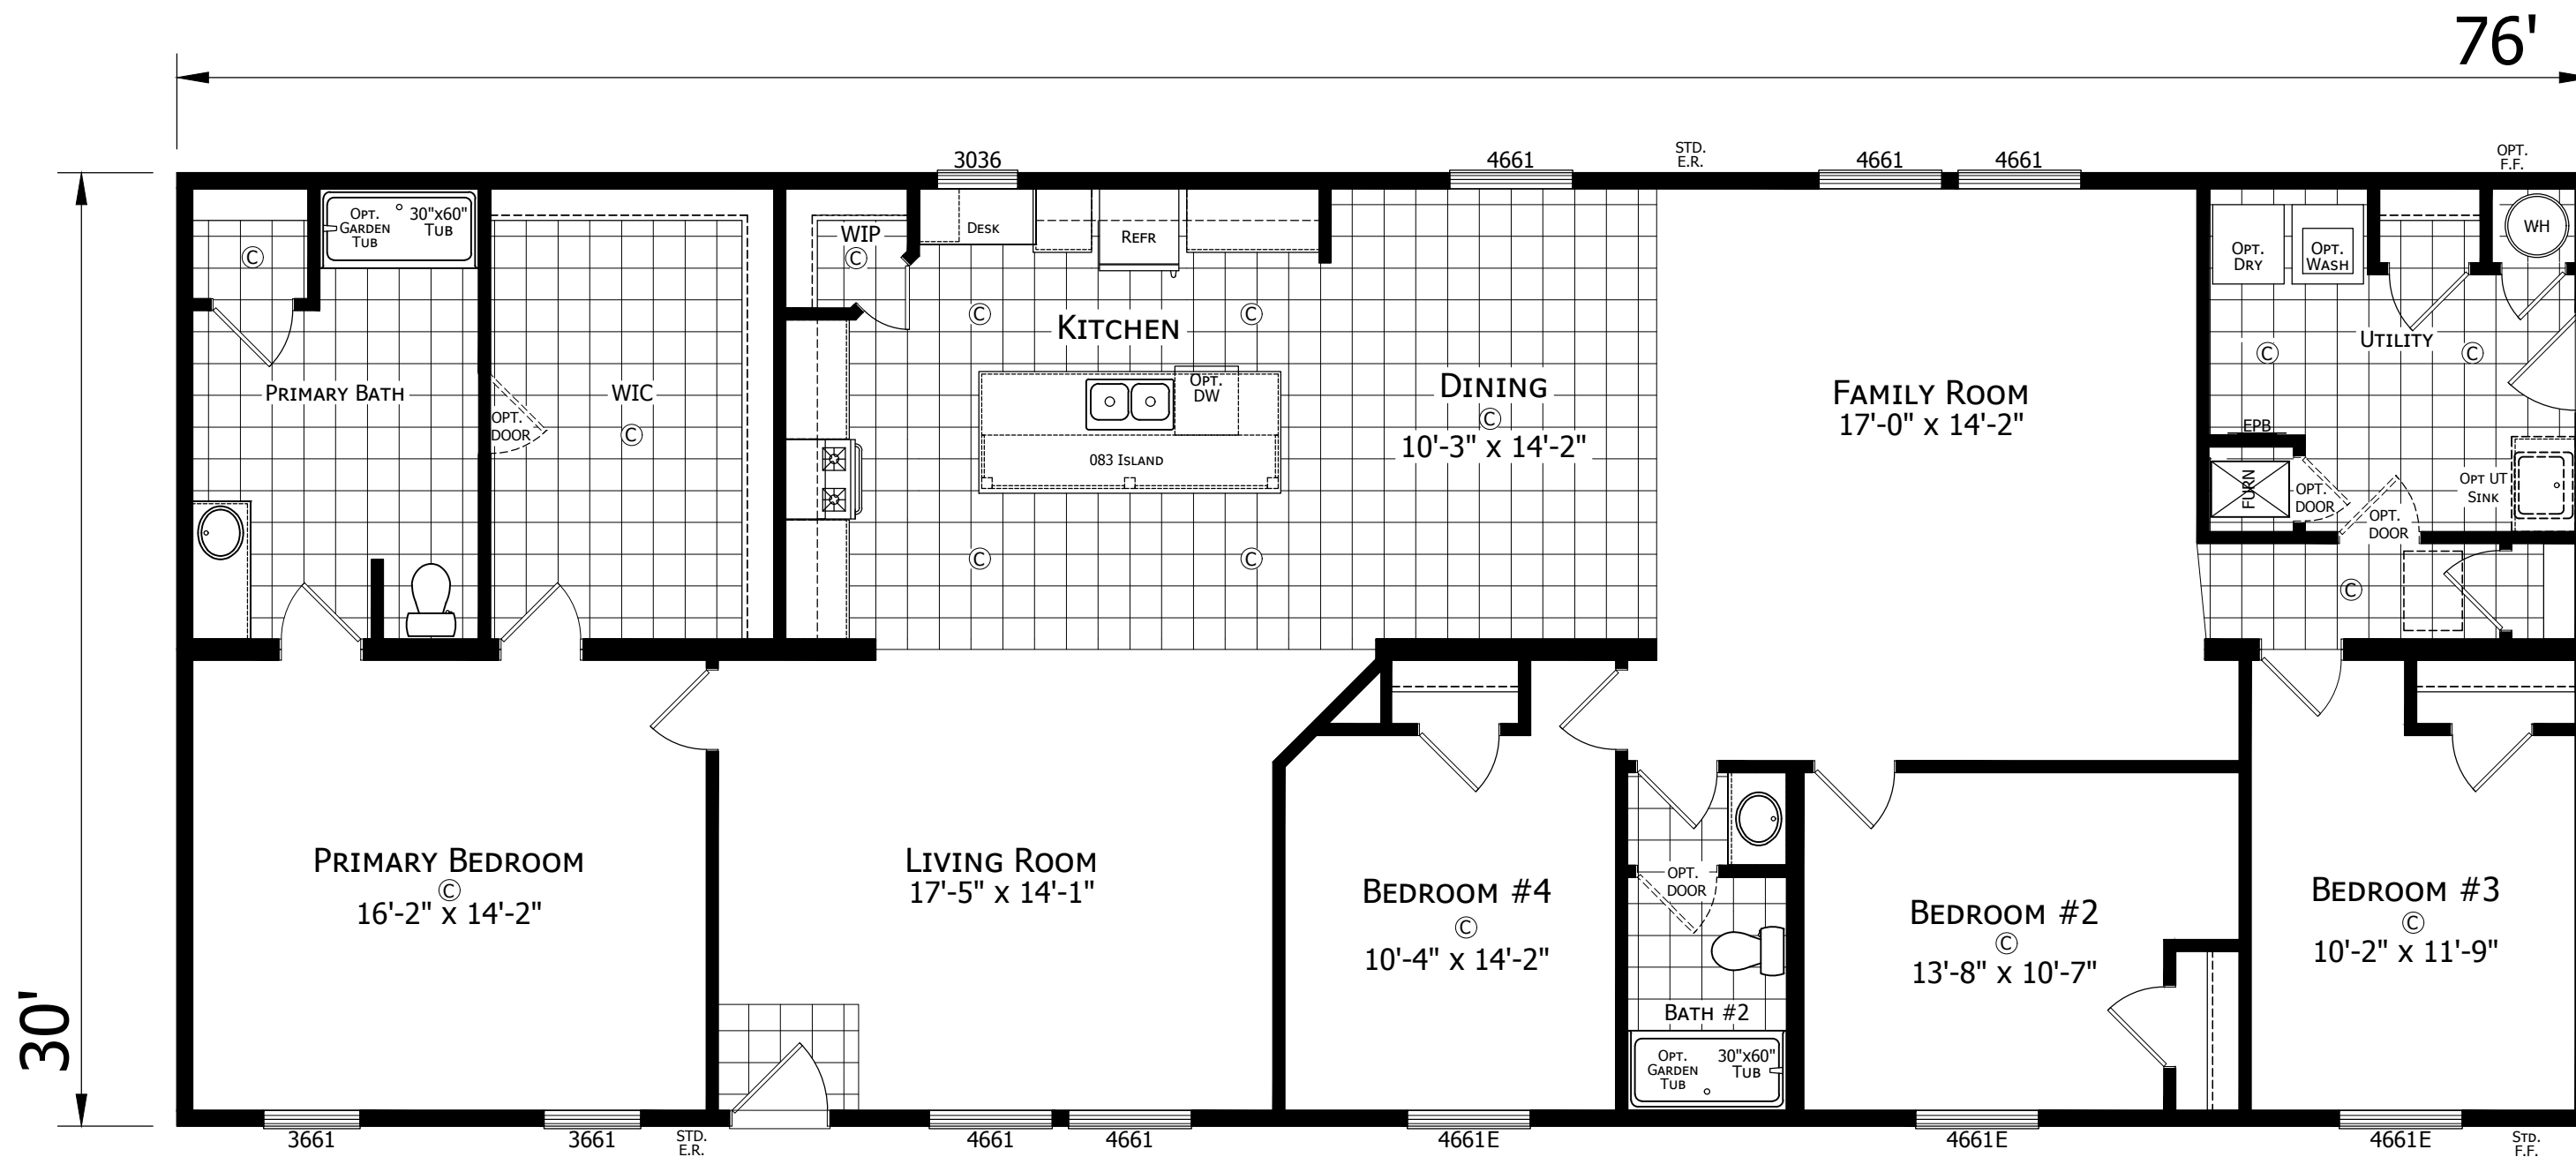

112APB-3276M42179
4 BEDROOM 2 BATH
912 x 360
2280 Sq. Ft. TOTAL

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"


TITLE:
LITERATURE
PLAN

FILENAME: 112APB-3276M42179


WAS 3280 201

SHEET:
L-101


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

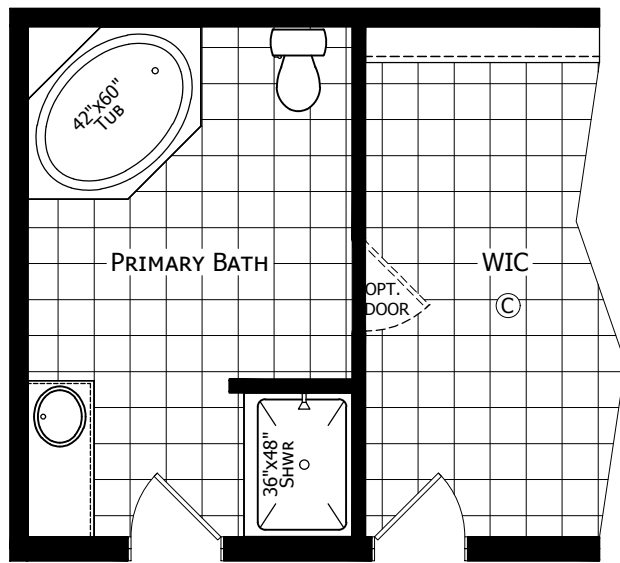


OPTIONAL PRIMARY BATH #1

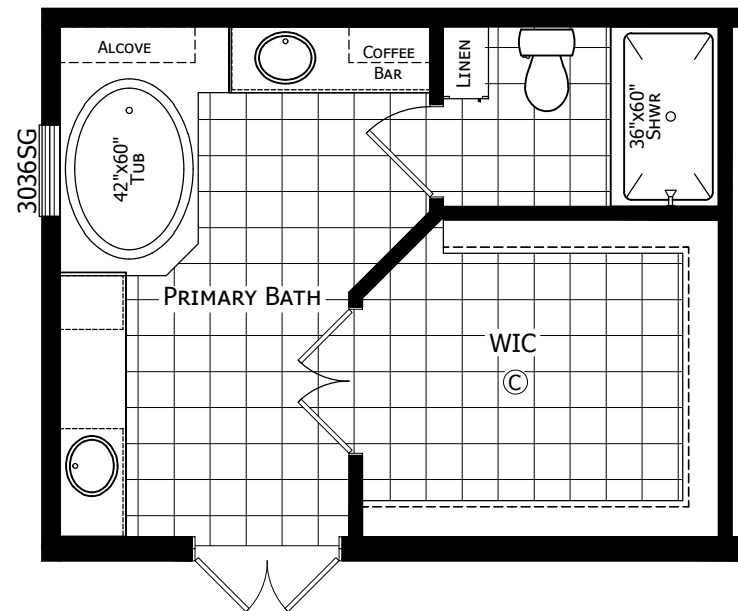


OPTIONAL PRIMARY BATH #2

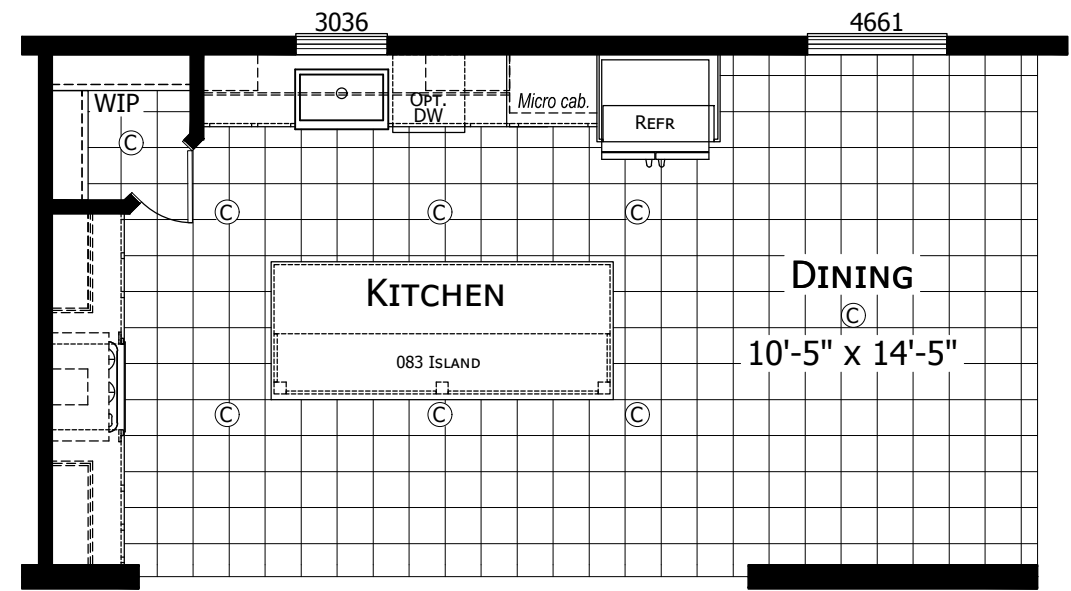


OPTIONAL ULTIMATE KITCHEN 2

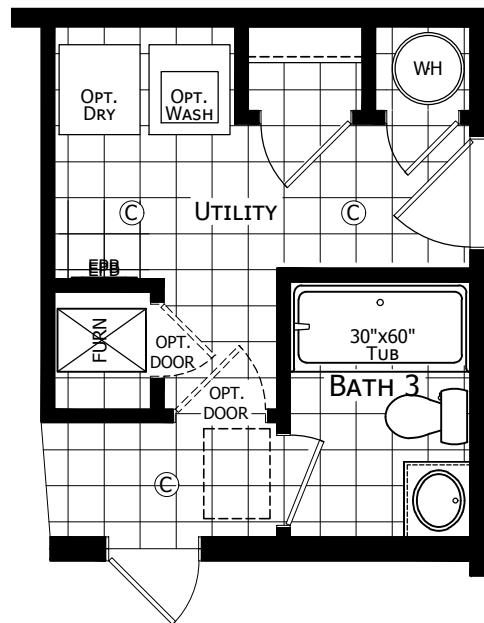

OPTIONAL BATH #3

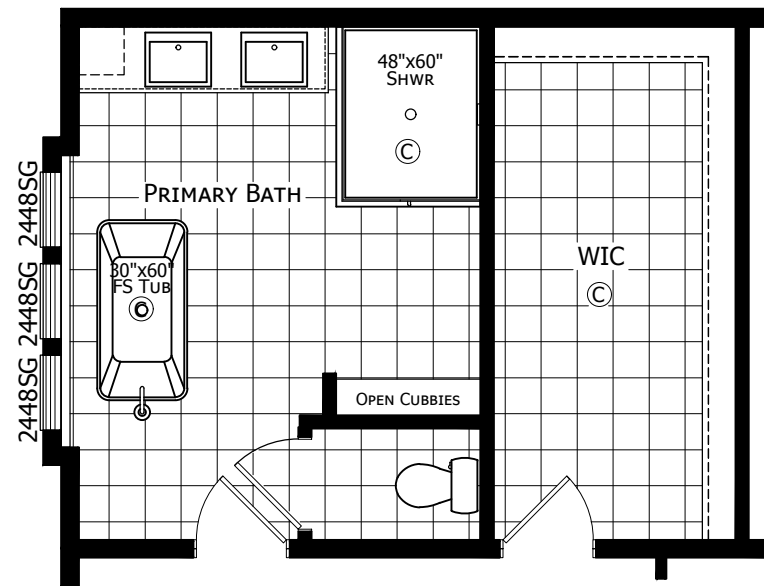

OPTIONAL RADIANT SPA BATH

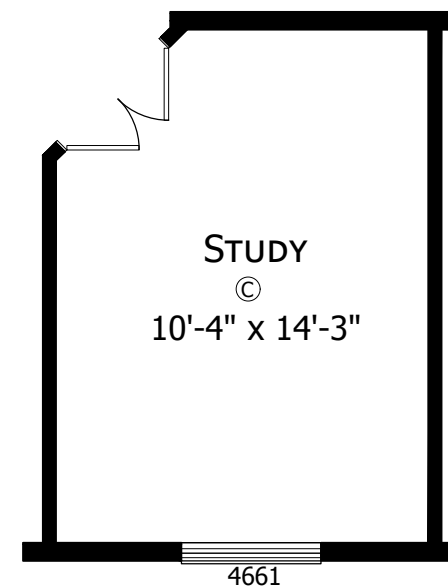

OPTIONAL STUDY

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"


TITLE:
**LITERATURE
PLAN OPTIONS**

FILENAME: 112APB-3276M42179


WAS 3280 201

SHEET:
L-102


PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL,
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION

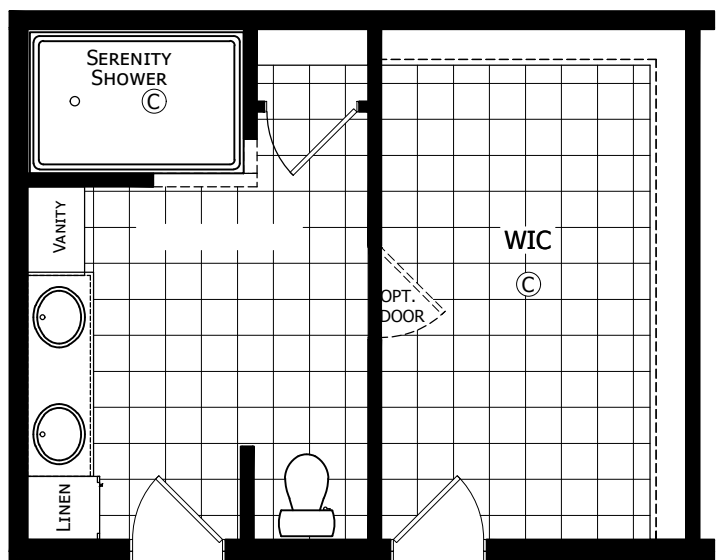


OPTIONAL SERENITY BATH #1

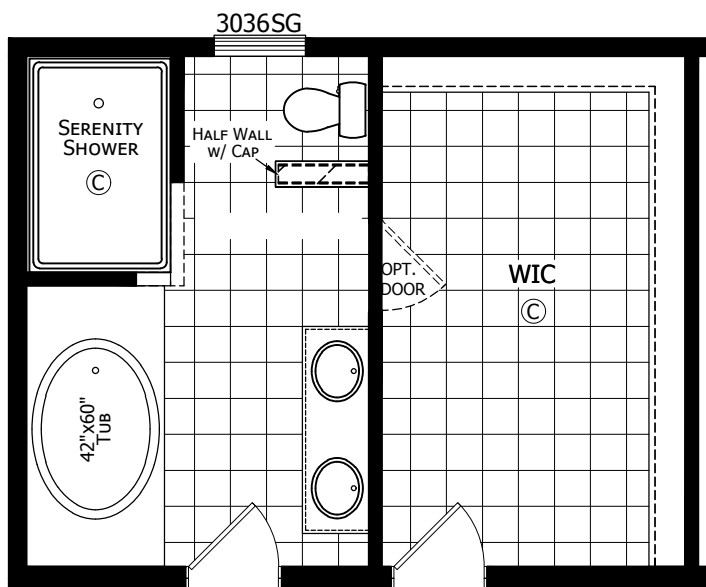


OPTIONAL SERENITY BATH #2

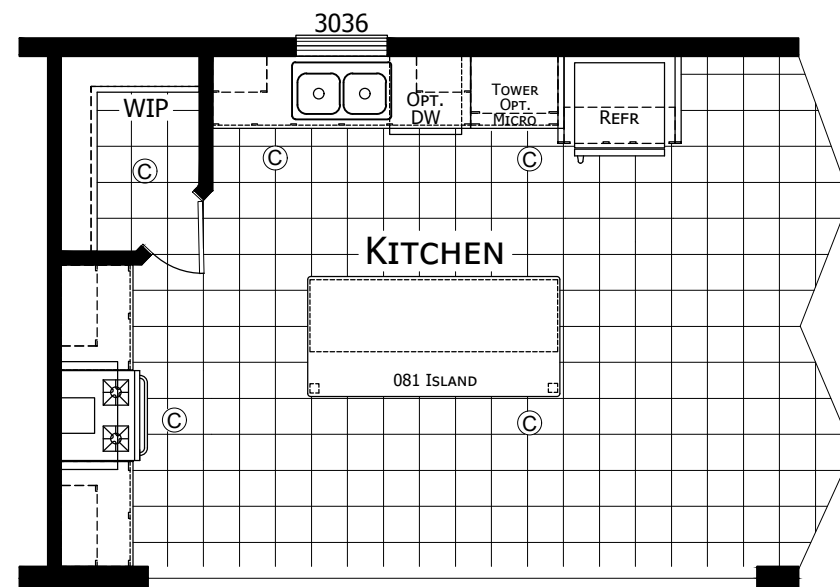


OPTIONAL SUMMIT KITCHEN
AVAILABLE W/ OPT. STONE COUNTERTOPS

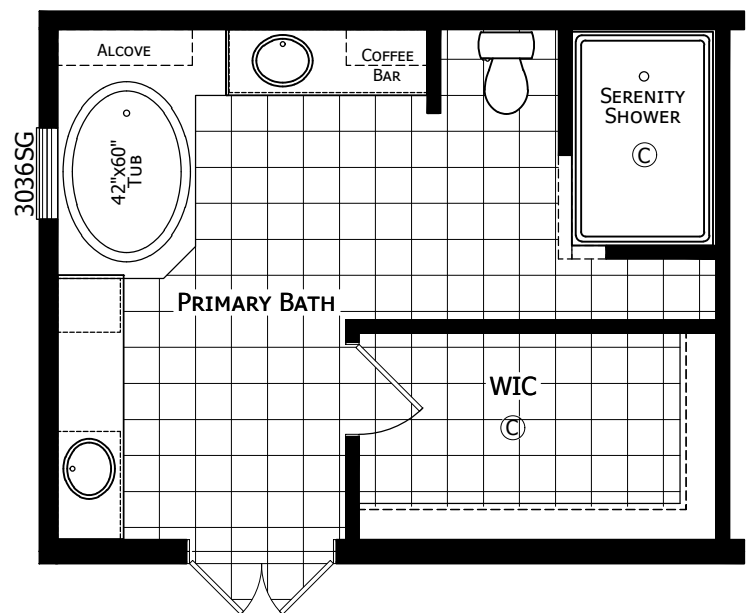

OPTIONAL SERENITY BATH #3

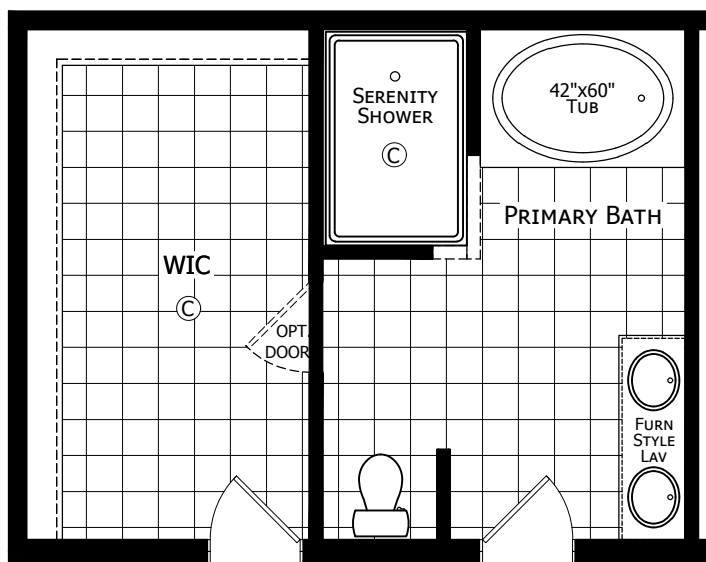

OPTIONAL SERENITY BATH #4

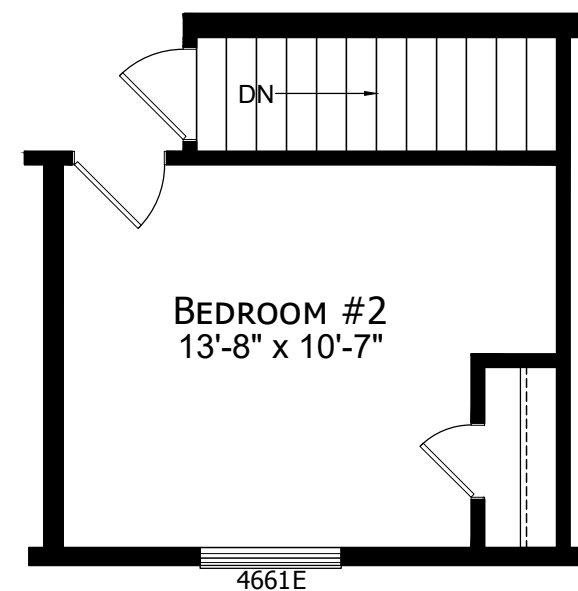

STAIRWELL OPTION

CHAMPION

MANUFACTURED BEAUTIFULLY™

308 SHERIDAN DRIVE TOPEKA, IN 46571

MODIFICATIONS

PROJECT:
112APB-3276M42179
76'-0" x 30'-0"
4 BD 2 BT

DRAWN BY: A.GOULD

DATE: 05-15-24

SCALE: 3/16" = 1'-0"

TITLE:
LITERATURE
PLAN OPTIONS

FILENAME: 112APB-3276M42179

WAS 3280 201

SHEET:
L-103

PROPRIETARY AND CONFIDENTIAL
THESE DRAWINGS AND SPECIFICATIONS ARE ORIGINAL.
PROPRIETARY AND CONFIDENTIAL MATERIALS OF CHAMPION.
COPYRIGHT © 1976-2024 BY CHAMPION