

REQUEST FOR INFORMATION (RFI)

PROJECT :	BKK2	R.F.I. NO. :	523213-01-RFI-AR-0015
TO :	CTA	ATTENTION :	CTA
SUBMITTED DATE:	15-Jan-26	NEED REPLY BY DATE :	22-Jan-26

SUBMISSION OF : ☒ Q&A ☐ Drawing ☒ Document ☐ Others (as specified below)

SUBJECT : Request for Confirmation - Confirm Ceiling Type 6th FL (C4 or C10)


Total Page (s) : 2 (Including this page)


FUNCTION :	<input type="checkbox"/> Structural (ST)	<input type="checkbox"/> Electrical & Communication (EL)	<input type="checkbox"/> Mechanical (ME)	<input type="checkbox"/> Vertical Transport (VT)
	<input checked="" type="checkbox"/> Architectural (AR)	<input type="checkbox"/> Fire Protection (FI)	<input type="checkbox"/> Hydraulic & Sanitary (HY)	<input type="checkbox"/> Other (O)

(1) CONTRACTOR REQUEST FOR INFORMATION :

Ceiling type for Chiller Plant Room in L6 is different between layout plan and reflected ceiling plan.

Please confirm which type to be used.

Requested by : 
Engineering Manager


Reviewed by : 
Project Manager


(2) ATTN : Commtech Asia (Thailand)

☐ For Approval ☐ See Note ☒ Please Clarify

Note : Referring to the Finishing Schedule, the Chiller Plant room is to be C10.

C10	CHILLER PLANT ROOM	ACOUSTIC CEILING	EXPOSED CEILING PLASTER 100 MM THK ROCKWOOL 80KG/m ³ WRAP WITH BLACK GLASS CLOTH MECHANICAL FILING
-----	--------------------	------------------	---

From : GAA Group
By : 
Name / Position : Mr. Itsarate Trachuengtong/
Project Manager
Date : 15-Jan-26

Reviewed By : 
Commtech Asia (Thailand)
Name / Position : Finlay Coady
Sr. Project Manager
Date : 21 January 2026

(3) ATTN : AURECON

☐ For Approval ☐ See Note ☒ Please Clarify

Note : SLA: Please refer to the notes in the attached markup.

From : Commtech Asia (Thailand)
By :
Name / Position : (
Date :


Reviewed By : Tarkoon Suwansukhum
AURECON
Name / Position : (Tarkoon S / Architect)
Date : 29 January 2026

(4) ATTN : STT GDC

☒ Clarification only ☐ Not Approved
☐ Approved for proceeding work
☐ Approved with comments, proceeding work in compliance with comments
☐ Approved with comments, not for proceeding work and need to re-submit

Note : Concur with SLA's response with acoustic work as indicated on drawing

From : AURECON
By :
Name / Position : (
Date :


Reviewed By : 
STT GDC
Name / Position : Sirawit Thepsuwan
Date : 4 Feb 2026

Ceiling type for Chiller Plant Room in L6 is different between layout plan and reflected ceiling plan.

Please confirm which type to be used.

SLA: The ceiling finish C10 is the correct Chiller room ceiling specification.

L6 Layout

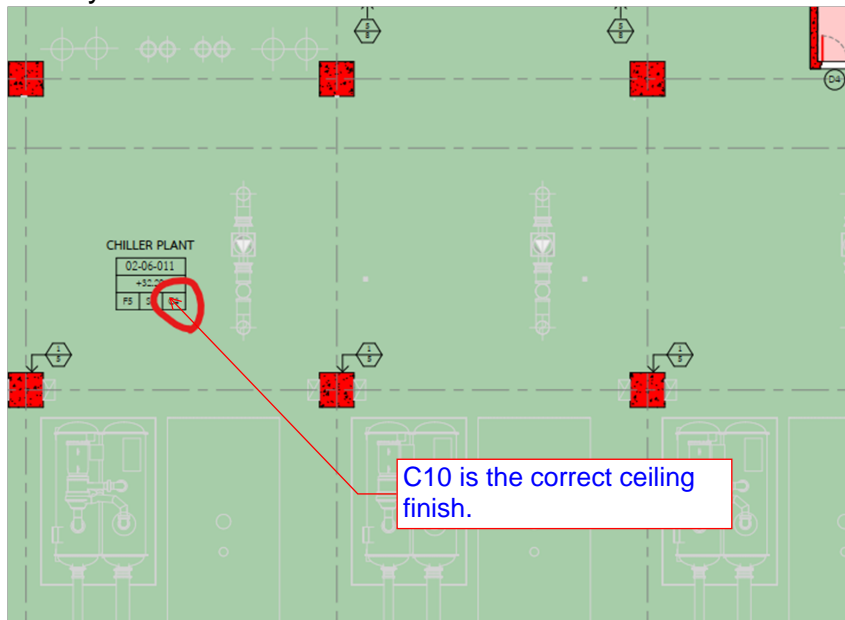

L6 Reflected Ceiling Plan

