

REQUEST FOR INFORMATION (RFI)

PROJECT :	BKK2	R.F.I. NO. :	523213-01-RFI-AR-0010
TO :	CTA	ATTENTION :	CTA
SUBMITTED DATE:	20-Jan-26	NEED REPLY BY DATE :	27-Jan-26

SUBMISSION OF : ☒ Q&A ☐ Drawing ☒ Document ☐ Others (as specified below)

SUBJECT : Request for Confirmation - Indicate Wall Structure and Wall Finishes Type for Batt S2, S3 and EE Room 6th Floor


Total Page (s) : 2 (Including this page)

FUNCTION : ☐ Structural (ST) ☐ Electrical & Communication (EL) ☐ Mechanical (ME) ☐ Vertical Transport (VT)

☒ Architectural (AR) ☐ Fire Protection (FI) ☐ Hydraulic & Sanitary (HY) ☐ Other (O)

(1) CONTRACTOR REQUEST FOR INFORMATION :

Indicate Wall Structure and Wall Finishes Type for Batt S2, S3 and EE Room 6th Floor.

Requested by : 
Engineering ManagerReviewed by : 
Project Manager

(2) ATTN : Commtech Asia (Thailand)

☐ For Approval ☐ See Note ☒ Please Clarify

Note : Aurecon to confirm the wall finishings for the highlighted areas

From : GAA Group

By : Name / Position : Mr. Itsarate Trachuengtong/
Project Manager

Date : 20-Jan-26

Reviewed By : 
Commtech Asia (Thailand)

Name / Position : Finlay Coady

Date : Sr. Project Manager

21 January 2026

(3) ATTN : AURECON

☐ For Approval ☐ See Note ☐ Please Clarify

Note : SLA: Please refer to the notes in the attached markup.

From : Commtech Asia (Thailand)

By :

Name / Position ()

Date :

Reviewed By : Tarkoon Suwansukhum
AURECON

Name / Position : (Tarkoon S / Architect)

Date : 29 January 2026

(4) ATTN : STT GDC

☒ Clarification only ☐ Not Approved

☐ Approved for proceeding work

☐ Approved with comments, proceeding work in compliance with comments

☐ Approved with comments, not for proceeding work and need to re-submit

Note : Concur with SLA's response

From : AURECON

By :

Name / Position ()


Date :

Reviewed By : STT GDC 

Name / Position : Sirawit Thepsuwan


Date : 4 Feb 2026

Indicate wall structure, wall finishes type for Batt S2, S3 and EE Room 6th Floor.

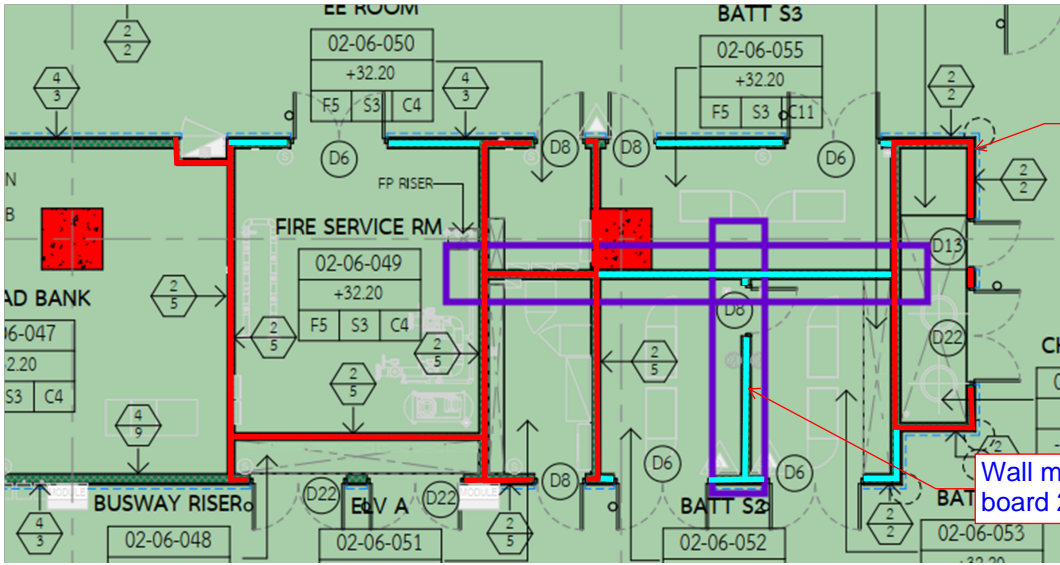

Wall material 2, block wa
2Hrs fire rated.

Wall material 4, gypsum
board 2Hrs fire rated.

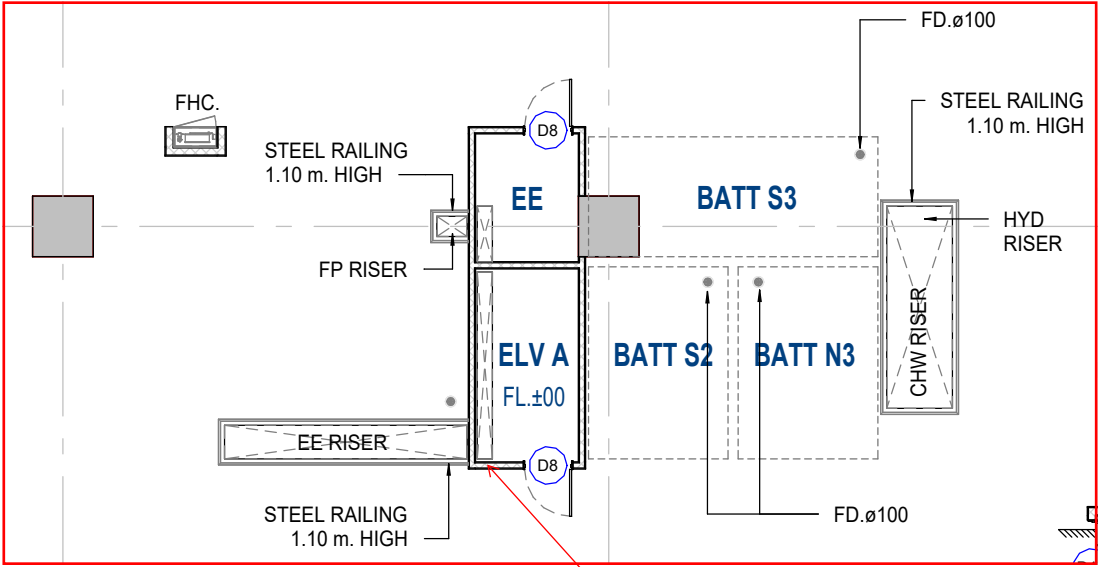

Block wall by TTI.