



Corrected evaluation: Finistral-7B-LoRA vs the Mistral-7B-v0.1 backbone

■ Accuracy ■ Weighted F1

FPB decontaminated (n=560)

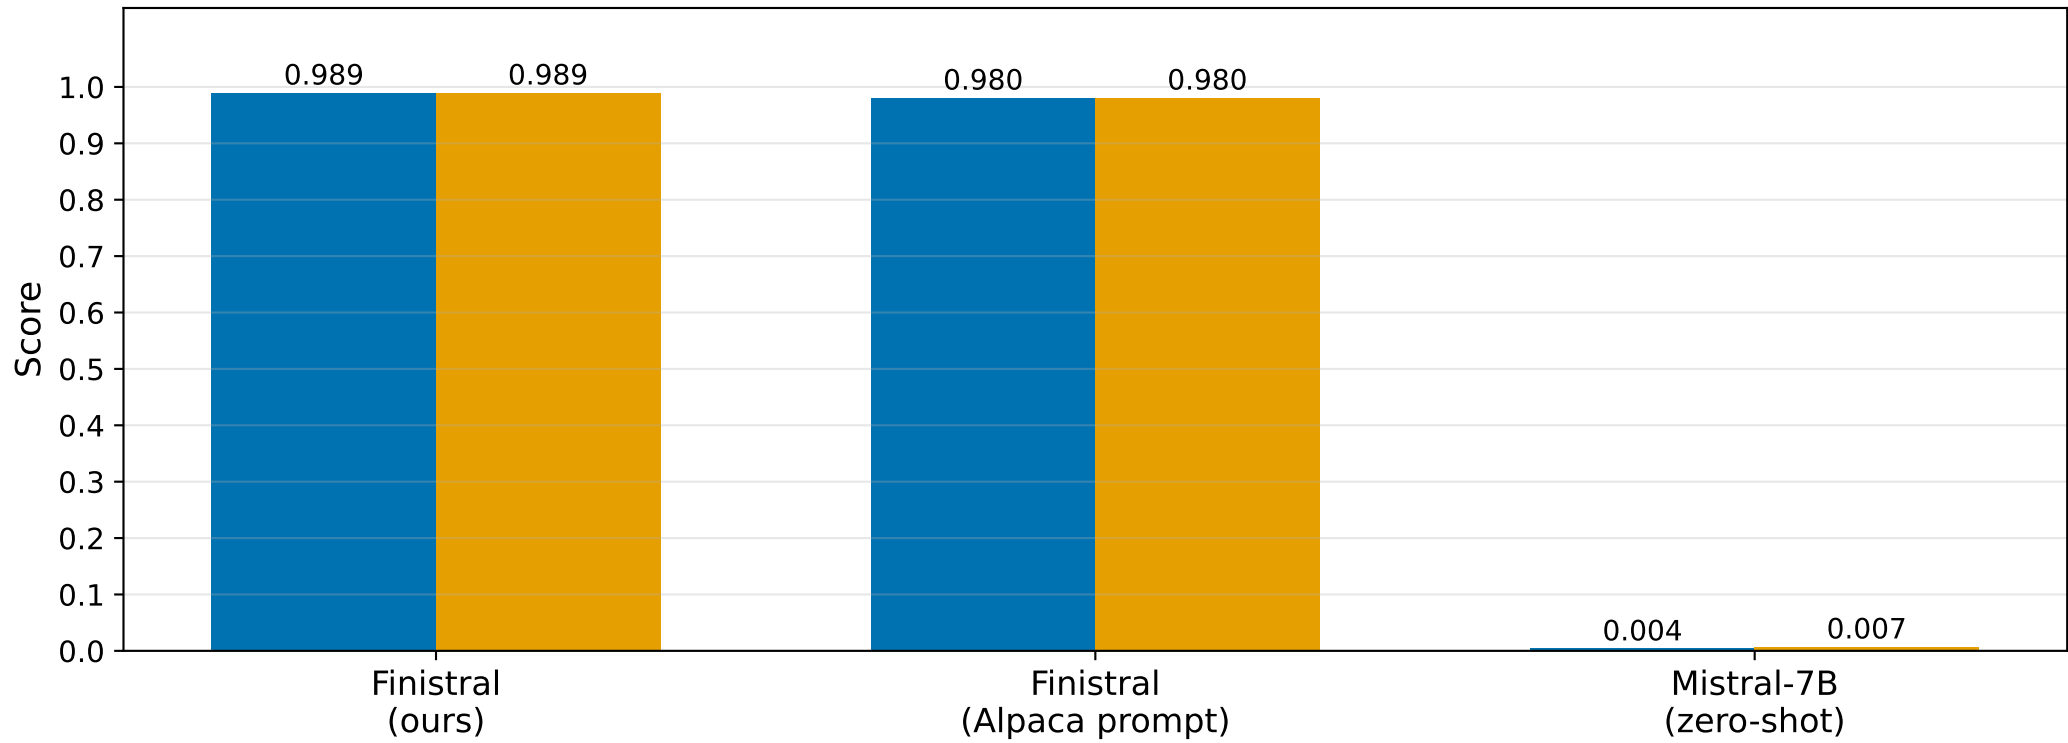

FiQA-SA (decontaminated, n=235)

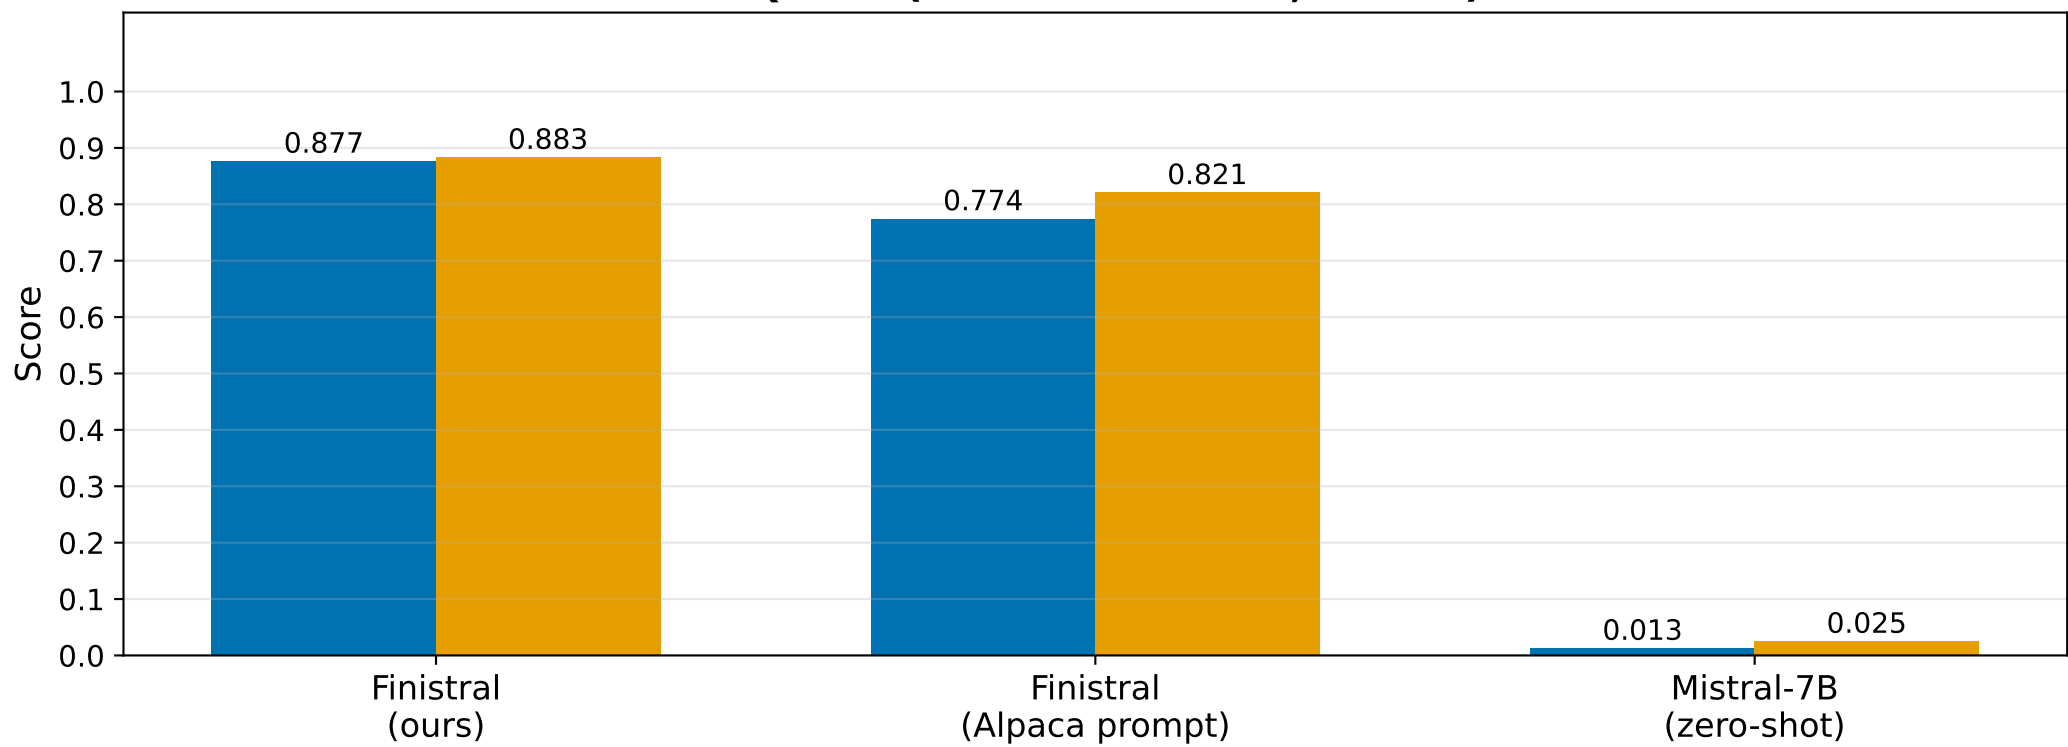

TFNS (decontaminated, n=2,373)

