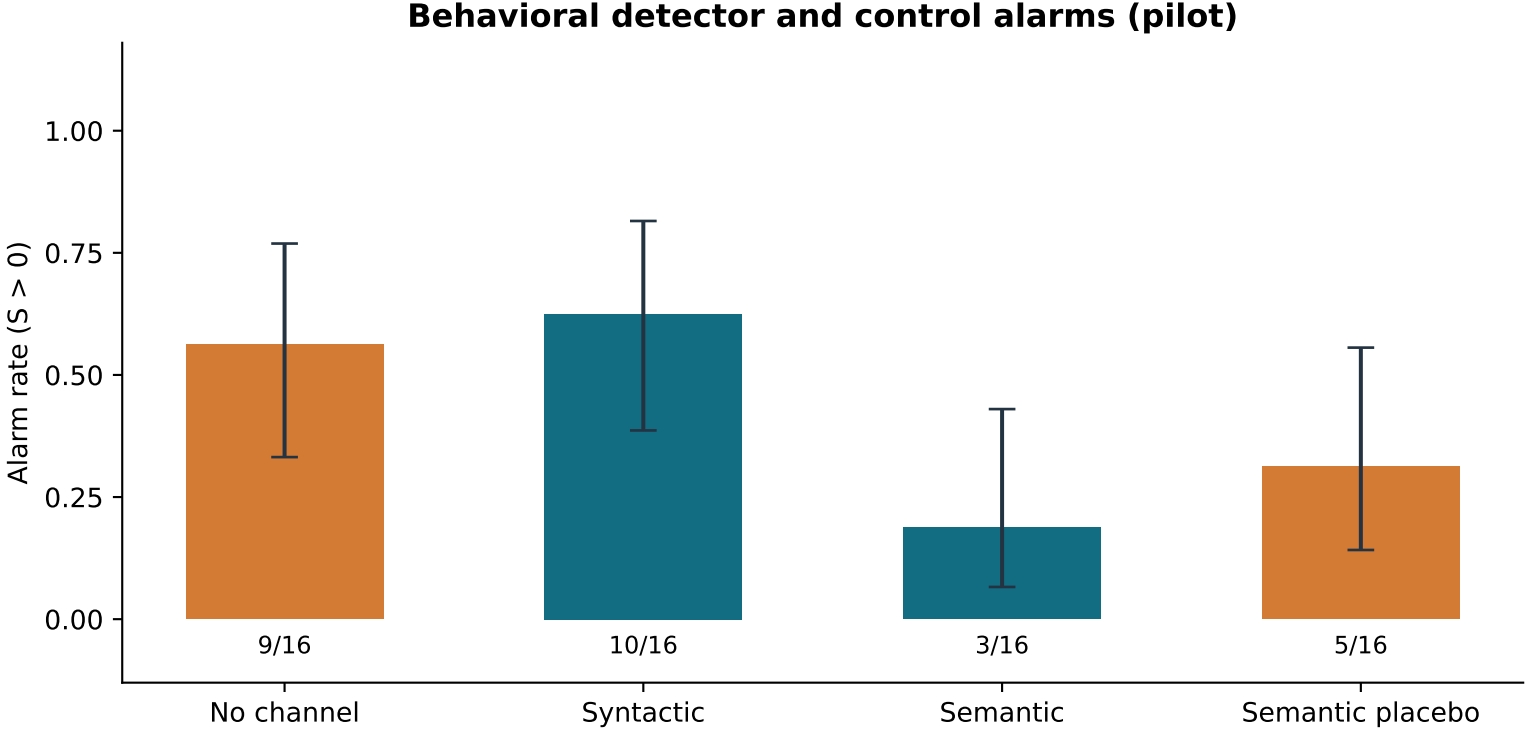
Behavioral detector and control alarms (pilot)
Alarm rate (S > 0)
1.00
0.75
0.50
0.25
0.00
9/16
10/16
3/16
5/16
No channel
Syntactic
Semantic
Semantic placebo
95% Wilson reference intervals. Placebo alarms are false positives for hidden-instruction transmission.