

System Performance

We have made an estimate of the annual energy generation of your system. This takes into account the following factors that affect the output of a solar array.

The location of the system

Sunlight is weaker near the poles than near the equator. We use data from a meteorological model of the intensity of sunlight over the course of the year in different locations all over the world.

The orientation of the system

Solar panels that face south receive a little more sunlight than panels that face east or west. However, in diffuse light the orientation of the panels makes little difference, so the effect is less marked than many people imagine.

The degree of shading

If you have trees, neighbouring buildings or nearby high ground that will shade your PV array, the output of the system will be reduced. We have used a 'sunpath diagram' that estimates how often sunlight will be blocked from reaching the panels.

**We expect your system to generate
3,043 kWh per year**


Installation data

Installation capacity of PV system – kWp (stc)	3.92 kWp
Orientation of the PV system – degrees from South	See roof diagrams
Inclination of system (pitch) – degrees from horizontal	See roof diagrams
Postcode region	Zone 2


Performance Calculations

kWh/kWp (Kk)	See sunpath diagrams
Shade Factor (SF)	See sunpath diagrams
Estimated output (kWp × Kk × SF)	3043 kWh

Roof diagrams




Roof East Orientation: -72° Pitch: 38°

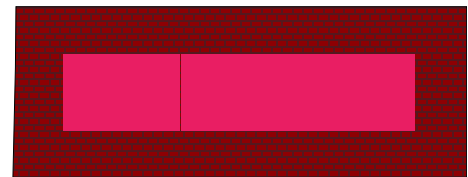


Roof East Orientation: -72° Pitch: 38°

Sunpath diagrams

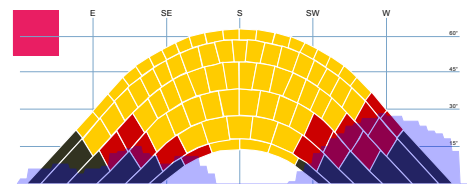

Shade factor: 0.86 Kk: 966

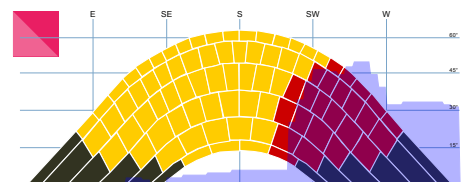

Shade factor: 0.76 Kk: 966

Important note: The performance of solar PV systems is impossible to predict with certainty due to the variability in the amount of sunlight from location to location and from year to year. This estimate is based upon a model that takes account of meteorological data at your location and makes an allowance for losses due to shading of the panels. This is a complex calculation however, and no model can be 100% accurate. It should not be considered a guarantee of performance.

If shading is present on your system that will reduce its output to the factor stated. This factor was calculated using industry standard shading methodology and we believe that this will yield results within 10% of the actual energy estimate stated for most systems.


Battery Storage

We have included 10.2 kWh of battery storage in this proposal. On sunny days, when your PV array is producing more electricity than you are using in the property, you will be able to store the spare energy and use it at night.

Battery storage systems increase the proportion of electricity generated by a solar PV array that is consumed in the property rather than exported to the grid. Excess solar energy that is not needed during the day can be stored and subsequently used overnight

This leads to financial savings, as you replace expensive imported electricity (at 24.50 p/kWh) with electricity generated by your solar panels.

Where will your power come from?

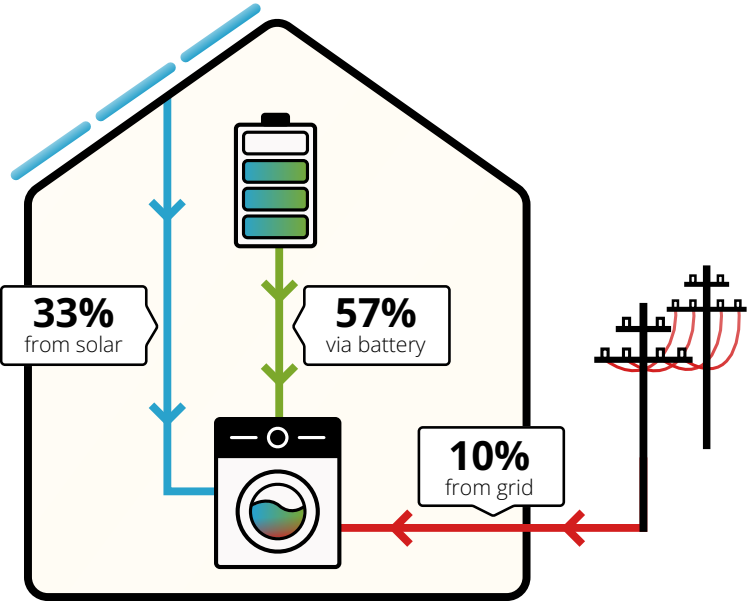

How battery storage reduces your grid dependence

Including battery storage will reduce your grid dependence by an extra 57% compared with a PV-only system. You should only need to buy around 10% of your power from the grid.

90%
total reduction of grid dependence with battery

Estimated PV self-consumption – PV only	
Assumed occupancy archetype	home all day
Assumed annual domestic electricity consumption	2000 kWh
Expected solar PV self-consumption (PV Only)	669 kWh
Grid electricity independence / Self-sufficiency (PV Only)	33%

Estimated PV self-consumption – with EESS	
Assumed usable capacity of electrical energy storage device, which is used for self-consumption	9.2 kWh
Expected solar PV self-consumption (with EESS)	1795 kWh
Grid electricity independence / Self-sufficiency (with EESS)	90%

Important note: We have used the recommended MCS method to determine the likely self-consumption of your property. We have assumed you are home all day and that your annual electricity consumption is 2000 kWh.

The energy performance and benefits of EESS is impossible to predict with certainty due to the numerous functions a system can be programmed to perform. This estimate is given as guidance only. It should not be considered as a guarantee of performance.

Your Energy Explained


In addition to the MCS calculation of system output we have run a detailed model of your system to estimate how much of the electricity generated by the system you are likely to use yourself and how much will go to the grid.

Our model simulates how your system behaves minute-by-minute over the course of an entire year, allowing us to predict how the solar array and battery will meet your electricity consumption at different times. For example we can look at a sunny day in summer where your generation may considerably exceed what you use in the house, or a dull day in winter where you may still need to import significant amounts of electricity from the grid. We can also predict the state of charge of the battery at any point in the year, and we can calculate financial benefits by applying electricity tariffs, including variable ones that change by the time of day. This allows us to more accurately predict likely savings from the system.


Accredited systems installed in the UK are eligible for export payments for each unit of electricity exported through the Smart Export Guarantee (SEG). You can get details from your electricity supplier or from Ofgem (ofgem.gov.uk).

Where your electricity comes from in a typical year


Based on an electricity usage of 2000 kWh per year, the graph below shows how much electricity used in the property is expected to come directly from the solar panels, how much is expected to come via battery storage, and how much is expected to come directly from the grid.

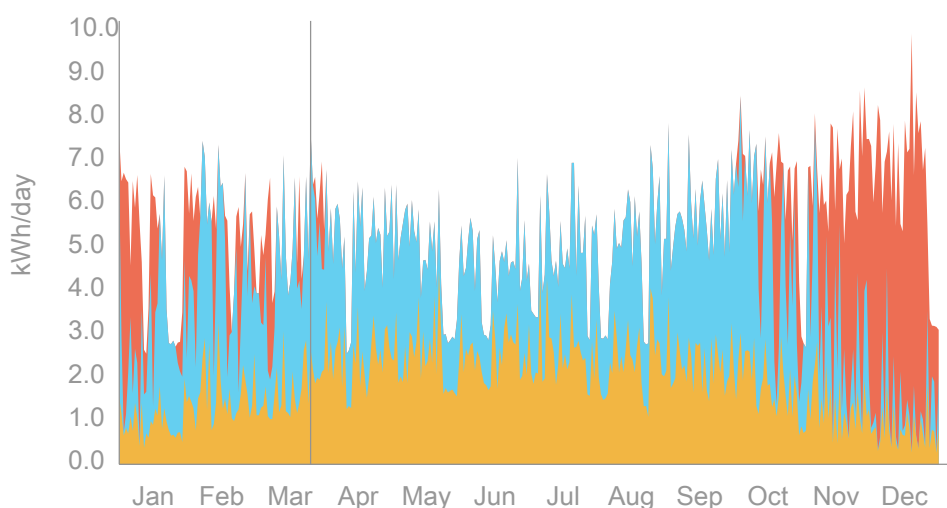


Annual Generation

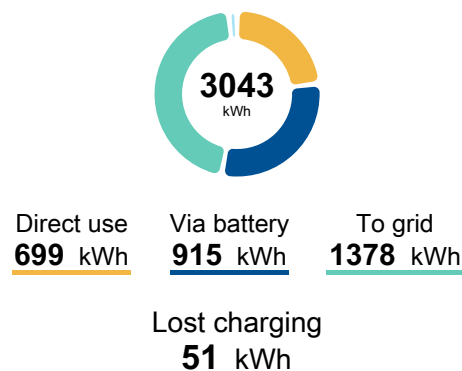

Annual Consumption

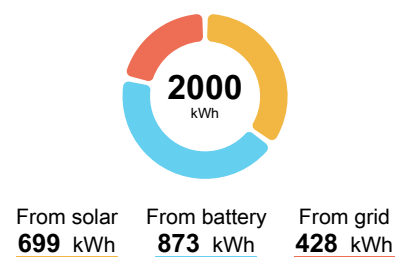

Annual Import/Export



Quote



John-Test Wick
112 The Grove
BR4 9JZ

Quote reference: 1506757
Quote date: 09/04/2026
Quote by: Tej Patel
Quote validity: 30 days

Description of goods and services		Price
Goods		
9 x InstaGen 435W solar panel		£1,058.40
26 x Fastensol black universal clamp		£25.48
16 x Fastensol black end cap		£10.08
16 x Fastensol portrait pan tile roof hook		£85.12
8 x Fastensol silver rail 3550mm		£203.28
16 x Fastensol portrait flat tile roof hook		£76.16
2 x Fastensol rail splice		£3.92
InstaGen 1ph 3.68kW Hybrid inverter		£938.00
2 x InstaGen 5kWh Battery V2		£2,380.00
2 x AC isolator - IMO - 20A 4-pole		£28.00
2 x IMO 25A DC Isolator 4-pole 2-string		£92.40
4 x MC4 4mm Connector Pair		£14.32
50m reel of 4mm ² solar cable		£44.80
Acrel ADL 200 1ph kWh Gen Meter		£41.30
Label sheet		£2.52
Battery Hazard Warning Label Pack		£3.50
InstaGen BMS for 5kWh Battery V2		£490.00
InstaGen 5kWh Battery Stack Base		£21.00
Battery Warning Label Stickers		£3.50
Battery in Installation Stickers		£3.50
Goods total		£5,525.28
Services		
None		£0.00
Services total		£0.00
System cost		£5,525.28
Total before VAT		£5,525.28
VAT at 0%		£0.00
Total including VAT		£5,525.28

Order form

Pay in full

You'll need to pay for your system in full. If applicable, we've outlined any stage payments below to give you full transparency from the start.

If you have questions or need to discuss other arrangements, just reach out. You'll also find more details in our terms and conditions.

Payment Stages

£5,525.28
Total cost up front


2. Read and sign below

To proceed with your order, please sign below.

1. You understand that all solar production and financial predictions shown are estimates. 2. You accept the total cost and payment schedule associated with your preferred payment option. 3. You have read and accepted our Terms and Conditions.

Customer signature	Customer name	Date

Pay in Full

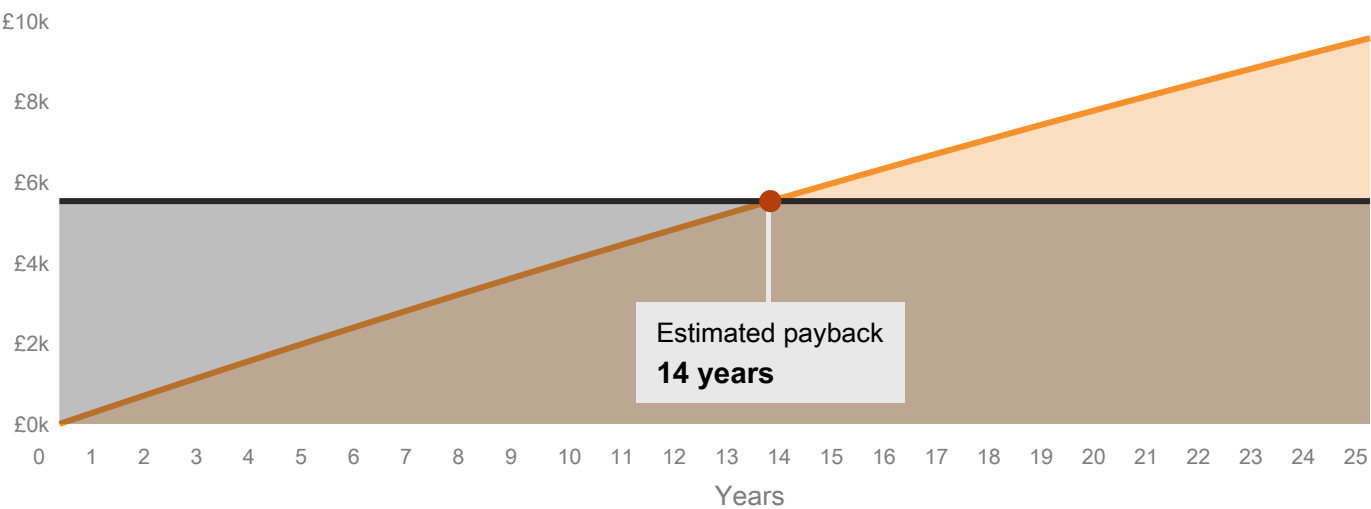

Year	Running costs	Discounted yearly costs	Discounted cumulative costs	Discounted yearly benefits	Discounted cumulative benefits	Cashflow
1	£0	£5,525	£5,525	£437	£437	-£5,088
2	£0	£0	£5,525	£432	£870	-£4,655
3	£0	£0	£5,525	£428	£1,297	-£4,228
4	£0	£0	£5,525	£423	£1,720	-£3,805
5	£0	£0	£5,525	£418	£2,138	-£3,387
6	£0	£0	£5,525	£413	£2,551	-£2,974
7	£0	£0	£5,525	£408	£2,960	-£2,566
8	£0	£0	£5,525	£404	£3,363	-£2,162
9	£0	£0	£5,525	£399	£3,762	-£1,763
10	£0	£0	£5,525	£395	£4,157	-£1,368
11	£0	£0	£5,525	£390	£4,547	-£978
12	£0	£0	£5,525	£386	£4,933	-£592
13	£0	£0	£5,525	£381	£5,314	-£211
14	£0	£0	£5,525	£377	£5,691	£166
15	£0	£0	£5,525	£373	£6,064	£539
16	£0	£0	£5,525	£368	£6,433	£907
17	£0	£0	£5,525	£364	£6,797	£1,272
18	£0	£0	£5,525	£360	£7,157	£1,632
19	£0	£0	£5,525	£356	£7,513	£1,988
20	£0	£0	£5,525	£352	£7,865	£2,340
21	£0	£0	£5,525	£348	£8,213	£2,688
22	£0	£0	£5,525	£344	£8,557	£3,032
23	£0	£0	£5,525	£340	£8,897	£3,372
24	£0	£0	£5,525	£336	£9,234	£3,708
25	£0	£0	£5,525	£332	£9,566	£4,041

Payment summary

Total cost up front	£5,525
System cost including tax	£5,525

Disclaimer

Currency amounts are rounded to the nearest whole unit. We estimate the system's costs and benefits over the lifetime of the system using the assumptions shown on the Financial Benefits page. Please review these carefully to ensure they reflect your circumstances. Actual returns may vary and depend on variables that cannot be predicted.