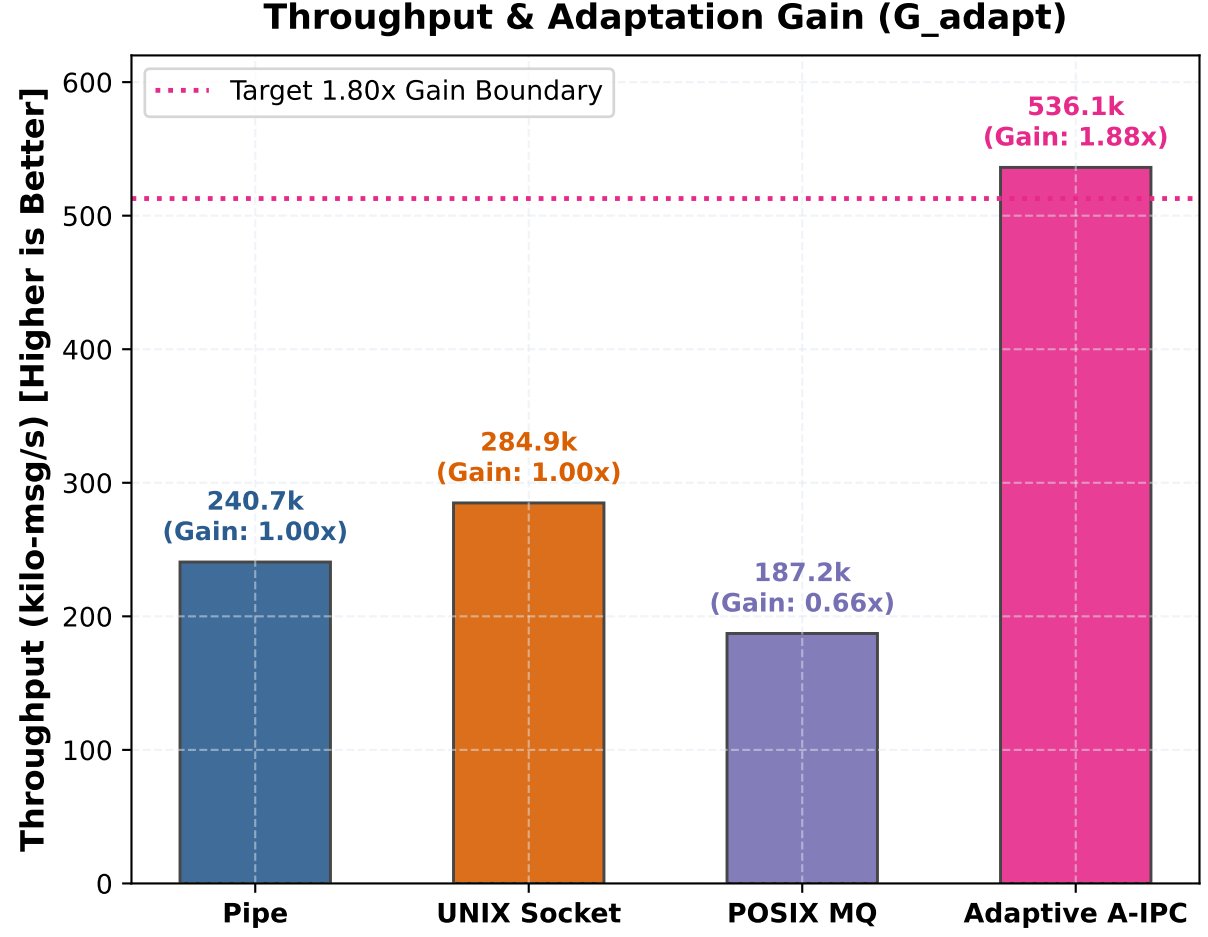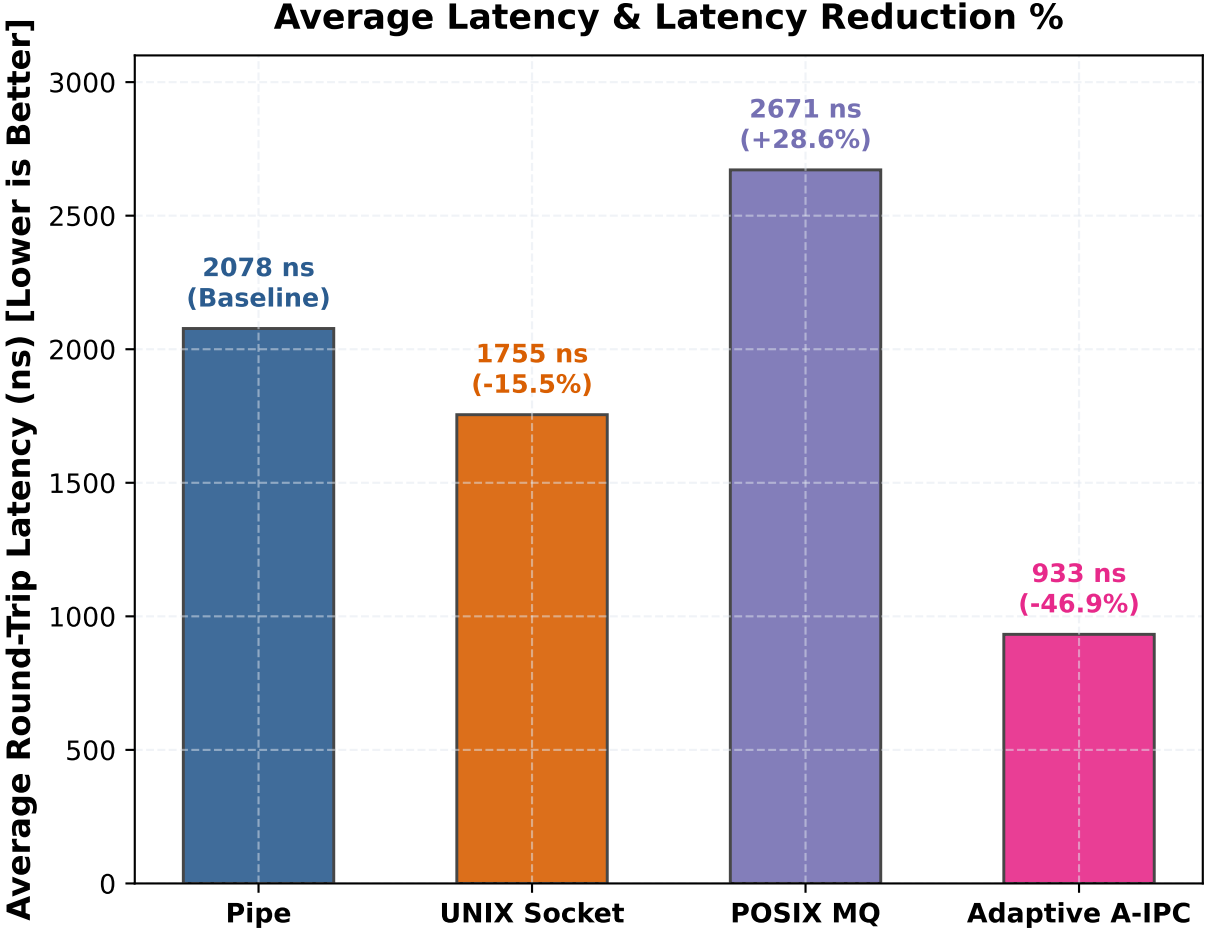Figure 4: Adaptation Gain Validation on Mixed Workload (80% 64 B + 20% 16 KB)