



## Research Paper

# Optimization of heat sinks for data center server CPUs cooled via single-phase immersion cooling

M. Khoshvaght-Aliabadi<sup>a,b,c,\*</sup>, P. Ghodrati<sup>a</sup>, A. Nasrolahzadeh<sup>d</sup>, Y.T. Kang<sup>a,c,\*</sup>

<sup>a</sup> School of Mechanical Engineering, Korea University, 145 Anam-ro, Seongbuk-gu, Seoul 02841, Republic of Korea

<sup>b</sup> Department of Chemical Engineering, Shahrood Branch, Islamic Azad University, Shahrood, Iran

<sup>c</sup> Research Center for Plus Energy Building Innovative Technology, School of Mechanical Engineering, Korea University, 145 Anam-ro, Seongbuk-Gu, Seoul 02841, South Korea

<sup>d</sup> Department of Chemical Engineering, Faculty of Engineering, Ferdowsi University of Mashhad, Iran

## ARTICLE INFO

## Keywords:

Data center  
Immersion cooling  
Heat sink optimization  
Thermal design power  
Dielectric coolants

## ABSTRACT

As modern data centers increasingly support high-performance computing and AI-driven applications, advanced thermal management becomes ever more critical. Single-phase immersion cooling offers an effective and energy-efficient solution for managing high thermal loads. This study focuses on optimizing heat sink geometries and coolant conditions for a dual-CPU server with 24 DIMMs immersed in FC-40 dielectric fluid. Using response surface methodology with a Box-Behnken design (RSM-BBD), this study systematically evaluates the effects of design and operational variables on CPUs temperature, temperature uniformity, and the power required for coolant pumping and thermal restoration. The sensitivity analysis reveals that the coolant flow rate exerts the greatest influence across all optimization criteria. Apart from CPUs temperature, geometric parameters have a more pronounced effect on the remaining optimization metrics than the coolant inlet temperature. The optimized model satisfies all metrics for effective immersion cooling. Specifically, under a thermal design power (TDP) of 400 W, the CPUs temperature is maintained below 60 °C, with the temperature difference between the CPUs kept below 5 °C. Furthermore, the model can handle higher TDPs of up to 600 W while keeping the CPUs temperature below 85 °C. It also performs effectively for servers equipped with advanced chips, such as GaN-based devices, at TDPs up to 800 W. Among all the coolants evaluated, Novec™ 7200 demonstrates the ability to maintain the CPUs temperature at 58.3 °C while requiring the lowest pumping power. Furthermore, the proposed correlations accurately predict the thermal behavior of heat-generating components, with an average absolute deviation of less than 10 %.

## 1. Introduction

Driven by the rapid advancement of technologies such as artificial intelligence (AI) and high-performance computing (HPC), data centers (DCs) have seen a sharp rise in energy demand, leading to a substantial increase in global electricity consumption [1]. In this context, communication technologies are projected to consume around 20 % of the global electricity by 2030 [2]. At the same time, global DC capacity demand is projected to grow significantly, rising from 60 GW in 2023 to as much as 219 GW by 2030, and potentially reaching 298 GW under high-growth scenarios. Notably, AI-ready DCs, characterized by rapidly increasing power densities, are anticipated to make up approximately 70 % of the total demands by the end of the decade [3]. In parallel with this capacity expansion, the total energy consumption of DCs is expected

to increase from 286 TWh in 2016 to 752 TWh by 2030, primarily driven by the substantial power requirements of their cooling systems [4].

DC components consume a substantial amount of electricity, most of which is converted into heat that must be effectively managed to ensure reliable operation [5]. At the same time, ongoing trends in server miniaturization and integration have significantly increased chip power density and operating temperatures. When chip temperatures exceed 75 °C, server failure rates rise exponentially [6]. To mitigate this risk, IT equipment must be kept below critical temperature thresholds, making efficient cooling systems essential for the performance and stability of DCs [7,8]. In recent years, the energy consumption of DCs has been growing at an annual rate of approximately 12 %, accounting for 1.3 %–2 % of global electricity usage [9,10], with cooling systems responsible for 30–50 % of that consumption [11,12]. In this context, optimizing cooling technologies has emerged as a major research focus, not only to

\* Corresponding authors at: The School of Mechanical Engineering, Korea University, 145 Anam-ro, Seongbuk-gu, Seoul 02841, Republic of Korea.

E-mail addresses: [mkhaliabadi@gmail.com](mailto:mkhaliabadi@gmail.com), [mkhaliabadi@korea.ac.kr](mailto:mkhaliabadi@korea.ac.kr) (M. Khoshvaght-Aliabadi), [ytkang@korea.ac.kr](mailto:ytkang@korea.ac.kr) (Y.T. Kang).

<https://doi.org/10.1016/j.applthermaleng.2025.127790>

Received 27 June 2025; Received in revised form 31 July 2025; Accepted 7 August 2025

Available online 17 August 2025

1359-4311/© 2025 Elsevier Ltd. All rights are reserved, including those for text and data mining, AI training, and similar technologies.

| Nomenclature  |                                                | <i>in</i>  | inlet                          |
|---------------|------------------------------------------------|------------|--------------------------------|
|               |                                                | <i>out</i> | outlet                         |
|               |                                                | <i>m</i>   | maximum                        |
|               |                                                | <i>s</i>   | solid                          |
| Greek symbols |                                                | Acronyms   |                                |
| $c_p$         | specific heat capacity (J/kg.°C)               | AAD        | Average Absolute Deviation     |
| $g$           | gravitational acceleration (m <sup>2</sup> /s) | ANOVA      | Analysis of Variance           |
| $h$           | fin height (mm)                                | AI         | Artificial Intelligence        |
| $l$           | fin length (mm)                                | BBD        | Box-Behnken Design             |
| $Q$           | coolant flow rate (lpm)                        | CCD        | Central Composite Design       |
| $p$           | pressure (Pa)                                  | CPU        | Central Processing Units       |
| $P_p$         | pumping power (W)                              | DC         | Data Center                    |
| $R$           | thermal resistance (°C/W)                      | DIMM       | Dual Inline Memory Module      |
| $s$           | fin spacing (mm)                               | GPU        | Graphics Processing Unit       |
| $T$           | temperature (°C)                               | HS         | Heat Sink                      |
| $t$           | fin thickness (mm)                             | IT         | Information Technology         |
| $u$           | velocity (m/s)                                 | PCB        | Printed Circuit Board          |
| $V$           | volumetric flow rate (m <sup>3</sup> /s)       | PCH        | Platform Controller Hub        |
|               |                                                | PSU        | Power Supply Unit              |
|               |                                                | RSM        | Response Surface Method        |
|               |                                                | SPIC       | Single-Phase Immersion Cooling |
|               |                                                | TDP        | Thermal Design Power (W)       |
|               |                                                | TPIC       | Two-Phase Immersion Cooling    |
| Subscripts    |                                                |            |                                |
| <i>amb</i>    | ambient                                        |            |                                |
| <i>c</i>      | coolant                                        |            |                                |
| <i>d</i>      | DIMM                                           |            |                                |

maintain safe operating temperatures but also to enhance the overall energy efficiency of DCs [13].

Cooling electronic components remains a critical challenge and has been addressed through various strategies, including forced air cooling [14,15], heat pipes [16,17], phase change materials [18,19], and liquid cooling systems [20,21]. Among these, air cooling remains the most widely used method in DCs [8]. Conventional forced air-cooling systems can effectively manage thermal loads up to 37 W/cm<sup>2</sup> [22]; however, they are increasingly inadequate for modern DCs, particularly when compared to advanced liquid cooling methods, that can handle significantly higher chip power densities [10]. In space-constrained 1U servers, advanced heat sink configurations, such as vapor chambers and heat pipes with cut fins, have been shown to reduce thermal resistance and enhance cooling efficiency, particularly at elevated power levels [23]. Moreover, air-cooling systems require substantial volumetric airflow and high fan power, which not only decreases their overall efficiency but also leads to elevated noise levels and operational costs [24]. Similarly, the cooling capacity of heat pipes is generally limited to localized hotspots, reducing their effectiveness in managing the broader thermal load of an entire system [25]. In this context, liquid cooling offers significant advantages over other approaches and has gained considerable attention in recent years [26,27]. It can be implemented either indirectly via cold plates [28] or directly through immersion cooling [29].

Immersion liquid cooling, a technique in which electronic components are submerged in dielectric fluids, has gained increasing interest due to its enhanced heat dissipation performance and ability to accommodate higher computational densities. Zhang et al. [30] conducted a comprehensive review of immersion cooling technologies, highlighting that, due to its superior heat transfer performance, uniform temperature regulation, and low noise levels, immersion cooling has emerged as an effective solution for the thermal management of high heat flux electronic devices. This technology is generally classified into two main categories: single-phase immersion cooling (SPIC) and two-phase immersion cooling (TPIC). While TPIC offers a significantly higher heat transfer coefficient, reportedly improving performance by 72–79 % [31], its widespread adoption is hindered by several

challenges, including the high cost of coolants [29], environmental concerns [32], and reliability issues [33]. In contrast, SPIC is recognized for its simplicity, lower cost, and greater environmental compatibility, despite having a relatively lower heat transfer coefficient (<2 kW/m<sup>2</sup>.K) [31]. Notably, Wang et al. [34] demonstrated that a pump-driven SPIC system reduced the peak temperature and thermal variability of electronic components by 39.4 % and 74 %, respectively. These advantages underscore the potential of SPIC as a practical and scalable thermal management solution for modern high-performance data centers.

Bansode et al. [35] confirmed that servers fully enclosed in cooling fluids can operate efficiently under elevated temperature conditions. Multiple studies have indicated that SPIC systems improve power usage effectiveness. Supporting these findings, Hnayno et al. [36] evaluated the performance of conventional air cooling versus SPIC in high heat flux servers, showing that SPIC reduces power consumption per server by at least 20 %, thereby demonstrating its substantial energy-saving potential. Additionally, forced convection systems have exhibited superior performance compared to natural circulation systems in SPIC setups [37]. Taddeo et al. [38] employed both experimental and numerical approaches to demonstrate that SPIC provides an effective solution for cooling server tanks containing 54 servers, each rated at 400 W. Due to the risk of electrical hazards, advanced immersion cooling systems generally employ dielectric liquids as the coolant [39].

Among the various dielectric fluids, fluorocarbons, hydro-fluoroethers, engineered coolants, and oils are the most commonly used in SPIC systems. Jithin et al. [40] compared the cooling performance of deionized water, mineral oil, and e-fluoride, identifying deionized water as the most effective for controlling electronic component temperatures. Cheng et al. [41], in their experiments using 3 M Novec 7100, investigated the effects of different flow rates and heat sink materials. Their findings revealed that lower flow rates resulted in higher CPU temperatures and less uniform cooling, whereas increased flow rates significantly enhanced thermal performance, emphasizing the critical role of coolant properties and flow dynamics in system optimization. Wen et al. [42] designed five novel nanofluids based on FC-40 and performed simulations to assess their performance in a SPIC system. Among them, Al-FC40 exhibited the best thermal performance, reducing peak CPU

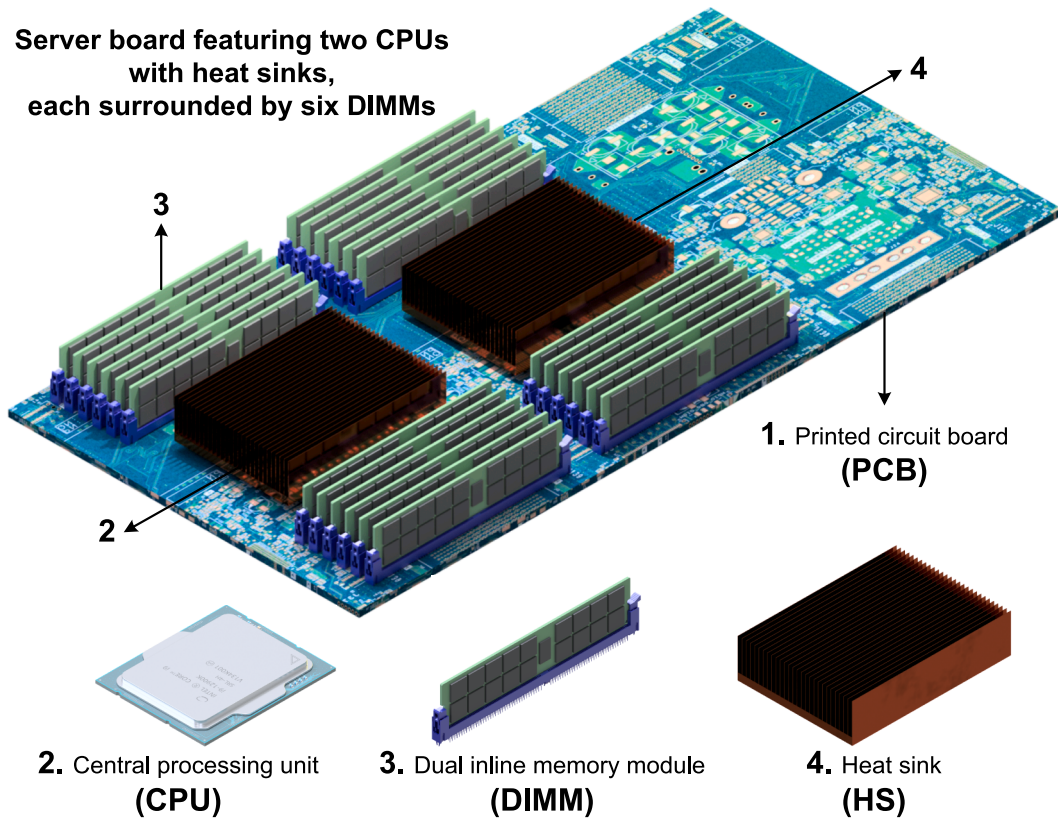


Fig. 1. An illustrative schematic of 1U rack server board.

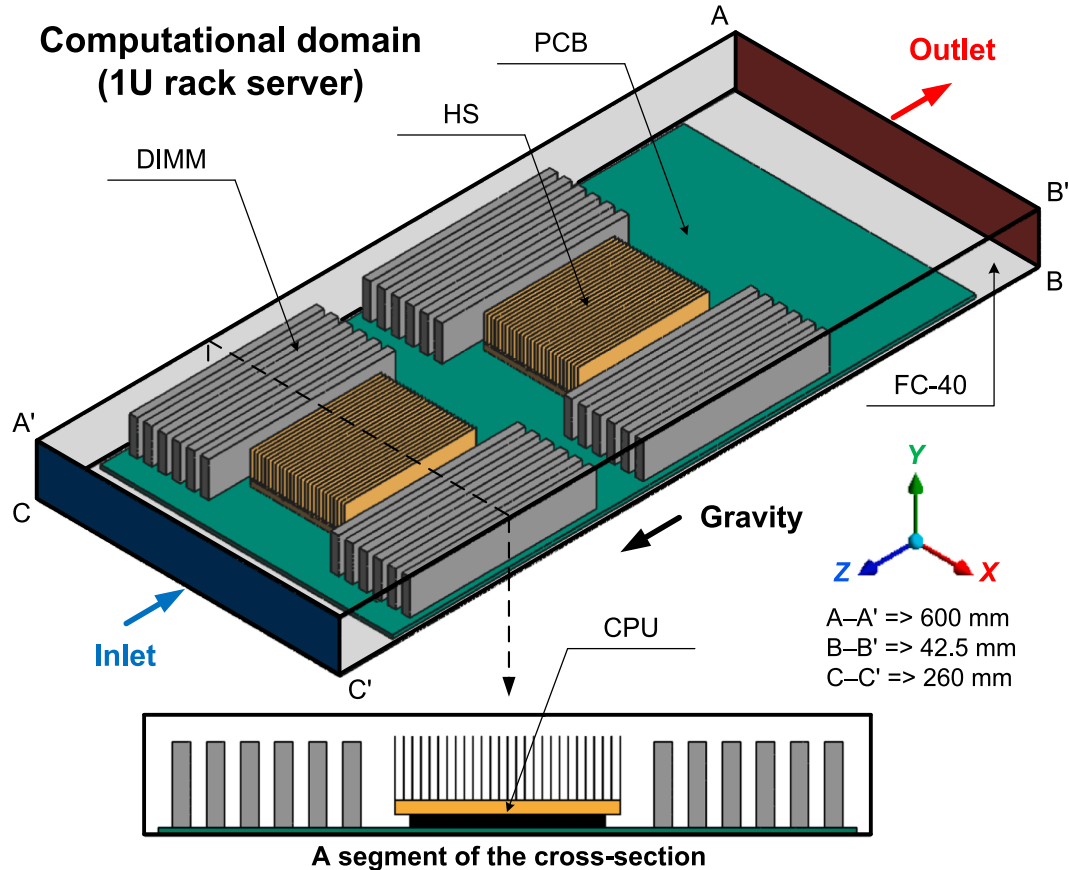
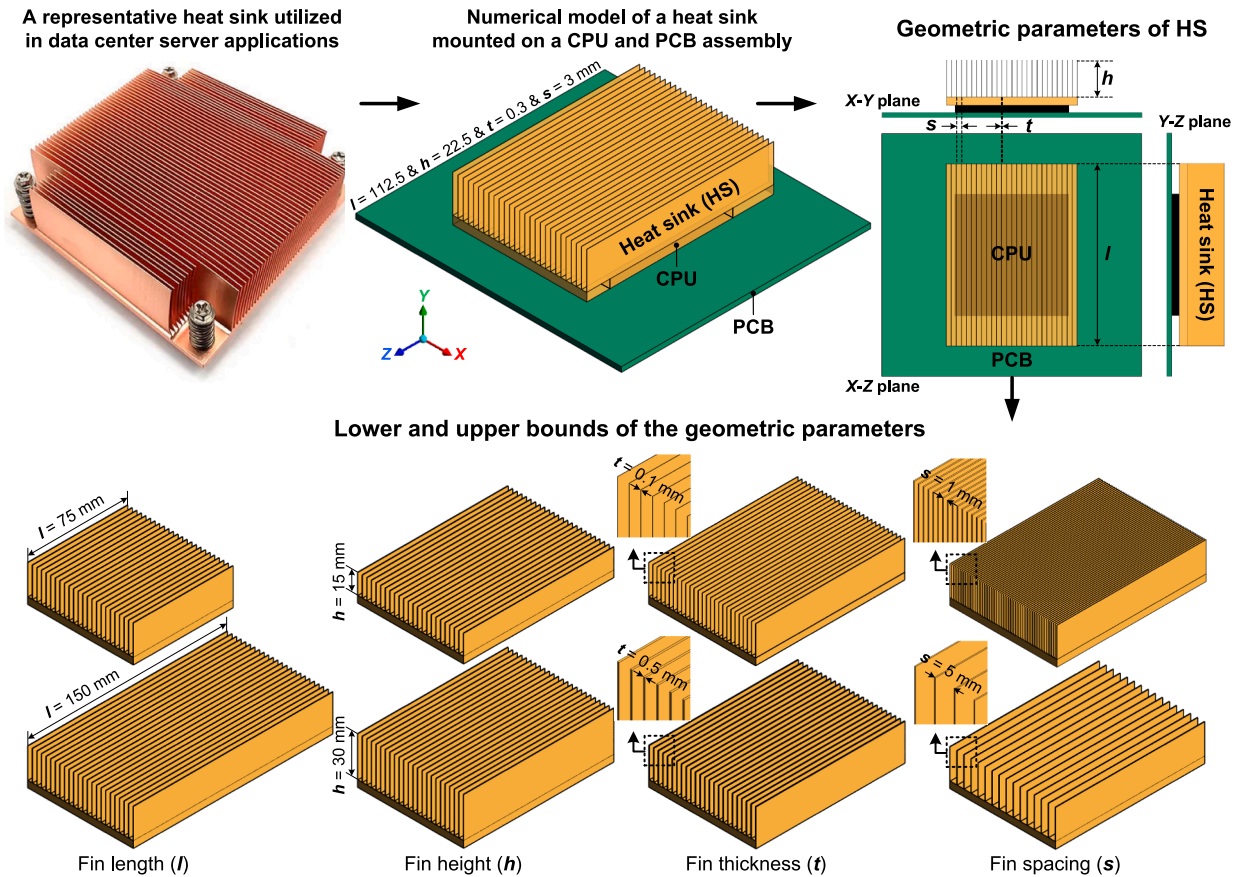


Fig. 2. Computational domain for the 1U rack server configuration employed in the single-phase immersion cooling study.

**Table 1**

Technical specifications of the components in the 1U rack server.

| Component                                          | Printed circuit board (PCB)                   | Central processing unit (CPU)                               | Dual inline memory module (DIMM)                                                        | Heat sink (HS)                           |
|----------------------------------------------------|-----------------------------------------------|-------------------------------------------------------------|-----------------------------------------------------------------------------------------|------------------------------------------|
| Function                                           | Mechanical support and electrical connections | Performing calculations and severing as a major heat source | Providing volatile memory for temporary data storage and serving as a minor heat source | Absorbing and dissipating heat from CPUs |
| Number                                             | 1                                             | 2                                                           | 24                                                                                      | 2                                        |
| Dimension [mm]                                     | $250 \times 3 \times 500$                     | $70 \times 4.5 \times 75$                                   | $6.5 \times 30 \times 160$                                                              | $80 \times 22.5 \times 112.5$            |
| Power [W]                                          | 0                                             | 100–800                                                     | 15                                                                                      | 0                                        |
| Material                                           | FR-40                                         | Silicon                                                     | Silicon                                                                                 | Copper                                   |
| Density [ $\text{kg/m}^3$ ]                        | 1850                                          | 2300                                                        | 2300                                                                                    | 8978                                     |
| Thermal conductivity [ $\text{W/m}\cdot\text{s}$ ] | 0.3                                           | 98.4                                                        | 98.4                                                                                    | 387.6                                    |
| Specific heat [ $\text{J/kg}\cdot\text{K}$ ]       | 1000                                          | 721                                                         | 721                                                                                     | 381                                      |

**Fig. 3.** Geometric structures of the straight-fin heat sink.**Table 2**

Optimization factors along with their symbols, units, and corresponding levels.

| Factors                      | Symbols  | Units              | Levels |       |     |
|------------------------------|----------|--------------------|--------|-------|-----|
| A: Fin length                | $l$      | mm                 | −1     | 0     | +1  |
| B: Fin height                | $h$      | mm                 | 75     | 112.5 | 150 |
| C: Fin thickness             | $t$      | mm                 | 15     | 22.5  | 30  |
| D: Fin spacing               | $s$      | mm                 | 0.1    | 0.3   | 0.5 |
| E: Coolant flow rate         | $Q$      | lpm                | 1      | 3     | 5   |
| F: Coolant inlet temperature | $T_{in}$ | $^{\circ}\text{C}$ | 2      | 5     | 8   |
|                              |          |                    | 20     | 30    | 40  |

temperature by 6.5 % owing to its superior thermal conductivity. Despite these advancements, experimental studies in this field remain limited, primarily focusing on operating conditions, coolant selection, and heat dissipation enhancement. Shrigondekar et al. [43] systematically analyzed the thermal performance of SPIC in a 1U server using dielectric fluids (PAO-6 and FC-40), highlighting the significant

influence of system parameters such as inlet/outlet configuration, fin pitch, fluid bypass, and viscosity-driven flow characteristics on heat transfer efficiency.

While several studies have investigated the performance of SPIC systems, the current body of literature remains limited, particularly in addressing the escalating thermal demands of modern data center hardware driven by rapid advances in AI and HPC. Most existing studies have primarily focused on low- to medium-TDP (Thermal Design Power) processors, with insufficient attention paid to high-TDP scenarios, which pose more severe thermal management challenges [27]. Moreover, due to the high cost and complexity of experimental setups, numerical simulations have emerged as a viable alternative for early-stage design and optimization of SPIC systems [44]. However, conventional heat sink designs, originally developed for air-cooled or indirect liquid cooling applications, have not been systematically re-evaluated for immersion environments, where the thermophysical behavior of dielectric fluids imposes unique design constraints [45]. In particular, the role of fin



**Table 3**

BBD matrix and corresponding results obtained from numerical simulations.

| Test No. | Factors             |                     |                     |                     |                      |                                  | Responses                       |                                             |                                                    |                                           |
|----------|---------------------|---------------------|---------------------|---------------------|----------------------|----------------------------------|---------------------------------|---------------------------------------------|----------------------------------------------------|-------------------------------------------|
|          | A: <i>l</i><br>[mm] | B: <i>h</i><br>[mm] | C: <i>t</i><br>[mm] | D: <i>s</i><br>[mm] | E: <i>Q</i><br>[lpm] | F: <i>T<sub>in</sub></i><br>[°C] | Average CPU temperature<br>[°C] | Maximum CPUs<br>temperature Difference [°C] | Coolant<br>pumping power<br>× 10 <sup>-5</sup> [W] | Coolant<br>temperature<br>difference [°C] |
| 1        | 75                  | 15                  | 0.3                 | 1                   | 5                    | 30                               | 92.49                           | 3.12                                        | 19.91                                              | 7.12                                      |
| 2        | 150                 | 15                  | 0.3                 | 1                   | 5                    | 30                               | 85.7                            | 7.15                                        | 23.68                                              | 7.12                                      |
| 3        | 75                  | 30                  | 0.3                 | 1                   | 5                    | 30                               | 102.6                           | 7.6                                         | 35.29                                              | 7.12                                      |
| 4        | 150                 | 30                  | 0.3                 | 1                   | 5                    | 30                               | 107.68                          | 15.22                                       | 40.38                                              | 7.12                                      |
| 5        | 75                  | 15                  | 0.3                 | 5                   | 5                    | 30                               | 81.75                           | 6.27                                        | 17.44                                              | 7.12                                      |
| 6        | 150                 | 15                  | 0.3                 | 5                   | 5                    | 30                               | 76.7                            | 11.01                                       | 20.9                                               | 7.12                                      |
| 7        | 75                  | 30                  | 0.3                 | 5                   | 5                    | 30                               | 73.57                           | 7.55                                        | 26.03                                              | 7.12                                      |
| 8        | 150                 | 30                  | 0.3                 | 5                   | 5                    | 30                               | 66.32                           | 10.53                                       | 32.88                                              | 7.12                                      |
| 9        | 112.5               | 15                  | 0.1                 | 3                   | 2                    | 30                               | 119.78                          | 15.61                                       | 2.59                                               | 17.84                                     |
| 10       | 112.5               | 30                  | 0.1                 | 3                   | 2                    | 30                               | 103.52                          | 24.01                                       | 4.51                                               | 17.84                                     |
| 11       | 112.5               | 15                  | 0.5                 | 3                   | 2                    | 30                               | 107.03                          | 14.01                                       | 2.65                                               | 17.84                                     |
| 12       | 112.5               | 30                  | 0.5                 | 3                   | 2                    | 30                               | 94.8                            | 24.52                                       | 4.6                                                | 17.84                                     |
| 13       | 112.5               | 15                  | 0.1                 | 3                   | 8                    | 30                               | 75.56                           | 4.83                                        | 63.46                                              | 4.45                                      |
| 14       | 112.5               | 30                  | 0.1                 | 3                   | 8                    | 30                               | 68.01                           | 8.28                                        | 103.78                                             | 4.37                                      |
| 15       | 112.5               | 15                  | 0.5                 | 3                   | 8                    | 30                               | 66.43                           | 4.39                                        | 64.33                                              | 4.45                                      |
| 16       | 112.5               | 30                  | 0.5                 | 3                   | 8                    | 30                               | 56.92                           | 8.84                                        | 104.01                                             | 4.45                                      |
| 17       | 112.5               | 22.5                | 0.1                 | 1                   | 5                    | 20                               | 80.37                           | 8.88                                        | 32.9                                               | 7.12                                      |
| 18       | 112.5               | 22.5                | 0.5                 | 1                   | 5                    | 20                               | 73.84                           | 8.81                                        | 32.97                                              | 7.12                                      |
| 19       | 112.5               | 22.5                | 0.1                 | 5                   | 5                    | 20                               | 70.15                           | 10.53                                       | 27.38                                              | 7.12                                      |
| 20       | 112.5               | 22.5                | 0.5                 | 5                   | 5                    | 20                               | 57.61                           | 9.01                                        | 25.87                                              | 7.12                                      |
| 21       | 112.5               | 22.5                | 0.1                 | 1                   | 5                    | 40                               | 100.39                          | 8.85                                        | 32.87                                              | 7.12                                      |
| 22       | 112.5               | 22.5                | 0.5                 | 1                   | 5                    | 40                               | 93.84                           | 8.81                                        | 32.97                                              | 7.12                                      |
| 23       | 112.5               | 22.5                | 0.1                 | 5                   | 5                    | 40                               | 90.15                           | 10.53                                       | 27.38                                              | 7.12                                      |
| 24       | 112.5               | 22.5                | 0.5                 | 5                   | 5                    | 40                               | 77.61                           | 9.01                                        | 25.87                                              | 7.12                                      |
| 25       | 75                  | 22.5                | 0.3                 | 1                   | 2                    | 30                               | 124.74                          | 13.52                                       | 3.63                                               | 17.84                                     |
| 26       | 150                 | 22.5                | 0.3                 | 1                   | 2                    | 30                               | 113.47                          | 20.78                                       | 4.49                                               | 17.84                                     |
| 27       | 75                  | 22.5                | 0.3                 | 5                   | 2                    | 30                               | 94.41                           | 15.84                                       | 2.95                                               | 17.84                                     |
| 28       | 150                 | 22.5                | 0.3                 | 5                   | 2                    | 30                               | 89.53                           | 21.61                                       | 3.83                                               | 17.84                                     |
| 29       | 75                  | 22.5                | 0.3                 | 1                   | 8                    | 30                               | 72.68                           | 4.38                                        | 87.27                                              | 4.45                                      |
| 30       | 150                 | 22.5                | 0.3                 | 1                   | 8                    | 30                               | 73.83                           | 8.24                                        | 101.78                                             | 4.45                                      |
| 31       | 75                  | 22.5                | 0.3                 | 5                   | 8                    | 30                               | 70.74                           | 5.1                                         | 68.09                                              | 4.45                                      |
| 32       | 150                 | 22.5                | 0.3                 | 5                   | 8                    | 30                               | 63.31                           | 7.62                                        | 84.38                                              | 4.45                                      |
| 33       | 112.5               | 15                  | 0.3                 | 3                   | 2                    | 20                               | 100.06                          | 14.49                                       | 2.58                                               | 17.84                                     |
| 34       | 112.5               | 30                  | 0.3                 | 3                   | 2                    | 20                               | 86.53                           | 23.76                                       | 4.41                                               | 17.84                                     |
| 35       | 112.5               | 15                  | 0.3                 | 3                   | 8                    | 20                               | 58.45                           | 4.57                                        | 62.98                                              | 4.45                                      |
| 36       | 112.5               | 30                  | 0.3                 | 3                   | 8                    | 20                               | 49.56                           | 8.62                                        | 100.1                                              | 4.45                                      |
| 37       | 112.5               | 15                  | 0.3                 | 3                   | 2                    | 40                               | 120.06                          | 14.49                                       | 2.58                                               | 17.84                                     |
| 38       | 112.5               | 30                  | 0.3                 | 3                   | 2                    | 40                               | 106.53                          | 23.76                                       | 4.41                                               | 17.84                                     |
| 39       | 112.5               | 15                  | 0.3                 | 3                   | 8                    | 40                               | 78.45                           | 4.57                                        | 62.98                                              | 4.45                                      |
| 40       | 112.5               | 30                  | 0.3                 | 3                   | 8                    | 40                               | 69.56                           | 8.62                                        | 100.1                                              | 4.45                                      |
| 41       | 75                  | 22.5                | 0.1                 | 3                   | 5                    | 20                               | 72.63                           | 7.42                                        | 26.66                                              | 7.12                                      |
| 42       | 150                 | 22.5                | 0.1                 | 3                   | 5                    | 20                               | 69.51                           | 13.29                                       | 32.61                                              | 7.12                                      |
| 43       | 75                  | 22.5                | 0.5                 | 3                   | 5                    | 20                               | 57.92                           | 7.4                                         | 27.3                                               | 7.12                                      |
| 44       | 150                 | 22.5                | 0.5                 | 3                   | 5                    | 20                               | 58.95                           | 12.25                                       | 33.4                                               | 7.12                                      |
| 45       | 75                  | 22.5                | 0.1                 | 3                   | 5                    | 40                               | 92.63                           | 7.42                                        | 26.67                                              | 7.12                                      |
| 46       | 150                 | 22.5                | 0.1                 | 3                   | 5                    | 40                               | 89.51                           | 13.29                                       | 32.61                                              | 7.12                                      |
| 47       | 75                  | 22.5                | 0.5                 | 3                   | 5                    | 40                               | 77.93                           | 7.39                                        | 27.29                                              | 7.12                                      |
| 48       | 150                 | 22.5                | 0.5                 | 3                   | 5                    | 40                               | 78.95                           | 12.25                                       | 33.4                                               | 7.12                                      |
| 49       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |
| 50       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |
| 51       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |
| 52       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |
| 53       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |
| 54       | 112.5               | 22.5                | 0.3                 | 3                   | 5                    | 30                               | 78.65                           | 10.19                                       | 30.15                                              | 7.12                                      |

geometry in immersion cooling has received limited attention, despite its critical impact on heat transfer efficiency.

The primary novelty of this study lies in addressing this significant gap through a comprehensive and systematic numerical investigation focused on the geometric and operational optimization of heat sinks specifically tailored for SPIC applications. Key geometric parameters, including fin length, fin height, fin thickness, and fin spacing, are evaluated alongside operational variables such as coolant flow rate and inlet temperature, using FC-40 as the working fluid. The performance is assessed based on four key metrics: average CPUs temperature, maximum CPUs temperature difference, coolant temperature rise, and pumping power. To ensure practical relevance, the optimized design is further tested across a wide range of TDP values (200 to 800 W) to

demonstrate scalability. Additionally, the model's adaptability is validated with multiple dielectric fluids. Finally, empirical correlations are proposed for predicting the thermal behavior of major heat-generating components (CPUs and DIMMs), offering valuable guidelines for the design and thermal management of SPIC systems in next-generation data centers.

## 2. Research implementation

### 2.1. Rack server structure and model configuration

A 1U rack server consists of multiple components, each generating varying amounts of heat and collectively influencing the overall thermal

**Table 4**

Typical specifications and thermophysical properties of FC-40 within the operating temperature range of 0–100 °C [56].

| Typical specifications      | Unit                 |                                                                                                                                                      |           |
|-----------------------------|----------------------|------------------------------------------------------------------------------------------------------------------------------------------------------|-----------|
| Appearance                  | –                    | Clear and colorless                                                                                                                                  |           |
| Average molecular weight    | g/mol                | 650                                                                                                                                                  |           |
| Boiling point at 1 atm      | °C                   | 165                                                                                                                                                  |           |
| Pour point                  | °C                   | –57                                                                                                                                                  |           |
| Vaper pressure              | Pa                   | 287                                                                                                                                                  |           |
| Latent heat of vaporization | J/g                  | 69                                                                                                                                                   |           |
| Coefficient of expansion    | 1/°C                 | 0.0012                                                                                                                                               |           |
| Surface tension             | Dynes/cm             | 16                                                                                                                                                   |           |
| Ozone depletion potential   | –                    | 0                                                                                                                                                    |           |
| Refractive index            | –                    | 1.29                                                                                                                                                 |           |
| Thermophysical properties   | Unit                 | Correlation                                                                                                                                          | Deviation |
| Thermal conductivity        | W/m <sup>2</sup> .°C | $\lambda = 6.5458 \times 10^{-2} - (6.3265 \times 10^{-5} T) + (1.7444 \times 10^{-8} T^2)$                                                          | 0.61 %    |
| Specific heat capacity      | J/kg.°C              | $c_p = 1013.9205 + (1.9935 T) - (3.1064 \times 10^{-3} T^2)$                                                                                         | 0.35 %    |
| Density                     | Kg/m <sup>3</sup>    | $\rho = 1897.4313 - (2.1733 T) + (2.5098 \times 10^{-4} T^2)$                                                                                        | 0.11 %    |
| Dynamic viscosity           | Pa.s                 | $\mu = 7.4417 \times 10^{-3} - (2.0621 \times 10^{-4} T) + (2.9595 \times 10^{-6} T^2) - (2.2672 \times 10^{-8} T^3) + (7.1023 \times 10^{-11} T^4)$ | 0.85 %    |

characteristics of the system [46]. Among these components, CPUs and GPUs are the primary sources of heat generation, particularly in servers designed for AI or HPC applications. This is largely because these units account for a significant portion of the overall power consumption in such systems. Consequently, the thermal management of CPUs and GPUs poses one of the most critical challenges in DS server cooling. In GPU-free servers, CPUs alone can consume over half of the total power, highlighting the urgent need for effective cooling [47]. Accordingly, a substantial body of research has focused on CPU thermal management, as existing literature indicates that the thermal influence of other


components on immersion cooling performance is comparatively minor [44]. Additionally, survey data indicate that the majority of DC servers (over 62.6 %) employ a dual-processor configuration [48]. In alignment with these findings, the present study focuses on the thermal management of processors in a rack server equipped with two CPUs.

The physical model employed in this study is based on a third-generation server configuration, featuring two Intel Xeon microprocessors [49]. Each CPU is surrounded by two dual inline memory module (DIMM) blocks, with each block containing six DIMMs, as illustrated in Fig. 1. The model configuration, developed using ANSYS Design-Modeler, is illustrated in Fig. 2, while its technical specifications are provided in Table 1. The computational domain dimensions are 600 mm (length, z-axis) × 42.5 mm (height, y-axis) × 260 mm (width, x-axis). A similar server model was previously investigated by Chhetri et al. [50]; however, in their study, the DIMMs were simplified as a single block and assumed to be non-heat-generating components.

## 2.2. Heat sink designs and coolant characteristics

In the physical model considered in this study, heat sinks are required only for the CPUs, as they generate high power and have a comparatively limited surface area for heat dissipation. The heat sink design under investigation incorporates straight fins, with key geometric parameters optimized to enhance the thermal management of DC servers utilizing SPIC. The optimization process targets four primary geometric parameters: fin length ( $l$ ), fin height ( $h$ ), fin thickness ( $t$ ), and fin spacing ( $s$ ), as illustrated in Fig. 3. In addition to these design parameters, two operating conditions are also considered: coolant flow rate ( $Q$ ) and the coolant inlet temperature ( $T_{in}$ ). These factors are incorporated into the analysis to achieve a comprehensive and effective thermal management strategy.

Previous experimental investigations [51] and numerical studies [52] have shown that matching the height of the heat sink fins to the cabinet height, thereby eliminating the gap between the server and the cabinet's upper wall, enhances coolant flow through the heat sink channels and prevents bypass effects. This improvement reduces thermal resistance, resulting in more effective cooling of the components. However, to explore the interaction between fin height and other design parameters, this study treats fin height as a variable geometric factor.

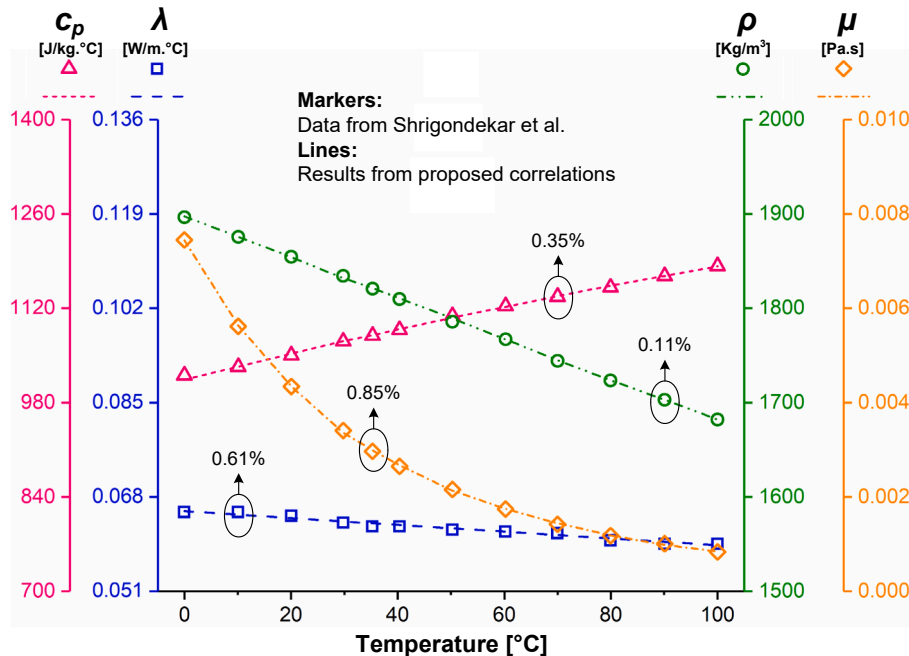

**Fig. 4.** Accuracy of FC-40 thermophysical property predictions using the proposed correlations.

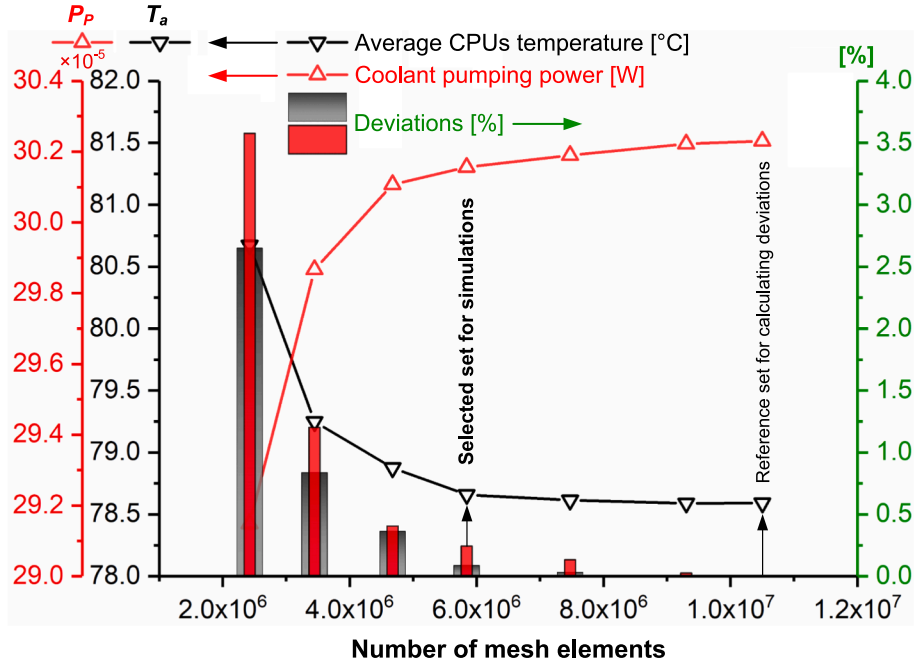


Fig. 5. Variation of average CPUs temperature and coolant pressure drop with the number of mesh elements.

To optimize these factors, the response surface methodology (RSM) is employed. Among the various RSM approaches, Central Composite Design (CCD) and Box-Behnken Design (BBD) are among the most commonly used methods [53]. In this study, as shown in Table 2, all geometric parameters and operating conditions are treated as independent variables to enable a comprehensive evaluation. As a result, a large number of simulations would typically be required. However, the BBD method offers a notable advantage by substantially reducing computational demands, as it requires fewer simulations while still accurately assessing the effects of independent variables on the responses and revealing their interactions [54]. Its reliability and effectiveness have been demonstrated in previous research, with extensive documentation available in the literature [55]. In this study, a total of 54 simulations are performed to analyze key response variables such as the average CPU temperature and coolant pressure drop, as outlined in Table 3.

A quadratic polynomial model is formulated using RSM to characterize how each response variable is influenced by the selected independent variables:

$$Y = \beta_0 + \sum_{i=1}^k \beta_i X_i + \sum_{i=1}^k \beta_{ii} X_i^2 + \sum_{i=1}^k \sum_{j=1}^k \beta_{ij} X_i X_j + \varepsilon \quad (1)$$

where  $Y$  denotes the response,  $\beta_0$  is the intercept or model constant,  $\beta_i$  are the linear coefficients,  $\beta_{ii}$  are the quadratic coefficients, and  $\beta_{ij}$  represent the interaction coefficients. The terms  $X_i$  and  $X_j$  are the independent variables, and  $\varepsilon$  accounts for the random error.

In SPIC systems, dielectric fluids with high boiling points are commonly used to maintain the coolant temperature below the evaporation threshold throughout the cooling process. In this study, FC-40, a thermally stable, fully fluorinated liquid with a boiling point of 165 °C, is employed [56]. Despite its relatively low thermal conductivity, this fluid enhances thermal convection due to its lower viscosity compared to commonly used alternatives [57]. The superior performance of this fluorinated liquid, relative to dielectric oils such as PAO-6, has been demonstrated by Shrigondekar et al. [43]. To estimate the thermo-physical properties of FC-40, the correlations presented in Table 4 are developed based on their experimental data. These correlations are valid within the temperature range of 0–100 °C, which fully encompasses the operational temperature range of the coolant in this study. As illustrated

in Fig. 4, the proposed correlations demonstrate improved predictive accuracy for the measured values compared to those developed by Wang et al. [58] using linear regression analysis.

### 2.3. Governing equations and boundary conditions

To streamline the simulation process while ensuring a realistic representation of actual operating conditions, the following assumptions are adopted in the development of the present SPIC model:

- The 3D model focuses primarily on CPUs cooling; therefore, only adjacent DIMMs are included. Components such as the platform controller hub (PCH) and power supply unit (PSU) are omitted due to their downstream placement, low TDP, and greater distance from the CPUs, which according to existing literature [59], result in minimal impact on heat transfer.
- The CPUs and DIMMs are modeled as uniform heat sources.
- The solid components are assumed to have constant physical properties throughout the analysis.
- FC-40 is modeled as a Newtonian fluid.
- The effect of gravity acts in the direction opposite to the coolant flow.
- Due to the inherently complex and turbulent nature of the internal flow, it is modeled as turbulence [24].
- The Boussinesq approximation is used to link Reynolds stresses with mean velocity gradients by introducing an effective turbulent viscosity [37].
- Due to the low Brinkman number, viscous dissipation is considered negligible [52].
- Heat loss to the environment via free convection and radiation is neglected.

Based on these assumptions, the Reynolds averaged Navier-Stokes and energy equations used to model FC-40 flow and heat transfer in the server cooling process via single-phase immersion are expressed as follows [60]:

o Continuity equation:

$$\nabla \cdot (\rho \vec{u}) = 0 \quad (2)$$

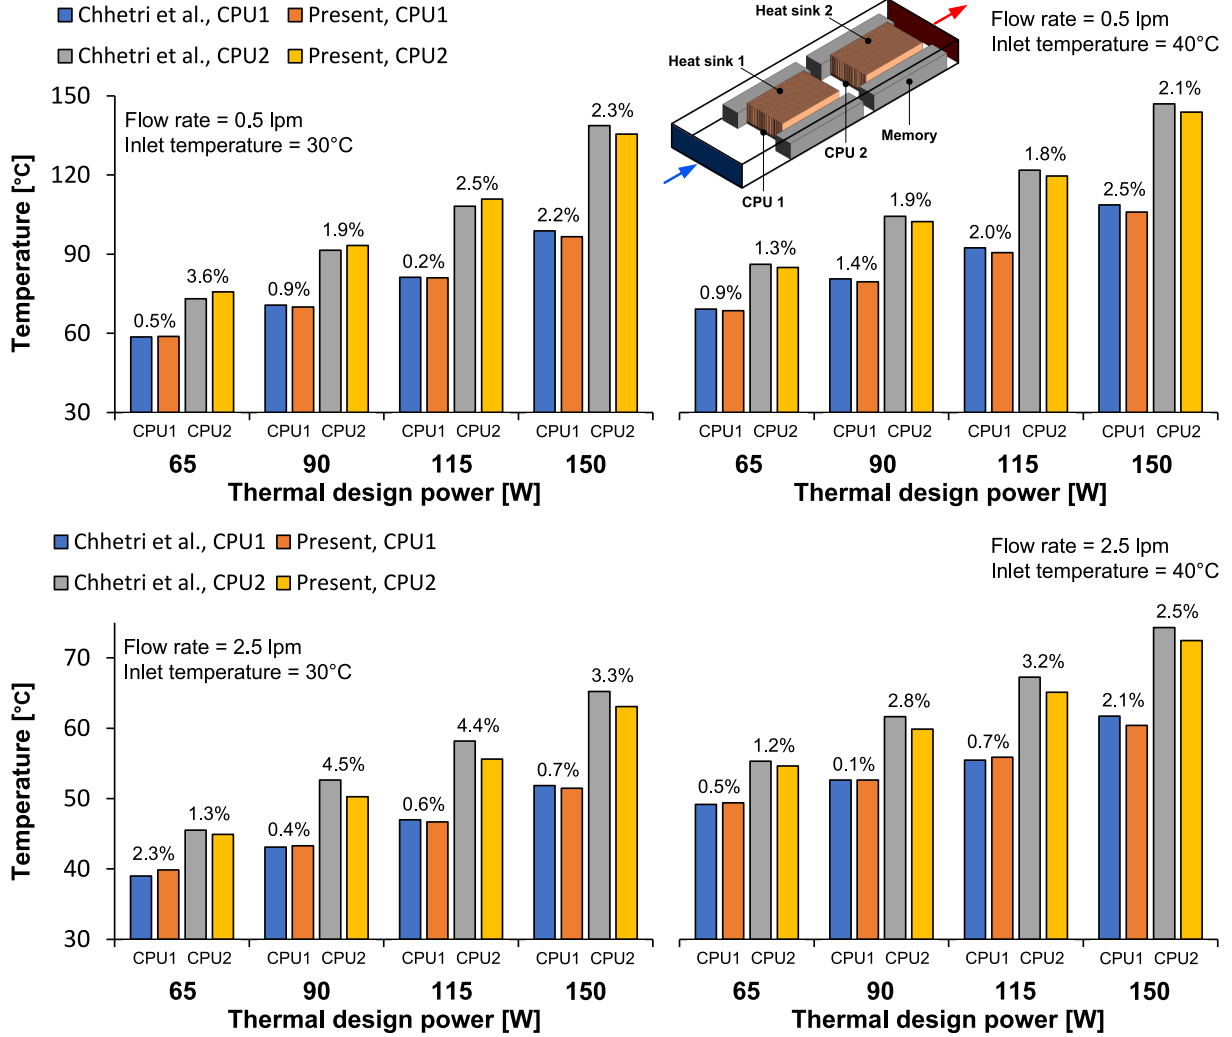


Fig. 6. Physical model used for validation and comparison of results.

o Momentum equations:

$$\nabla \cdot (\rho \vec{u} \vec{u}) = -\nabla p + (\mu + \mu_t) \nabla^2 \vec{u} \quad (3)$$

o Energy equation (for the coolant domain):

$$\nabla \cdot (\lambda \nabla T) = \nabla \cdot (\rho c_p \vec{u} \cdot T) \quad (4)$$

where  $u$ ,  $p$ , and  $T$  represent the coolant velocity, pressure, and temperature, respectively, while  $\mu_t$  denotes the turbulent viscosity and  $g$  signifies gravitational acceleration.

o Energy equation (for the solid domain):

$$\nabla \cdot (\lambda_s \nabla T_s) = 0 \quad (5)$$

where the subscript  $s$  refers to the solid domain, i.e., the PCB, CPUs, DIMMs, and HSs.

Compared to the standard  $k$ - $\epsilon$  model, the RNG turbulence model provides enhanced accuracy by considering eddy effects and employing analytical formulations for the turbulent Prandtl number and viscosity, particularly in low Reynolds number flows. Although the Realizable

model also delivers high accuracy, its greater computational cost and time requirements can limit its applicability. Therefore, the RNG  $k$ - $\epsilon$  model is selected in this study to simulate turbulent flow, as it provides an optimal balance between accuracy and computational efficiency [61]. The corresponding equations are presented below:

o  $k$ -equation:

$$\frac{\partial(\rho k)}{\partial t} + \frac{\partial(\rho k u_i)}{\partial x_i} = \frac{\partial}{\partial x_j} \left( \alpha_k \mu_{eff} \frac{\partial k}{\partial x_j} \right) + G_k + G_b + \rho \epsilon \quad (6)$$

where  $\alpha_k$  is the turbulent Prandtl number,  $\mu_{eff}$  indicates the effective kinetic viscosity coefficient, and  $G_k$  and  $G_b$  represent the source terms for turbulent kinetic energy.

o  $\epsilon$ -equation:

$$\frac{\partial(\rho \epsilon)}{\partial t} + \frac{\partial(\rho \epsilon u_i)}{\partial x_i} = \frac{\partial}{\partial x_j} \left( \alpha_\epsilon \mu_{eff} \frac{\partial \epsilon}{\partial x_j} \right) + C_{1\epsilon} \frac{\epsilon}{k} (G_k + C_{3\epsilon} G_b) - C_{2\epsilon} \rho \frac{\epsilon^2}{k} - R_\epsilon \quad (7)$$

where  $\alpha_\epsilon$  is the turbulent Prandtl number;  $C_{1\epsilon}$ ,  $C_{2\epsilon}$ , and  $C_{3\epsilon}$  are model constants, and the correction factor (denoted as  $R_\epsilon$ ) is defined as follows:

$$R_\epsilon = \frac{C_\mu \rho \eta^3 (1 - \eta/\eta_0) \epsilon^3}{1 + \beta \eta^3} \frac{\epsilon^3}{k} \quad (8)$$

where  $\eta$  is the expansion parameter (the ratio of the turbulent to mean



**Table 5**

Description of the evaluation metrics.

| Index        | Average CPUs temperature ( $T_a$ )                                                                                            | Maximum CPUs temperature difference ( $\Delta T_m$ )                                                      | Coolant pumping power ( $P_p$ )                                                                           | Coolant temperature difference ( $\Delta T_c$ )                                                         |
|--------------|-------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------|
| Significance | A critical indicator of thermal performance, directly influencing system reliability, operational stability, and CPU lifespan | An essential metric for assessing the uniformity of heat distribution across CPUs                         | A key parameter influencing the total energy consumption and overall thermal management system efficiency | A vital factor for representing the thermal energy required to restore the coolant to its initial state |
| Feature      | Represents the arithmetic mean of the CPUs temperatures                                                                       | Quantifies the largest observed temperature disparity between CPUs                                        | Represents the mechanical power required to circulate the coolant through the cooling loop                | Defines the temperature difference between the coolant's outlet and inlet                               |
| Formula      | $T_a = (T_{CPU1} + T_{CPU2})/2$                                                                                               | $\Delta T_m = (T_{max} + T_{min})/2$                                                                      | $P_p = V \times \Delta p$                                                                                 | $\Delta T_c = T_{out} - T_{in}$                                                                         |
| Objective    | Maintaining $T_a$ below 60 °C to ensure efficient heat dissipation and avoid performance degradation or thermal stress        | Minimizing $\Delta T_m$ (below 5 °C) to promote uniform thermal conditions and enhance system reliability | Minimizing $P_p$ (less than 5 % of total system power) to reduce energy consumption                       | Minimizing $\Delta T_c$ (preferably less than 5 °C) to reduce coolant restoration energy                |

strain time scales), and  $C_\mu$ ,  $\eta_0$ , and  $\beta$  are model constants.

The inlet boundary of the immersion cooling chamber is defined by a specified inlet velocity at a constant temperature, while the outlet boundary is set as a pressure outlet. The CPU and DIMM components are modeled as volumetric heat sources. The liquid–solid interface is treated using a coupled boundary condition, and non-slip conditions are imposed on all solid surfaces. Furthermore, the external surfaces of the server frame are considered adiabatic.

#### 2.4. Solution approach

The governing equations, along with the assigned boundary conditions, are solved iteratively using a pressure-based, double-precision solver within the ANSYS Fluent package (version 2021R2), employing the finite volume method. To handle the pressure–velocity coupling, the pressure correction method based on the SIMPLE algorithm is employed. For the spatial discretization of the computational domain, the pressure term is discretized using a second-order scheme, while the momentum, energy, turbulent kinetic energy, and turbulent dissipation rate equations are discretized using the second-order upwind method. To ensure numerical stability and facilitate convergence, relaxation factors are set as follows: 0.3 for pressure, 1.0 for density, 0.7 for momentum, 0.8 for turbulent kinetic energy, 0.8 for turbulent dissipation rate, 1.0 for turbulent viscosity, and 1.0 for energy. In addition, the iterative solution is initially tested with a residual threshold of  $10^{-4}$  for all variables and gradually refined down to  $10^{-8}$ . The results indicated that reducing the residual below  $10^{-6}$  led to negligible changes (less than 0.02 %) in key output parameters such as the average CPUs temperature and coolant pumping power. Therefore, to balance computational efficiency with solution accuracy, a residual value of  $10^{-6}$  is adopted for all variables.

### 3. Grid independence analysis and model validation

In this study, ANSYS Meshing is employed to generate the computational grid. The typical mesh configuration consists of structured hexahedral cells in the solid domain and unstructured tetrahedral cells in the fluid domain. To accelerate convergence, reduce computational cost, and maintain solution accuracy, the fluid domain mesh is subsequently converted into a polyhedral mesh using ANSYS Fluent's polyhedral meshing strategy. To assess the impact of grid density on simulation outcomes and ensure grid independence of the results, several grid configurations with varying numbers of elements are analyzed. This investigation is conducted using a model with mid-level geometric parameters ( $l = 112.5$  mm,  $h = 22.5$  mm,  $t = 0.3$  mm, and  $s = 3$  mm) and operating conditions ( $Q = 5$  lpm and  $T_{in} = 30$  °C). As shown in Fig. 5, when the total number of elements exceeds 5.843 million, variations in both the average CPUs temperature and coolant pumping power become negligible. Specifically, increasing the mesh density from 5.843 million to 7.474 million elements results in changes of less than 0.06 % (equivalent to 0.21 °C) in the average CPU temperature and less than 0.11 % in the coolant pumping power. Even when the mesh density is nearly doubled to 10.5 million elements, the variations in these parameters remain minimal, specifically, 0.08 % for the average CPU temperature and 0.24 % for coolant pumping power. Based on these observations, all subsequent simulations are conducted using mesh densities within this validated range to ensure the reliability and accuracy of the numerical results.

To validate the present model and the adopted numerical method, the study conducted by Chhetri et al. [50], which has been extensively used by other researchers [62,63] for validation purposes, was employed as a reference. As depicted in Fig. 6, their investigation focused on SPIC of a server equipped with two CPUs, each operating under different TDP levels (65, 90, 115, and 150 W). Cooling was conducted using EC-110, with inlet temperatures ranging from 25 to 40 °C and flow rates varying between 0.5 and 2.5 lpm. A comparative analysis was performed considering the minimum and maximum coolant flow rates at two different inlet temperatures for each TDP level. The results are summarized in Fig. 6. The findings indicate that, under the specified comparison conditions, the deviation between CPU temperatures predicted by the present model and those reported in the reference study ranges from 0.1 % to 4.5 %. These discrepancies can be attributed to the assumptions made and the differing approaches to computational domain discretization employed in each study. Nevertheless, the relatively low deviation values confirm that the present model is reliable and can be confidently used to predict heat transfer behavior in SPIC systems.

### 4. Results and discussion

To assess the impact of geometric parameters ( $l$ ,  $h$ ,  $t$ , and  $s$ ) and operating conditions ( $Q$  and  $T_{in}$ ) on the thermal management of DC servers utilizing SPIC, four key evaluation indices are considered: (1) the average temperature of CPUs ( $T_a$ ), (2) the maximum temperature difference among CPUs ( $\Delta T_m$ ), (3) the power consumption required for coolant pumping ( $P_p$ ), and (4) the coolant temperature difference between outlet and inlet ( $\Delta T_c$ ). A detailed explanation of these evaluation indices is provided in Table 5. Based on these criteria, the following sections present a comprehensive analysis of the results. The effects of design and operational variables on thermal and hydraulic responses are examined, and the optimal configuration for simultaneously achieving the desired performance objectives is identified.

#### 4.1. Optimization results

An analysis of variance (ANOVA) is conducted for the response variables:  $T_a$ ,  $\Delta T_m$ ,  $P_p$ , and  $\Delta T_c$ . The results are provided in Appendix A and organized as Tables A-1 through A-4. These tables assess the

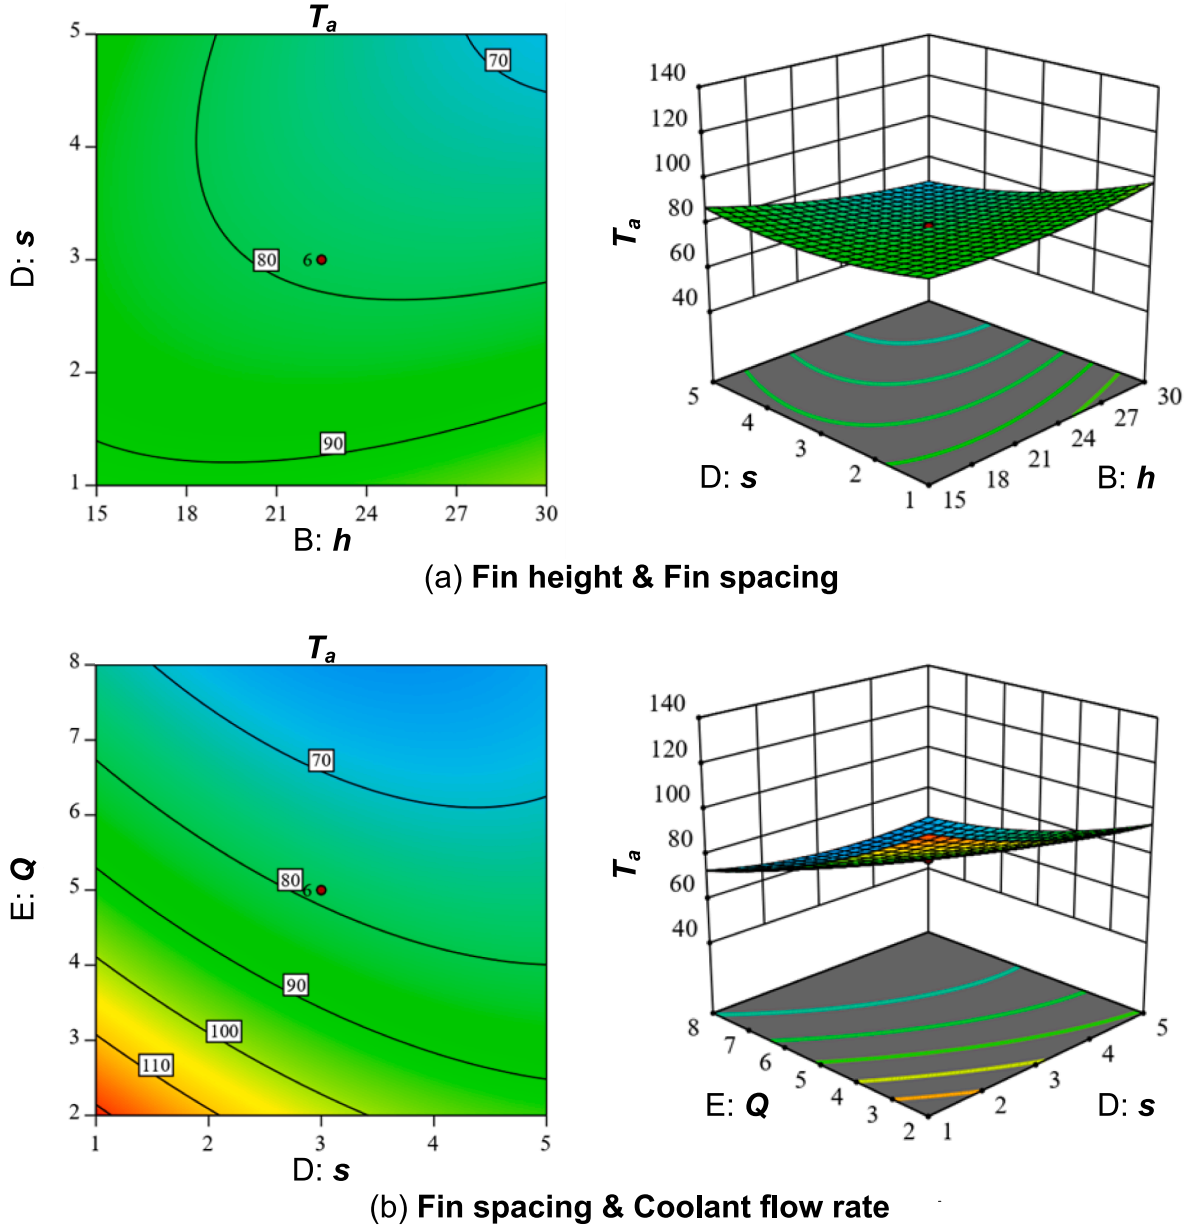


Fig. 7. Interaction effects on average CPUs temperature: (a) fin height and fin spacing. (b) Fin spacing and coolant flow rate.

significance of the model and the strength of interaction for each independent variable using key statistical indicators, including the p-value and F-value. The p-value serves as the primary criterion for assessing the significance of individual parameters, their interactions, and the model's overall validity. When the p-value is below the 0.05 significance level, it indicates that the associated model term has a statistically significant impact on the response variable. Conversely, p-values greater than 0.1 suggest that the term is not statistically significant and does not meaningfully contribute to the model. Additionally, a higher F-value indicates a greater degree of significance for the associated model term.

Among the independent parameters evaluated,  $Q$  exhibits the most significant influence on both the thermal and hydraulic performance of the immersion cooling system. The sensitivity analysis reveals the following order of influence on  $T_a$ :  $Q > T_{in} > s > t > h > l$ , indicating that the operating parameters of FC-40 as the coolant, particularly  $Q$ , play a more critical role than geometric parameters of HSs in governing overall cooling efficiency. For  $\Delta T_m$ , the order of influence is:  $Q > h > l > s > t > T_{in}$ . This emphasizes the key role of  $Q$  in achieving thermal uniformity across both CPUs. Enhancing  $Q$  in conjunction with optimized HS

geometries contributes to a more uniform temperature distribution and improved system reliability. In terms of  $P_p$ , the ranking is:  $Q > h > s > l > t > T_{in}$ , again highlighting  $Q$  as the primary contributor to hydraulic performance and energy consumption. Finally, for  $\Delta T_c$ , the order of influence is:  $Q > t > h > l > s > T_{in}$ , further confirming the dominant role of  $Q$  in both primary and secondary energy metrics. The final quadratic regression equations, which describe the influence of the independent variables on  $T_a$ ,  $\Delta T_m$ ,  $P_p$ , and  $\Delta T_c$  in relation to the design parameters, are summarized in Appendix B as Eqs. B-1 through B-4. These equations effectively capture the system's behavior across the actual levels of the evaluated factors, demonstrating a strong fit to the simulations results.

As illustrated in Fig. 7a, increasing both  $h$  and  $s$  results in a reduction in  $T_a$  during SPIC. The increase in  $h$  enhances the total heat transfer surface area, thereby improving convective heat transfer. This facilitates greater heat absorption from the CPUs into the surrounding fluid, leading to a noticeable decrease in their operating temperature. For instance, when  $Q$  is maintained at 2 lpm, doubling  $h$  from 15 mm to 30 mm reduces the temperature of CPU 1 from 92.8 °C to 74.6 °C, representing a 19.6 % decrease. Similarly, the temperature of CPU 2 decreases


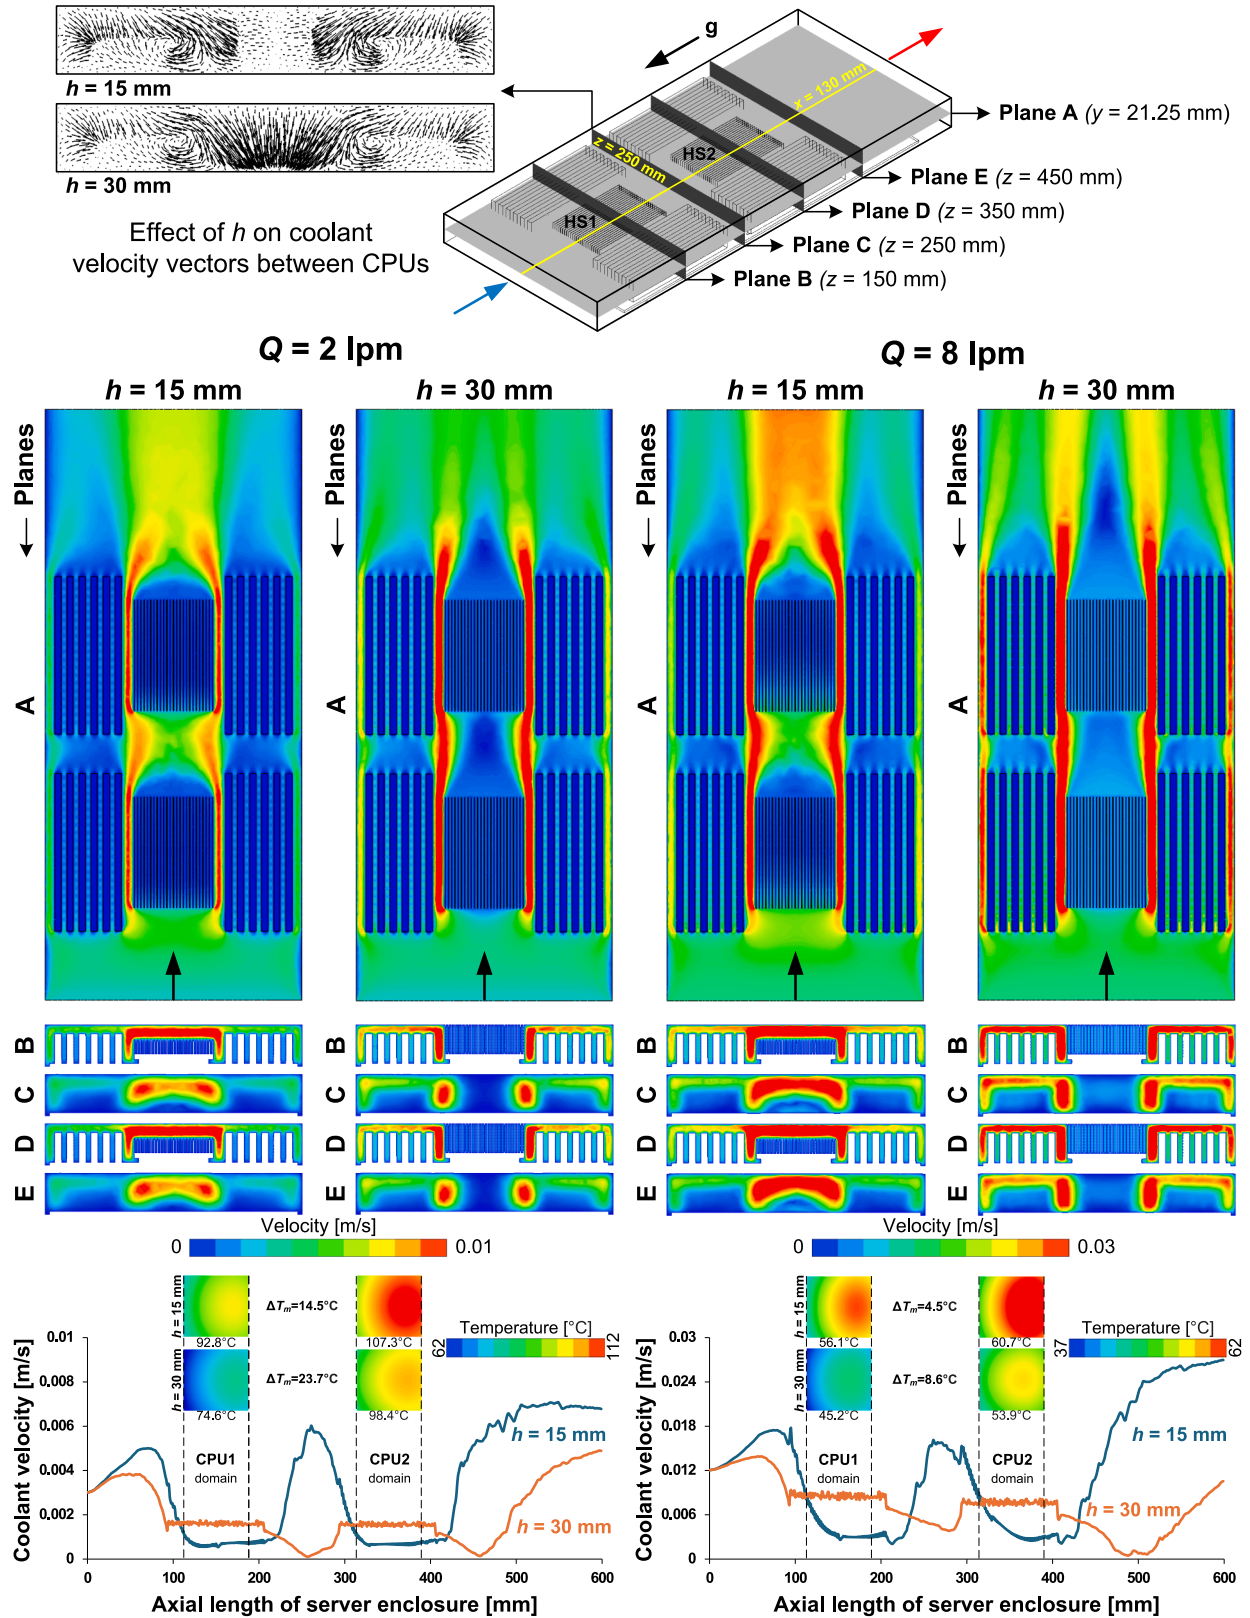


Fig. 8. Effects of fin height ( $h = 15$  and  $30$  mm) and coolant flow rate ( $Q = 2$  and  $8$  lpm) on the flow features of FC-40 within the data center server enclosure (with constant parameters:  $l = 112.5$  mm,  $t = 0.3$  mm,  $s = 3$  mm, and  $T_{in} = 20$  °C).

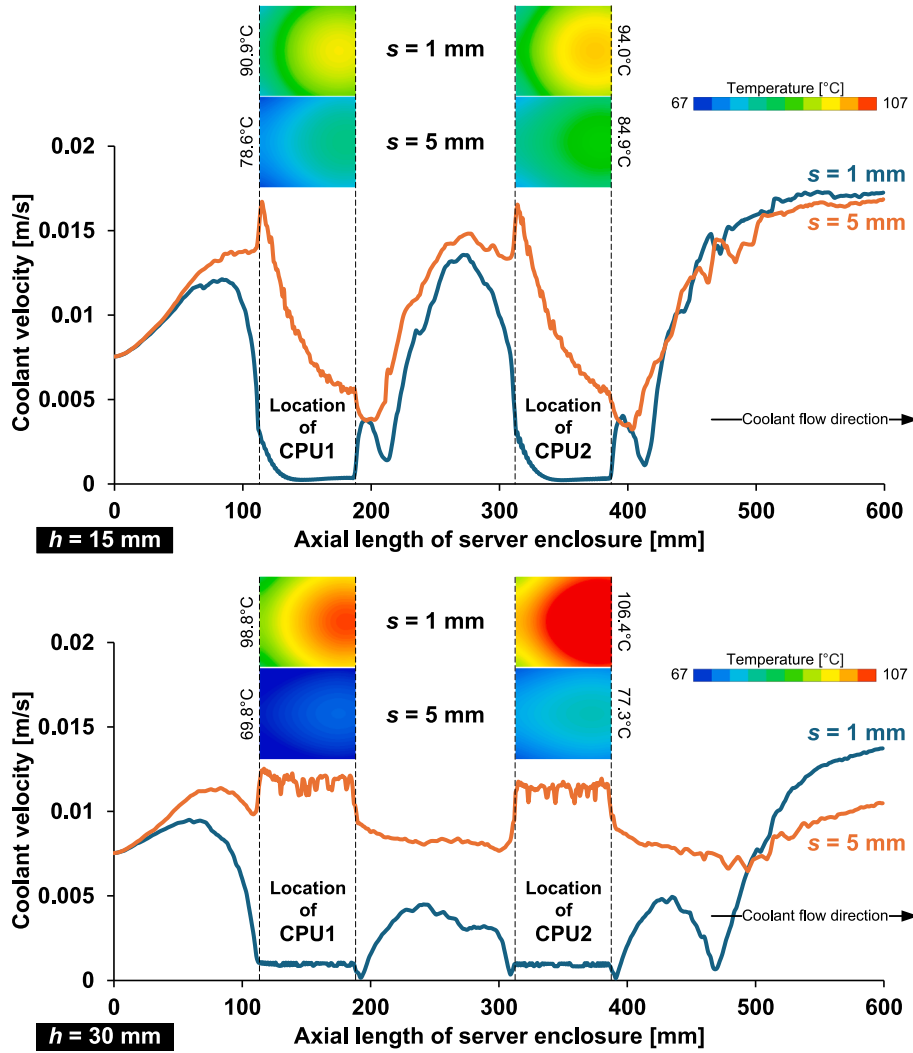

**Fig. 9.** Combined effects of fin height and fin spacing on the velocity distribution of FC-40 and the temperature profile of heat sinks within the data center server enclosure (with constant parameters:  $l = 75 \text{ mm}$ ,  $t = 0.3 \text{ mm}$ ,  $Q = 5 \text{ lpm}$ , and  $T_{in} = 30^{\circ}\text{C}$ ).


from  $107.3^{\circ}\text{C}$  to  $98.4^{\circ}\text{C}$ , corresponding to an 8.3 % reduction. However, excessively tall fins may introduce drawbacks, particularly in systems using viscous coolants like FC-40. As shown in Fig. 8, a greater  $h$  can increase flow resistance and lead to the formation of low-velocity or even stagnant regions between CPUs, especially at a low  $Q$ . As indicated by the velocity vectors, downstream of CPU 1, the elevated resistance causes a loss of coolant momentum, promoting secondary flows and formation of recirculation zones. These flow disruptions impede effective heat removal from CPU 2 and may lead to thermal stratification or the formation of localized hot spots in the second half of the server. This phenomenon significantly impacts thermal performance, as evidenced by a 63.4 % increase in  $\Delta T_m$  at  $Q = 2 \text{ lpm}$  when  $h$  is increased from 15 mm to 30 mm. Notably, this discrepancy further escalates to 91.1 % at  $Q = 8 \text{ lpm}$ , highlighting the compounded influence of  $h$  and flow dynamics on overall cooling efficiency. However, the increased obstruction of the flow path caused by taller fins enhances coolant velocity around the DIMMs, thereby improving their cooling performance. For instance, at  $Q = 2 \text{ lpm}$ , implementing 30 mm fins on the HSs results in a 12.8 % reduction in the average DIMMs temperature ( $T_d$ ). Nevertheless, in the context of server thermal management, maintaining effective CPU cooling and ensuring temperature uniformity across CPUs remains the primary concern. Moreover, taller fins lead to heavier heat sinks, which may raise manufacturing complexity and cost.

In contrast, increasing  $s$ , which simultaneously reduces the number

of fins, can partially offset the additional material usage and weight associated with taller fins. A larger  $s$  also widens the flow channels for the FC-40 coolant through the HSs, thereby reducing the risk of flow blockage and enhancing overall heat dissipation. This is achieved by facilitating better coolant access to the heated surfaces of the CPUs, thereby improving convective heat transfer. Although a smaller  $s$  can be employed at high  $Q$  due to enhanced forced convection, improper optimization of  $s$  may lead to significant drawbacks. Specifically, overly narrow spacing substantially increases pressure drop, which not only elevates  $P_p$  but also deteriorates coolant distribution. For example, at  $s = 1 \text{ mm}$  (with constant parameters:  $l = 75 \text{ mm}$ ,  $h = 22.5 \text{ mm}$ ,  $t = 0.3 \text{ mm}$ , and  $T_{in} = 30^{\circ}\text{C}$ ), increasing  $Q$  from 2 to 8 lpm can reduce  $T_a$  by 41.7 %, but it also results in a  $P_p$  rise of up to 24-fold. Therefore, an optimal configuration typically involves a medium to wide  $s$  combined with a sufficiently high  $Q$ , ensuring a balanced trade-off between heat transfer surface area and fluid mobility.

As illustrated in Fig. 9, the elevated fluid velocity in channels with a larger  $s$  improves coolant circulation, helping to suppress the development of localized hotspots on CPU surfaces. This leads to more effective and uniform thermal management across the system. Furthermore, a larger  $s$  simplifies the manufacturing process and facilitates easier maintenance operations, such as cleaning and servicing of the HSs. Fig. 7b further confirms that simultaneously increasing both  $s$  and  $Q$  results in a lower  $T_a$ . Kim et al. [52] also recommended increasing  $s$  to



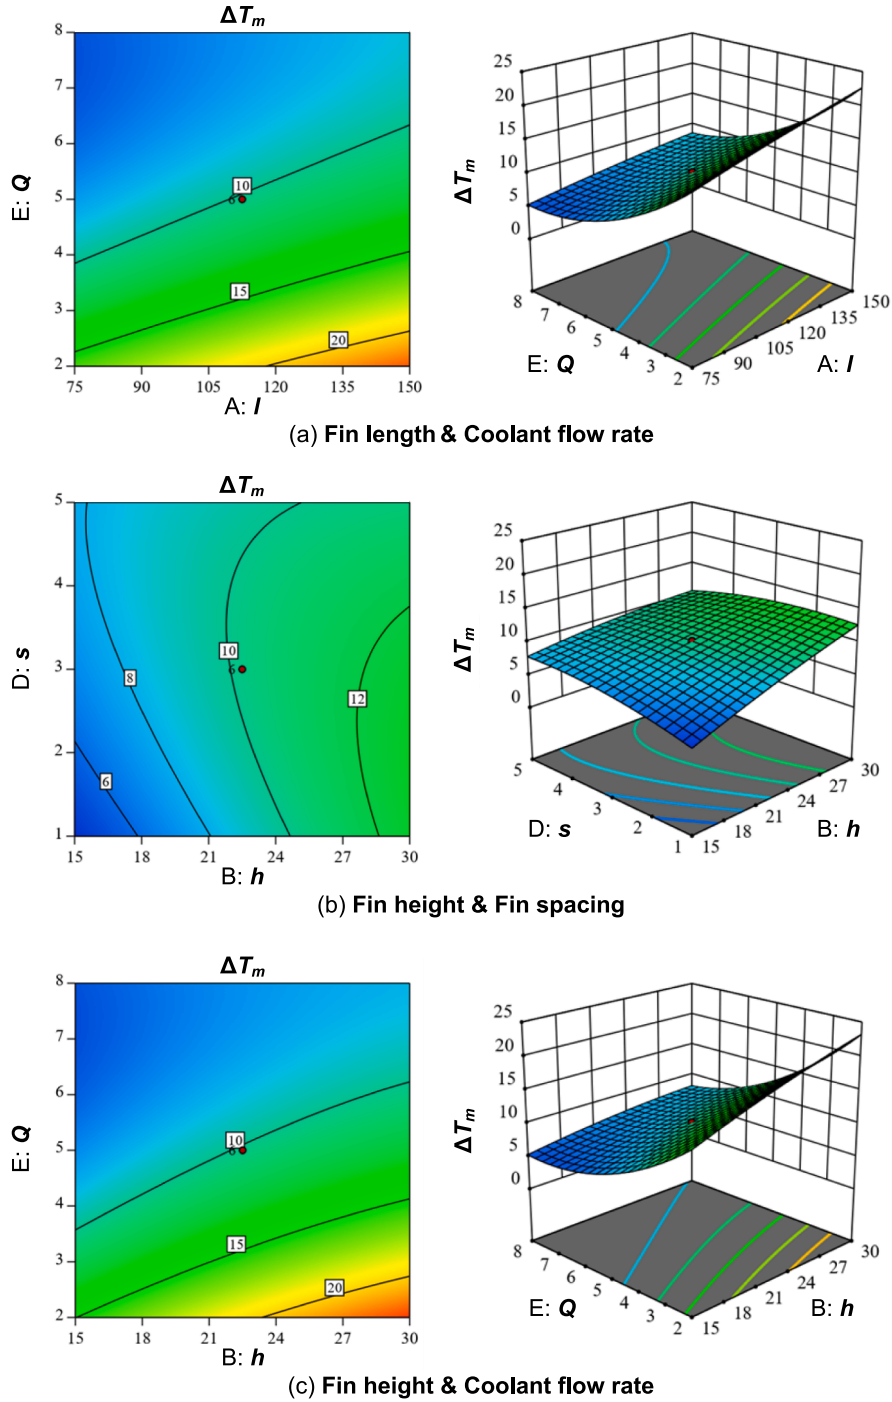


**Fig. 10.** Interaction effects on maximum CPUs temperature difference: (a) fin length and coolant flow rate. (b) Fin height and fin spacing. (c) Fin height and coolant flow rate.

facilitate the flow of high-viscosity dielectric fluids, thereby enhancing the convective heat transfer coefficient. Similarly, Wu et al. [45] found that increasing  $t$ , which directly reduces  $s$  for a fixed number of fins, does not provide significant thermal benefits beyond a thickness of 0.5 mm.

Although  $l$  has the least influence on  $T_a$  among the independent parameters, it can significantly affect  $\Delta T_m$  and  $P_p$ , and  $\Delta T_c$ . This influence is evident in the interaction between  $l$  and  $Q$ , as illustrated in Fig. 10a. The results indicate that reducing  $l$  in combination with increasing  $Q$  leads to a substantial decrease in  $\Delta T_m$ . To evaluate the effect of  $l$  on the cooling performance of the system, the variations of key parameters at the minimum and maximum levels of  $l$  and  $Q$  across the transverse plane ( $x = 130$  mm) are presented in Fig. 11. The influence of

$l$  on coolant flow characteristics within the server enclosure is clearly observable through the velocity contours. Although employing longer fins increases the heat transfer area and extends the contact time between the coolant and CPU surfaces, thereby reducing CPU temperatures, it also amplifies the temperature difference between CPU 1 and CPU 2, resulting in higher  $\Delta T_m$  values. This occurs because the first HS with a greater  $l$  absorbs more heat from CPU 1, thereby increasing the temperature of the coolant as it exits the HS. Consequently, the cooling effectiveness for CPU 2 diminishes, particularly under low  $Q$  conditions. Moreover, the effect of  $l$  on the flow pattern downstream of CPU 1 plays a crucial role in the thermal performance of CPU 2. The velocity vectors indicate that reducing  $l$  causes the streamlines to deflect more effectively



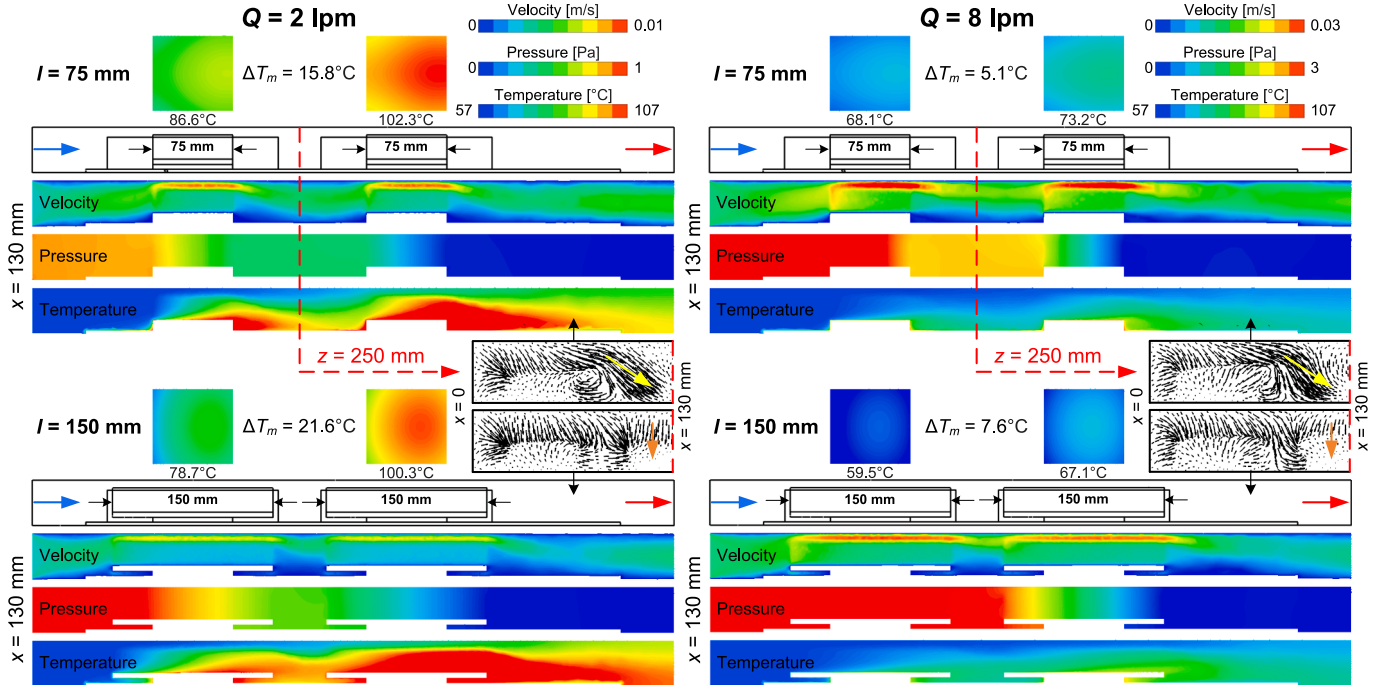

**Fig. 11.** Effects of fin length ( $l = 75$  and  $150$  mm) and coolant flow rate ( $Q = 2$  and  $8$  lpm) on the velocity, pressure, and temperature distributions of FC-40 within the data center server enclosure (with constant parameters:  $h = 22.5$  mm,  $t = 0.3$  mm,  $s = 5$  mm, and  $T_{in} = 30$  °C).

toward CPU 2. This behavior resembles jet flow, which enhances the cooling performance of CPU 2 by directing more coolant toward it.

The pressure contours confirm that longer channels increase flow resistance, resulting in a higher pressure drop and greater  $P_p$ . For instance, under the conditions examined in Fig. 11, doubling  $l$  increases  $P_p$  by 29.9 % at  $Q = 2$  lpm and by 23.9 % at  $Q = 8$  lpm. Additionally, the temperature contours indicate that HSs with longer  $l$  result in higher outlet coolant temperatures. This, in turn, elevates secondary power consumption required to restore the coolant temperature and return it to the cooling cycle. From a thermal and mechanical design perspective, increasing  $l$  also entails added weight, material usage, and overall system size, without providing a proportionate improvement in cooling performance. Therefore, considering all key performance parameters, it can be predicted that designing the HSs length to match the CPUs length may enhance cooling performance in SPIC systems.

In contrast to the interaction observed between  $h$  and  $s$  in Fig. 7a, where increasing both parameters results in lower  $T_a$  values, the findings in Fig. 10b indicate that decreasing these parameters improves temperature uniformity between CPUs and leads to a reduction in  $\Delta T_m$  values. Further evidence of enhanced uniformity with lower  $h$  values is shown in the interaction between  $h$  and  $Q$ , as depicted in Fig. 10c. This figure demonstrates that selecting the minimum  $h$  in combination with a sufficiently high  $Q$  enables the attainment of the target temperature uniformity between CPUs (i.e.,  $\Delta T_m < 5$  °C). Moreover, this configuration significantly contributes to a reduction in  $P_p$ , primarily by minimizing flow resistance due to lower obstruction and decreasing pressure drop at reduced  $Q$ . This trend is further confirmed in Fig. 12a. A similar analysis, based on Fig. 12b, can be carried out to examine the interaction between  $l$  and  $Q$ . As previously discussed,  $l$  exhibits minimal influence on  $T_a$  and has a slightly adverse effect on  $\Delta T_m$ . Consequently, selecting the minimum value of  $l$  reduces the pressure drop typically associated with longer flow paths through narrow channels, thereby enabling the application of higher  $Q$  values under a constant  $P_p$  condition. Regarding Fig. 12c, the interaction between  $s$  and  $Q$  on  $P_p$  is of a similar order of magnitude to that of the interaction between  $l$  and  $Q$ , yet it is substantially weaker than the interaction between  $h$  and  $Q$ . This observation is further supported by the F-values reported in Tables A-3, where the


interaction terms AE and DE have F-values of 25.47 and 37.47, respectively, compared to a significantly higher value of 311.37 for the interaction term BE.

The results presented in Fig. 13a indicate that a reduction in  $h$  positively impacts decreasing  $\Delta T_c$ , thereby lowering the secondary energy required to restore the coolant temperature. Furthermore, when this reduction in  $h$  is combined with an increase in  $t$ , the minimum  $\Delta T_c$  values are achieved. However, as shown in Fig. 13b, the influence of  $t$  is more pronounced at lower values of  $Q$ . As  $Q$  increases beyond 6 lpm, the effect of  $t$  on  $\Delta T_c$  diminishes, leading to a convergence in  $\Delta T_c$  values, with the lowest values being attained regardless of further increases in  $t$ .

The optimization criteria aim to minimize all response parameters listed in Table 5, namely  $T_a$ ,  $\Delta T_m$ ,  $P_p$ , and  $\Delta T_c$ , while ensuring that all independent variables remain within their specified bounds. Among the items evaluated in Table 6, Case No. 1, characterized by dimensions of  $l = 75$  mm,  $h = 15.01$  mm,  $t = 0.5$  mm,  $s = 3.06$  mm,  $Q = 6.62$  lpm, and  $T_{in} = 20.06$  °C, is identified as the optimal case. To develop a specific and practically manufacturable geometric model for the HSs, and to establish controllable operating conditions, all independent variables are rounded to appropriate levels of precision. It should be noted that due to the substantial impact of server layout on SPIC, the developed model is specifically applicable to the server configuration considered in this study. Its accuracy may be affected by changes in the arrangement of CPUs and DIMMs or by the inclusion of additional components within the server chassis. Nevertheless, the final optimized model is utilized in the following sections to investigate the effects of TDP and coolant type.

#### 4.2. Analysis under different TDP scenarios

In recent years, the rapid advancement of AI technologies along with the increasing demand for high-speed processing has significantly raised the TDP requirements of CPUs used in DC servers. Despite this upward trend, most existing research on SPIC have primarily focused on CPUs with low to medium TDP levels [27]. This section investigates the performance of the optimized heat sink model ( $l = 75$  mm,  $h = 15$  mm,  $t = 0.5$  mm, and  $s = 3$  mm) and its corresponding operating conditions ( $Q = 7$  lpm and  $T_{in} = 20$  °C) for SPIC over a broad range of TDP values, from

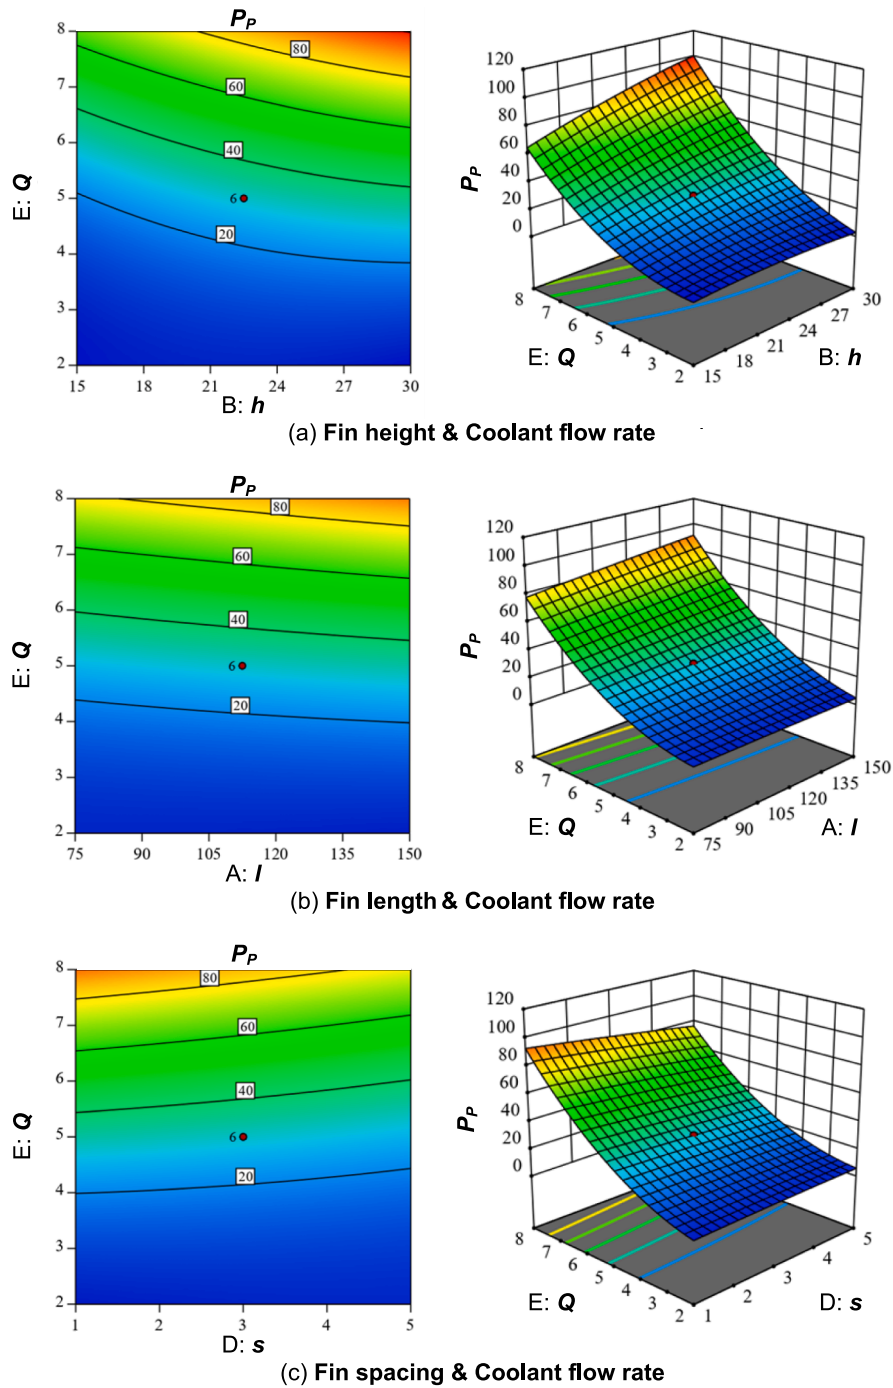

**Fig. 12.** Interaction effects on coolant pumping power ( $\times 10^5$ ): (a) fin height and coolant flow rate. (b) Fin length and coolant flow rate, (c) fin spacing and coolant flow rate.

100 W to 800 W. These values are representative of typical loads in DC servers and extend to the upper limits reported in previous studies [27]. The objective is to evaluate whether SPIC, in conjunction with the proposed heat sink design and optimized operational settings, can effectively meet the thermal management needs of next-generation DC CPUs operating under higher TDP conditions.

Fig. 14 illustrates the variations in thermal resistance ( $R$ ),  $T_a$ ,  $\Delta T_m$ , and  $\Delta T_c$  with increasing TDP. The results demonstrate a consistent decrease in  $R$  as TDP increases for both CPUs. This trend is primarily attributed to changes in the physical properties of the coolant, most notably, its  $\mu$ , which decreases by approximately 16.7 % as TDP increases from 100 to 800 W. This finding contrasts with the typical

behavior observed in air-cooled systems, where  $R$  generally remains relatively constant despite changes in TDP [43]. Notably, the reduction in  $R$  with increasing TDP is more pronounced for CPU 2 compared to CPU 1. Within the examined TDP range, CPU 1 exhibits a 7.7 % decrease in  $R$ , whereas CPU 2 shows a more substantial reduction of 9.8 %. This difference is attributed to the enhanced convective performance of the coolant flowing through CPU 2. The reduction in  $\mu$  the coolant facilitates more effective convective heat transfer, which in turn leads to improved cooling performance and a more pronounced decrease in  $R$ .

The findings indicate that thermal management of DC servers using the proposed cooling system can be effectively maintained for silicon-based CPUs with TDP values up to 600 W, ensuring their temperatures

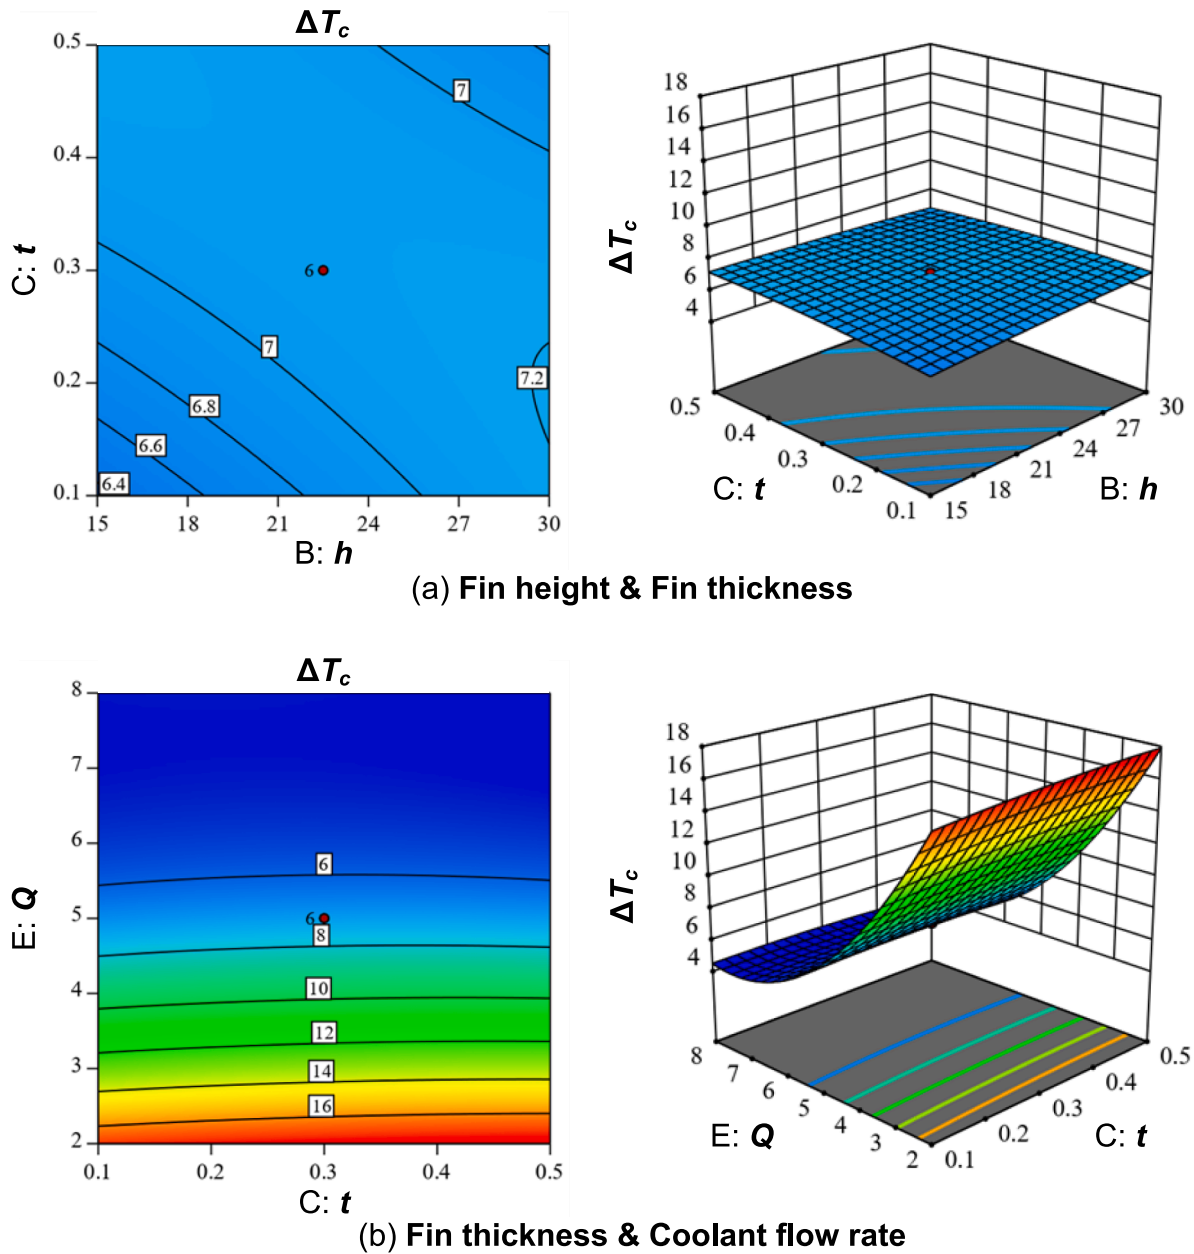


Fig. 13. Interaction effects on coolant temperature difference: (a) fin height and fin thickness. (b) Fin thickness and coolant flow rate.

Table 6

Optimized cases identified through RSM-BBD analysis.

| Number | A: $l$ [mm] | B: $h$ [mm] | C: $t$ [mm] | D: $s$ [mm] | E: $Q$ [lpm] | F: $T_{in}$ [°C] | Ta [°C] | $\Delta T_m$ [°C] | $P_p \times 10^{-5}$ [W] | $\Delta T_c$ [°C] | Desirability |
|--------|-------------|-------------|-------------|-------------|--------------|------------------|---------|-------------------|--------------------------|-------------------|--------------|
| 1      | 75.00       | 15.01       | 0.50        | 3.06        | 6.62         | 20.06            | 57.82   | 3.12              | 33.57                    | 4.99              | 0.91         |
| 2      | 75.00       | 15.37       | 0.50        | 2.89        | 6.49         | 20.00            | 56.61   | 3.10              | 36.69                    | 4.87              | 0.90         |
| 3      | 75.00       | 15.00       | 0.50        | 3.09        | 6.57         | 20.13            | 57.46   | 3.12              | 34.70                    | 4.92              | 0.90         |
| 4      | 75.00       | 15.00       | 0.50        | 3.15        | 6.68         | 20.08            | 56.86   | 3.15              | 36.02                    | 4.83              | 0.90         |
| 5      | 75.00       | 15.08       | 0.50        | 2.86        | 6.76         | 20.00            | 56.23   | 2.93              | 38.18                    | 4.77              | 0.90         |
| 6      | 75.72       | 15.44       | 0.50        | 2.82        | 6.56         | 20.12            | 57.12   | 3.12              | 36.23                    | 4.92              | 0.90         |
| 7      | 75.00       | 15.63       | 0.50        | 2.76        | 6.48         | 20.10            | 57.39   | 3.12              | 35.54                    | 4.99              | 0.90         |
| 8      | 75.15       | 15.02       | 0.50        | 2.89        | 6.88         | 20.02            | 55.69   | 2.94              | 39.84                    | 4.69              | 0.89         |
| 9      | 75.00       | 15.02       | 0.49        | 3.09        | 6.64         | 20.05            | 57.45   | 3.12              | 35.60                    | 4.87              | 0.89         |
| 10     | 75.70       | 15.00       | 0.50        | 3.15        | 6.44         | 20.13            | 58.20   | 3.24              | 32.76                    | 5.04              | 0.89         |

remain within the permissible operating range (i.e., below 85 °C) [64]. Moreover, for servers utilizing chips with higher thermal stability, such as gallium nitride (GaN)-based devices commonly employed in high-power and specialized high-frequency applications, the proposed

cooling system remains effective due to these chips' elevated permissible operating temperatures, which can exceed 100 °C. The  $\Delta T_m$  values obtained for TDP levels below 600 W remain within the acceptable range, consistently staying below 5 °C. This observation highlights both the

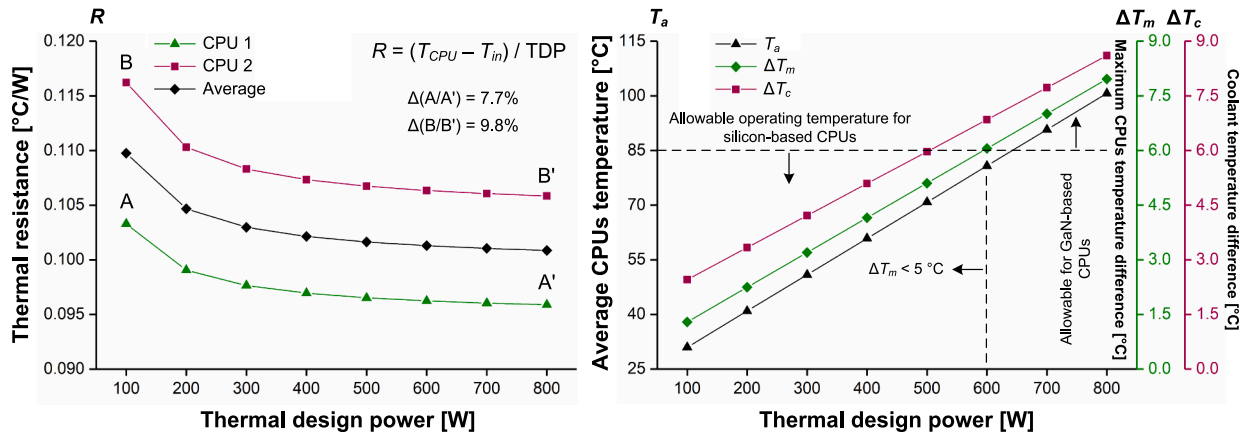


Fig. 14. Variations in thermal resistance, average CPU temperature, maximum CPUs temperature difference, and coolant temperature difference as a function of thermal design power.

thermal stability of the system and the notable uniformity in temperature distribution among the CPUs within the server. Notably, for every 100 W increase in TDP, the  $\Delta T_m$  increases by approximately 1 °C. Specifically, at a TDP of 100 W,  $\Delta T_m$  is measured at 1.29 °C, rising to 7.96 °C at 800 W. As expected, the coolant temperature increases with higher TDP values due to greater heat absorption. Nevertheless, across the entire studied TDP range, the  $\Delta T_c$  remains below 10 °C, indicating a substantial reduction in the energy required during the coolant cooling cycle to restore its temperature. For example, at a TDP of 500 W,  $\Delta T_c$  is 5.97 °C, which closely corresponds with experimental results reported by Shrigondekar et al. [43] for FC-40 fluid.

#### 4.3. Performance comparison of various coolants

Research indicates that the type of coolant plays a critical role in the thermal management of DC servers. For instance, studies have demonstrated that in immersion cooling systems, replacing air with liquid coolants can significantly improve heat dissipation, reducing chip temperatures by more than 20 % [65]. This section presents a performance evaluation of various dielectric liquids by comparing their thermal and hydraulic characteristics. The objective is to identify the most suitable coolant for SPIC, based on critical performance metrics. The fluids assessed in this study fall into four main categories: fluorocarbons (FC-40, FC-74, FC-75, FC-77, and FC-3283), hydrofluoroethers (HFE-7200, HFE-7300, HFE-7500, and HFE-7600), engineered coolants (Novec™ 7200) [64], and oils (Mineral, Synthetic, and Silicone) [1]. To ensure a fair comparison under identical conditions, the TDP of the CPUs is assumed to be 400 W, while that of the DIMMs is set to 15 W. Furthermore, the geometric parameters of the heat sink and the operating conditions are taken at their optimized values.

Fig. 15 illustrates the impact of coolant type on key performance parameters. The results clearly indicate that the selection of coolant significantly influences on the thermal and hydraulic behavior of the SPIC process. Among the tested coolants, synthetic oil yields the lowest  $T_a$  of 57.8 °C, followed closely by Novec™ 7200, which achieved a  $T_a$  of 58.3 °C. In addition, Novec™ 7200 exhibits the lowest  $P_p$ , indicating its superior hydraulic performance. The enhanced performance of Novec™ 7200 can be attributed to the unique thermophysical properties of Novec™ 7200, which include the lowest  $\mu$  and the highest  $\lambda$ , excluding coolants within the oil category, among all fluids evaluated. The findings suggest that coolants with lower  $\mu$  and higher  $\lambda$  generally lead to improved thermal and hydraulic performance across nearly all coolant categories. This conclusion aligns with prior research [66], which has shown that  $\mu$  and  $\lambda$  have a more pronounced impact on the cooling efficiency of SPIC systems than  $\rho$  and  $c_p$ .

Within the fluorocarbon category, FC-74 exhibits the lowest  $\mu$  and a

moderate  $\lambda$ , which accounts for its relatively low  $T_a$  and  $P_p$ . Notably, FC-74 also results in higher values of  $\Delta T_m$  and  $\Delta T_c$  compared to the other fluorocarbons in the same group. In the hydrofluoroether category, HFE-7200 demonstrates superior performance, primarily due to its low  $\mu$  and high  $\lambda$ . Although it yields a higher  $\Delta T_m$  compared to the other coolants in this group, its  $\Delta T_c$  remains nearly equivalent to that of the others. This suggests that the secondary energy required for thermal recovery is comparable across the fluids. Additionally, HFE-7000's low  $\rho$  further contributes to its favorable hydraulic characteristics, making it the most efficient coolant among the hydrofluoroethers evaluated. The results also indicate that, for the engineered coolant of Novec™ 7200, the influence of  $\mu$  on cooling performance is more pronounced than that of  $\lambda$ . Choi et al. [67] previously underscored the critical role of  $\mu$  in the performance of engineered coolants used in SPIC systems. In the oil category, the influence of  $\mu$  is significantly more pronounced than that of other thermophysical properties. Among the evaluated oils, synthetic oil exhibits the best overall performance, primarily due to its lowest  $\mu$ . Specifically, the use of synthetic oil results in a reduction of  $T_a$  by 3.9 °C and 2.7 °C compared to mineral and silicone oils, respectively. Additionally, it improves  $\Delta T_m$  and  $\Delta T_c$  by approximately 1 °C, while lowering  $P_p$  by a factor of about 1.58 compared to mineral oil and more than 7.18 times relative to silicone oil. The sequential trends demonstrating the influence of thermophysical properties on key performance parameters for each category of coolant are identified through sensitivity analysis and are summarized in Fig. 15.

However, the effectiveness of different coolants in DIMMs cooling varies depending on their thermophysical properties and flow conditions. The results indicate that oil coolants are generally more effective in achieving lower  $T_d$ . For instance, when compared to FC-40, silicone oil reduces the average  $T_d$  by up to 3.5 °C while also decreasing the  $P_p$  by approximately 20 %. This enhanced performance can be attributed to the less restricted flow paths between DIMMs, which are typically spaced further apart than the fins in the HS (s). This configuration allows for more efficient convective heat transfer, particularly when using oil coolants with relatively high  $\lambda$  and  $c_p$ . Moreover, despite the inherently higher  $\mu$  of oil coolants, the design of the DIMMs region does not impose significant flow resistance, minimizing the negative impact of  $\mu$  on hydraulic performance. Additionally, the increased cross-sectional area for coolant flow around the DIMMs reduces fluid velocity, increasing the relative contribution of natural convection compared to forced convection. Under such conditions, the benefits of higher  $\lambda$  become more prominent, further enhancing the cooling efficiency of oil coolants in this region. Consequently, in addition to providing more effective DIMM cooling compared to other coolants, oil coolants present several advantages that make them highly suitable for SPIC applications. These benefits include low toxicity, non-corrosiveness, environmental



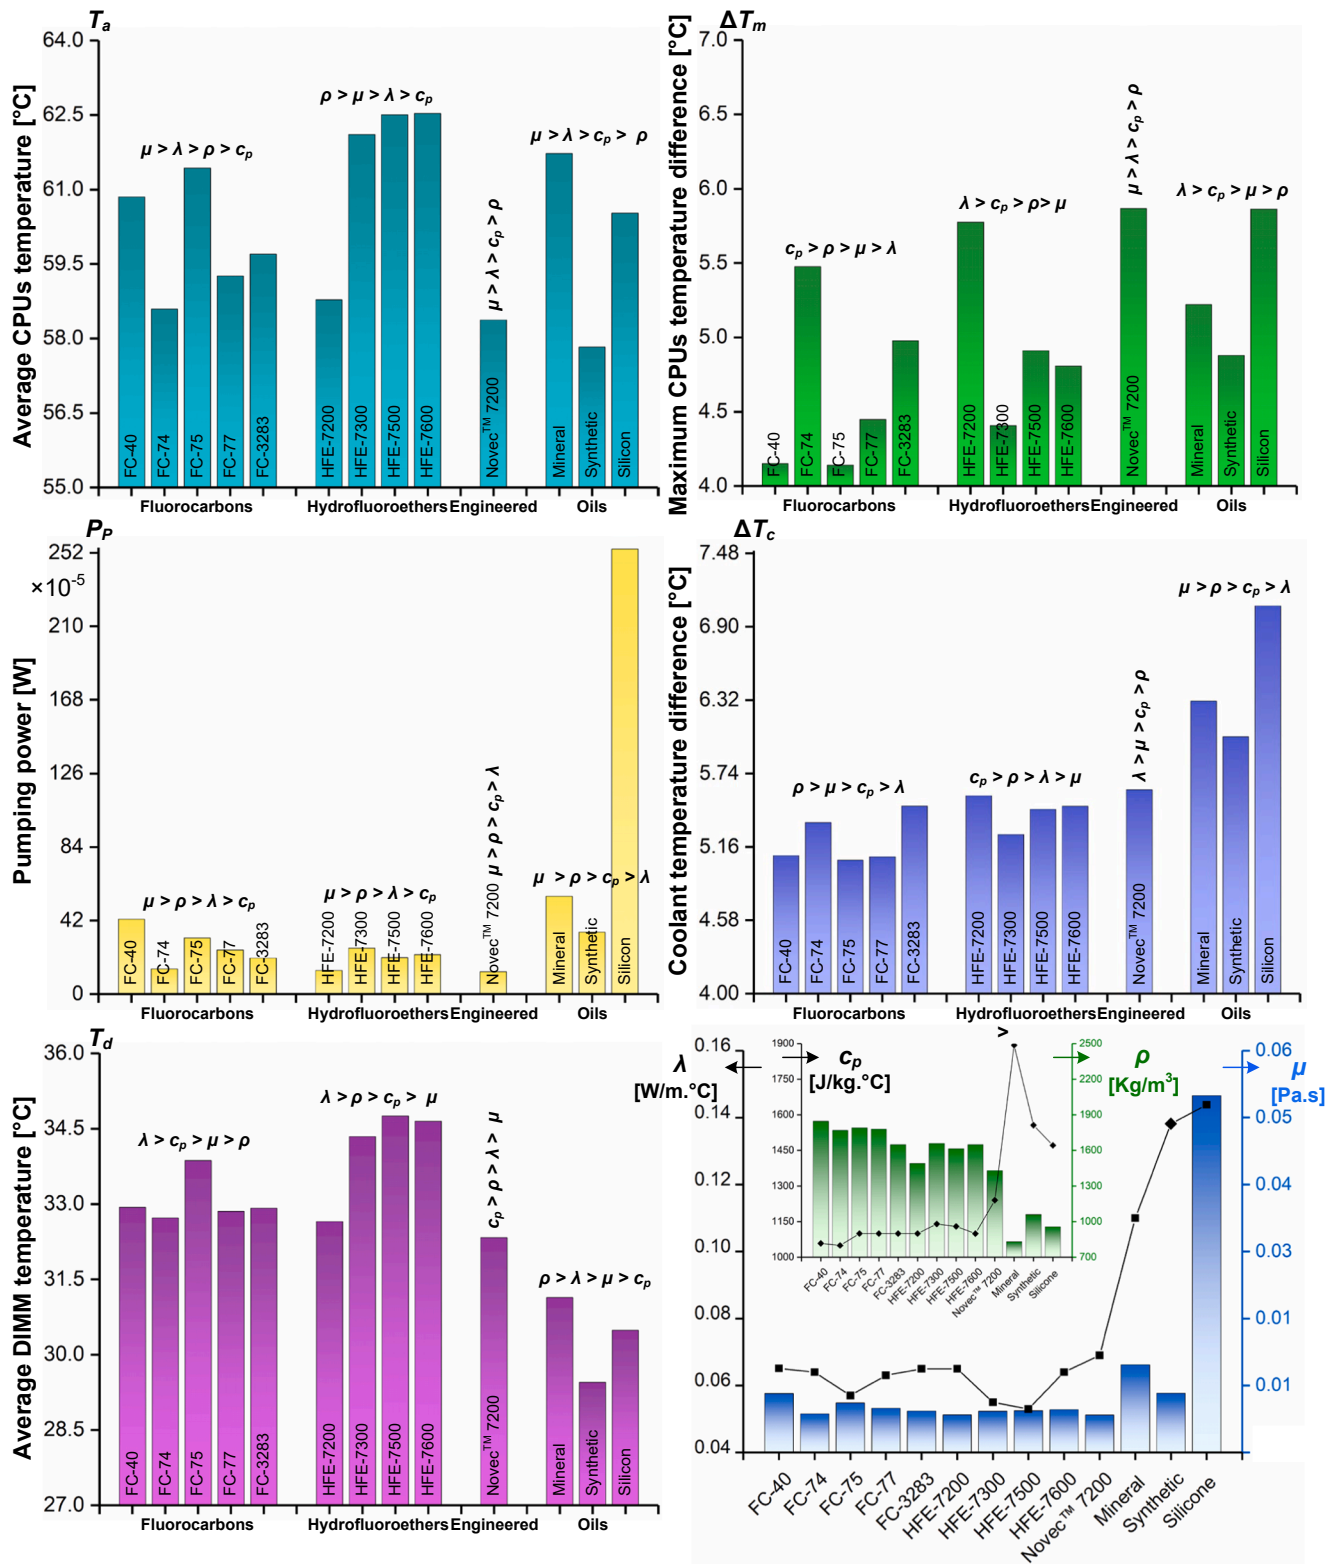


Fig. 15. Effects of coolant type on average CPUs temperature, maximum CPUs temperature difference, pumping power, coolant temperature difference, and average DIMMs temperature.

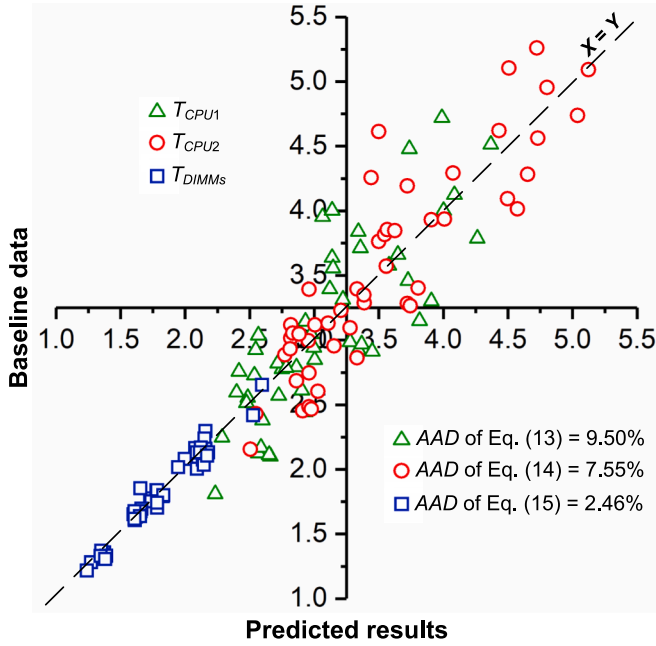


Fig. 16. Comparison of baseline data with predicted results from the developed correlations.

compatibility, cost-effectiveness, and relatively high boiling points. Nevertheless, to fully realize their potential and optimize performance, further dedicated investigations are required.

#### 4.4. Proposed correlations

To enhance the practical applicability of this research, dimensionless correlations are developed to predict the temperatures of key components within DC servers cooled using FC-40. These correlations are formulated based on independent variables, allowing for the direct estimation of the temperatures of CPU 1, CPU 2, and DIMMs. The significance of these correlations lies in their ability to estimate component temperatures as a function of HS geometric parameters, coolant operating conditions and thermophysical properties. The derived correlations are presented as follows:

$$\frac{T_{CPU1}}{T_{amb}} = 13.7109 Re^{-0.2769} \left( \frac{T_{in}}{T_{amb}} \right)^{0.3795} \left( \frac{h}{l} \right)^{-0.0347} \left( \frac{t}{s} \right)^{0.0424} \quad (9)$$

$$\frac{T_{CPU2}}{T_{amb}} = 21.8058 Re^{-0.3384} \left( \frac{T_{in}}{T_{amb}} \right)^{0.3304} \left( \frac{h}{l} \right)^{-0.0241} \left( \frac{t}{s} \right)^{0.0303} \quad (10)$$

$$\frac{T_{DIMMs}}{T_{amb}} = 4.2459 Re^{-0.1886} \left( \frac{T_{in}}{T_{amb}} \right)^{0.6513} \left( \frac{h}{l} \right)^{-0.0388} \left( \frac{t}{s} \right)^{-0.0023} \quad (11)$$

where  $Re$  denotes the Reynolds number, which captures the combined effects of the coolant's properties and flow rate.  $T_{amb}$  represents the ambient temperature, set at 25 °C, and is used as the reference value to nondimensionalize the temperature variables. To validate the accuracy of the developed correlations, the baseline data are compared with the values predicted by Eqs. (13), (14), and (15) in Fig. 16. The results indicate that the majority of the baseline data points fall within the 90 % confidence interval of the predicted values. Additionally, the Average Absolute Deviation (AAD) for each parameter is calculated using the following equation, with the results also illustrated in the figure. The

calculated AAD values are 9.50 % for  $T_{CPU1}$ , 7.55 % for  $T_{CPU2}$ , and 2.46 % for  $T_{DIMMs}$ .

$$AAD(\%) = \frac{|T_{correlation} - T_{baseline}|}{T_{baseline}} \times 100 \quad (12)$$

#### 5. Conclusion and future research directions

This study focuses on the optimization of heat sink geometries and coolant operating conditions in a dual-CPU server equipped with 24 DIMMs immersed in FC-40 dielectric fluid. By employing response surface methodology based on a Box-Behnken design (RSM-BBD), the influence of critical geometric and operational parameters is systematically evaluated and optimized. The main findings of this research are summarized as follows:

- New correlations are developed to predict the thermophysical properties of FC-40 (thermal conductivity, specific heat capacity, density, and viscosity) with less than 1 % deviation across the temperature range of 0 to 100 °C, supporting more precise thermal modeling.
- The sensitivity analysis reveals that the coolant flow rate ( $Q$ ) is the most influential factor for all performance metrics, particularly in reducing average CPUs temperature ( $T_a$ ). Geometric parameters ( $l$ ,  $h$ ,  $t$ , and  $s$ ) show stronger effects than inlet temperature ( $T_{in}$ ) on
- maximum CPUs temperature difference ( $\Delta T_m$ ), coolant pumping power ( $P_p$ ), and coolant temperature difference ( $\Delta T_c$ ).
- The optimal case ( $l = 75$  mm,  $h = 15$  mm,  $t = 0.5$  mm,  $s = 3$  mm,  $Q = 7$  lpm, and  $T_{in} = 20$  °C) maintains CPU temperatures below 60 °C at a thermal design power of 400 W, while ensuring excellent temperature uniformity ( $\Delta T_m < 5$  °C) and low  $P_p$  and  $\Delta T_c$  values. The optimized design maintains safe operating temperatures up to 600 W (silicon-based CPUs) and remains effective even at 800 W for advanced GaN-based processors.
- Among the tested coolants, Novec™ 7200 offers the best overall performance, achieving the lowest  $T_a$  of 56.3 °C and the lowest  $P_p$  of  $12.8 \times 10^{-5}$  W. Within the fluorocarbon category, FC-74 resulted in the lowest  $T_a$  of 58.5 °C, while FC-40 and FC-75 exhibited the most uniform temperature distributions, with a minimum  $\Delta T_m$  of approximately 4.1 °C.
- The proposed correlations accurately predict CPU and DIMM temperatures, with average absolute deviations of 9.50 % for  $T_{CPU1}$ , 7.55 % for  $T_{CPU2}$ , and 2.46 % for  $T_{DIMMs}$ .

The results confirm that the optimized thermal management model provides effective cooling performance for data center servers, even under high CPU thermal loads. To facilitate practical implementation, the proposed heat sinks are currently being fabricated and evaluated at the laboratory scale. Future research should focus on exploring advanced heat sink configurations tailored for both single-phase and two-phase immersion cooling, optimized based on server architecture and coolant properties. Additionally, integrating the optimized designs with passive (e.g., internal baffles, heat pipes) or active (e.g., liquid jets, micropumps) enhancement techniques may further improve thermal performance and address the growing demands of next-generation high-performance computing systems.

#### Declaration of generative AI and AI-assisted technologies in the writing process

During the preparation of this work the authors used ChatGPT in order to modify the English of paper. After using this service, the authors

reviewed and edited the content as needed and took full responsibility for the content of the publication.

review & editing, Project administration, Funding acquisition.

Funding information

Korea University National Research Foundation of Korea (NRF) Grant No. RS-2023-00222363.

CRediT authorship contribution statement

**M. Khoshvaght-Aliabadi:** Writing – original draft, Supervision, Project administration, Methodology, Formal analysis, Conceptualization. **P. Ghodrati:** Investigation, Data curation, Writing – original draft. **A. Nasrolahzadeh:** Validation, Investigation. **Y.T. Kang:** Writing –

Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

Acknowledgments

This work was supported by the National Research Foundation of Korea (NRF) grant funded by the Korean government (MSIT) (Grant number: RS-2023-00222363).

Appendix A. Analysis of variance (ANOVA) Tables

This appendix presents the ANOVA results for the key metrics analyzed in this study:  
Table A-1: ANOVA for average CPUs temperature ( $T_a$ ).  
Table A-2: ANOVA for maximum CPU temperature difference ( $\Delta T_m$ ).  
Table A-3: ANOVA for coolant pumping power ( $P_p$ ).  
Table A-4: ANOVA for coolant temperature difference ( $\Delta T_c$ ).

Table A-1  
Analysis of variance for average CPUs temperature ( $T_a$ ).

| Source         | Sum of squares | df | Mean square | F-value   | p-value  |             |
|----------------|----------------|----|-------------|-----------|----------|-------------|
| Model          | 15641.20       | 27 | 579.30      | 30.70     | < 0.0001 | Significant |
| A-l            | 68.87          | 1  | 68.87       | 3.65      | 0.0671   |             |
| B-h            | 245.93         | 1  | 245.93      | 13.03     | 0.0013   |             |
| C-t            | 708.44         | 1  | 708.44      | 37.55     | < 0.0001 |             |
| D-s            | 1833.78        | 1  | 1833.78     | 97.19     | < 0.0001 |             |
| E-Q            | 8700.52        | 1  | 8700.52     | 461.13    | < 0.0001 |             |
| F- $T_{in}$    | 2400.26        | 1  | 2400.26     | 127.21    | < 0.0001 |             |
| AB             | 11.68          | 1  | 11.68       | 0.6193    | 0.4384   |             |
| AC             | 8.63           | 1  | 8.63        | 0.4575    | 0.5048   |             |
| AD             | 10.20          | 1  | 10.20       | 0.5404    | 0.4688   |             |
| AE             | 12.20          | 1  | 12.20       | 0.6468    | 0.4285   |             |
| AF             | 1.037E-06      | 1  | 1.037E-06   | 5.495E-08 | 0.9998   |             |
| BC             | 0.5349         | 1  | 0.5349      | 0.0283    | 0.8676   |             |
| BD             | 320.66         | 1  | 320.66      | 17.00     | 0.0003   |             |
| BE             | 26.86          | 1  | 26.86       | 1.42      | 0.2436   |             |
| BF             | 1.815E-07      | 1  | 1.815E-07   | 9.620E-09 | 0.9999   |             |
| CD             | 18.01          | 1  | 18.01       | 0.9545    | 0.3376   |             |
| CE             | 0.1972         | 1  | 0.1972      | 0.0105    | 0.9194   |             |
| CF             | 6.528E-06      | 1  | 6.528E-06   | 3.460E-07 | 0.9995   |             |
| DE             | 218.58         | 1  | 218.58      | 11.58     | 0.0022   |             |
| DF             | 0.0000         | 1  | 0.0000      | 1.437E-06 | 0.9991   |             |
| EF             | 1.938E-07      | 1  | 1.938E-07   | 1.027E-08 | 0.9999   |             |
| A <sup>2</sup> | 6.14           | 1  | 6.14        | 0.3253    | 0.5733   |             |
| B <sup>2</sup> | 92.64          | 1  | 92.64       | 4.91      | 0.0357   |             |
| C <sup>2</sup> | 0.1880         | 1  | 0.1880      | 0.0100    | 0.9213   |             |
| D <sup>2</sup> | 253.84         | 1  | 253.84      | 13.45     | 0.0011   |             |
| E <sup>2</sup> | 255.77         | 1  | 255.77      | 13.56     | 0.0011   |             |
| F <sup>2</sup> | 92.12          | 1  | 92.12       | 4.88      | 0.0361   |             |
| Residual       | 490.57         | 26 | 18.87       |           |          |             |
| Lack of fit    | 490.57         | 21 | 23.36       |           |          |             |
| Pure error     | 0.0000         | 5  | 0.0000      |           |          |             |
| Cor total      | 16131.77       | 53 |             |           |          |             |

Adj R-Squared = 0.9696, Pred R-Squared = 0.8411, Adequate Precision = 22.4666.

**Table A-2**Analysis of variance for maximum CPUs temperature difference ( $\Delta T_m$ ).

| Source                   | Sum of squares | df | Mean square | F-value   | p-value  | Significant |
|--------------------------|----------------|----|-------------|-----------|----------|-------------|
| Model                    | 1471.18        | 27 | 54.49       | 66.15     | < 0.0001 | Significant |
| A- <i>l</i>              | 151.24         | 1  | 151.24      | 183.62    | < 0.0001 |             |
| B- <i>h</i>              | 186.00         | 1  | 186.00      | 225.83    | < 0.0001 |             |
| C- <i>t</i>              | 1.62           | 1  | 1.62        | 1.97      | 0.1727   |             |
| D- <i>s</i>              | 3.56           | 1  | 3.56        | 4.32      | 0.0476   |             |
| E- <i>Q</i>              | 916.84         | 1  | 916.84      | 1113.15   | < 0.0001 |             |
| F- <i>T<sub>in</sub></i> | 0.0001         | 1  | 0.0001      | 0.0001    | 0.9927   |             |
| AB                       | 0.4163         | 1  | 0.4163      | 0.5054    | 0.4834   |             |
| AC                       | 0.5149         | 1  | 0.5149      | 0.6252    | 0.4363   |             |
| AD                       | 2.87           | 1  | 2.87        | 3.49      | 0.0732   |             |
| AE                       | 5.54           | 1  | 5.54        | 6.72      | 0.0154   |             |
| AF                       | 8.989E-06      | 1  | 8.989E-06   | 0.0000    | 0.9974   |             |
| BC                       | 1.20           | 1  | 1.20        | 1.46      | 0.2380   |             |
| BD                       | 17.25          | 1  | 17.25       | 20.94     | 0.0001   |             |
| BE                       | 28.77          | 1  | 28.77       | 34.93     | < 0.0001 |             |
| BF                       | 9.730E-07      | 1  | 9.730E-07   | 1.181E-06 | 0.9991   |             |
| CD                       | 1.08           | 1  | 1.08        | 1.31      | 0.2624   |             |
| CE                       | 0.1768         | 1  | 0.1768      | 0.2146    | 0.6470   |             |
| CF                       | 0.0001         | 1  | 0.0001      | 0.0001    | 0.9926   |             |
| DE                       | 1.16           | 1  | 1.16        | 1.41      | 0.2456   |             |
| DF                       | 0.0001         | 1  | 0.0001      | 0.0001    | 0.9907   |             |
| EF                       | 9.180E-07      | 1  | 9.180E-07   | 1.115E-06 | 0.9992   |             |
| A <sup>2</sup>           | 0.4570         | 1  | 0.4570      | 0.5549    | 0.4630   |             |
| B <sup>2</sup>           | 1.92           | 1  | 1.92        | 2.34      | 0.1384   |             |
| C <sup>2</sup>           | 0.2439         | 1  | 0.2439      | 0.2961    | 0.5910   |             |
| D <sup>2</sup>           | 10.20          | 1  | 10.20       | 12.38     | 0.0016   |             |
| E <sup>2</sup>           | 101.85         | 1  | 101.85      | 123.66    | < 0.0001 |             |
| F <sup>2</sup>           | 0.0236         | 1  | 0.0236      | 0.0286    | 0.8669   |             |
| Residual                 | 21.41          | 26 | 0.8237      |           |          |             |
| Lack of fit              | 21.41          | 21 | 1.02        |           |          |             |
| Pure error               | 0.0000         | 5  | 0.0000      |           |          |             |
| Cor total                | 1492.60        | 53 |             |           |          |             |

Adj R-Squared = 0.9856, Pred R-Squared = 0.925, Adequate Precision = 33.9352.

**Table A-3**Analysis of variance for coolant pumping power ( $P_p$ ).

| Source                   | Sum of squares | df | Mean square | F-value   | p-value  | Significant |
|--------------------------|----------------|----|-------------|-----------|----------|-------------|
| Model                    | 44930.52       | 27 | 1664.09     | 401.60    | < 0.0001 | Significant |
| A- <i>l</i>              | 239.58         | 1  | 239.58      | 57.82     | < 0.0001 |             |
| B- <i>h</i>              | 1862.75        | 1  | 1862.75     | 449.54    | < 0.0001 |             |
| C- <i>t</i>              | 0.1307         | 1  | 0.1307      | 0.0315    | 0.8604   |             |
| D- <i>s</i>              | 301.96         | 1  | 301.96      | 72.87     | < 0.0001 |             |
| E- <i>Q</i>              | 38161.93       | 1  | 38161.93    | 9209.65   | < 0.0001 |             |
| F- <i>T<sub>in</sub></i> | 0.0000         | 1  | 0.0000      | 8.337E-06 | 0.9977   |             |
| AB                       | 2.76           | 1  | 2.76        | 0.6671    | 0.4215   |             |
| AC                       | 0.0129         | 1  | 0.0129      | 0.0031    | 0.9559   |             |
| AD                       | 0.6534         | 1  | 0.6534      | 0.1577    | 0.6945   |             |
| AE                       | 105.54         | 1  | 105.54      | 25.47     | < 0.0001 |             |
| AF                       | 1.494E-06      | 1  | 1.494E-06   | 3.606E-07 | 0.9995   |             |
| BC                       | 1.64           | 1  | 1.64        | 0.3953    | 0.5350   |             |
| BD                       | 16.57          | 1  | 16.57       | 4.00      | 0.0561   |             |
| BE                       | 1290.24        | 1  | 1290.24     | 311.37    | < 0.0001 |             |
| BF                       | 1.842E-06      | 1  | 1.842E-06   | 4.445E-07 | 0.9995   |             |
| CD                       | 1.27           | 1  | 1.27        | 0.3065    | 0.5845   |             |
| CE                       | 0.5298         | 1  | 0.5298      | 0.1279    | 0.7235   |             |
| CF                       | 0.0000         | 1  | 0.0000      | 7.073E-06 | 0.9979   |             |
| DE                       | 155.28         | 1  | 155.28      | 37.47     | < 0.0001 |             |
| DF                       | 0.0001         | 1  | 0.0001      | 0.0000    | 0.9961   |             |
| EF                       | 1.842E-06      | 1  | 1.842E-06   | 4.445E-07 | 0.9995   |             |
| A <sup>2</sup>           | 0.6468         | 1  | 0.6468      | 0.1561    | 0.6960   |             |
| B <sup>2</sup>           | 57.76          | 1  | 57.76       | 13.94     | 0.0009   |             |
| C <sup>2</sup>           | 2.26           | 1  | 2.26        | 0.5465    | 0.4664   |             |
| D <sup>2</sup>           | 2.22           | 1  | 2.22        | 0.5354    | 0.4709   |             |
| E <sup>2</sup>           | 2349.88        | 1  | 2349.88     | 567.10    | < 0.0001 |             |
| F <sup>2</sup>           | 1.47           | 1  | 1.47        | 0.3559    | 0.5560   |             |
| Residual                 | 107.74         | 26 | 4.14        |           |          |             |
| Lack of Fit              | 107.74         | 21 | 5.13        |           |          |             |
| Pure Error               | 0.0000         | 5  | 0.0000      |           |          |             |
| Cor Total                | 45038.25       | 53 |             |           |          |             |

Adj R-Squared = 0.9976, Pred R-Squared = 0.9875, Adequate Precision = 67.77.



**Table A-4**Analysis of variance for coolant temperature difference ( $\Delta T_c$ ).

| Source                   | Sum of squares | df | Mean square | F-value   | p-value  |             |
|--------------------------|----------------|----|-------------|-----------|----------|-------------|
| Model                    | 1251.35        | 27 | 46.35       | 424.66    | < 0.0001 | Significant |
| A- <i>l</i>              | 6.501E-07      | 1  | 6.501E-07   | 5.957E-06 | 0.9981   |             |
| B- <i>h</i>              | 0.2508         | 1  | 0.2508      | 2.30      | 0.1416   |             |
| C- <i>t</i>              | 0.2833         | 1  | 0.2833      | 2.60      | 0.1192   |             |
| D- <i>s</i>              | 2.501E-07      | 1  | 2.501E-07   | 2.292E-06 | 0.9988   |             |
| E- <i>Q</i>              | 1043.70        | 1  | 1043.70     | 9563.11   | < 0.0001 |             |
| F- <i>T<sub>in</sub></i> | 1.053E-07      | 1  | 1.053E-07   | 9.652E-07 | 0.9992   |             |
| AB                       | 2.592E-07      | 1  | 2.592E-07   | 2.375E-06 | 0.9988   |             |
| AC                       | 2.000E-08      | 1  | 2.000E-08   | 1.833E-07 | 0.9997   |             |
| AD                       | 1.702E-07      | 1  | 1.702E-07   | 1.559E-06 | 0.9990   |             |
| AE                       | 2.145E-07      | 1  | 2.145E-07   | 1.966E-06 | 0.9989   |             |
| AF                       | 8.820E-08      | 1  | 8.820E-08   | 8.081E-07 | 0.9993   |             |
| BC                       | 0.7501         | 1  | 0.7501      | 6.87      | 0.0144   |             |
| BD                       | 9.800E-09      | 1  | 9.800E-09   | 8.979E-08 | 0.9998   |             |
| BE                       | 0.4245         | 1  | 0.4245      | 3.89      | 0.0593   |             |
| BF                       | 1.125E-10      | 1  | 1.125E-10   | 1.031E-09 | 1.0000   |             |
| CD                       | 1.620E-08      | 1  | 1.620E-08   | 1.484E-07 | 0.9997   |             |
| CE                       | 0.7501         | 1  | 0.7501      | 6.87      | 0.0144   |             |
| CF                       | 5.062E-08      | 1  | 5.062E-08   | 4.639E-07 | 0.9995   |             |
| DE                       | 3.781E-08      | 1  | 3.781E-08   | 3.465E-07 | 0.9995   |             |
| DF                       | 6.845E-08      | 1  | 6.845E-08   | 6.272E-07 | 0.9994   |             |
| EF                       | 1.125E-10      | 1  | 1.125E-10   | 1.031E-09 | 1.0000   |             |
| A <sup>2</sup>           | 0.0132         | 1  | 0.0132      | 0.1207    | 0.7310   |             |
| B <sup>2</sup>           | 0.0542         | 1  | 0.0542      | 0.4970    | 0.4871   |             |
| C <sup>2</sup>           | 0.3380         | 1  | 0.3380      | 3.10      | 0.0902   |             |
| D <sup>2</sup>           | 0.0133         | 1  | 0.0133      | 0.1216    | 0.7301   |             |
| E <sup>2</sup>           | 160.77         | 1  | 160.77      | 1473.07   | < 0.0001 |             |
| F <sup>2</sup>           | 0.2144         | 1  | 0.2144      | 1.96      | 0.1728   |             |
| Residual                 | 2.84           | 26 | 0.1091      |           |          |             |
| Lack of Fit              | 2.84           | 21 | 0.1351      |           |          |             |
| Pure Error               | 0.0000         | 5  | 0.0000      |           |          |             |
| Cor Total                | 1254.19        | 53 |             |           |          |             |

Adj R-Squared = 0.9977, Pred R-Squared = 0.9881, Adequate Precision = 60.2987.

**Appendix B. Final quadratic regression models**

This appendix presents the final quadratic regression equations for the key performance metrics analyzed in this study:

Eq. B-1: Quadratic regression equation for average CPUs temperature ( $T_a$ ).Eq. B-2: Quadratic regression equation for maximum CPU temperature difference ( $\Delta T_m$ ).Eq. B-3: Quadratic regression equation for coolant pumping power ( $P_p$ ).Eq. B-4: Quadratic regression equation for coolant temperature difference ( $\Delta T_c$ ).

Average CPUs temperature ( $T_a$ ) =  $78.66 - 1.69 \times A - 3.2 \times B - 5.43 \times C - 8.74 \times D - 19.04 \times E + 10 \times F + 1.21 \times AB + 1.04 \times AC - 0.7983 \times AD + 1.24 \times AE + 0.0004 \times AF + 0.2586 \times BC - 6.33 \times BD + 1.3 \times BE - 0.0002 \times BF - 1.5 \times CD + 0.157 \times CE - 0.0006 \times CF + 5.23 \times DE - 0.0018 \times DF + 0.0002 \times EF - 0.7725 \times A^2 + 3 \times B^2 + 0.1352 \times C^2 + 4.97 \times D^2 + 4.99 \times E^2 - 4.99 \times F^2$  (B-1)

Maximum CPUs temperature difference ( $\Delta T_m$ ) =  $10.20 + 2.51 \times A + 2.78 \times B - 0.2597 \times C + 0.2597 \times D - 6.18 \times E - 0.0017 \times F + 0.2281 \times AB - 0.2537 \times AC - 0.4237 \times AD - 0.8320 \times AE + 0.0011 \times AF + 0.3875 \times BC - 1.47 \times BD - 1.34 \times BE + 0.0003 \times BF - 0.3676 \times CD + 0.1487 \times CE + 0.0021 \times CF + 0.3812 \times DE + 0.0038 \times DF - 0.0003 \times EF - 0.2108 \times A^2 - 0.4326 \times B^2 + 0.1540 \times C^2 - 0.9956 \times D^2 + 3.15 \times E^2 - 0.0479 \times F^2$  (B-2).

Coolant pumping power ( $P_p$ ) =  $30.16 + 3.16 \times A + 8.81 \times B - 0.0738 \times C - 3.55 \times D + 39.88 \times E - 0.0012 \times F + 0.5878 \times AB + 0.0402 \times AC + 0.2021 \times AD + 3.63 \times AE - 0.0004 \times AF - 0.4525 \times BC - 1.44 \times BD + 8.98 \times BE + 0.0005 \times BF - 0.3985 \times CD - 0.2573 \times CE + 0.0014 \times CF - 4.41 \times DE + 0.0036 \times DF - 0.0005 \times EF - 0.2508 \times A^2 - 2.37 \times B^2 + 0.4692 \times C^2 - 0.4644 \times D^2 + 15.11 \times E^2 - 0.3786 \times F^2$  (B-3).

Coolant temperature difference ( $\Delta T_c$ ) =  $7.13 + 0.0002 \times A + 0.1022 \times B + 0.1087 \times C - 0.0001 \times D - 6.59 \times E - 0.0001 \times F + 0.0002 \times AB + 0.0001 \times AC - 0.0001 \times AD - 0.0002 \times AE - 0.0001 \times AF - 0.3062 \times BC - 0.0000 \times BD - 0.1629 \times BE + 3.750E-06 \times BF + 0.0000 \times CD - 0.3062 \times CE + 0.0001 \times CF + 0.0001 \times DE + 0.0001 \times DF - 3.750E-06 \times EF + 0.0358 \times A^2 - 0.0726 \times B^2 - 0.1813 \times C^2 + 0.0359 \times D^2 + 3.95 \times E^2 + 0.1444 \times F^2$  (B-4).

**Data availability**

Data will be made available on request.

**References**

- [1] J. Cho, B. Park, S. Jang, Development of an independent modular air containment system for high-density data centers: experimental investigation of row-based cooling performance and PUE, *Energy* 258 (2022) 124787.
- [2] A.S.G. Andrae, T. Edler, On global electricity usage of communication technology: trends to 2030, *Challenges* 6 (2015) 117–157.
- [3] B. Srivathsan, M. Sorel, A. Bhan, P. Sachdeva, H. Batra, R. Sharma, R. Gupta, S. Choudhary, The race to build AI-ready data center capacity, *McKinsey & Company* (2024).
- [4] M. Koot, F. Wijnhoven, Usage impact on data center electricity needs: a system dynamic forecasting model, *Appl. Energy* 291 (2021) 116798.
- [5] M.H. Jahangir, R. Mokhtari, S.A. Mousavi, Performance evaluation and financial analysis of applying hybrid renewable systems in cooling unit of data centers – a case study, *Sustainable Energy Technol. Assess.* 46 (2021) 101220.
- [6] S.M. Sohel Murshed, C.A. Nieto de Castro, A critical review of traditional and emerging techniques and fluids for electronics cooling, *Renew. Sustain. Energy Rev.* 78 (2017) 821–833.

- [7] Z.-H. Hu, Y.-X. Zheng, Y.-G. Wang, Packing computing servers into the vessel of an underwater data center considering cooling efficiency, *Appl. Energy* 314 (2022) 118986.
- [8] W.-X. Chu, C.-C. Wang, A review on airflow management in data centers, *Appl. Energy* 240 (2019) 84–89.
- [9] N.A. Pambudi, A. Sarifudin, R.A. Firdaus, D.K. Ulfa, I.M. Gandidi, R. Romadhon, The immersion cooling technology: current and future development in energy saving, *Alex. Eng. J.* 61 (2022) 9509–9527.
- [10] A.H. Khalaj, S.K. Halgamuge, A Review on efficient thermal management of air- and liquid-cooled data centers: from chip to the cooling system, *Appl. Energy* 205 (2017) 1165–1188.
- [11] Z. Han, X. Sun, H. Wei, Q. Ji, D. Xue, Energy saving analysis of evaporative cooling composite air conditioning system for data centers, *Appl. Therm. Eng.* 186 (2021) 116506.
- [12] K. Haghsheenas, S. Taheri, M. Goudarzi, S. Mohammadi, Infrastructure aware heterogeneous-workloads scheduling for data center energy cost minimization, *IEEE Trans. Cloud Comput.* 10 (2022) 972–983.
- [13] C. Nadjahia, H. Louahliaa, S. Lemassonb, A review of thermal management and innovative cooling strategies for data center, *Sustainable Computing: Informatics and Systems* 19 (2018) 14–28.
- [14] A. Safari, A. Rahimi, An economic room-level thermal management of air-cooled cloud data centers based on human brain emotional intelligence, *Build. Environ.* 281 (2025) 113170.
- [15] N. Li, H. Li, K. Duan, W.-Q. Tao, Evaluation of the cooling effectiveness of air-cooled data centers by energy diagram, *Appl. Energy* 382 (2025) 125215.
- [16] Y. Zhang, C. Pan, N. Wang, Y. Tu, Y. Tian, M. Xu, Experimental study on the performance of cascaded separate microchannel heat pipes for data center cooling, *Appl. Therm. Eng.* 262 (2025) 125228.
- [17] H. Zhu, B. Lin, Digital twin-driven energy consumption management of integrated heat pipe cooling system for a data center, *Appl. Energy* 373 (2024) 123840.
- [18] Q. Wang, J. Tao, Z. Cui, T. Zhang, G. Chen, Passive enhanced heat transfer, hotspot management and temperature uniformity enhancement of electronic devices by micro heat sinks: a review, *Int. J. Heat Fluid Flow* 107 (2024) 109368.
- [19] T. Rehman, C.W. Park, Optimizing heat sink performance with porous media-PCM integration: an experimental investigation, *Appl. Therm. Eng.* 242 (2024) 122506.
- [20] M. Rezaee, M. Khoshvaght-Aliabadi, A.A. Abbasian Arani, S.H. Mazloumi, Heat transfer intensification in pin-fin heat sink by changing pin-length/longitudinal-pitch, *Chem. Eng. Process. - Process Intensif.* 141 (2019) 107544.
- [21] M. Khoshvaght-Aliabadi, P. Ghodrati, J.Y. Shin, Y.T. Kang, Impact of coolant distribution design on server-level thermal management in data centers, *Energy* 330 (2025) 136936.
- [22] H. Wang, X. Yuan, K. Zhang, X. Lang, H. Chen, H. Yu, S. Li, Performance evaluation and optimization of data center servers using single-phase immersion cooling, *Int. J. Heat Mass Transf.* 221 (2024) 125057.
- [23] K.Y. Ho, S.W. Cheng, K.C. Chang, C. Wang, C.C. Wang, B.L. Wu, C.C. Wang, Air cooled solutions for 1U servers with vapor chamber, heat pipe, and cut fins, *Int. Commun. Heat Mass Transfer* 164 (2025) 108817.
- [24] H. Rong, H. Zhang, S. Xiao, C. Li, C. Hu, Optimizing energy consumption for data centers, *Renew. Sustain. Energy Rev.* 58 (2016) 674–691.
- [25] A.C. Kheirabadi, D. Groulx, Cooling of server electronics: a design review of existing technology, *Appl. Therm. Eng.* 105 (2016) 622–638.
- [26] M. Khoshvaght-Aliabadi, P. Ghodrati, Y.T. Kang, Performance analysis of supercritical carbon dioxide as a coolant in cold plate systems, *Energy* 314 (2025) 134301.
- [27] S. Zheng, C. Su, X. Yang, Y. Zhang, K. Duan, Y. Zhang, Z. Huang, Y. Zhang, F. Liu, J. Wei, A comprehensive review of single-phase immersion cooling in data centers, *Appl. Therm. Eng.* 272 (2025) 126385.
- [28] M. Khoshvaght-Aliabadi, A. Abbaszadeh, A. Salimi, N. Salehi, Structural modifications of sinusoidal wavy minichannels cold plates applied in liquid cooling of lithium-ion batteries, *J. Storage Mater.* 57 (2023) 106208.
- [29] Y. Zhong, D. Liu, F. Wen, X. Li, H. Cao, T. Bao, K. Wang, K. Xiao, Long-Term Reliability Analysis of Crystal Oscillator under Immersion Cooling with Various Coolants, in: 2024 IEEE 74th Electronic Components and Technology Conference (ECTC), IEEE, 2024, pp. 1522–1529.
- [30] C. Zhang, H. Wang, Y. Huang, L. Zhang, Y. Chen, Immersion liquid cooling for electronics: Materials, systems, applications and prospects, *Renew. Sustain. Energy Rev.* 208 (2025) 114989.
- [31] B.B. Kanbur, C. Wu, S. Fan, F. Duan, System-level experimental investigations of the direct immersion cooling data center units with thermodynamic and thermoeconomic assessments, *Energy* 217 (2021) 119373.
- [32] P. Birbarah, T. Gebrael, T. Foulkes, A. Stillwell, A. Moore, R.P. Podgurski, N. Miljkovic, Water immersion cooling of high power density electronics, *Int. J. Heat Mass Transf.* 147 (2020) 118918.
- [33] Y. Zhong, D. Liu, F. Wen, R. Guo, T. Bao, K. Wang, H. Gong, H. Fang, X. Li, Y. He, H. Lian, Long-Term Reliability Evaluation on Single-Phase Immersion Cooling-Based Server with Electronic Fluorinated Liquid, in: 2023 IEEE 73rd Electronic Components and Technology Conference (ECTC), IEEE, 2023, pp. 1994–2000.
- [34] H. Wang, T. Tao, J. Xu, H. Shi, X. Mei, P. Gou, Thermal performance of a liquid-immersed battery thermal management system for lithium-ion pouch batteries, *J. Storage Mater.* 46 (2022) 103835.
- [35] P.V. Bansode, J.M. Shah, G. Gupta, D. Agonafer, H. Patel, D. Roe, R. Tufty, Measurement of the thermal performance of a custom-build single-phase immersion cooled server at various high and low temperatures for prolonged time, *Journal of Electronic Packaging* 142 (2020).
- [36] M. Hnayno, A. Chehade, H. Klabla, G. Polidori, C. Maalouf, Experimental investigation of a data-centre cooling system using a new single-phase immersion/liquid technique, *Case Stud. Therm. Eng.* 45 (2023) 102925.
- [37] Y. Huang, J. Ge, Y. Chen, C. Zhang, Natural and forced convection heat transfer characteristics of single-phase immersion cooling systems for data centers, *Int. J. Heat Mass Transf.* 207 (2023) 124023.
- [38] P. Taddeo, J. Romaní, J. Summers, J. Gustafsson, I. Martorell, J. Salom, Experimental and numerical analysis of the thermal behaviour of a single-phase immersion-cooled data centre, *Appl. Therm. Eng.* 234 (2023) 121260.
- [39] T. Chen, S.V. Garimella, Measurements and high-speed visualizations of flow boiling of a dielectric fluid in a silicon microchannel heat sink, *Int. J. Multiph. Flow* 32 (2006) 957–971.
- [40] K.V. Jithin, P.K. Rajesh, Numerical analysis of single-phase liquid immersion cooling for lithium-ion battery thermal management using different dielectric fluids, *Int. J. Heat Mass Transf.* 188 (2022) 122608.
- [41] C.C. Cheng, P.C. Chang, H.C. Li, F.I. Hsu, Design of a single-phase immersion cooling system through experimental and numerical analysis, *Int. J. Heat Mass Transf.* 160 (2020) 120203.
- [42] S. Wen, G. Chen, Q. Wu, Y. Liu, Simulation study on nanofluid heat transfer in immersion liquid-cooled server, *Applied Science* 13 (2023) 7575.
- [43] H. Shrigondekar, Y.C. Lin, C.C. Wang, Investigations on performance of single-phase immersion cooling system, *Int. J. Heat Mass Transf.* 206 (2023) 123961.
- [44] Y. Huang, B. Liu, S. Xu, C. Bao, Y. Zhong, C. Zhang, Experimental study on the immersion liquid cooling performance of high-power data center servers, *Energy* 297 (2024) 131195.
- [45] J. Wu, C. Chen, P. Wei, J. Zhang, Y.S. Lo, C. Hung, L. Guo, M. Zhang, G. Yang, W. Zheng, J. Wang, The Study on Improving CFD Simulation Accuracy for Heat Sink Design Optimization in Single-Phase Immersion Cooling System, in: 2024 23rd IEEE Intersociety Conference on Thermal and Thermomechanical Phenomena in Electronic Systems (ITherm), IEEE, 2024, pp. 1–7.
- [46] T.L. Vasques, P. Moura, A. Almeida, A review on energy efficiency and demand response with focus on small and medium data centers, *Energ. Eff.* 12 (2019) 1399–1428.
- [47] Datacom equipment power trends and cooling applications, (second ed.), American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (2012).
- [48] C. Jin, X. Bai, C. Yang, W. Mao, X. Xu, A review of power consumption models of servers in data centers, *Appl. Energy* 265 (2020) 114806.
- [49] J.M. Shah, R. Dandamudi, C. Bhatt, P. Rachamreddy, P. Bansode, D. Agonafer, CFD analysis of thermal shadowing and optimization of heatsinks in 3rd generation open compute server for single-phase immersion cooling, in: International Electronic Packaging Technical Conference and Exhibition, Vol. 59322, American Society of Mechanical Engineers, 2019 V001T02A015.
- [50] A. Chhetri, D. Kashyap, A. Mali, C. Agarwal, C. Ponraj, N. Gobinath, Numerical simulation of the single-phase immersion cooling process using a dielectric fluid in a data server, *Mater. Today: Proceedings* 51 (2022) 1532–1538.
- [51] M. Muneeswaran, Y.-C. Lin, C.-C. Wang, Performance analysis of single-phase immersion cooling system of data center using FC-40 dielectric fluid, *Int. Commun. Heat Mass Transfer* 145 (2023) 106843.
- [52] J. Kim, H. Choi, S. Lee, H. Lee, Computational study of single-phase immersion cooling for high-energy density server rack for data centers, *Appl. Therm. Eng.* 264 (2025) 125476.
- [53] D.C. Montgomery, Design and analysis of experiments, John Wiley & Sons, 2017.
- [54] S.L.C. Ferreira, R.E. Bruns, H.S. Ferreira, G.D. Matos, J.M. David, G.C. Brandão, E. G.P. da Silva, L.A. Portugal, P.S. dos Reis, A.S. Souza, W.N.L. dos Santos, Box-Behnken design: an alternative for the optimization of analytical methods, *Anal. Chim. Acta* 597 (2007) 179–186.
- [55] R.A. Ozer, Heat sink optimization with response surface methodology for single phase immersion cooling, *Int. J. Heat Fluid Flow* 112 (2025) 109745.
- [56] 3M™ Fluorinert™ Electronic Liquid FC-40: <https://multimedia.3m.com/mws/media/648880/3m-fluorinert-electronic-liquid-fc40.pdf>.
- [57] A. Vagiakis, D.N. Korres, C. Tzivanidis, Simulation of natural convection heat transfer in dielectric liquids for single-phase immersion cooling rack server, *Appl. Therm. Eng.* 274 (2025) 126595.
- [58] C. Wang, H. Yu, L. Xian, G. Liu, L. Chen, W.-Q. Tao, Study on the operation strategy of the water cooling system in the single-phase immersion cooling data center considering cooling tower performance, *Energ. Buildings* 324 (2024) 114890.
- [59] B. Ding, F. Xia, L. He, Y. Huang, A novel concept for performance enhancement of immersion-cooled data center servers, *Int. Commun. Heat Mass Transfer* 159 (2024) 107980.
- [60] D. Ni, F. Yu, CFD simulation study of flow equalisation plate model in single-phase immersion liquid cooling for servers, *Therm. Sci. Eng. Prog.* 47 (2024) 102268.
- [61] H. Zambrano, L.D.G. Sigalotti, F. Peña-Polo, L. Trujillo, Turbulent models of oil flow in a circular pipe with sudden enlargement, *App. Math. Model.* 39 (2015) 6711–6724.
- [62] X. Li, Z. Xu, S. Liu, X. Zhang, H. Sun, Server performance optimization for single-phase immersion cooling data center, *Appl. Therm. Eng.* 224 (2023) 120080.

- [63] S. Liu, Z. Xu, Z. Wang, X. Li, H. Sun, X. Zhang, H. Zhang, Optimization and comprehensive evaluation of liquid cooling tank for single-phase immersion cooling data center, *Appl. Therm. Eng.* 245 (2024) 122864.
- [64] O.A. Volodin, D.A. Shvetsov, V.S. Serdyukov, V.I. Zhukov, A.N. Pavlenko, Enhanced boiling and evaporation of dielectric fluids on modified surfaces for immersion cooling of electronic components – a review, *Appl. Therm. Eng.* 277 (2025) 127088.
- [65] N.A. Pambudi, A.M. Yusuf, A. Sarifudin, The use of single-phase immersion cooling by using two types of dielectric fluid for data center energy savings, *Energy Eng.* 119 (2021) 275–286.
- [66] X. Chen, Y. Huang, S. Xu, C. Bao, Y. Zhong, Y. Chen, C. Zhang, Thermal performance evaluation of electronic fluorinated liquids for single-phase immersion liquid cooling, *Int. J. Heat Mass Transf.* 220 (2024) 124951.
- [67] H. Choi, H. Lee, J. Kim, H. Lee, Hybrid single-phase immersion cooling structure for battery thermal management under fast-charging conditions, *Energ. Convers. Manage.* 287 (2023) 117053.