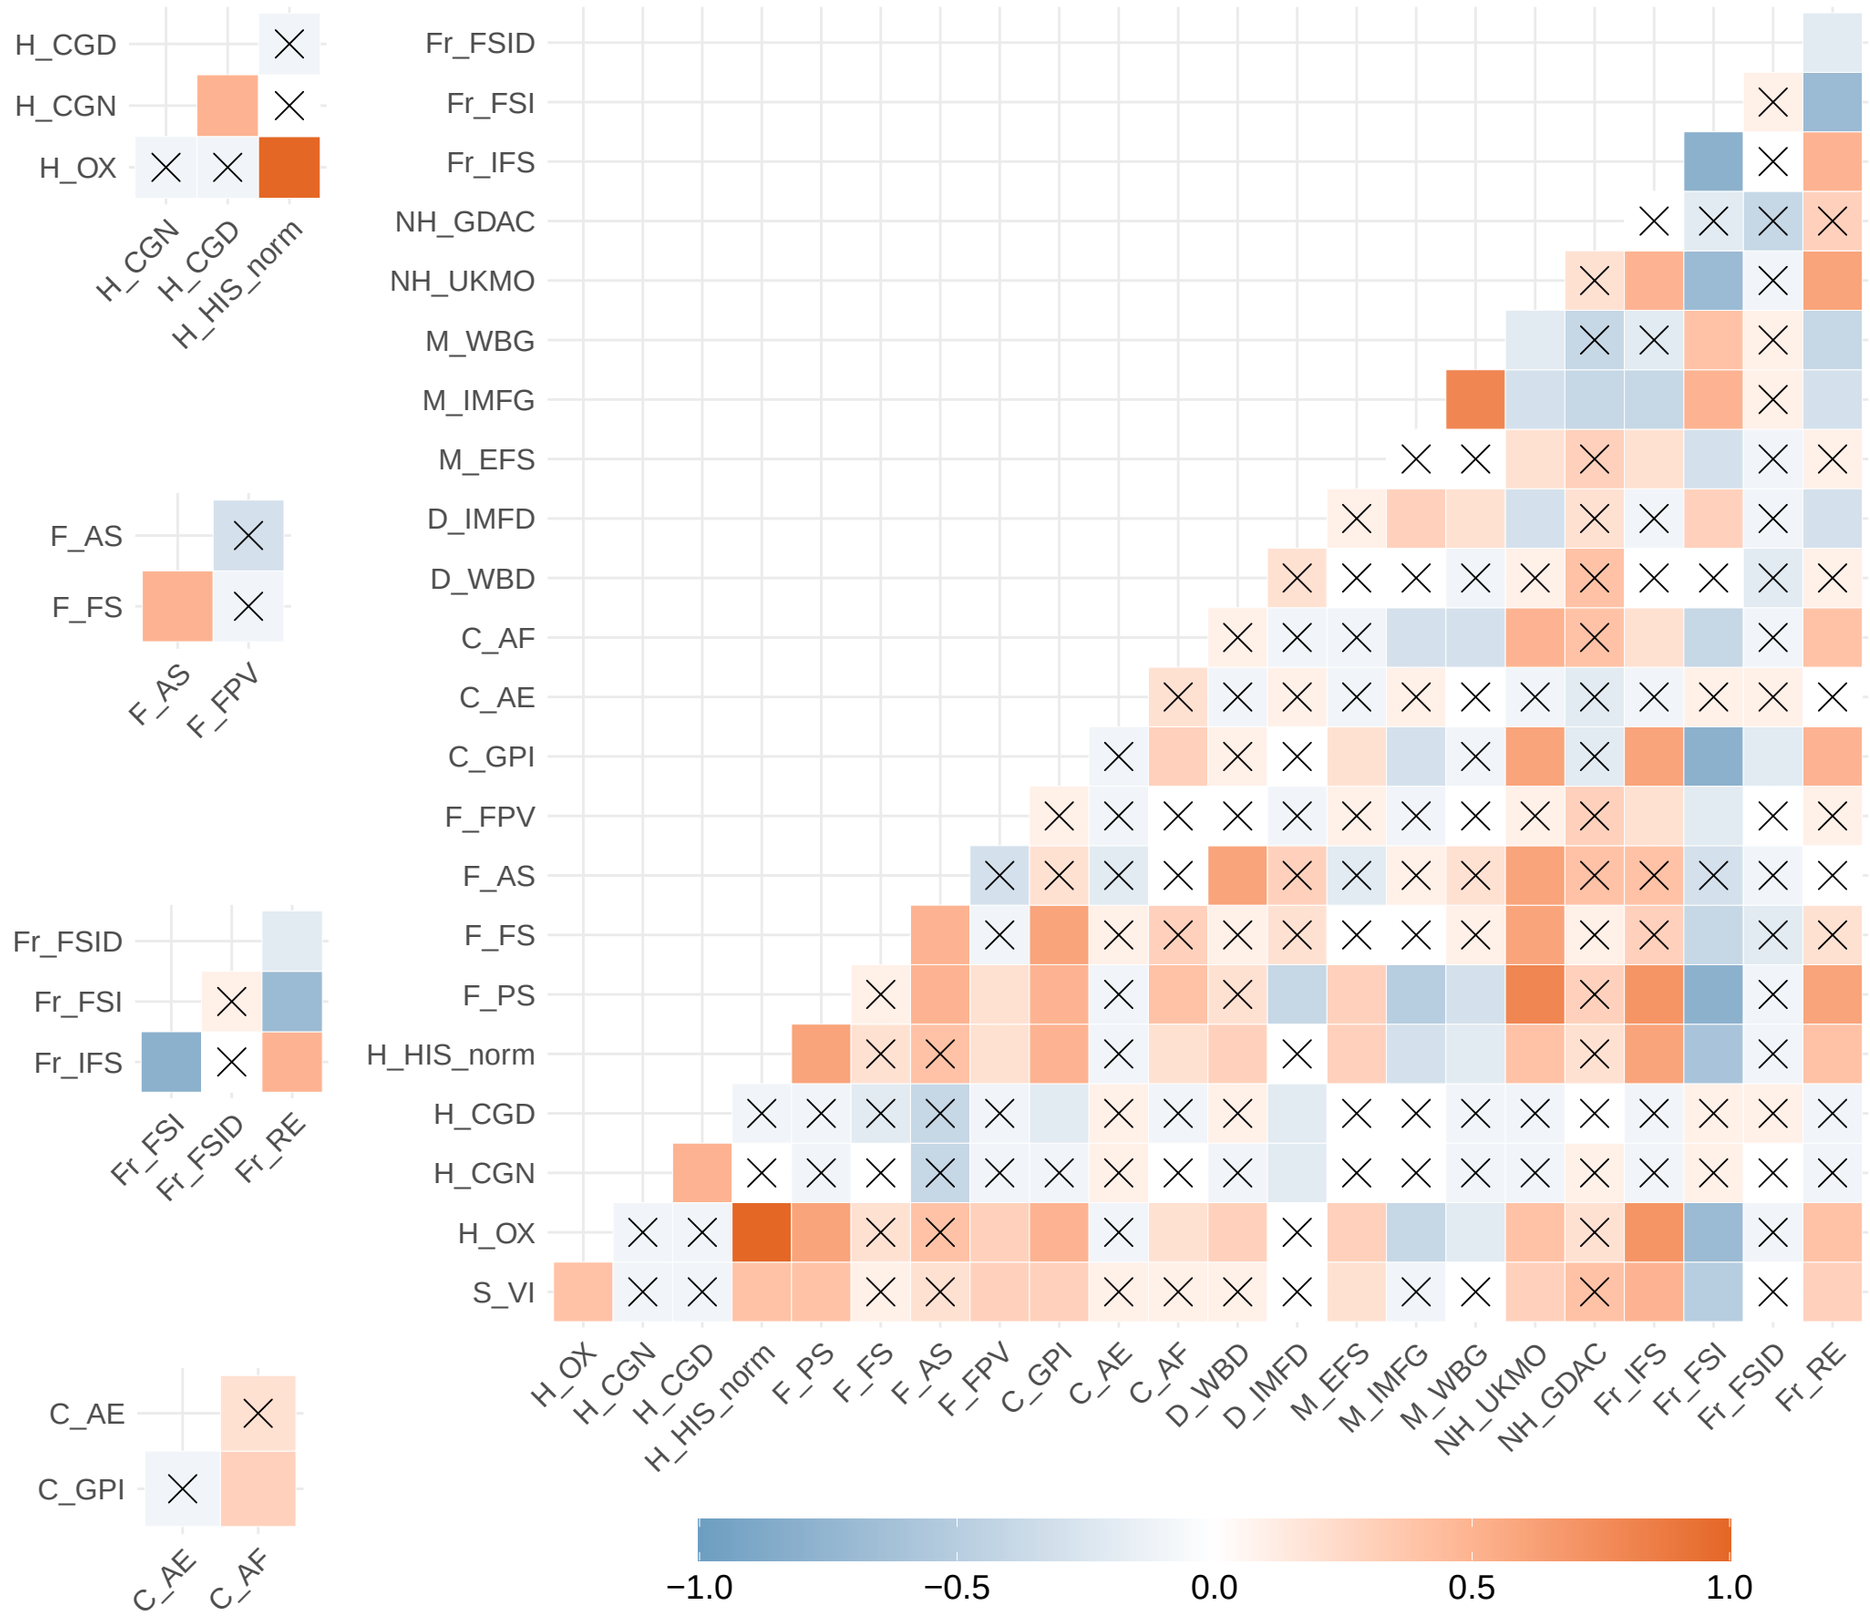
H_CGD
H_CGN
H_OX
H_CGN
H_CGD
H_HIS_norm
F_AS
F_FS
F_AS
F_FPV
Fr_FSID
Fr_FSI
Fr_IFS
Fr_FSI
Fr_FSID
Fr_RE
C_AE
C_GPI
C_AE
C_AF
Fr_FSID
Fr_FSI
Fr_IFS
NH_GDAC
NH_UKMO
M_WBG
M_IMFG
M_EFS
D_IMFD
D_WBD
C_AF
C_AE
C_GPI
F_FPV
F_AS
F_FS
F_PS
H_HIS_norm
H_CGD
H_CGN
H_OX
S_VI
H_OX
H_CGN
H_CGD
H_HIS_norm
F_PS
F_FS
F_AS
F_FPV
C_GPI
C_AE
C_AF
D_WBD
D_IMFD
M_EFS
M_IMFG
M_WBG
NH_UKMO
NH_GDAC
Fr_IFS
Fr_FSI
Fr_FSID
Fr_RE
−1.0
−0.5
0.0
0.5
1.0