


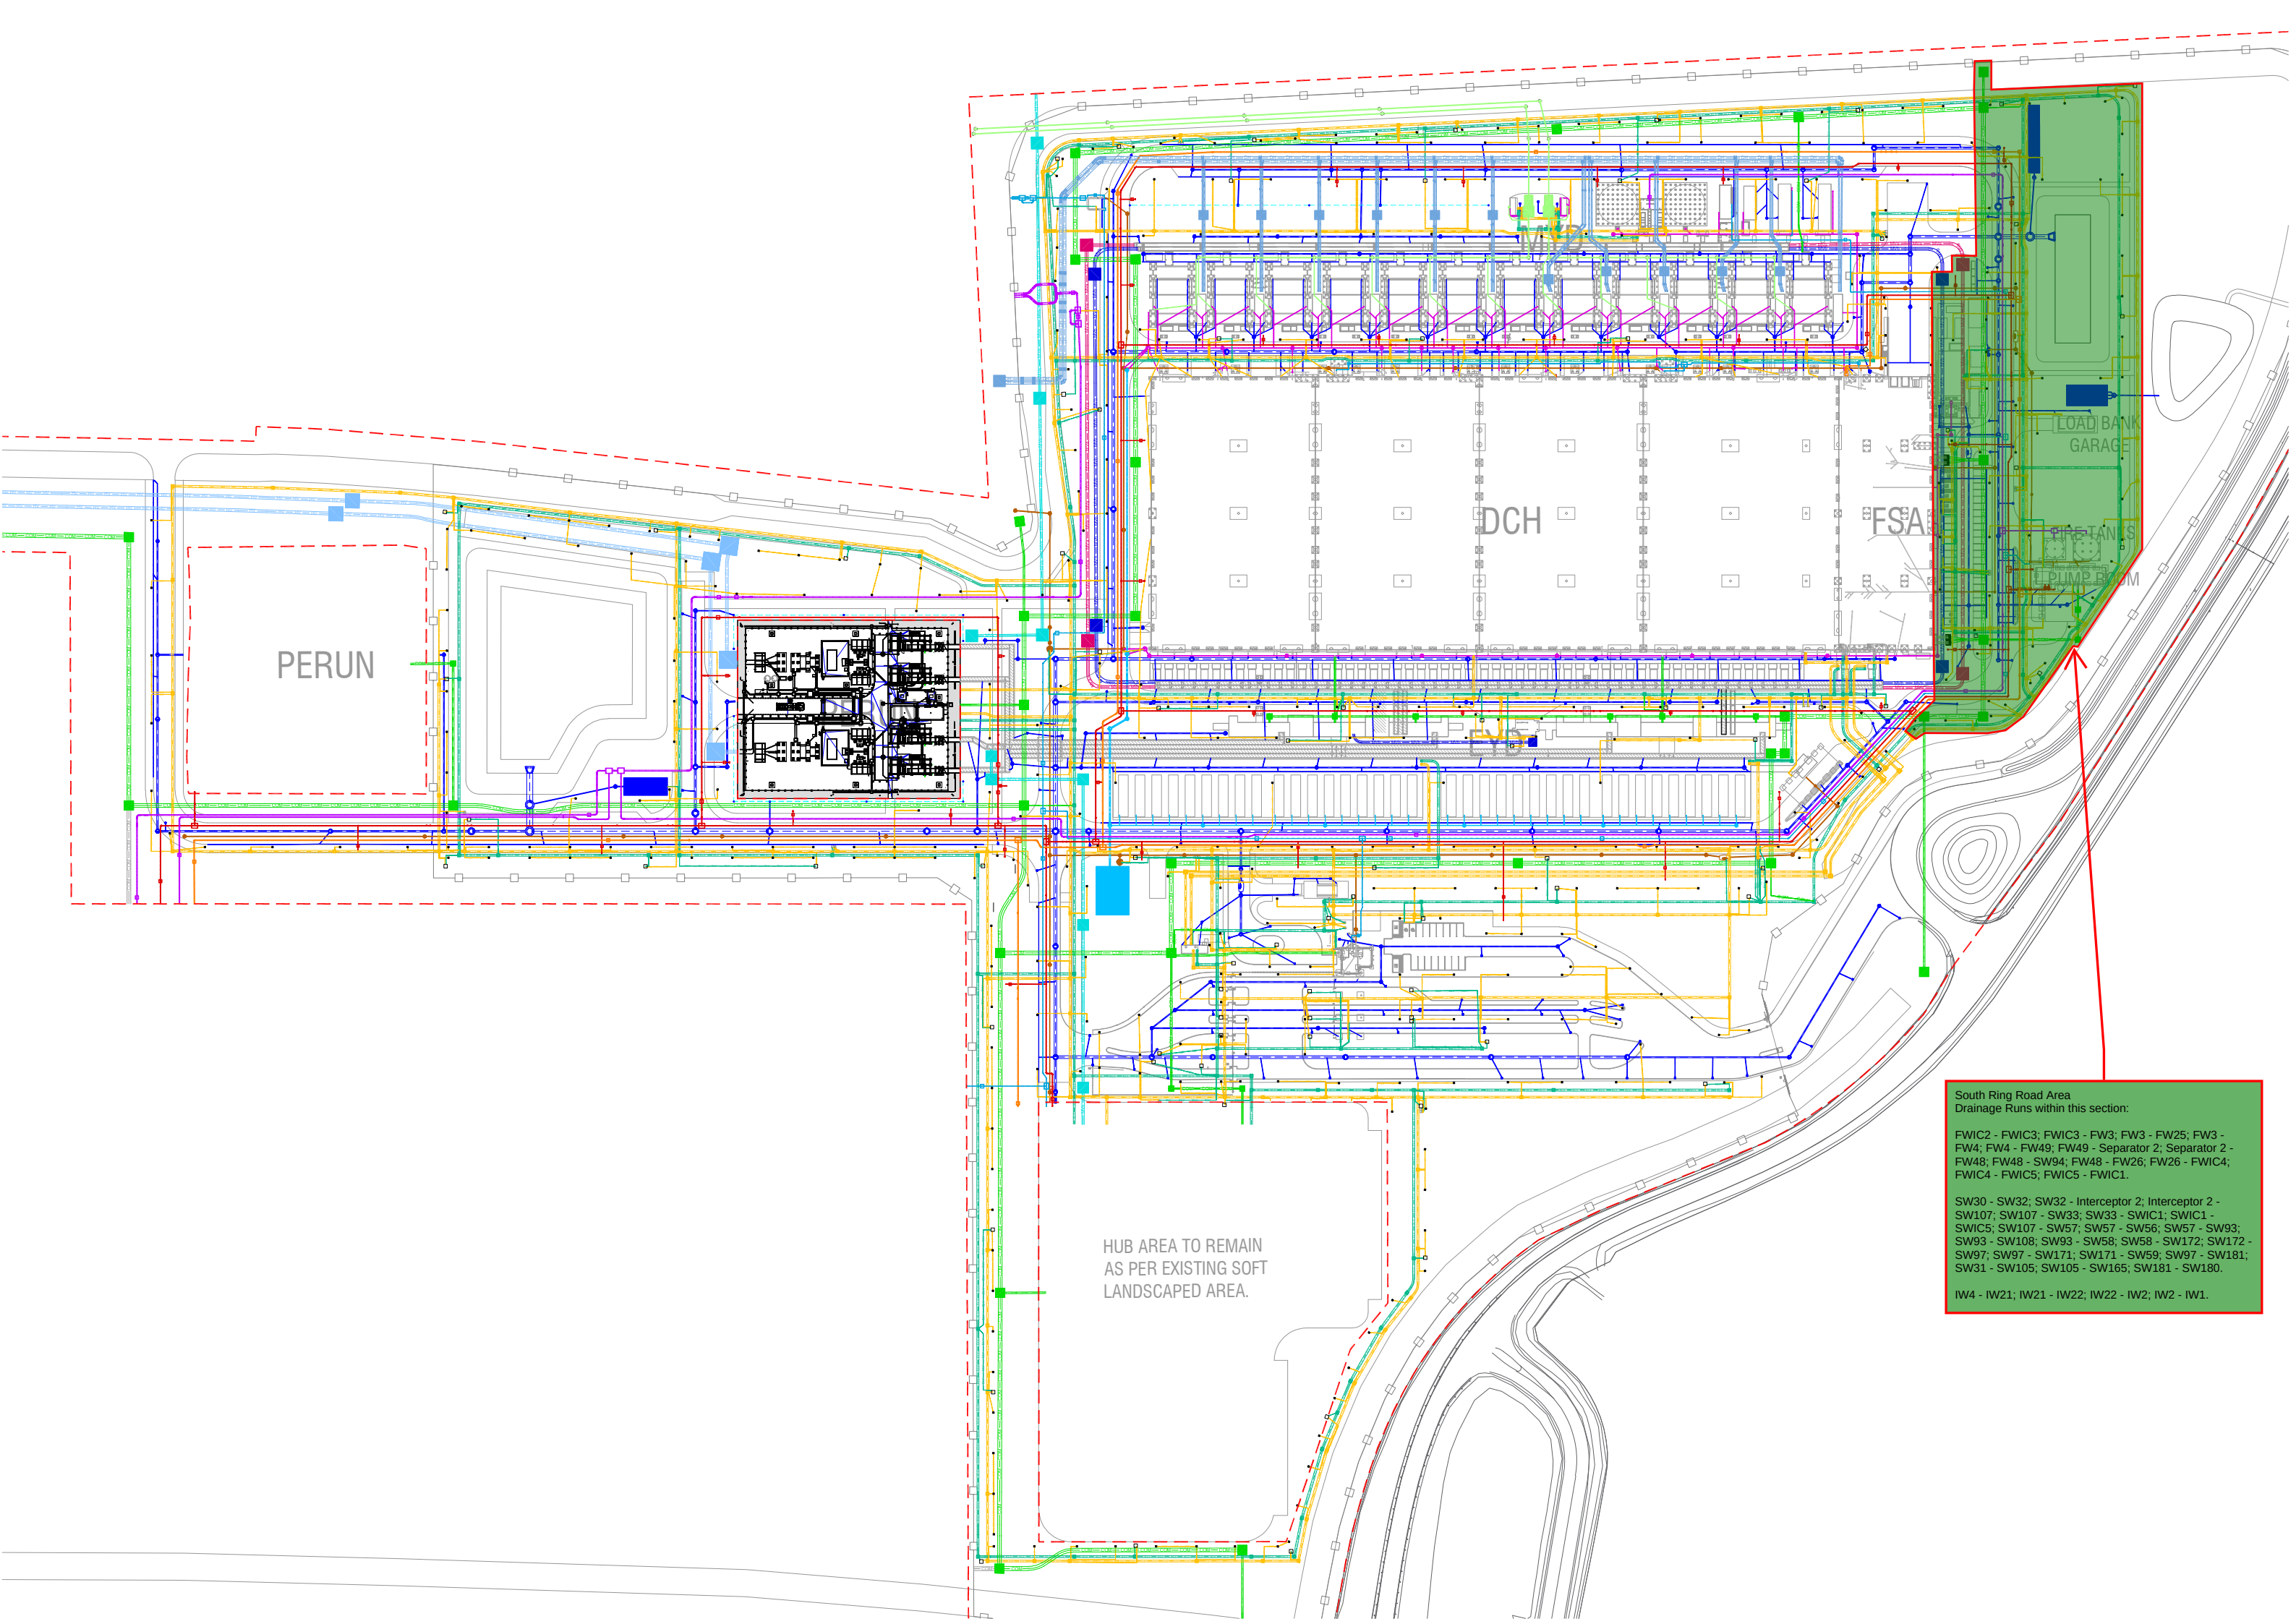

PERUN

DCH

FSA

LOAD BANK
GARAGE

FIRE TANKS
PUMP ROOM

HUB AREA TO REMAIN
AS PER EXISTING SOFT
LANDSCAPED AREA.

South Ring Road Area
Drainage Runs within this section:

FWIC2 - FWIC3; FWIC3 - FW3; FW3 - FW25; FW3 - FW4; FW4 - FW49; FW49 - Separator 2; Separator 2 - FW48; FW48 - SW94; FW48 - FW26; FW26 - FWIC4; FWIC4 - FWIC5; FWIC5 - FWIC1.

SW30 - SW32; SW32 - Interceptor 2; Interceptor 2 - SW107; SW107 - SW33; SW33 - SWIC1; SWIC1 - SWIC5; SW107 - SW57; SW57 - SW56; SW57 - SW93; SW93 - SW108; SW93 - SW58; SW58 - SW172; SW172 - SW97; SW97 - SW171; SW171 - SW59; SW97 - SW181; SW31 - SW105; SW105 - SW165; SW181 - SW180.

IW4 - IW21; IW21 - IW22; IW22 - IW2; IW2 - IW1.