


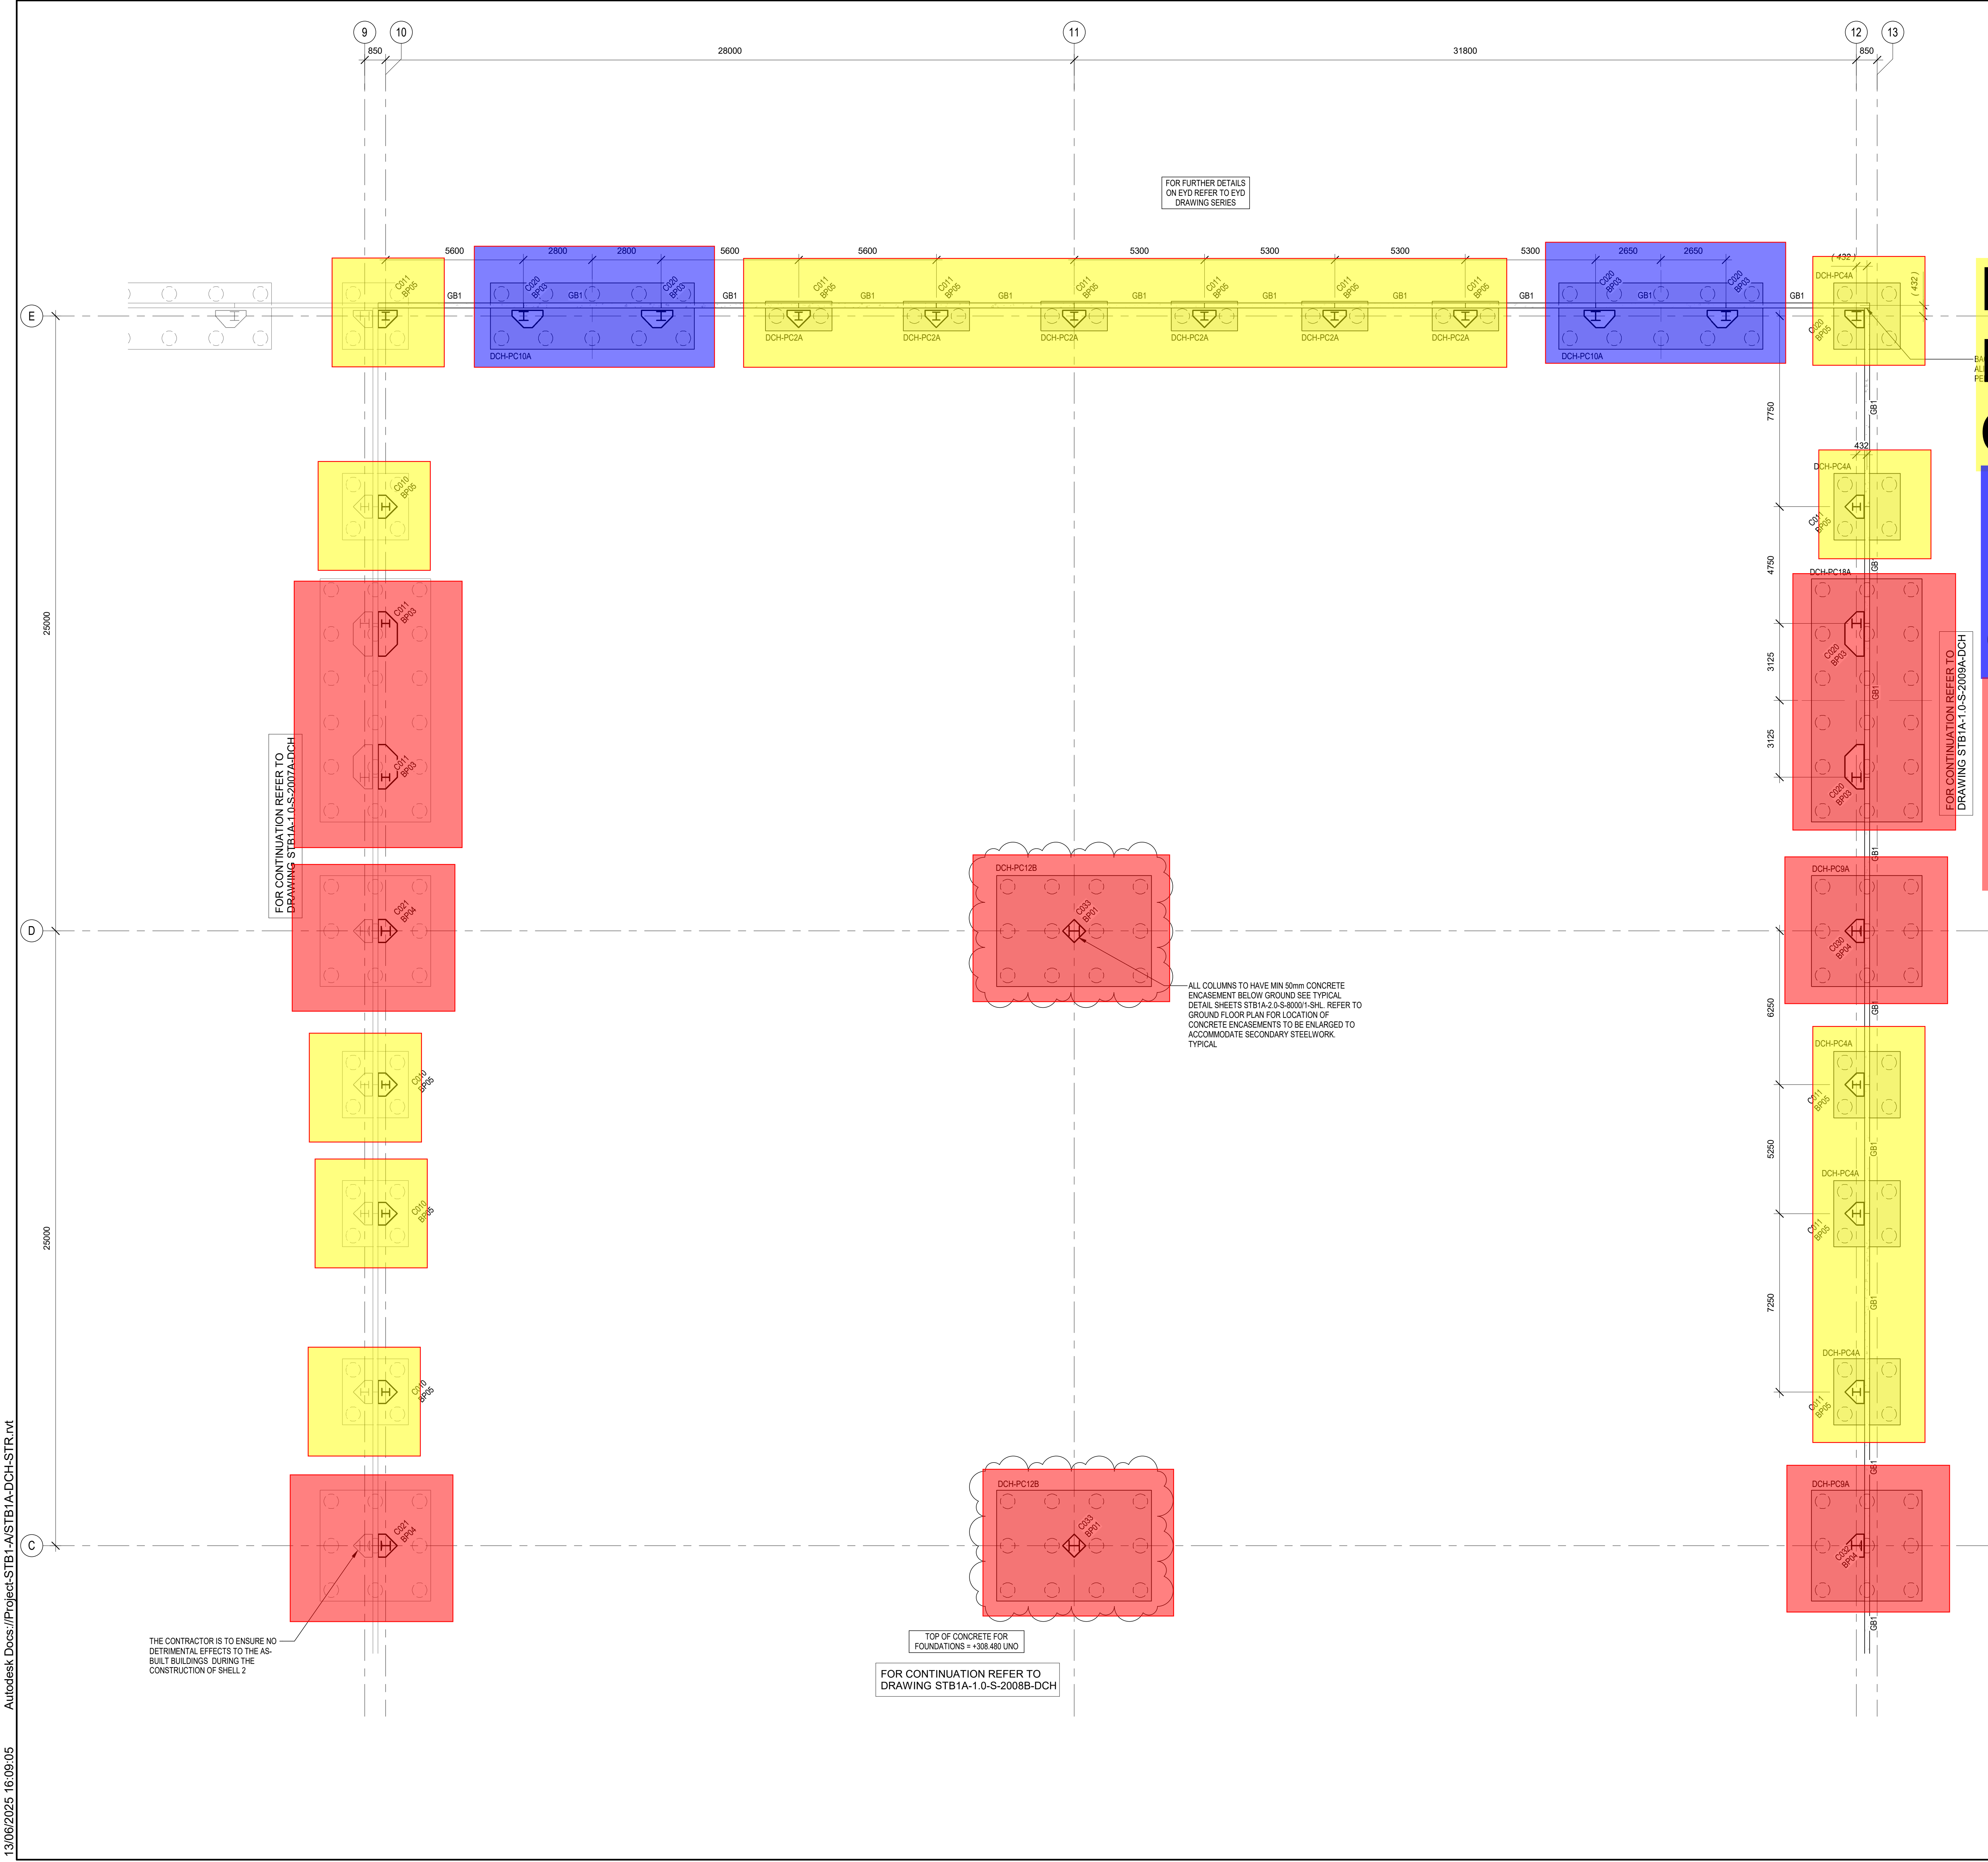

Dig:307.385
Blind: 307.485
Cut: 307.560
Dig: 306.975
Blind: 307.075
Cut: 307.150
Dig: 306.785
Blind: 306.885
Cut: 306.960

- NOTES:
1. DO NOT SCALE FROM THIS DRAWING
 2. ALL DIMENSIONS ARE IN MILLIMETRES UNO.
 3. ALL LEVELS ARE IN METRES UNO.
 4. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND ENGINEERS DRAWINGS AND SPECIFICATIONS
 5. FOR GENERAL NOTES REFER TO DRAWING STB1A-1.0-S-0010-SHL
 6. FOR SUBSTRUCTURE SECTIONS AND DETAILS REFER TO DRAWING SERIES STB1A-2.0-S-8000-SHL
 7. ALL FOUNDATION PADS ARE CENTERED ON COLUMNS UNLESS NOTED OTHERWISE
 8. GROUND LEVEL SLAB OMITTED FOR CLARITY
 9. TOP OF CONCRETE ENCASMENT AT COLUMNS SURROUNDED BY SLAB IN ENCLOSED SPACES TO MATCH TOP OF SURROUNDING STRUCTURAL SLAB AT FINAL CONDITION. SEE TYPICAL SEQUENCE OF STEEL COLUMN ENCASMENT DETAIL ON STB1A-2.0-S-8000-SHL
 10. ALL CONCRETE TO BE GRADE C30/37
 11. ALL REINFORCEMENT TO BE GRADE S50B MINIMUM
 12. GROUND FLOORS SLABS DESIGN IS BASED UPON A MINIMUM MODULUS OF SUB GRADE REACTION ACHIEVING A K=0.09N/mm² (APPROXIMATELY 30% CBR)

DCH PILECAP FOUNDATION SCHEDULE			
*DENOTES TO REFER TO PLAN			
TYPE MARK	LENGTH (mm)	WIDTH (mm)	DEPTH (mm)
DCH-PC2A	2700	1200	1000
DCH-PC4A	2700	2700	1000
DCH-PC5A	4000	2700	1000
DCH-PC6A	4500	2700	1000
DCH-PC8A	4500	4500	1600
DCH-PC9A	4500	4500	1600
DCH-PC10A	8300	2700	1400
DCH-PC10B	8950	2700	1400
DCH-PC12A	SEE DETAIL ON 8002		1000
DCH-PC12B	6300	4500	1600
DCH-PC18A	9900	4500	1600

DCH PLINTH SCHEDULE			
Type Mark	LENGTH (mm)	WIDTH (mm)	DEPTH (mm)
DCH-PL01	550.00	550.00	600
DCH-PL02	550.00	550.00	800
DCH-PL03	2500.00	550.00	800

DCH FOUNDATION RC INTENT			
TYPE MARK	TOP	BOTTOM	SIDE
DCH-PC2A	#20@150	#20@150	#16@200
DCH-PC4A	#20@150	#20@150	#16@200
DCH-PC5A	#20@150	#20@150	#16@200
DCH-PC6A	#20@150	#20@150	#16@200
DCH-PC8A	#26@125	#26@125	#16@200
DCH-PC9A	#26@125	#26@125	#16@200
DCH-PC10A	#26@125	#26@125	#16@200
DCH-PC10B	#26@125	#26@125	#16@200
DCH-PC12A	#20@150	#20@150	#16@200
DCH-PC12B	#26@125	#26@125	#16@200
DCH-PC18A	#26@125	#26@125	#16@200

GROUND BEAM SCHEDULE	
REF	TYPE
GB1	200x750 DEEP PRECAST BEAM
PRECAST BEAM RC INTENT = T&B: 2 No. #16 - SIDE: #12@200 - STIRRUP: #12@200	

DCH - STRUCTURAL SPS COLUMN	
TYPE MARK	TYPE
C010	HD 320 x 97.6
C011	HD 320 x 127
C020	HD 360 x 134
C021	HD 360 x 162
C030	HD 400 x 187
C032	HD 400 x 287
C033	HD 400 x 382

13/06/2025 16:09:05 Autodesk Docs\\Project\\STB1A-1.0-S-2008A-DCH-STR.rvt



- | DCH - STRUCTURAL SPS COLUMN | |
|-----------------------------|---------------|
| TYPE MARK | TYPE |
| C010 | HD 320 x 97.6 |
| C011 | HD 320 x 127 |
| C020 | HD 360 x 134 |
| C021 | HD 360 x 162 |
| C030 | HD 400 x 187 |
| C032 | HD 400 x 287 |
| C033 | HD 400 x 382 |