


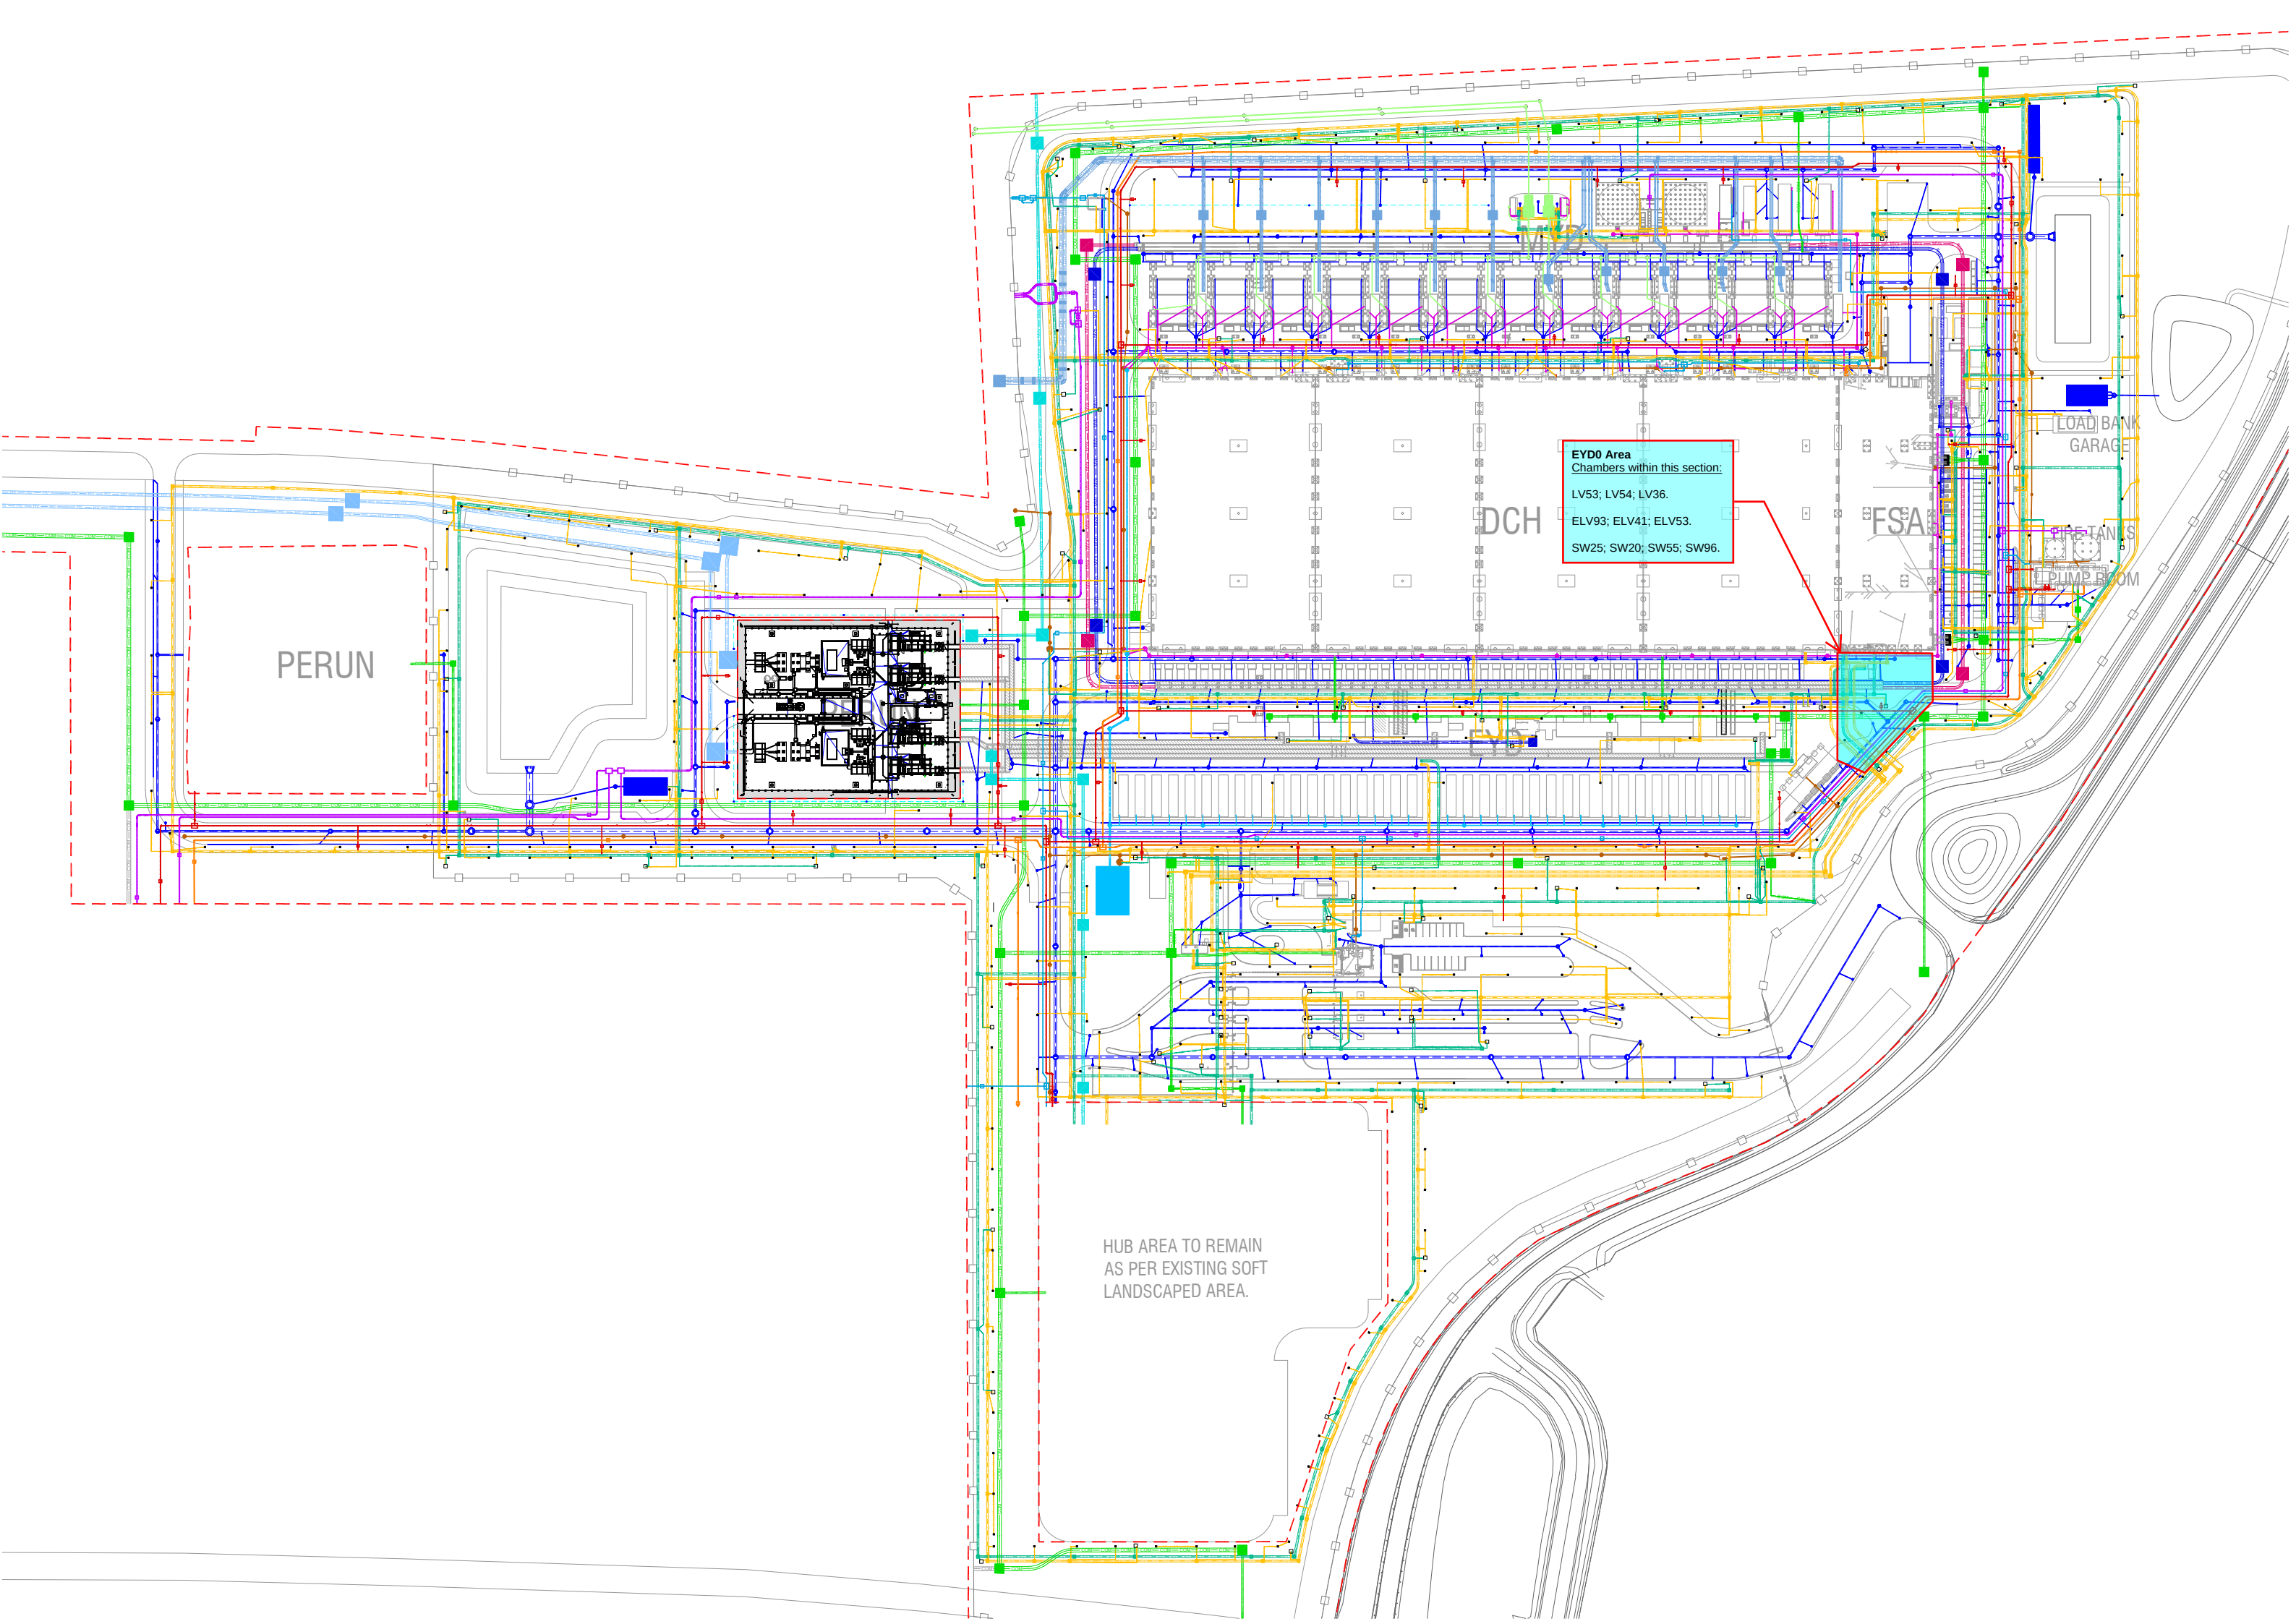

PERUN

DCH

FSA

LOAD BANK
GARAGE

FIRE TANKS
PUMP ROOM

EVD0 Area
Chambers within this section:
LV53; LV54; LV36.
ELV93; ELV41; ELV53.
SW25; SW20; SW55; SW96.

HUB AREA TO REMAIN
AS PER EXISTING SOFT
LANDSCAPED AREA.