



0
1:250 12.5m 25m

ARCHITECTURE:
ARC:MC
140-142 St. John Street,
London, EC1V 4UB
United Kingdom
t: +44 (0) 203 411 2571
e: info@arcmc.co.uk

INFRASTRUCTURE / CIVILS:
SWECO
Eldon House
2-3 Eldon Street
London,
EC2M 7LS
+44 (0) 20 3002 1210
e: www.sweco.co.uk

MEP:
Black & White Engineering
69 Wilson Street,
London, EC2A 2BB
United Kingdom
t: +44 (0) 207 683 7166
e: londoneng@bw-engineering.com

STB1A - PUF - IFC FINAL ISSUE (ISSUE FOR CONTRACT) 2026-01-23

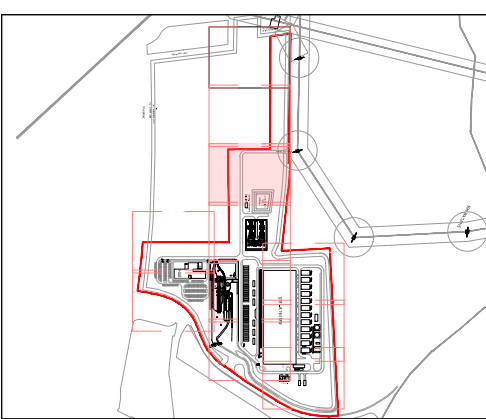

REVISIONS			Drawn By: MRP
NO.	DATE	DESCRIPTION	Approved By: CM
0.1	16/01/2025	DRAFT IFC ISSUE	Design Team: BW
0.2	21/02/2025	DRAFT IFC UPDATES	
0.3	12/03/2025	DRAFT IFC UPDATES	
1.0	11/04/2025	IFC FINAL ISSUE	
1.1	24/10/2025	POST IFC DRAFT ISSUE	
2.0	07/11/2025	POST IFC FINAL ISSUE	
3.0	09/01/2026	POST IFC DRAFT ISSUE	
4.0	23/01/2026	POST IFC FINAL ISSUE	

STB1A

BUCKINGHAM

Project Number: 65212899

Proposed Site Foul and Industrial Services
Layout Sheet 1

Discipline: Civil

Scale: 1:250

Sheet Size: A0

Sheet Number:
STB1A-1.0-C-1451-SDT

Current Rev: 4.0
Phase: IFC

Drawing Name: STB1A-1.0-C-1451-SDT.dwg
Native File Format: Civil 3D V.2024

NOTES:

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN METRES UNLESS OTHERWISE STATED. VALIDATE ALL MEASUREMENTS ON SITE.
- ANY DISCREPANCIES BETWEEN THE DRAWINGS AND OTHER DOCUMENTS SHOULD BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
- THIS DRAWING IS NOT AN INSTALLATION DRAWING. IT IS THE CONTRACTORS RESPONSIBILITY TO MAKE FINAL COORDINATED INSTALLATION SHOP DRAWINGS.
- THE CONTENTS OF THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE CURRENT REVISIONS OF ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, ELECTRICAL, SECURITY, TELECOMS DRAWINGS AND ALL RELEVANT SECTIONS OF THE SPECIFICATIONS.
- FOR DETAILED INFORMATION ON ENVIRONMENTAL CLOSURE VALVE (ECV) REQUIREMENTS REFER TO SPECIFICATION REF: STB1A - 33 31 00 - SITE SANITARY FOUL SEWER SYSTEM (EMEA). ECV'S WILL DIRECT CONTAMINATED FLOWS FROM THE INDUSTRIAL WATER SYSTEM TO THE FIRE WATER HOLDING TANK ON ACTIVATION OF THE FIRE ALARM.
- ALL FOUL AND INDUSTRIAL WATER DRAINAGE PIPES TO BE POLYETHYLENE (PE100) UP TO 300mm DIA, ALL PIPES OVER 300mm TO BE PRECAST CONCRETE (PCC). GENERAL ARRANGEMENT DRAWINGS DETAIL INTERNAL DIAMETERS OF DRAINAGE PIPES UNLESS NOTED OTHERWISE.

LEGEND

	STB1A WORKING AREA BOUNDARY
	SURFACE WATER DRAINAGE
	SURFACE WATER CONTAMINATED
	SURFACE WATER DRAINAGE CHANNEL
	SURFACE WATER PERFORATED PIPE
	FOUL WATER DRAINAGE
	FOUL WATER RISING MAIN
	FOUL WATER DRAINAGE CHANNEL
	INDUSTRIAL DRAINAGE
	BLOWDOWN WASTE
	TELECOMMUNICATION
	EXTRA LOW VOLTAGE NETWORK
	LOW VOLTAGE NETWORK
	MEDIUM VOLTAGE ROUTE A
	MEDIUM VOLTAGE ROUTE B
	MEDIUM VOLTAGE HUB
	HIGH VOLTAGE 110KV
	HEAT RECOVERY MAIN
	POTABLE WATER SUPPLY
	RAW WATER INFLOW (COOLING)
	HYDRANT MAIN
	SPRINKLER MAIN
	FOUL WATER DRAINAGE PUMPING STATION
	SURFACE WATER CHAMBER
	SURFACE WATER CONTAMINATED CHAMBER
	FOUL WATER CHAMBER
	RAW WATER INFLOW (COOLING) CHAMBER
	BLOWDOWN WASTE CHAMBER
	FUEL INTERCEPTOR
	FUEL RETENTION SEPARATOR
	FIRE RETENTION TANK
	GULLY
	EXTRA LOW VOLTAGE CHAMBER
	LOW VOLTAGE CHAMBER
	MEDIUM VOLTAGE ROUTE A CHAMBER
	MEDIUM VOLTAGE ROUTE B CHAMBER
	SECURITY MEDIUM VOLTAGE CHAMBER
	HIGH VOLTAGE CHAMBER
	TELECOMMUNICATION CHAMBER

FW15
CL: 306.376m
IL: 306.781m
Dp: 1.595m
Size: 12000mm
FOUL WATER CHAMBER FOR CONNECTION
TO STB2A SITE INFRASTRUCTURE

FOR CONTINUATION, REFER TO DRAWING STB1A-1.0-C-1453-SDT