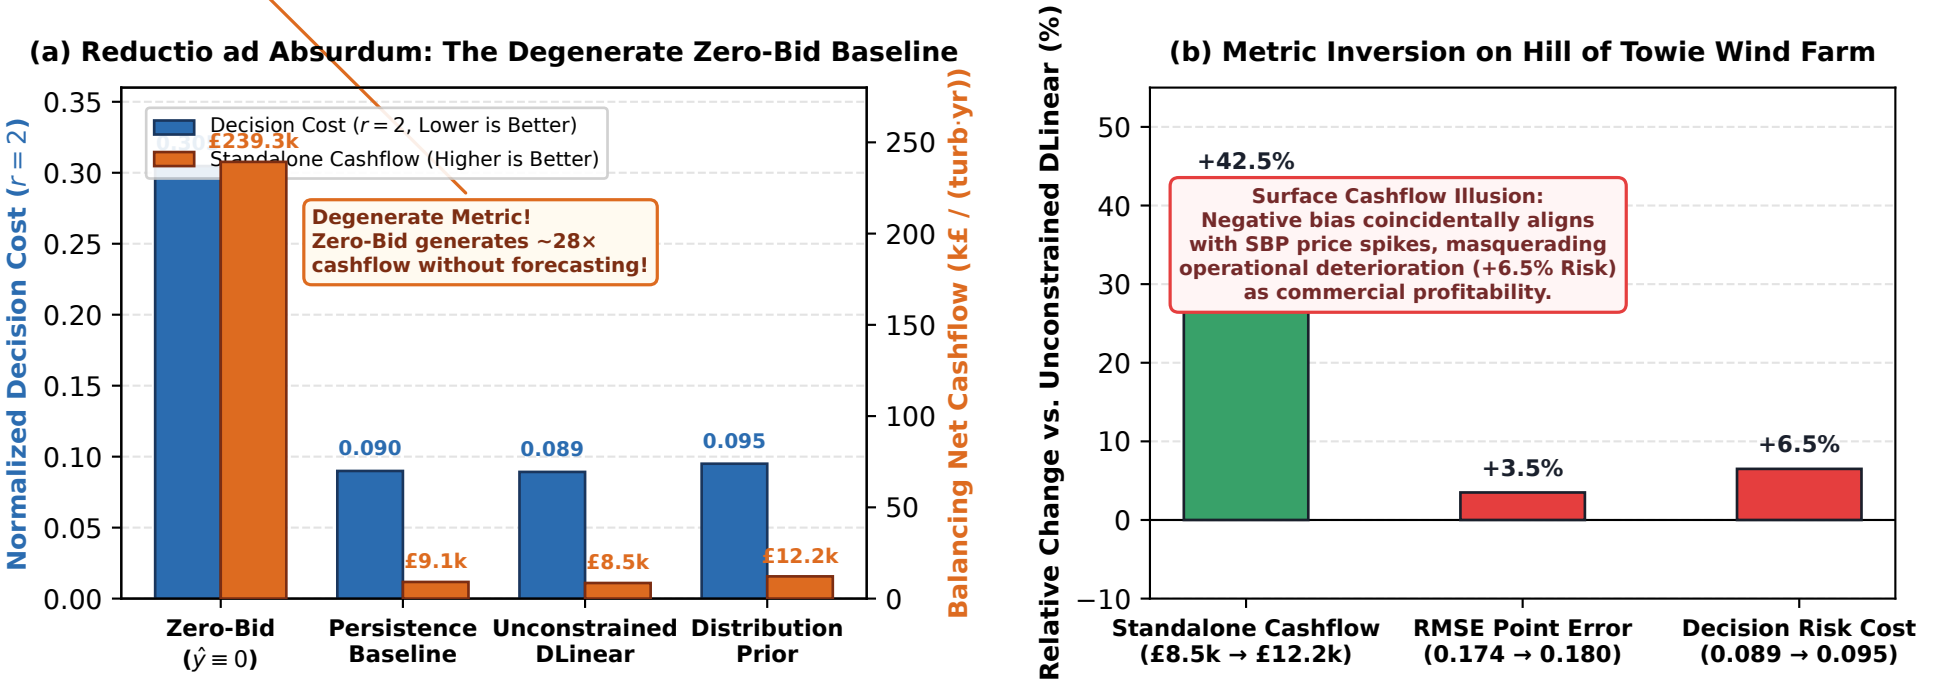
(a) Reductio ad Absurdum: The Degenerate Zero-Bid Baseline
Normalized Decision Cost (r = 2)
Balancing Net Cashflow (k£ / (turb·yr))
Decision Cost (r = 2, Lower is Better)
Standalone Cashflow (Higher is Better)
£239.3k
Degenerate Metric!
Zero-Bid generates ~28×
cashflow without forecasting!
0.090
£9.1k
0.089
£8.5k
0.095
£12.2k
Zero-Bid
(ŷ ≡ 0)
Persistence
Baseline
Unconstrained
DLinear
Distribution
Prior
(b) Metric Inversion on Hill of Towie Wind Farm
Relative Change vs. Unconstrained DLinear (%)
+42.5%
Surface Cashflow Illusion:
Negative bias coincidentally aligns
with SBP price spikes, masquerading
operational deterioration (+6.5% Risk)
as commercial profitability.
+3.5%
+6.5%
Standalone Cashflow
(£8.5k → £12.2k)
RMSE Point Error
(0.174 → 0.180)
Decision Risk Cost
(0.089 → 0.095)