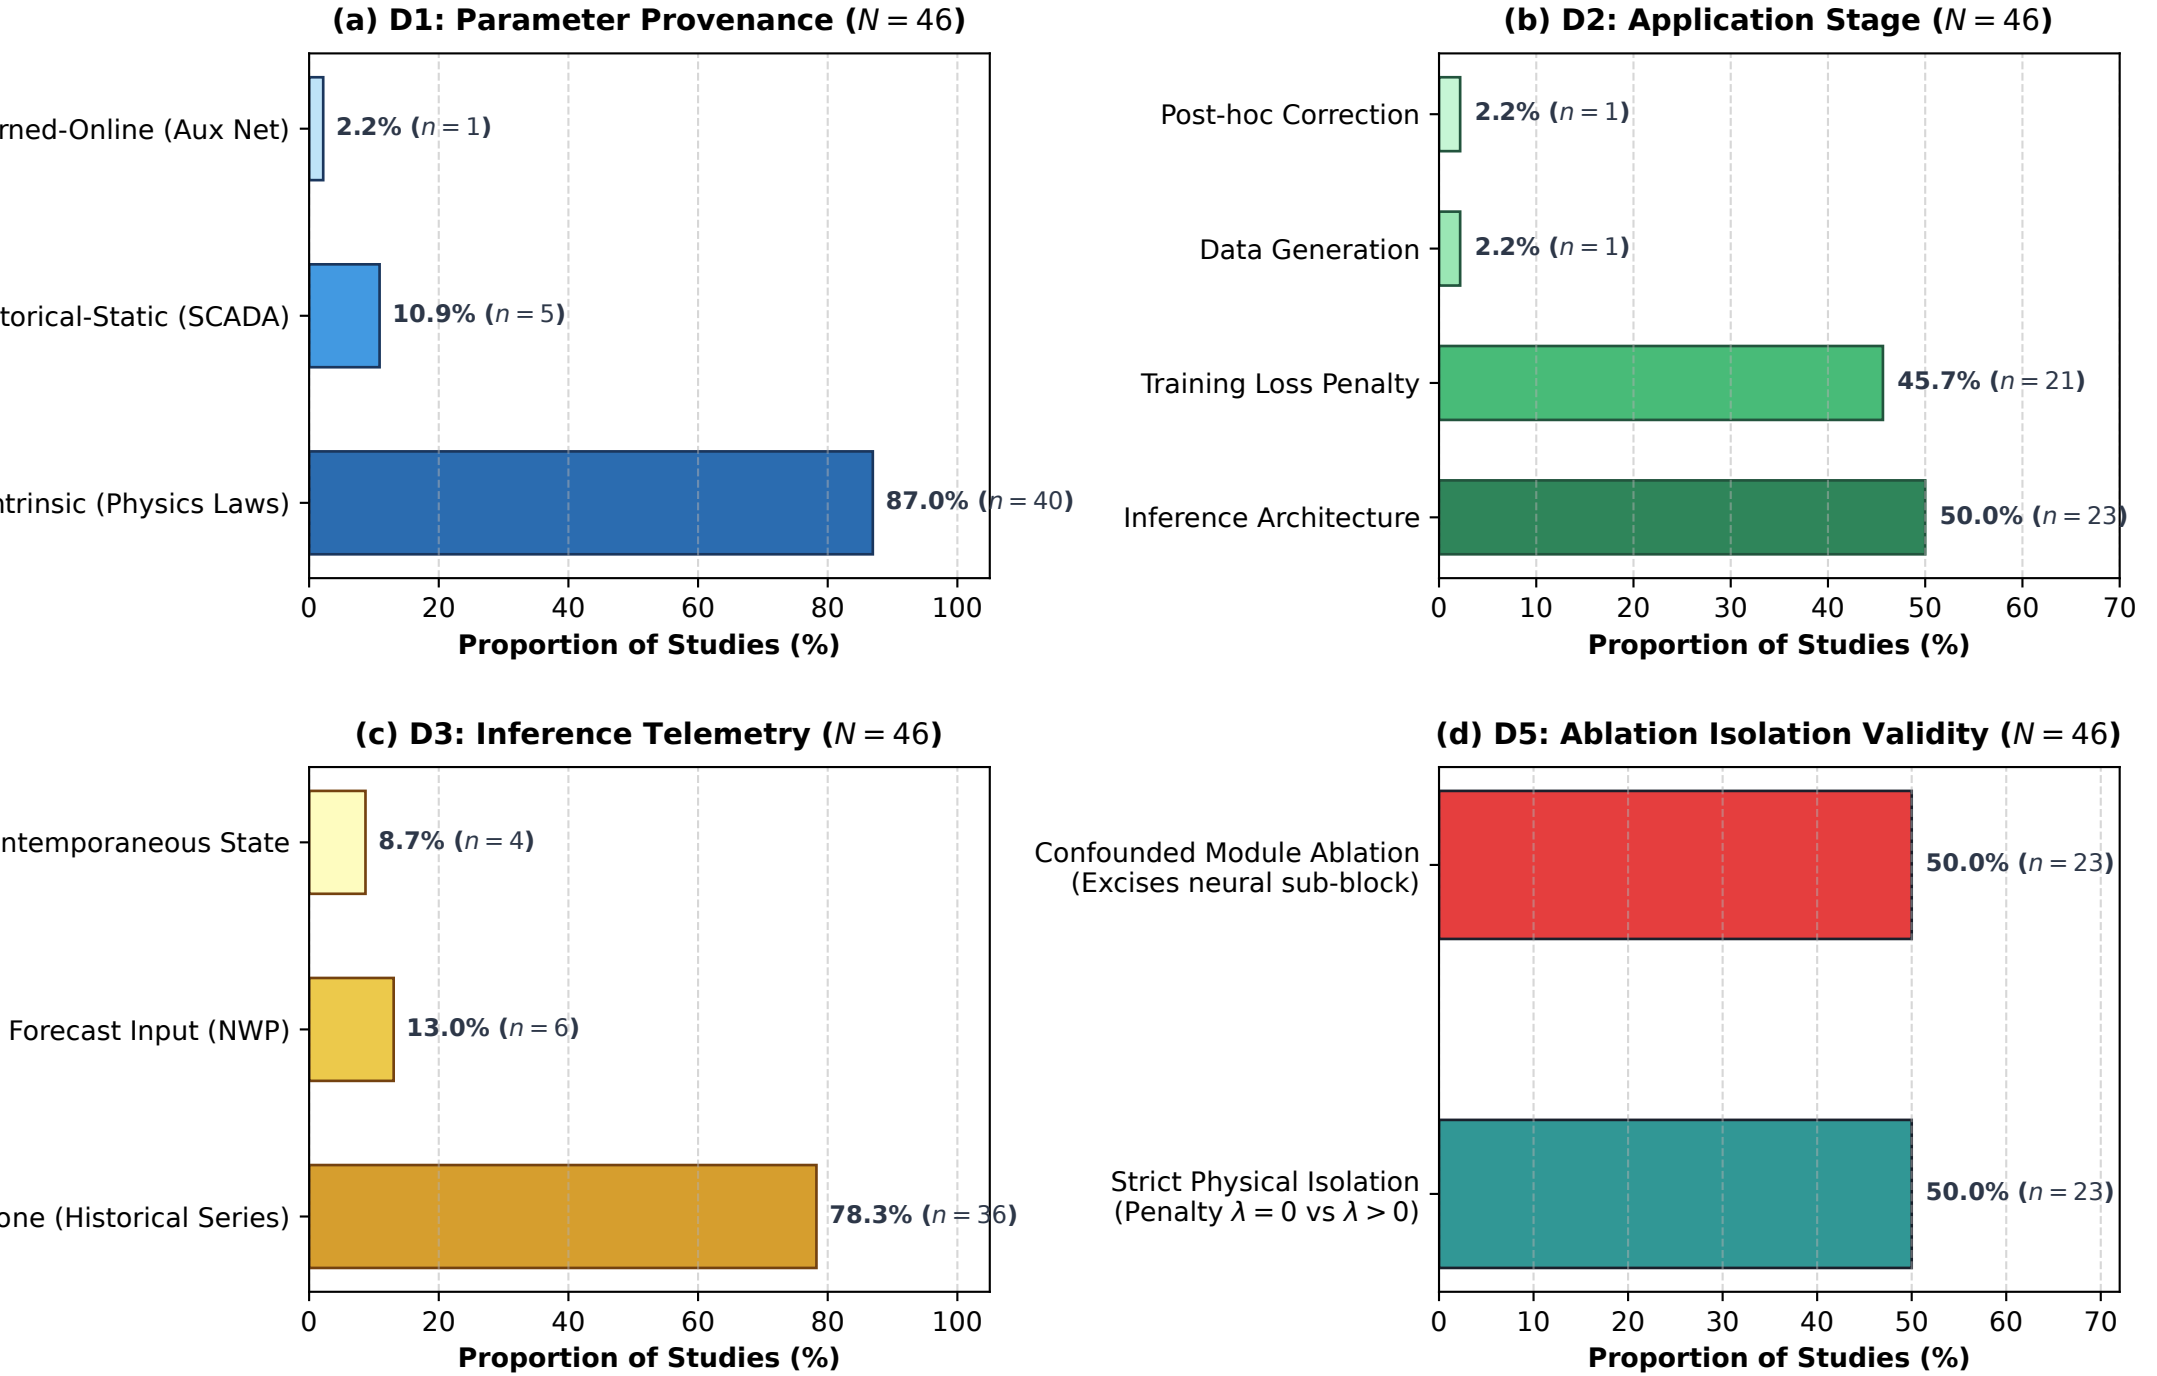
(a) D1: Parameter Provenance (N = 46)
rned-Online (Aux Net)
2.2% (n = 1)
torical-Static (SCADA)
10.9% (n = 5)
trinsic (Physics Laws)
87.0% (n = 40)
0
20
40
60
80
100
Proportion of Studies (%)
(b) D2: Application Stage (N = 46)
Post-hoc Correction
2.2% (n = 1)
Data Generation
2.2% (n = 1)
Training Loss Penalty
45.7% (n = 21)
Inference Architecture
50.0% (n = 23)
0
10
20
30
40
50
60
70
Proportion of Studies (%)
(c) D3: Inference Telemetry (N = 46)
ntemporaneous State
8.7% (n = 4)
Forecast Input (NWP)
13.0% (n = 6)
one (Historical Series)
78.3% (n = 36)
0
20
40
60
80
100
Proportion of Studies (%)
(d) D5: Ablation Isolation Validity (N = 46)
Confounded Module Ablation
(Excises neural sub-block)
50.0% (n = 23)
Strict Physical Isolation
(Penalty λ = 0 vs λ > 0)
50.0% (n = 23)
0
10
20
30
40
50
60
70
Proportion of Studies (%)