



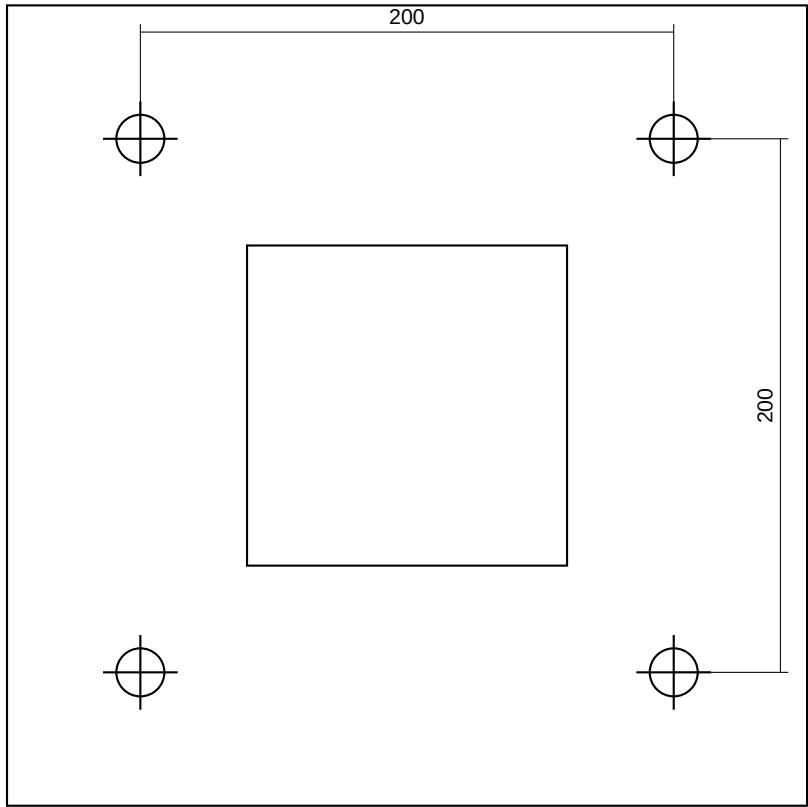

PLAN - 400x400x25 BASE PLATE WITH 4 No. M20 RODS

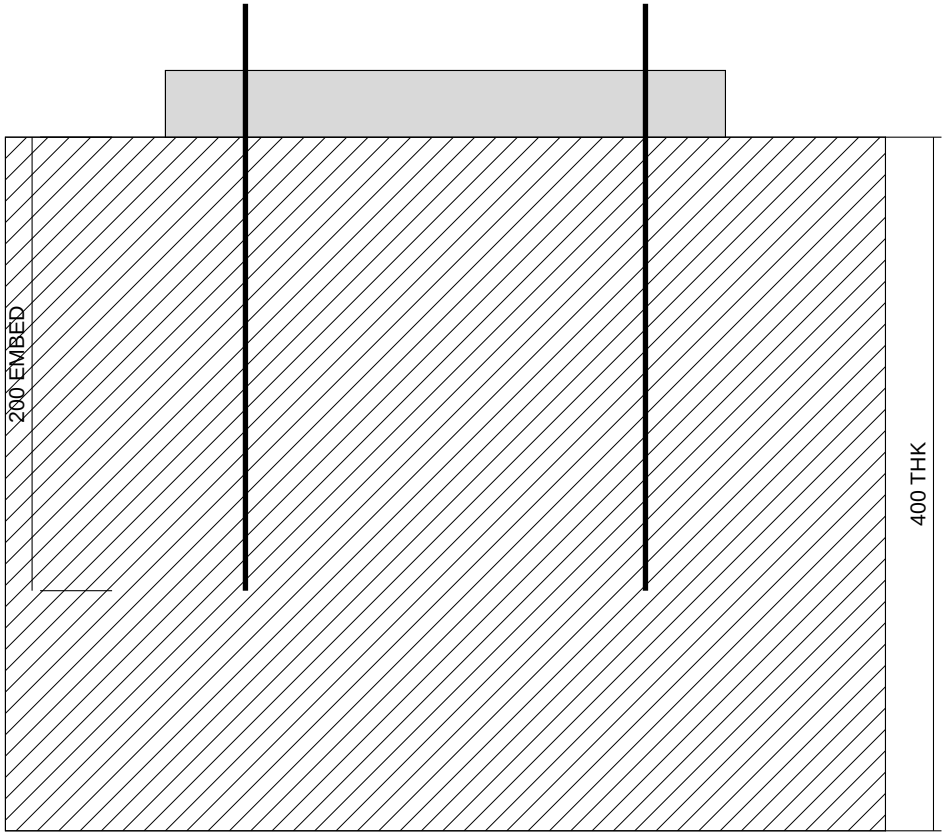


SECTION A-A - ANCHOR RODS IN 400 THK CONCRETE SLAB

GENERAL NOTES

1. CHEMICAL ANCHORS TO BE RAMSET CHEMSET REO 502 XTREM OR APPROVED EQUIVALENT.
2. ANCHORS: 4 No. M20 GRADE 8.8 GALVANISED THREADED ROD, 200 mm MIN EMBEDMENT, 22 mm DIA HOLE.
3. CONCRETE: N40 ($f_c = 40$ MPa). SLAB THICKNESS 400 THK. CRACKED CONCRETE ASSUMED.
4. EDGE DISTANCE 150 mm MIN. ANCHOR SPACING 200 mm.
5. DESIGN LOADS (ULS, GROUP TOTAL): TENSION $N^* = 60$ kN, SHEAR $V^* = 20$ kN.
6. INSTALL IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. CLEAN HOLES WITH BRUSH AND BLOWER.
7. SCAN FOR EXISTING REINFORCEMENT BEFORE DRILLING. ADHESIVE ANCHORS TO AS 5216.

SAMPLE ENGINEERING PTY LTD (FICTITIOUS)

PROJECT: DEMO WAREHOUSE EXTENSION
DRAWING TITLE: COLUMN BASE PLATE - CHEMICAL ANCHORS
SHEET NO: S-101
SCALE: 1:10 @ A3 REV: B DATE: 06/10/2026
STATUS: ISSUED FOR REVIEW

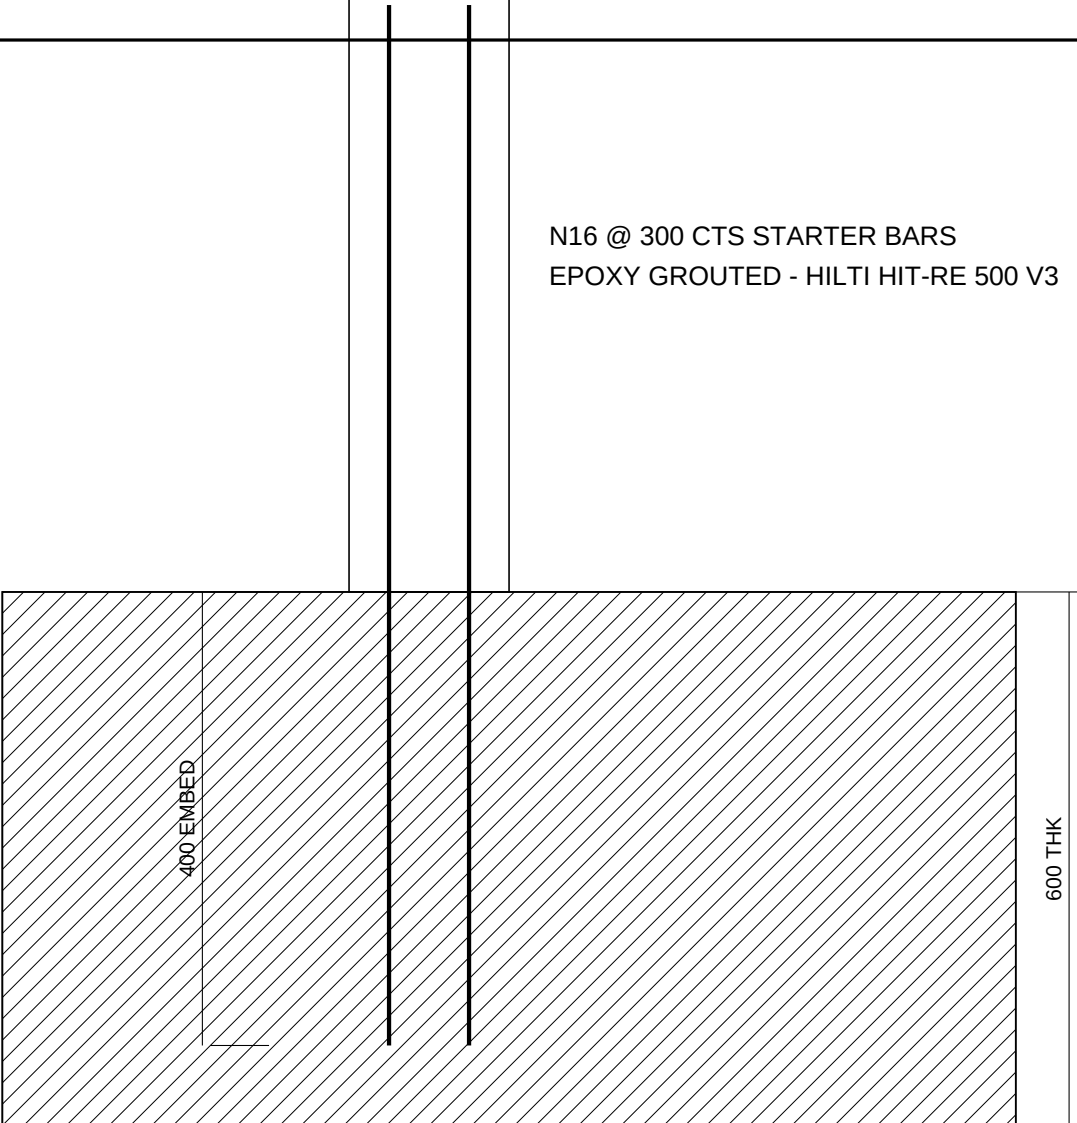

N16 @ 300 CTS STARTER BARS
EPOXY GROUTED - HILTI HIT-RE 500 V3

SECTION B-B - WALL TO EXISTING SLAB

GENERAL NOTES

1. N16 DOWELS @ 300 CTS EMBEDDED 400 mm INTO EXISTING SLAB WITH HILTI HIT-RE 500 V3 INJECTION EPOXY.
2. EXISTING SLAB CONCRETE $f_c = 32$ MPa (N32), 600 THK. COVER 50 mm.
3. DESIGN TENSION IN DOWELS: 45 kN/m ULS.
4. DRILL 20 mm DIA HOLES BY HAMMER DRILL. CLEAN HOLES WITH BRUSH AND COMPRESSED AIR.
5. INSTALLATION TO BE CARRIED OUT BY AEFAC CERTIFIED INSTALLERS. PROOF LOAD TEST 5% OF DOWELS.

SAMPLE ENGINEERING PTY LTD (FICTITIOUS)

PROJECT: DEMO WAREHOUSE EXTENSION
DRAWING TITLE: WALL STARTER BARS - POST-INSTALLED DOWELS
SHEET NO: S-102
SCALE: 1:10 @ A3 REV: B DATE: 06/10/2026
STATUS: ISSUED FOR REVIEW