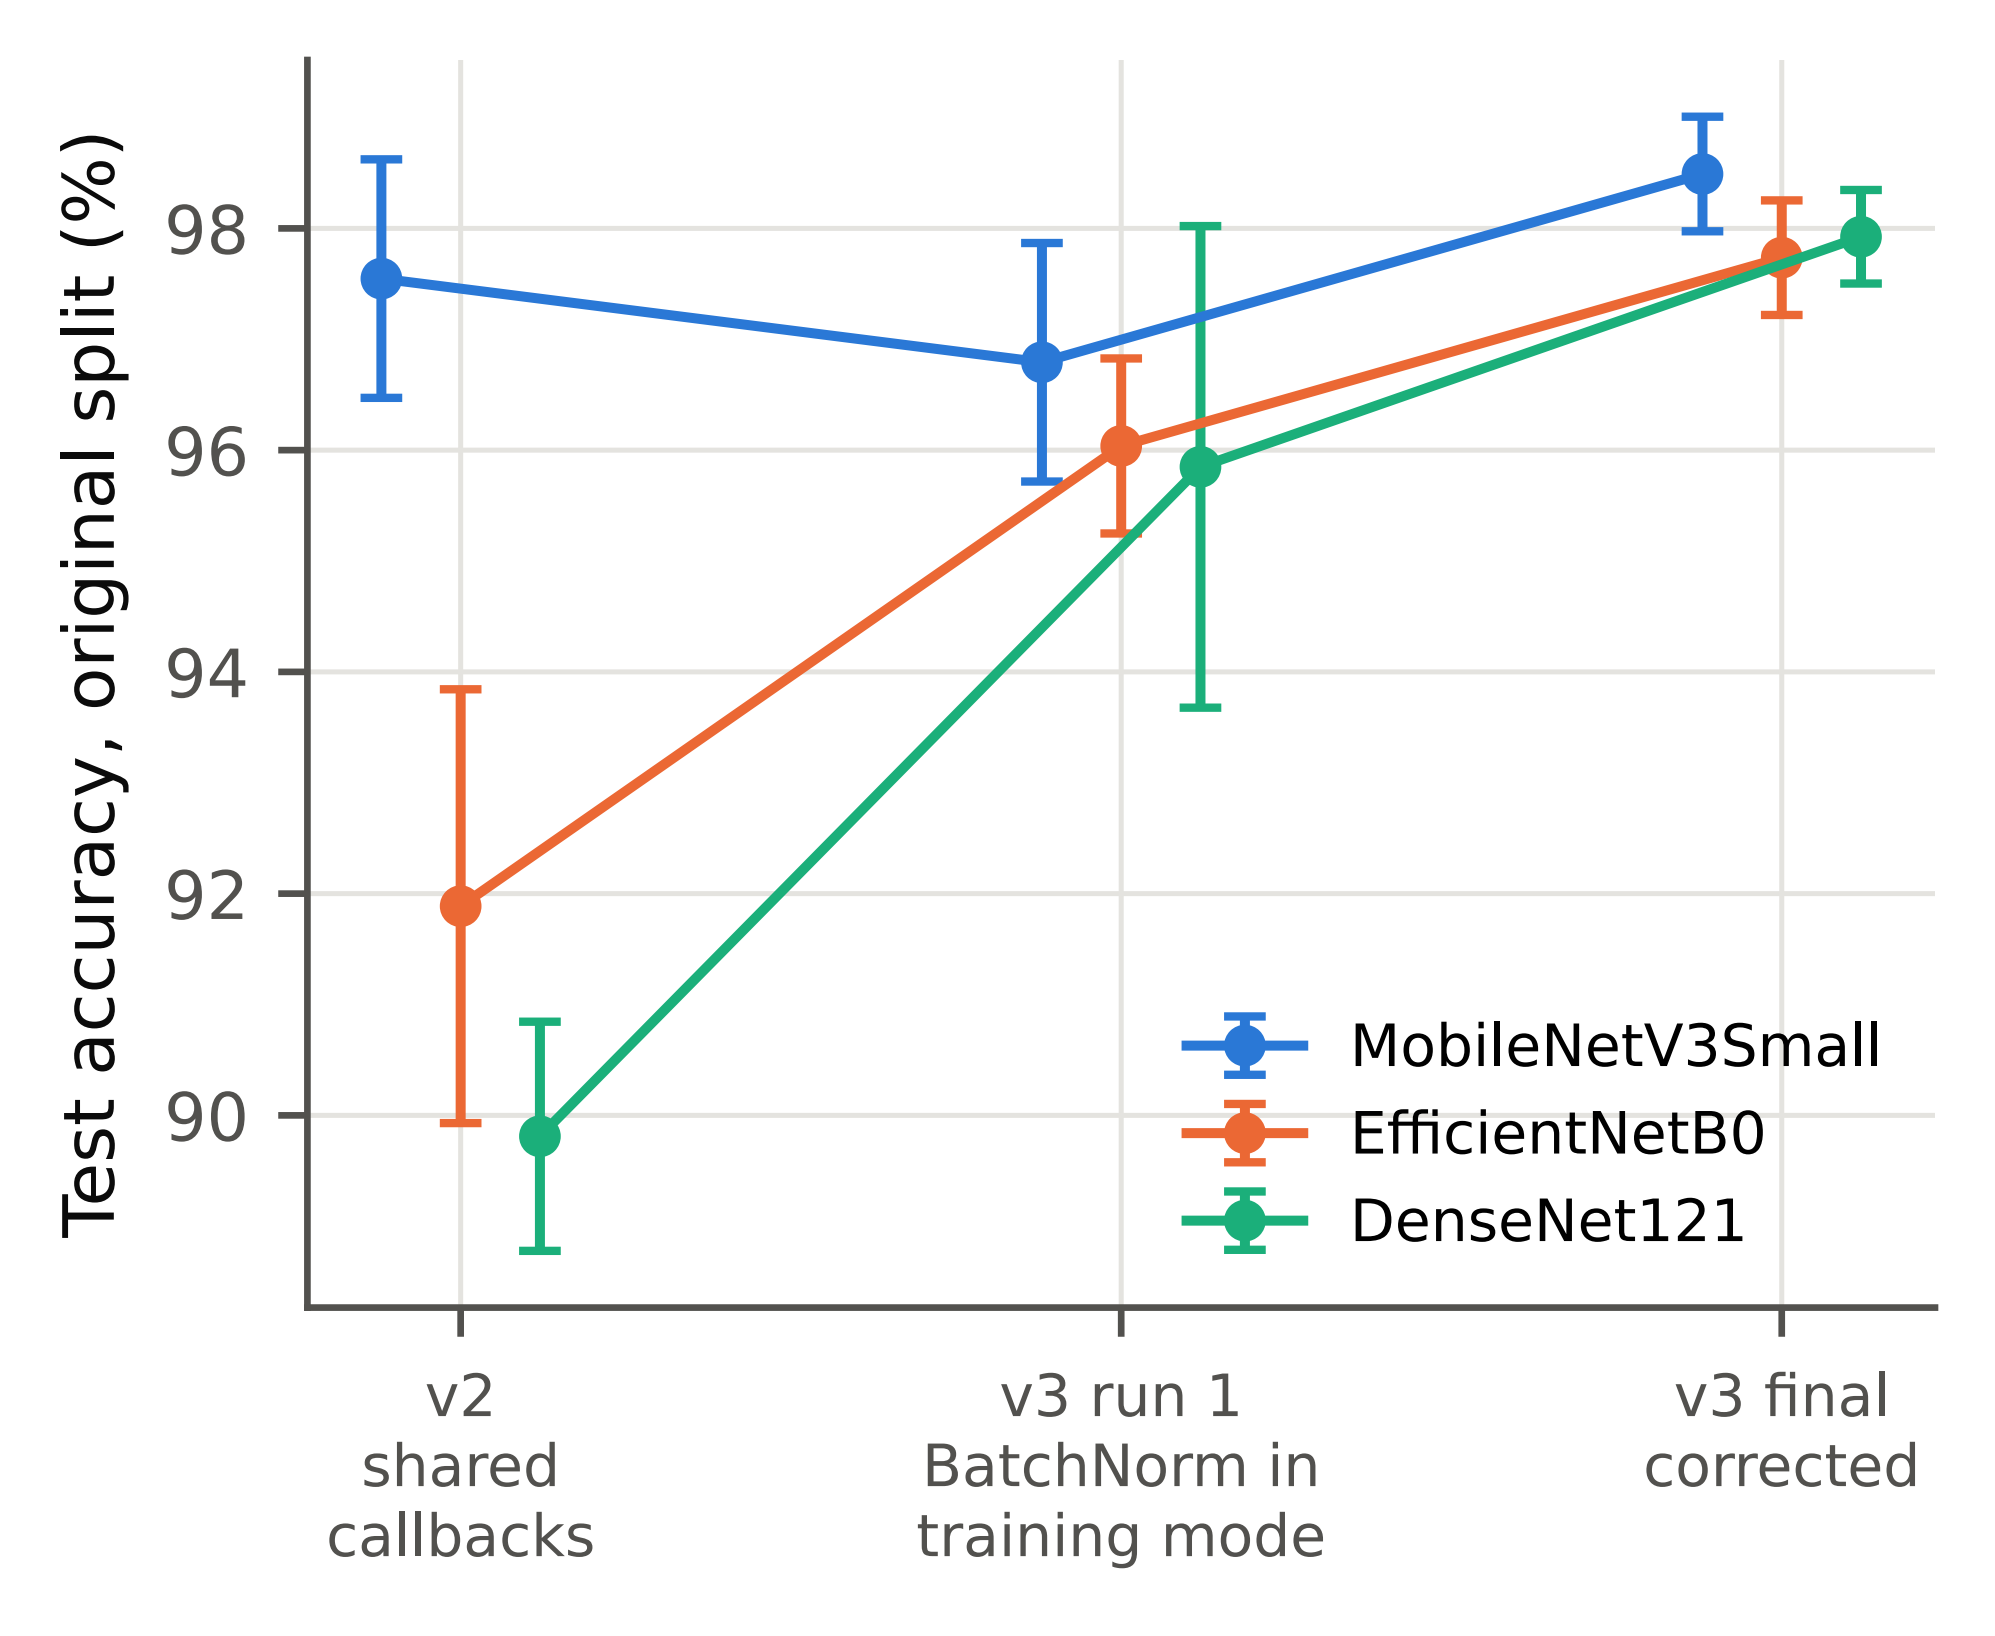

Test accuracy, original split (%)
98
96
94
92
90
MobileNetV3Small
EfficientNetB0
DenseNet121
v2
shared
callbacks
v3 run 1
BatchNorm in
training mode
v3 final
corrected