



Post-freeze resampling diagnostics - not confirmatory M4/M5

Centered-null rejection

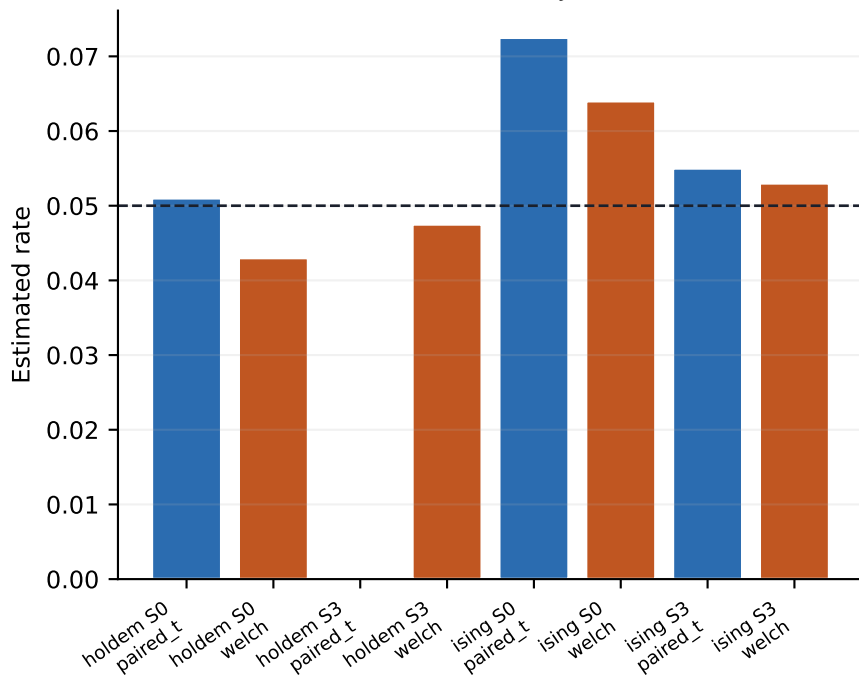

Centered-null interval inclusion

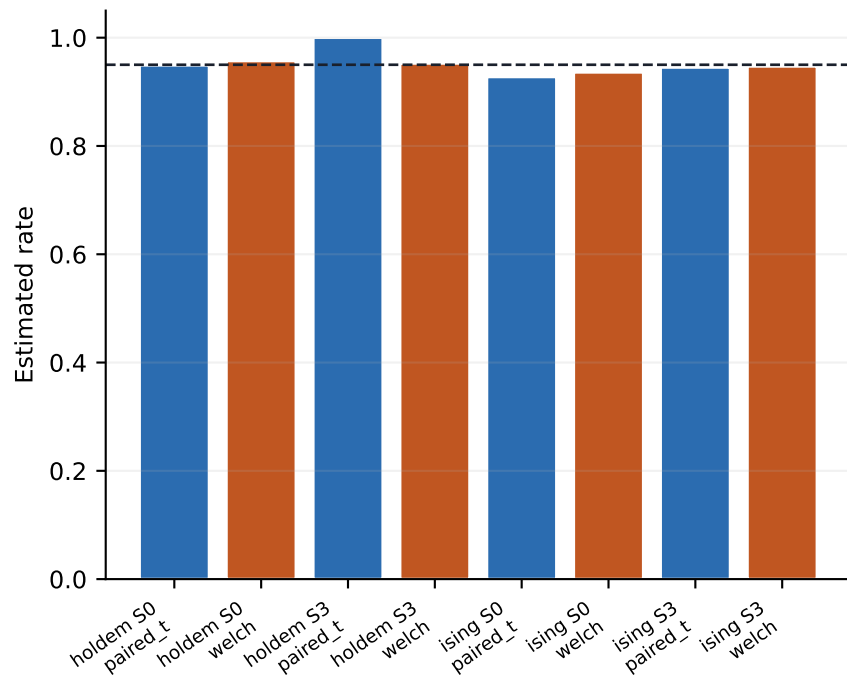

Promised A/A mirror and equal-temperature banks were not retained; bars use centered empirical proxies (B=2,000).