

FEATURES & BENEFITS

BOTTLE FILLER VALVE

With its patented stainless steel, push-button activated valve assembly which allows for front access stream adjustment as well as cartridge and strainer access, this bottle filler offers 100% lead free waterways. The valve works at an operating pressure range of 30 to 90 psi (2.1 to 6.2 bar).

CONSTRUCTION

Unit is made of 14 gauge Type 304 stainless steel with a satin finish that resists stains and corrosion, and has soft rounded corners. Unit features vandal-resistant bottom plate and dispensing nozzle.

VANDAL-RESISTANT

The push button and bottom plate are locked in place, discouraging unwanted vandal tampering.

LAMINAR FLOW

Adjustable, splash-free, 1 gpm (3.78 L) laminar water flow.

EFFICIENT AND FLEXIBLE INSTALLATION

Unit is designed for retrofit or new construction applications. No drain required for mounting over existing drinking fountain.

MOUNTING OPTIONS

Comes with an in-wall 3/16" thick steel mounting plate and select from back panel models to complete installation. Unit can mount on various wall types.



OPTIONS

- Water Filter: Model 6480 filter kit with 3000 gallon carbon block filter, filter head, and mounting bracket.
- Mounting Plate: Model 6700, in-wall mounting plate for model 1920.
- Mounting Plate: Model 6700R on-wall mounting plate for model 1920.
- Back Panel: Model BP15, satin finish stainless steel 15 inch back panel for Model 1920 over a single fountain.
- Back Panel: Model BP32, satin finish stainless steel 32" back panel for model 1920 bottle filler over a dual fountain.
- Drain Basin: Model 6468 drip tray accessory catches unused bottle filler water.

For more information, visit www.hawesco.com or call (888) 640-4297.

SPECIFICATIONS

Model 1920 wall mounted vandal-resistant bottle filler shall include 100% lead-free waterways, satin stainless steel construction, 1 gpm (3.78 L) laminar flow, push-button operated stainless steel valve with front-accessible cartridge and flow adjustment. It can be used as a stand-alone station or mounted above the Haws® 1001, 1011, 1107L, 1109, 1117L, and 1119 series drinking fountains. In extreme environments related to heat and cold, product(s) must be protected from damage/exposure due to these extreme conditions.

This product requires a mounting plate; either the 6700 in-wall or the 6700R on-wall support plate. (See options below)

APPLICATIONS

Great for business and municipality settings, indoors and out, this bottle filler can be placed virtually anywhere. It also compliments drinking fountains already in use.

Haws manufactures drinking fountains, faucets and electric water coolers to be lead-free by all known definitions including NSF/ANSI/CAN 61-Section 9, NSF/ANSI/CAN 372, California Proposition 65, and the Federal Safe Drinking Water Act. Product is compliant to California Health and Safety Code 116875 (AB 1953-2006), and 116876 (AB 100) "NSF/ANSI/CAN 61: Q ≤ 1".



1920 INDEX

INSTALLATION WITH:	TYPICAL USES	SEE SHEET...
1001/1011 BOWLS	HAWS SERIES 1001, H1001.8X, 1011, 1011.8X STYLE FOUNTAINS	3 OF 9
1109/1119 BOWLS		4 OF 9
1107/1117 BOWLS		5 OF 9
1311/1501 BOWLS		6 OF 9
1047		7 OF 9
6468		8 OF 9
CHILD HEIGHT	HAWS 1107P STD CONFIG CHILD HEIGHT, 1109P STD CONFIG CHILD HEIGHT, 1311P STD CONFIG CHILD HEIGHT	9 OF 9





1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO. REVISED PER BY: J.G.
DRAWN BY: DATE: CHK'D: J.G.
APPROVED: DATE: 11/2/24



MODEL(S)
1920/1920HPS/1920W

PART NUMBER
0510000490.D
REVISION
13

SCALE: N/A DRAWING TYPE: INSTALLATION SIZE: A SHEET 1 OF 9

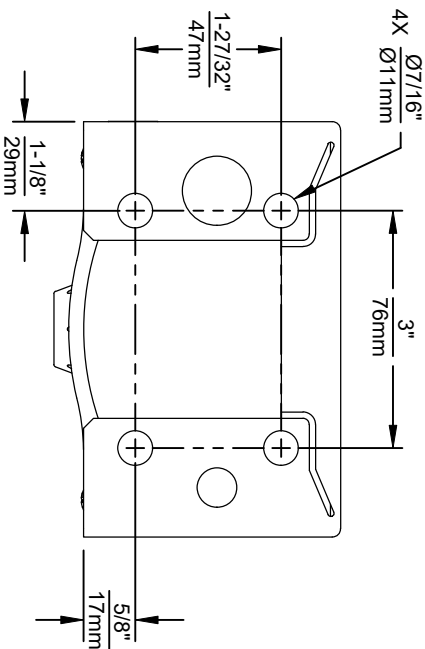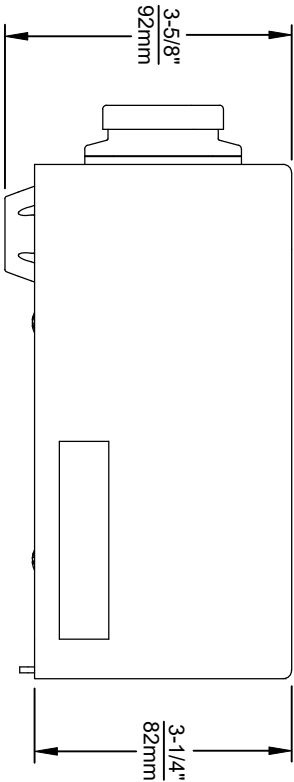

1920 SERIES MOUNTING HOLE LOCATIONS
(3/8"-16 UNC MOUNTING HARDWARE NOT SUPPLIED)

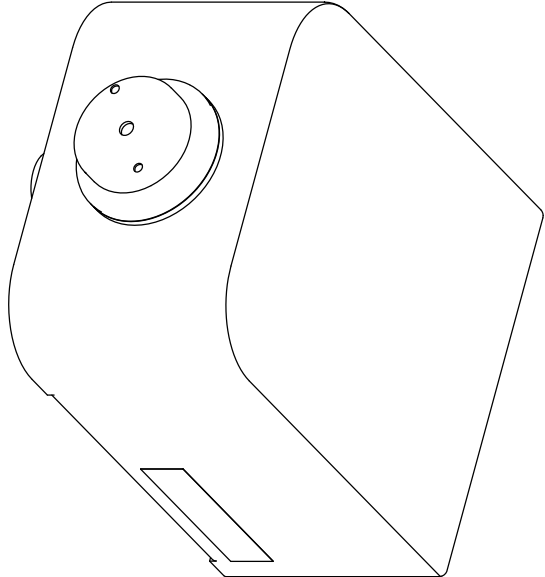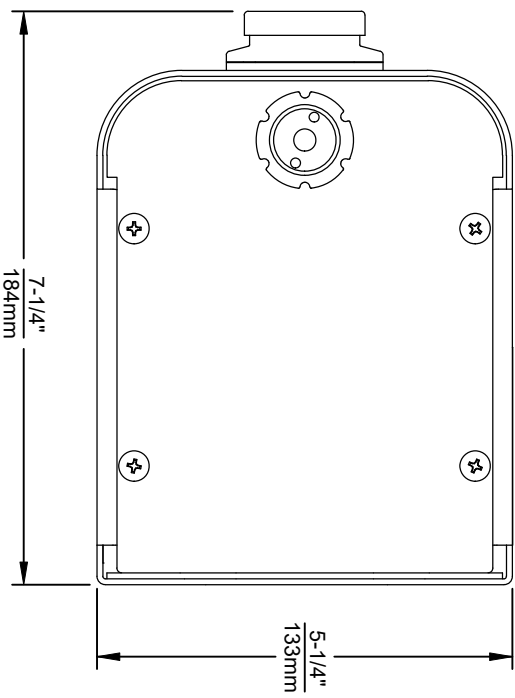

NOTES:



1. SEE SHEETS 2 THRU 7 FOR BOTTLE FILLER ADULT ADA HEIGHT APPLICATIONS AND SHEET 8 FOR CHILD ADA HEIGHT APPLICATIONS.
2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.



Haws
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWSCO.COM
WEBSITE: WWW.HAWSCO.COM

EON NO. REVISED PER BY:		MODEL(S)	
5041	EON 6131 J.G.	1920/1920HPS/1920W	
DRW	DATE: 08/25/16	PART NUMBER	
APPROVED:	DATE: 11/2/24	0510000490.D	
RH	SCALE: N/A	REVISION	
	DRAWING TYPE: INSTALLATION	13	
	SIZE: A	SHEET 2 OF 9	

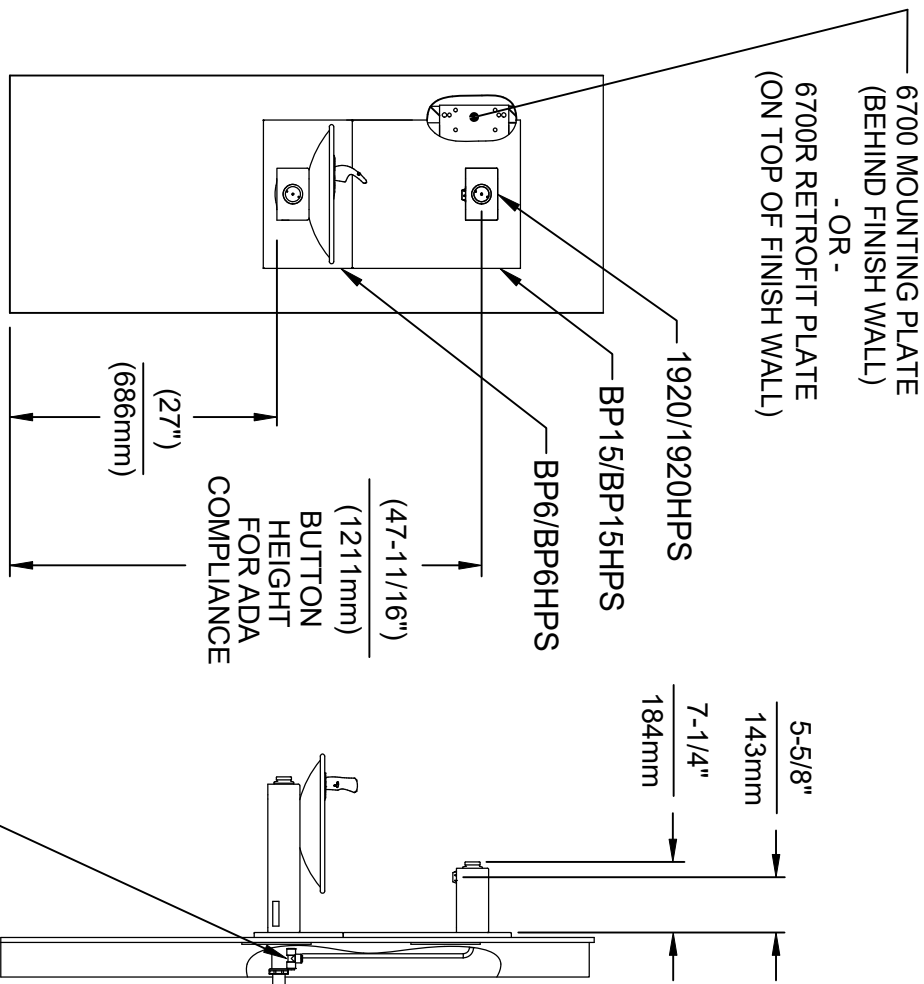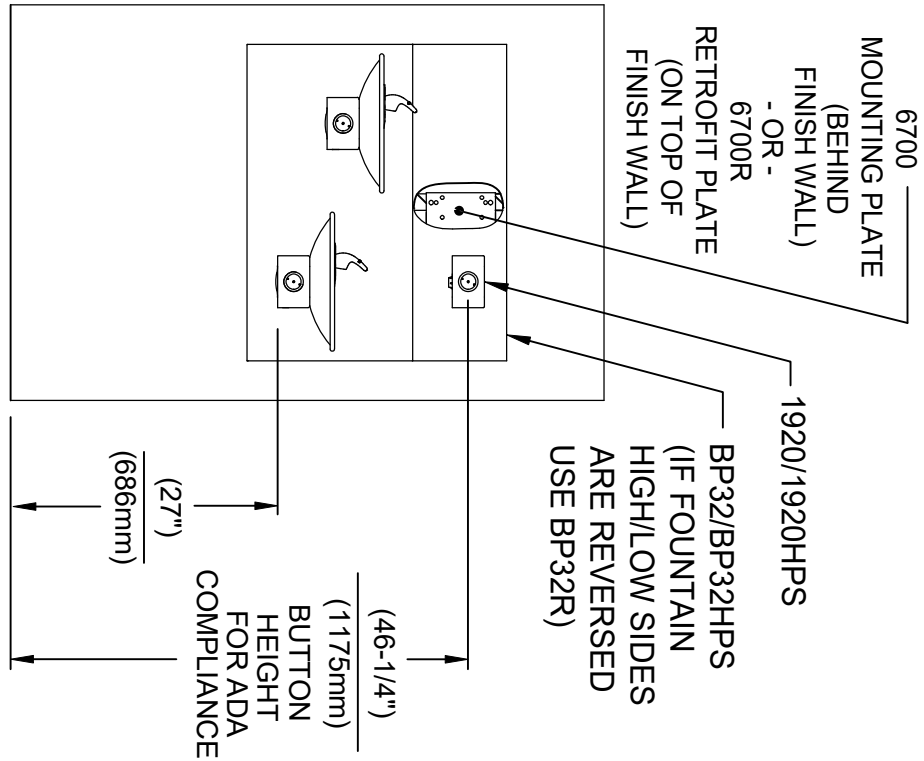


INSTALLATION ABOVE HAWS 1011 & H1011.8 SERIES

INSTALLATION ABOVE HAWS 1001 & H1001.8 SERIES

* IF YOUR FOUNTAIN IS THIS STYLE USE THESE DIMENSIONS

1. SEE SEPARATE INSTALLATION DRAWINGS FOR MOUNTING PLATES AND BACK PANELS (SHOWN FOR REFERENCE - NOT SUPPLIED).

2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION REQUIREMENTS OTHER THAN SHOWN.

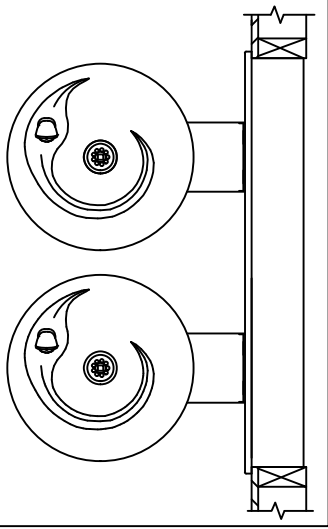


3/8" O.D. SUPPLY TUBING AND 3/8" O.D. PUSH-IN TEE SUPPLIED. (CONNECT TO FOUNTAIN SUPPLY LINE)



Haws
Since 1906

ECN NO.	REVISED PER BY	MODEL(S)	PART NUMBER
5081	ECN 6131 J.G.	1920/1920HPS/1920W	0510000490.D
DRAWN	DATE	CHKD	REVISION
11/29/24	11/29/24	J.G.	13
APPROVED	DATE	SCALE	SIZE
RH	11/29/24	N/A	A
DRAWING TYPE		INSTALLATION	SHEET 3 OF 9

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

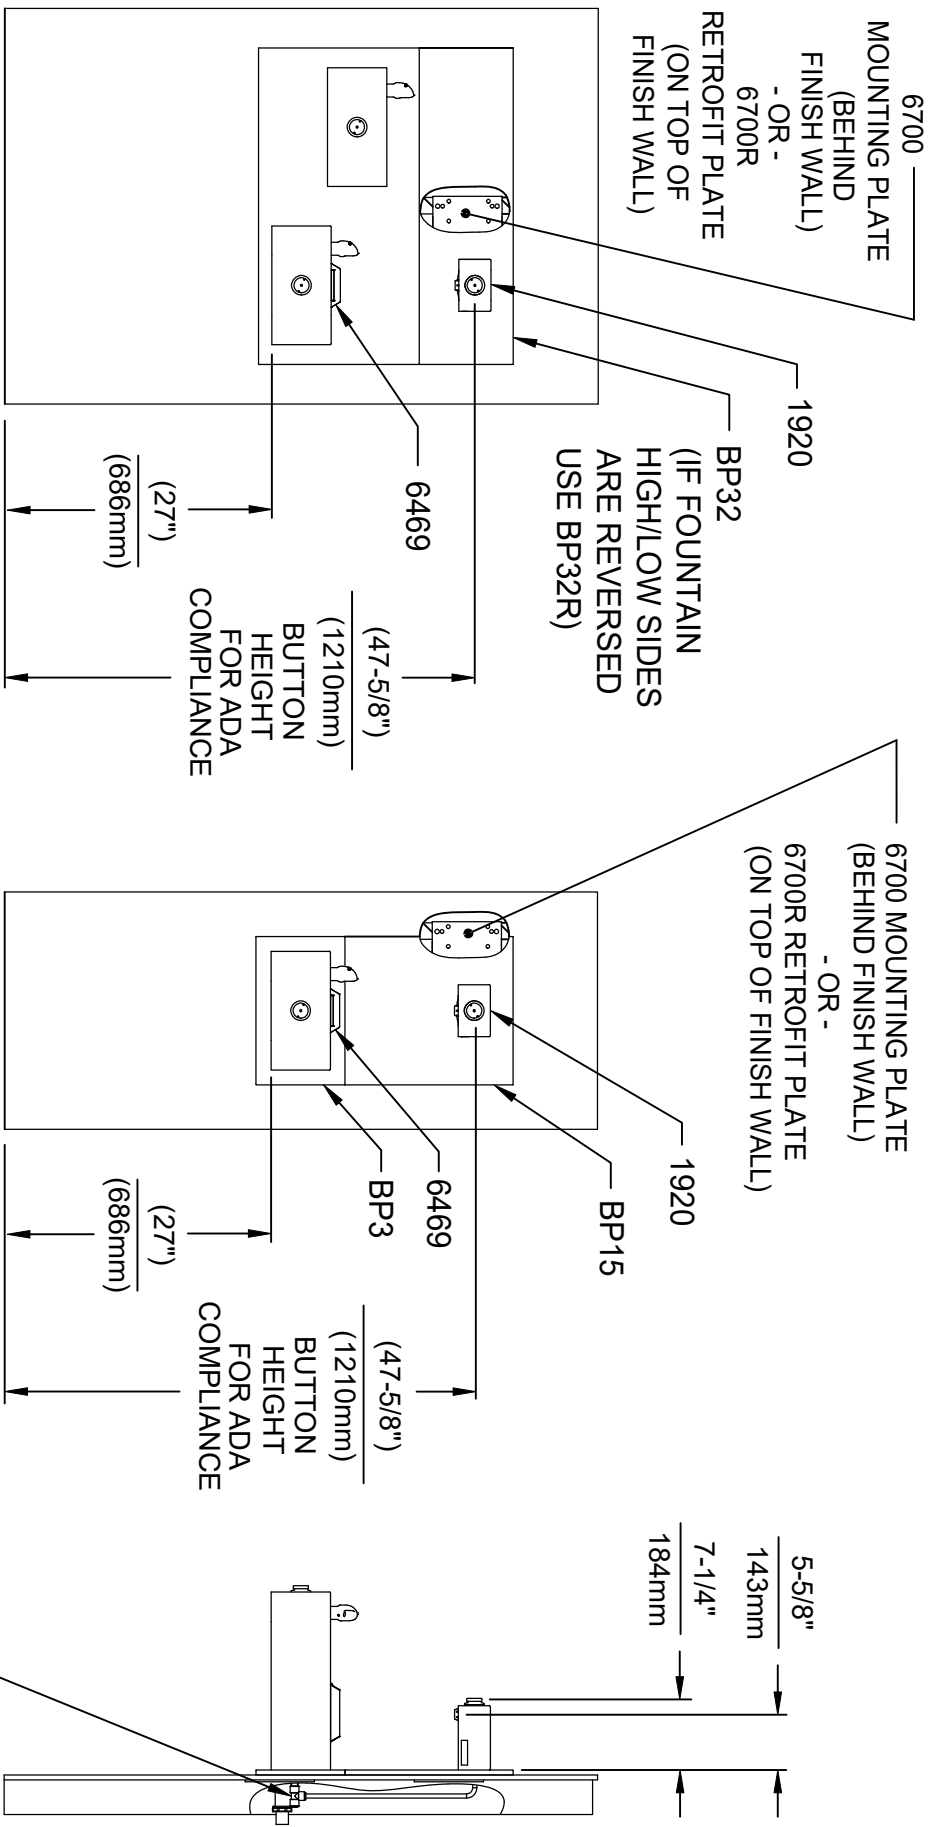


INSTALLATION ABOVE HAWS 1119 & H1119.8 SERIES

**INSTALLATION ABOVE HAWS 1109 & H1109.8 SERIES
SEE SHEET 8 FOR INSTALLATION AT CHILD HEIGHT**

* IF YOUR FOUNTAIN IS THIS STYLE USE THESE DIMENSIONS

1. SEE SEPARATE INSTALLATION DRAWINGS FOR MOUNTING PLATES AND BACK PANELS (SHOWN FOR REFERENCE - NOT SUPPLIED).

2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.

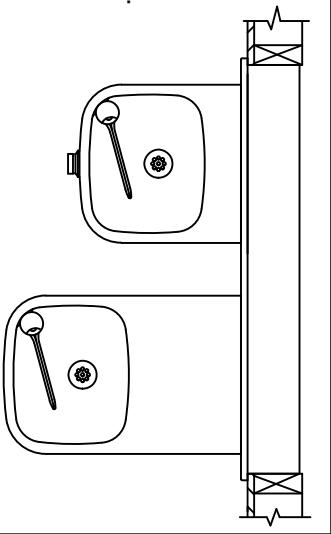

3/8" O.D. SUPPLY TUBING AND 3/8" O.D. PUSH-IN TEE SUPPLIED. (CONNECT TO FOUNTAIN SUPPLY LINE)






Haws
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO.	REVISED PER BY	MODEL(S)
5041	ECN 6131 J.G.	
DRAWN BY	DATE	CHKD.
11/15/17	11/15/17	J.G.
APPROVED:	DATE	
RH	11/29/24	
SCALE:	N/A	DRAWING TYPE:
INSTALLATION	SIZE:	A
SHEET	4	OF 9

PART NUMBER
0510000490.D
REVISION
13

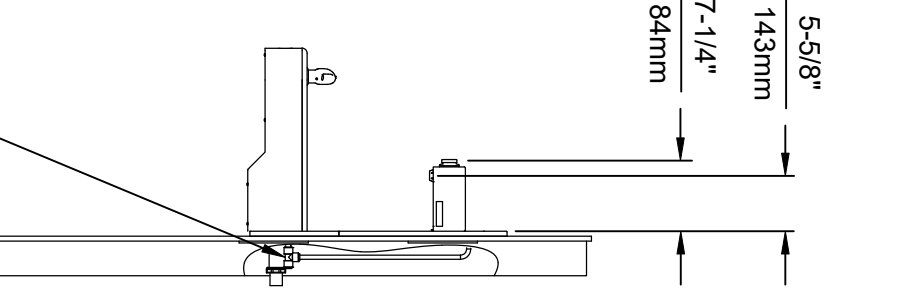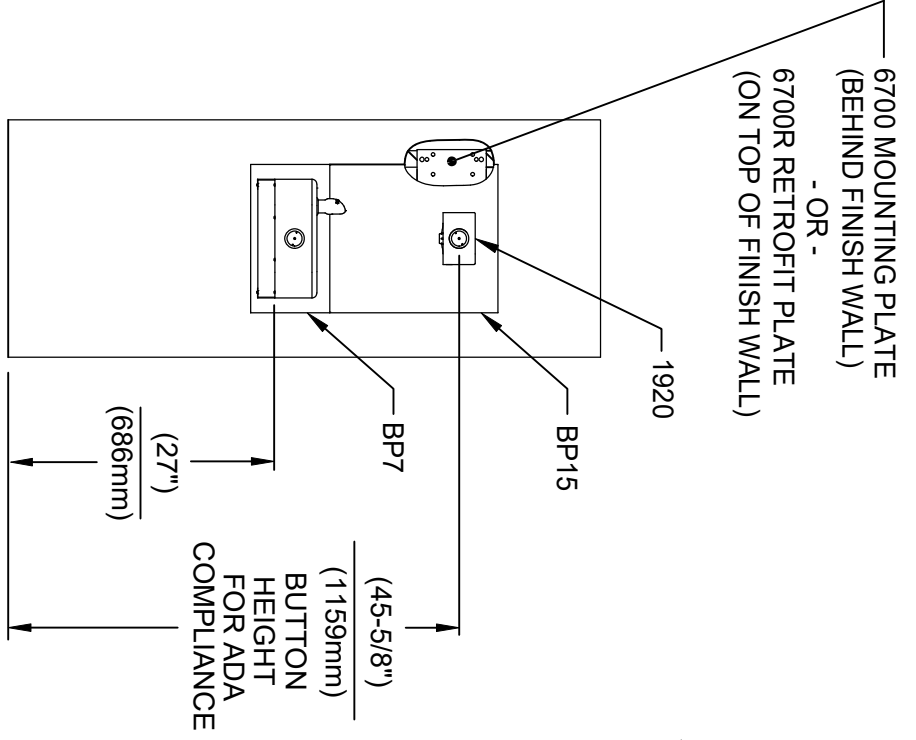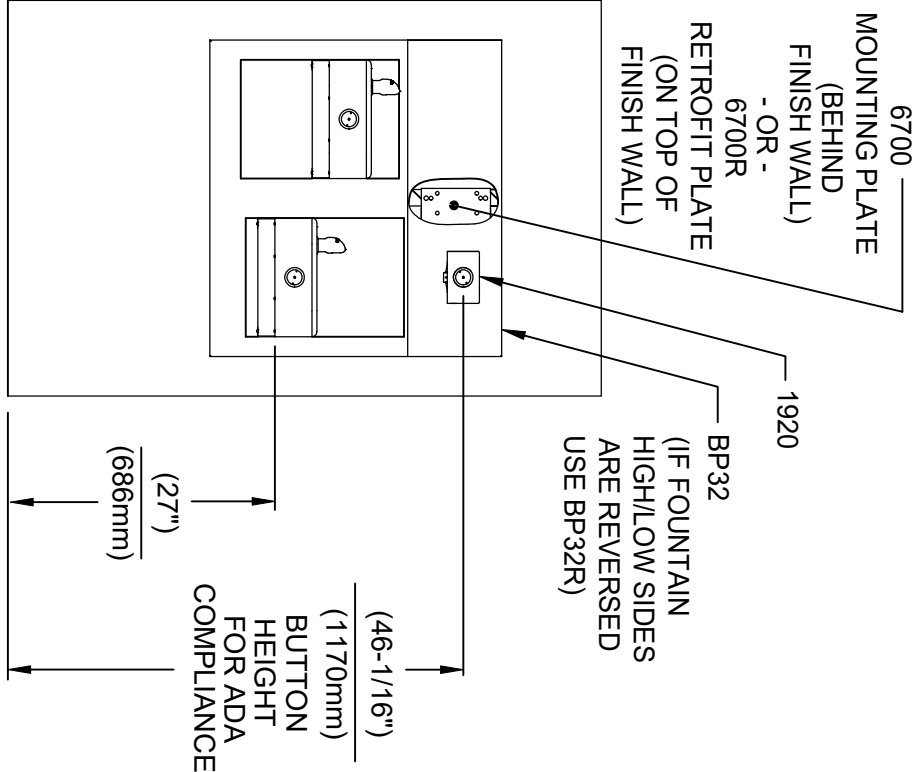


INSTALLATION ABOVE HAWS 1117L & H1117.8 SERIES

**INSTALLATION ABOVE HAWS 1107L & H1107.8 SERIES
SEE SHEET 8 FOR INSTALLATION AT CHILD HEIGHT**

* IF YOUR FOUNTAIN IS THIS STYLE USE THESE DIMENSIONS

1. SEE SEPARATE INSTALLATION DRAWINGS FOR MOUNTING PLATES AND BACK PANELS (SHOWN FOR REFERENCE - NOT SUPPLIED).

2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.



3/8" O.D. SUPPLY TUBING AND 3/8" O.D. PUSH-IN TEE SUPPLIED. (CONNECT TO FOUNTAIN SUPPLY LINE)






Haws
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO. REVISED PER BY: J.G.
DATE: 01/01/17
DRAWN: J.G.
APPROVED: J.G.
SCALE: N/A
DRAWING TYPE: INSTALLATION
SIZE: A
SHEET 5 OF 9

MODEL(S)
1920/1920HPS/1920W
PART NUMBER
0510000490.D
REVISION
13

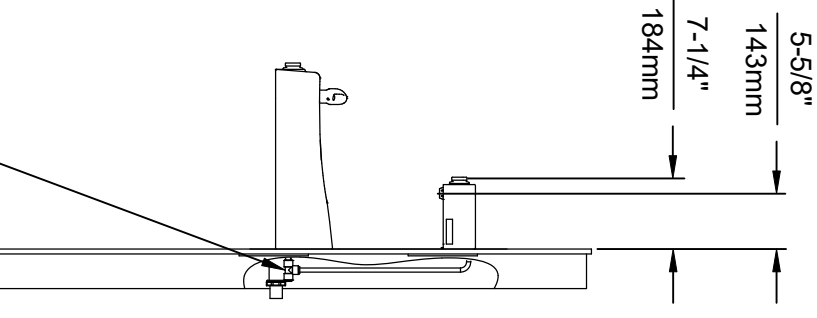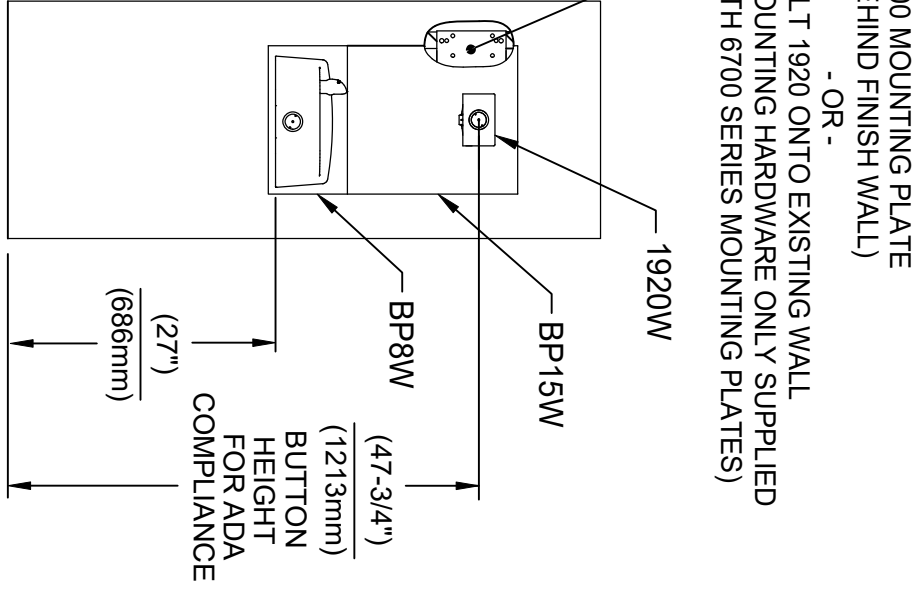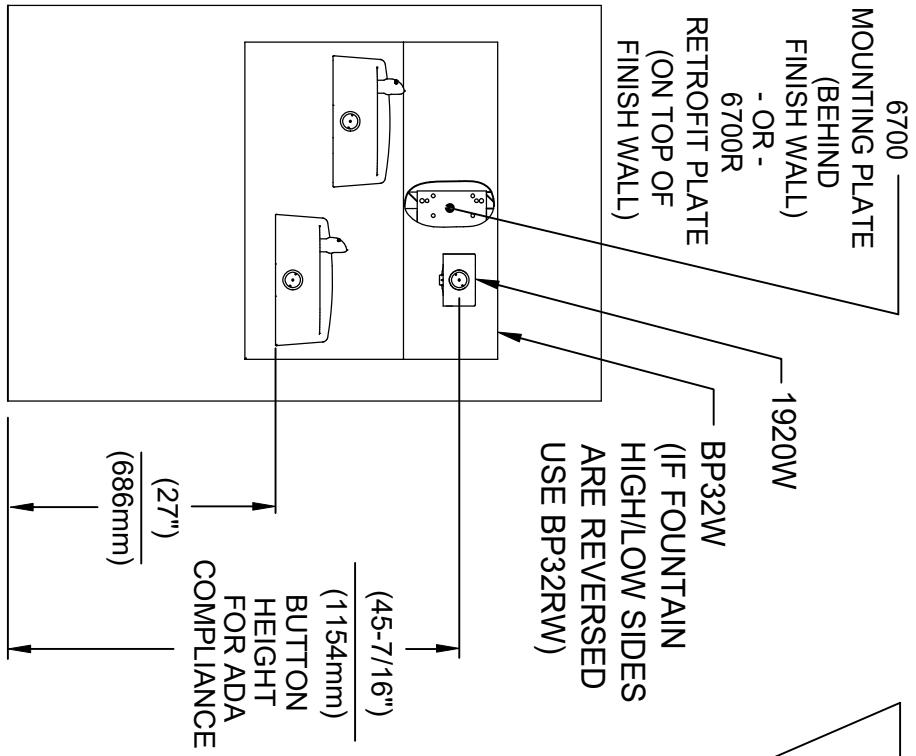


INSTALLATION ABOVE HAWS 1501

**INSTALLATION ABOVE HAWS 1311
SEE SHEET 8 FOR INSTALLATION AT CHILD HEIGHT**

* IF YOUR FOUNTAIN IS THIS STYLE USE THESE DIMENSIONS

1. SEE SEPARATE INSTALLATION DRAWINGS FOR MOUNTING PLATES AND BACK PANELS (SHOWN FOR REFERENCE - NOT SUPPLIED).
2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.

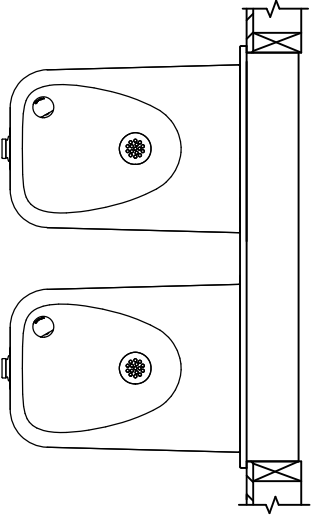

3/8" O.D. SUPPLY TUBING AND 3/8" O.D. PUSH-IN TEE SUPPLIED.
(CONNECT TO FOUNTAIN SUPPLY LINE)



Haws
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM


ECN NO. REVISED PER BY: J.G.
DATE: 02/15/17
APPROVED: RH

MODEL(S)
1920/1920HPS/1920W

PART NUMBER
0510000490.D
REVISION
13

SCALE: N/A
DRAWING TYPE: INSTALLATION
SIZE: A
SHEET 6 OF 9



6700 MOUNTING PLATE
(BEHIND FINISH WALL)
- OR -
BOLT 1920 ONTO EXISTING WALL
(MOUNTING HARDWARE ONLY SUPPLIED
WITH 6700 SERIES MOUNTING PLATES)

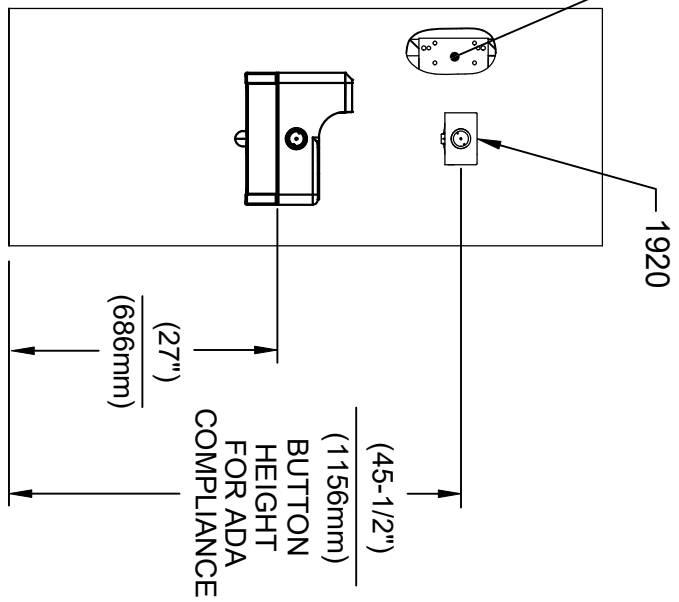

INSTALLATION ABOVE HAWS 1047

* IF YOUR FOUNTAIN IS THIS STYLE USE
THESE DIMENSIONS

1. SEE SEPARATE INSTALLATION DRAWINGS
FOR MOUNTING PLATES AND BACK PANELS
(SHOWN FOR REFERENCE - NOT SUPPLIED).
2. WHEN INSTALLING THIS UNIT, LOCAL,
STATE OR FEDERAL CODES SHOULD
BE ADHERED TO FOR INSTALLATION
LOCATIONS, WASTE & SUPPLY
REQUIREMENTS OTHER THAN SHOWN.

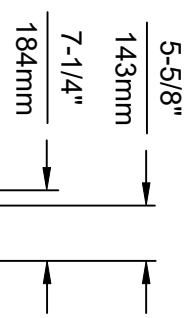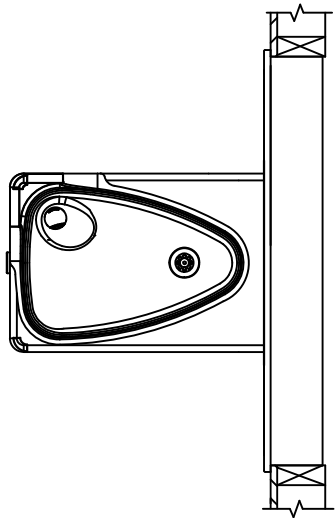

3/8" O.D. SUPPLY
TUBING AND 3/8" O.D.
PUSH-IN TEE SUPPLIED.
(CONNECT TO FOUNTAIN
SUPPLY LINE)




Haws
Since 1906

1455 KLEPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

ECN NO.	REVISED PER BY	MODEL(S)	PART NUMBER
5220	ECN 6131 J.G.	1920/1920HPS/1920W	0510000490.D
DRW'N BY	DATE	SCALE	REVISION
RH	11/29/24	N/A	13
APPROVED	DATE	DRAWING TYPE	SHEET 7 OF 9
		INSTALLATION	


6700 MOUNTING PLATE
(BEHIND FINISH WALL)
- OR -
6700R RETROFIT PLATE
(ON TOP OF FINISH WALL)

* MODELS 1920 (BOTTLE FILLER),
BP15, BP6 (BACK PANELS) AND
6468 (WASTE DRIP TRAY) ARE
ALL AVAILABLE TOGETHER AS
MODEL 1922.

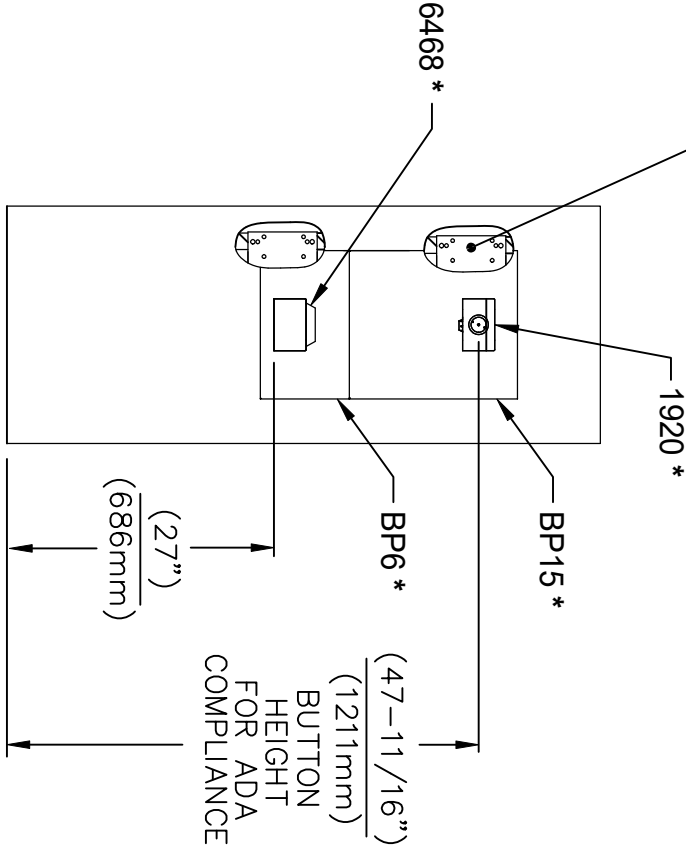

INSTALLATION ABOVE 6468

1. SEE SEPARATE INSTALLATION DRAWINGS FOR MOUNTING PLATE, WASTE DRIP TRAY AND BACK PANELS (SHOWN FOR REFERENCE - NOT SUPPLIED).
2. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.

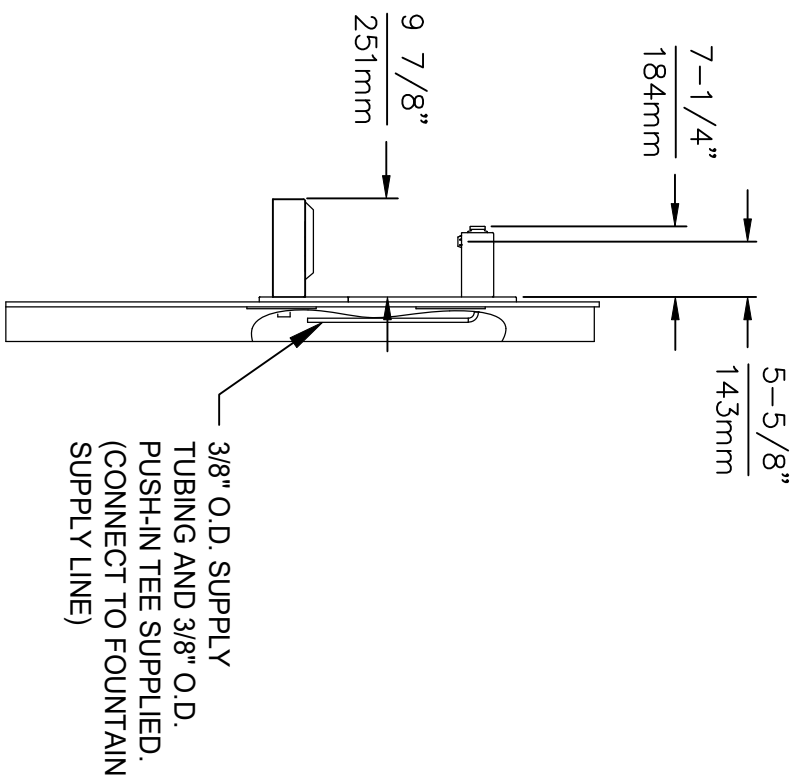





Haws®
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM


EQD NO.	REVISED PER BY	MODEL(S)	PART NUMBER
5807	EQD 6/13 J.G.	1920/1920HPS/1920W	0510000490.D
DRWD	DATE	CHKD	REVISION
10/20	10/20	J.G.	13
APPROVED:	DATE	SCALE:	SIZE:
RH	11/29/24	N/A	A
DRAWING TYPE:		SHEET 8 OF 9	
INSTALLATION			

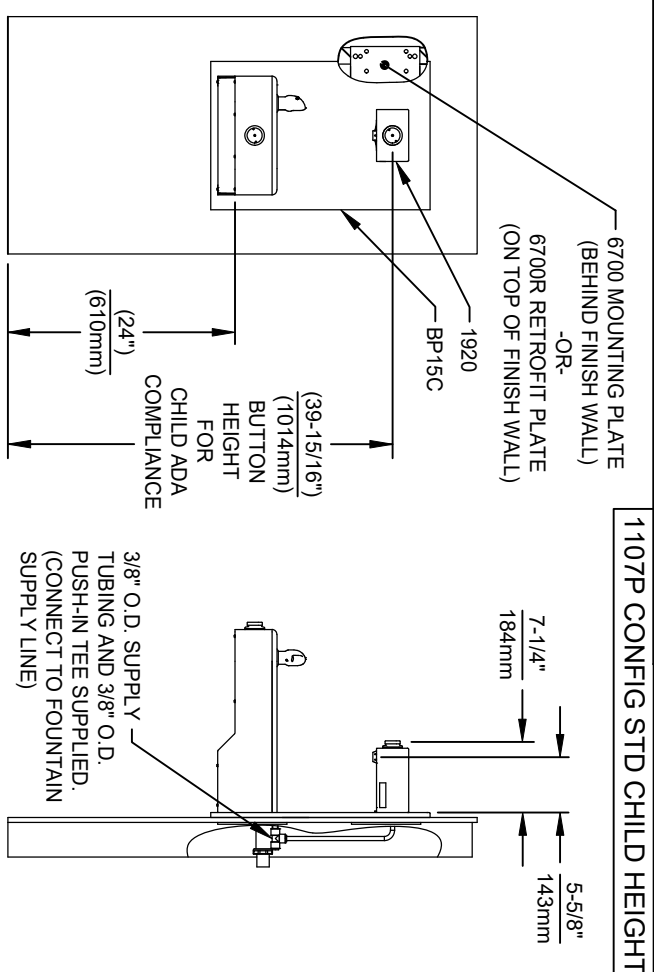

INSTALLATION FOR 1107P CONFIG STD CHILD HEIGHT

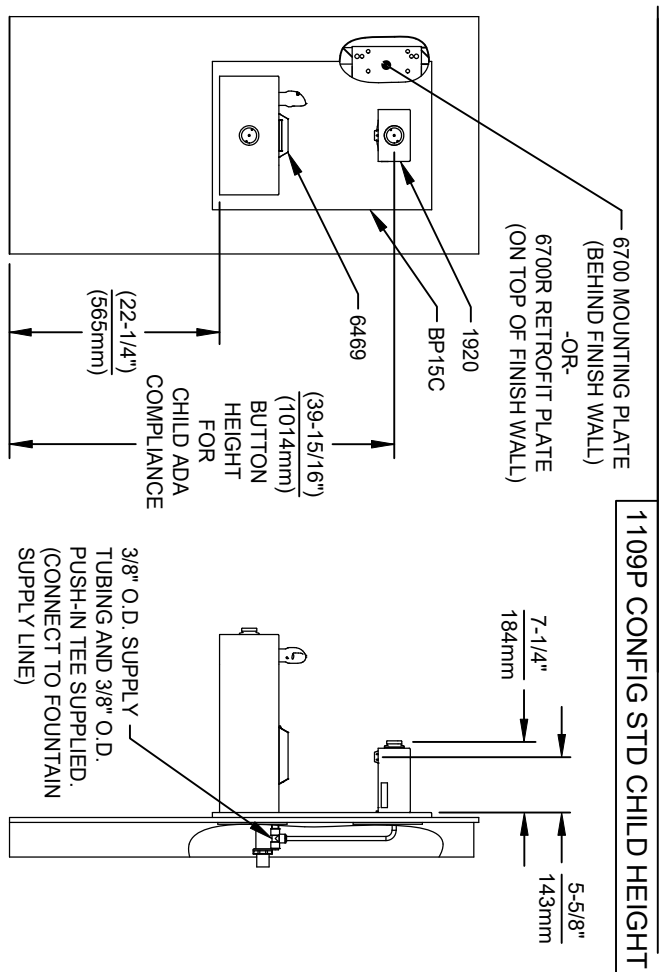

1109P CONFIG STD CHILD HEIGHT

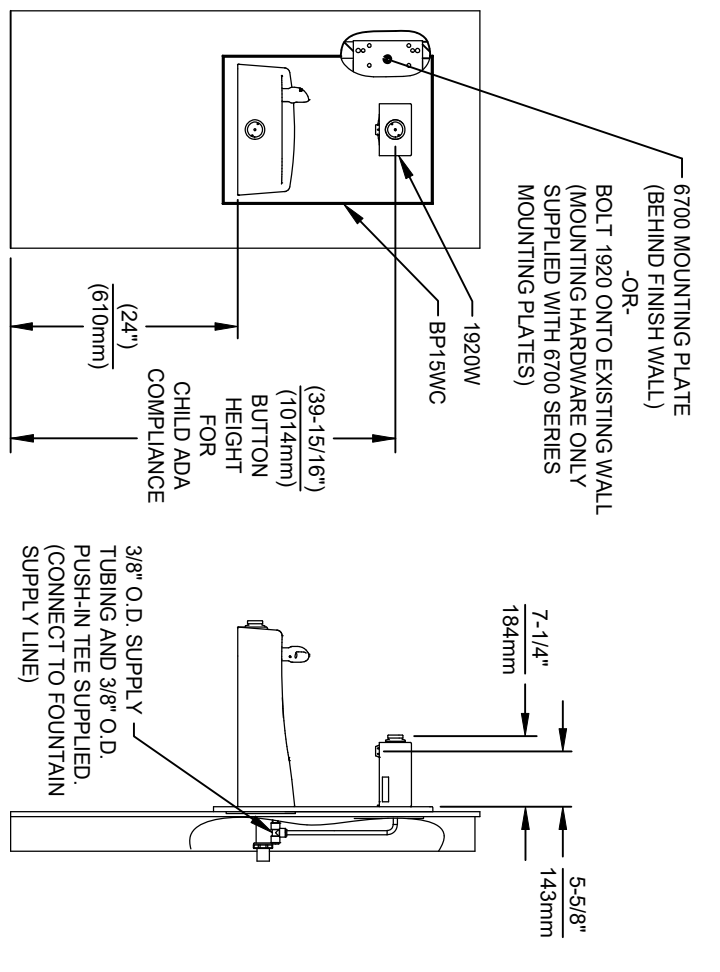

INSTALLATION FOR 1311P CONFIG STD CHILD HEIGHT

- NOTES:
1. HEIGHT DIMENSIONS SHOWN ARE FOR CHILD ADA APPLICATIONS:
 - BOTTLE FILLER HEIGHT AT 40" MAX.
 - DRINKING FOUNTAIN BUBBLER HEIGHT AT 30" MAX.
 - (SEE SHEETS 3, 4 & 5 FOR ADULT ADA HEIGHT DIMENSIONS)
 2. SEE SEPARATE 6700 DRAWINGS FOR MOUNTING PLATES AND BACK PANELS (SHOWN FOR REFERENCE - SOLD SEPERATELY OR PART OF A BUNDLED PRODUCT).
 3. WHEN INSTALLING THIS UNIT, LOCAL, STATE OR FEDERAL CODES SHOULD BE ADHERED TO FOR INSTALLATION LOCATIONS, WASTE & SUPPLY REQUIREMENTS OTHER THAN SHOWN.



Haws®
Since 1906

1455 KLEPPE LANE
SPARKS, NEVADA 89431
(775) 359-4712 FAX (775) 359-7424
E-MAIL: HAWS@HAWS.CO.COM
WEBSITE: WWW.HAWS.CO.COM

EQD NO. REVISED PER BY: J.G.	MODEL(S)
6700 EQD 6131 J.G.	1920/1920HPS/1920W
DRAWN BY: J.G.	
DATE: 11/29/24	
APPROVED: RH	
SCALE: N/A	DRAWING TYPE: INSTALLATION
SIZE: A	SHEET 9 OF 9
PART NUMBER: 0510000490.D	REVISION: 13