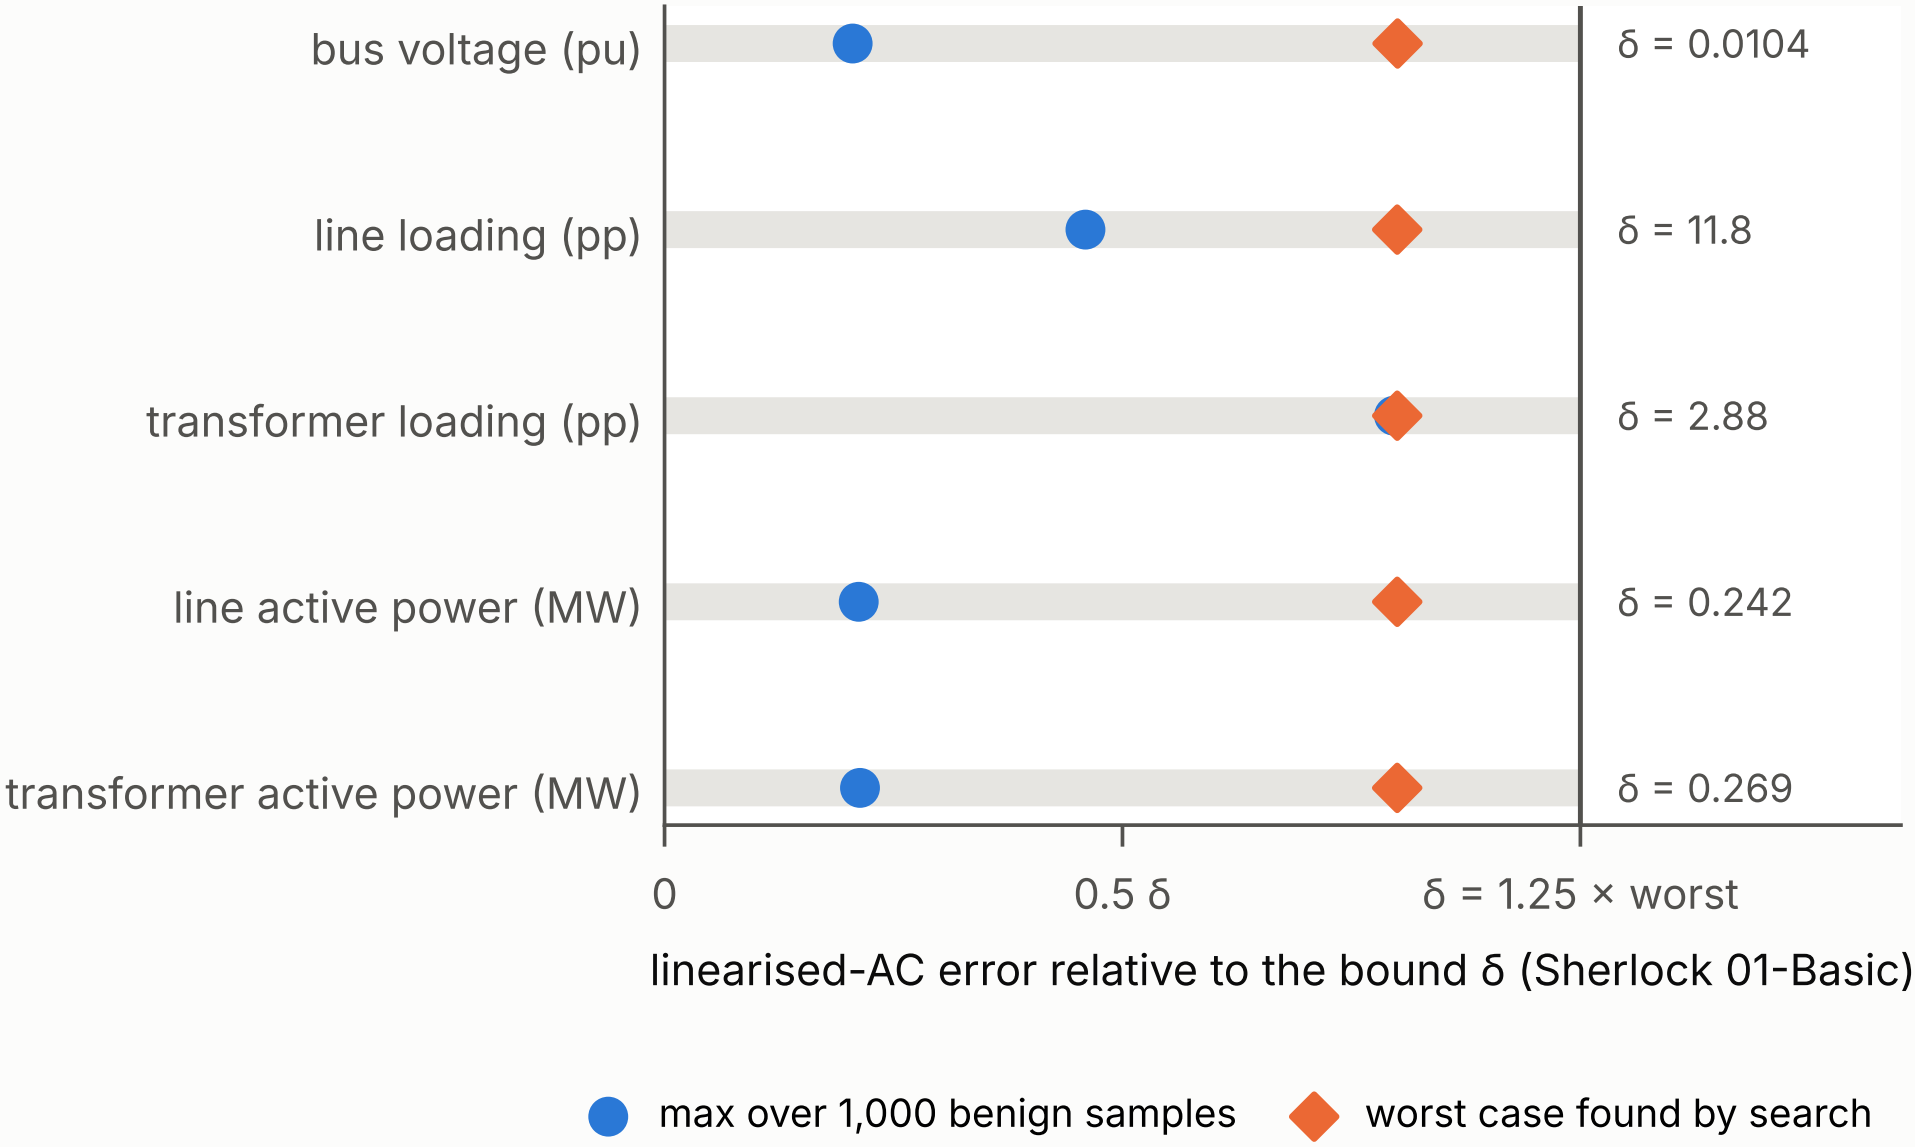
bus voltage (pu)
line loading (pp)
transformer loading (pp)
line active power (MW)
transformer active power (MW)
δ = 0.0104
δ = 11.8
δ = 2.88
δ = 0.242
δ = 0.269
0
0.5 δ
δ = 1.25 × worst
linearised-AC error relative to the bound δ (Sherlock 01-Basic)
max over 1,000 benign samples
worst case found by search