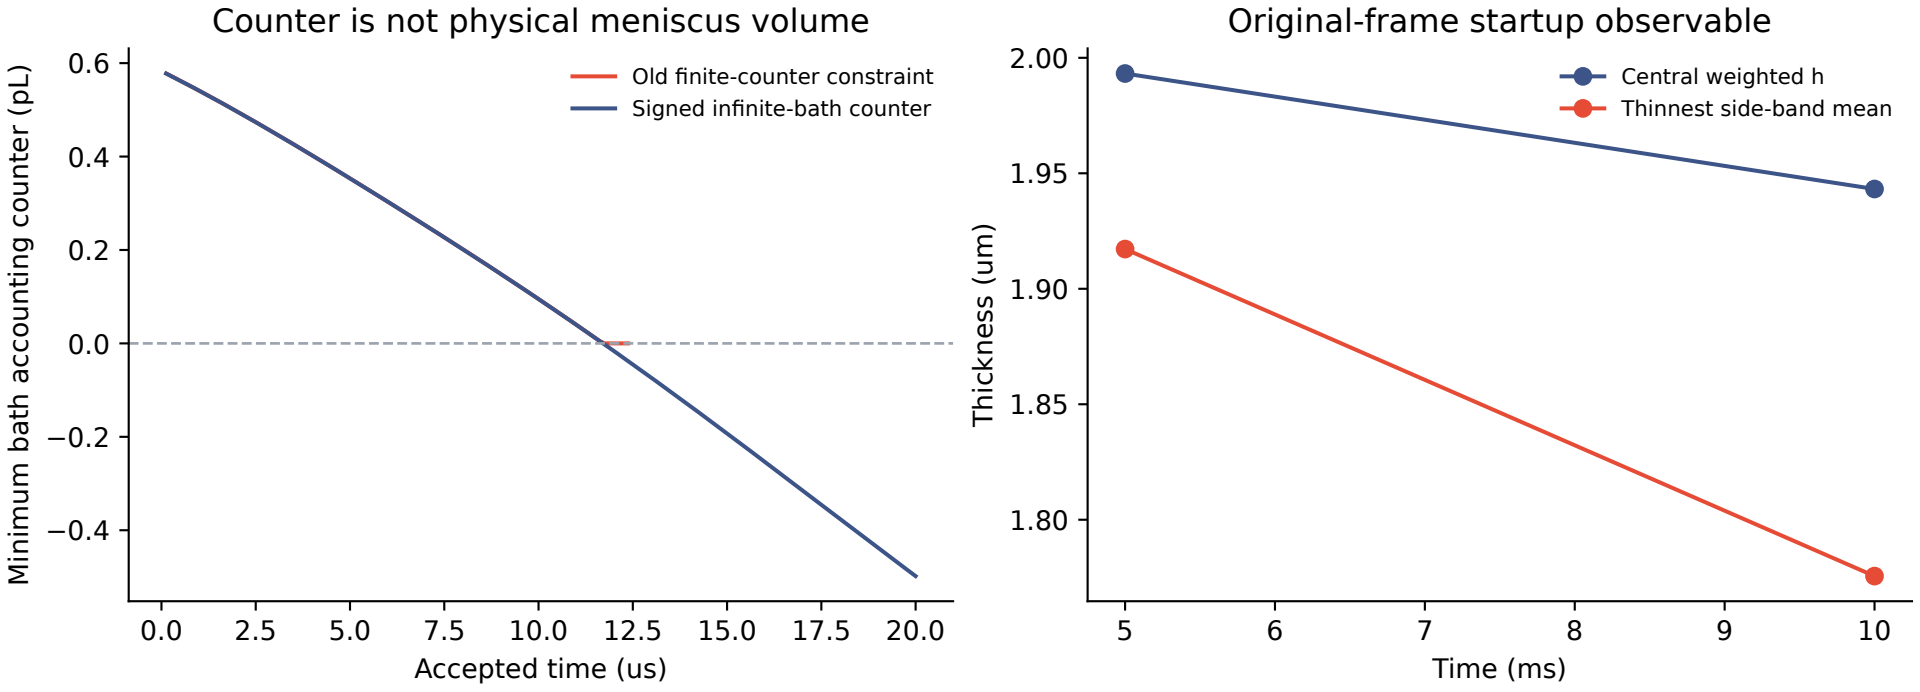

Counter is not physical meniscus volume
Old finite-counter constraint
Signed infinite-bath counter
Minimum bath accounting counter (pL)
0.6
0.4
0.2
0.0
−0.2
−0.4
0.0
2.5
5.0
7.5
10.0
12.5
15.0
17.5
20.0
Accepted time (us)
Original-frame startup observable
Central weighted h
Thinnest side-band mean
Thickness (um)
2.00
1.95
1.90
1.85
1.80
5
6
7
8
9
10
Time (ms)