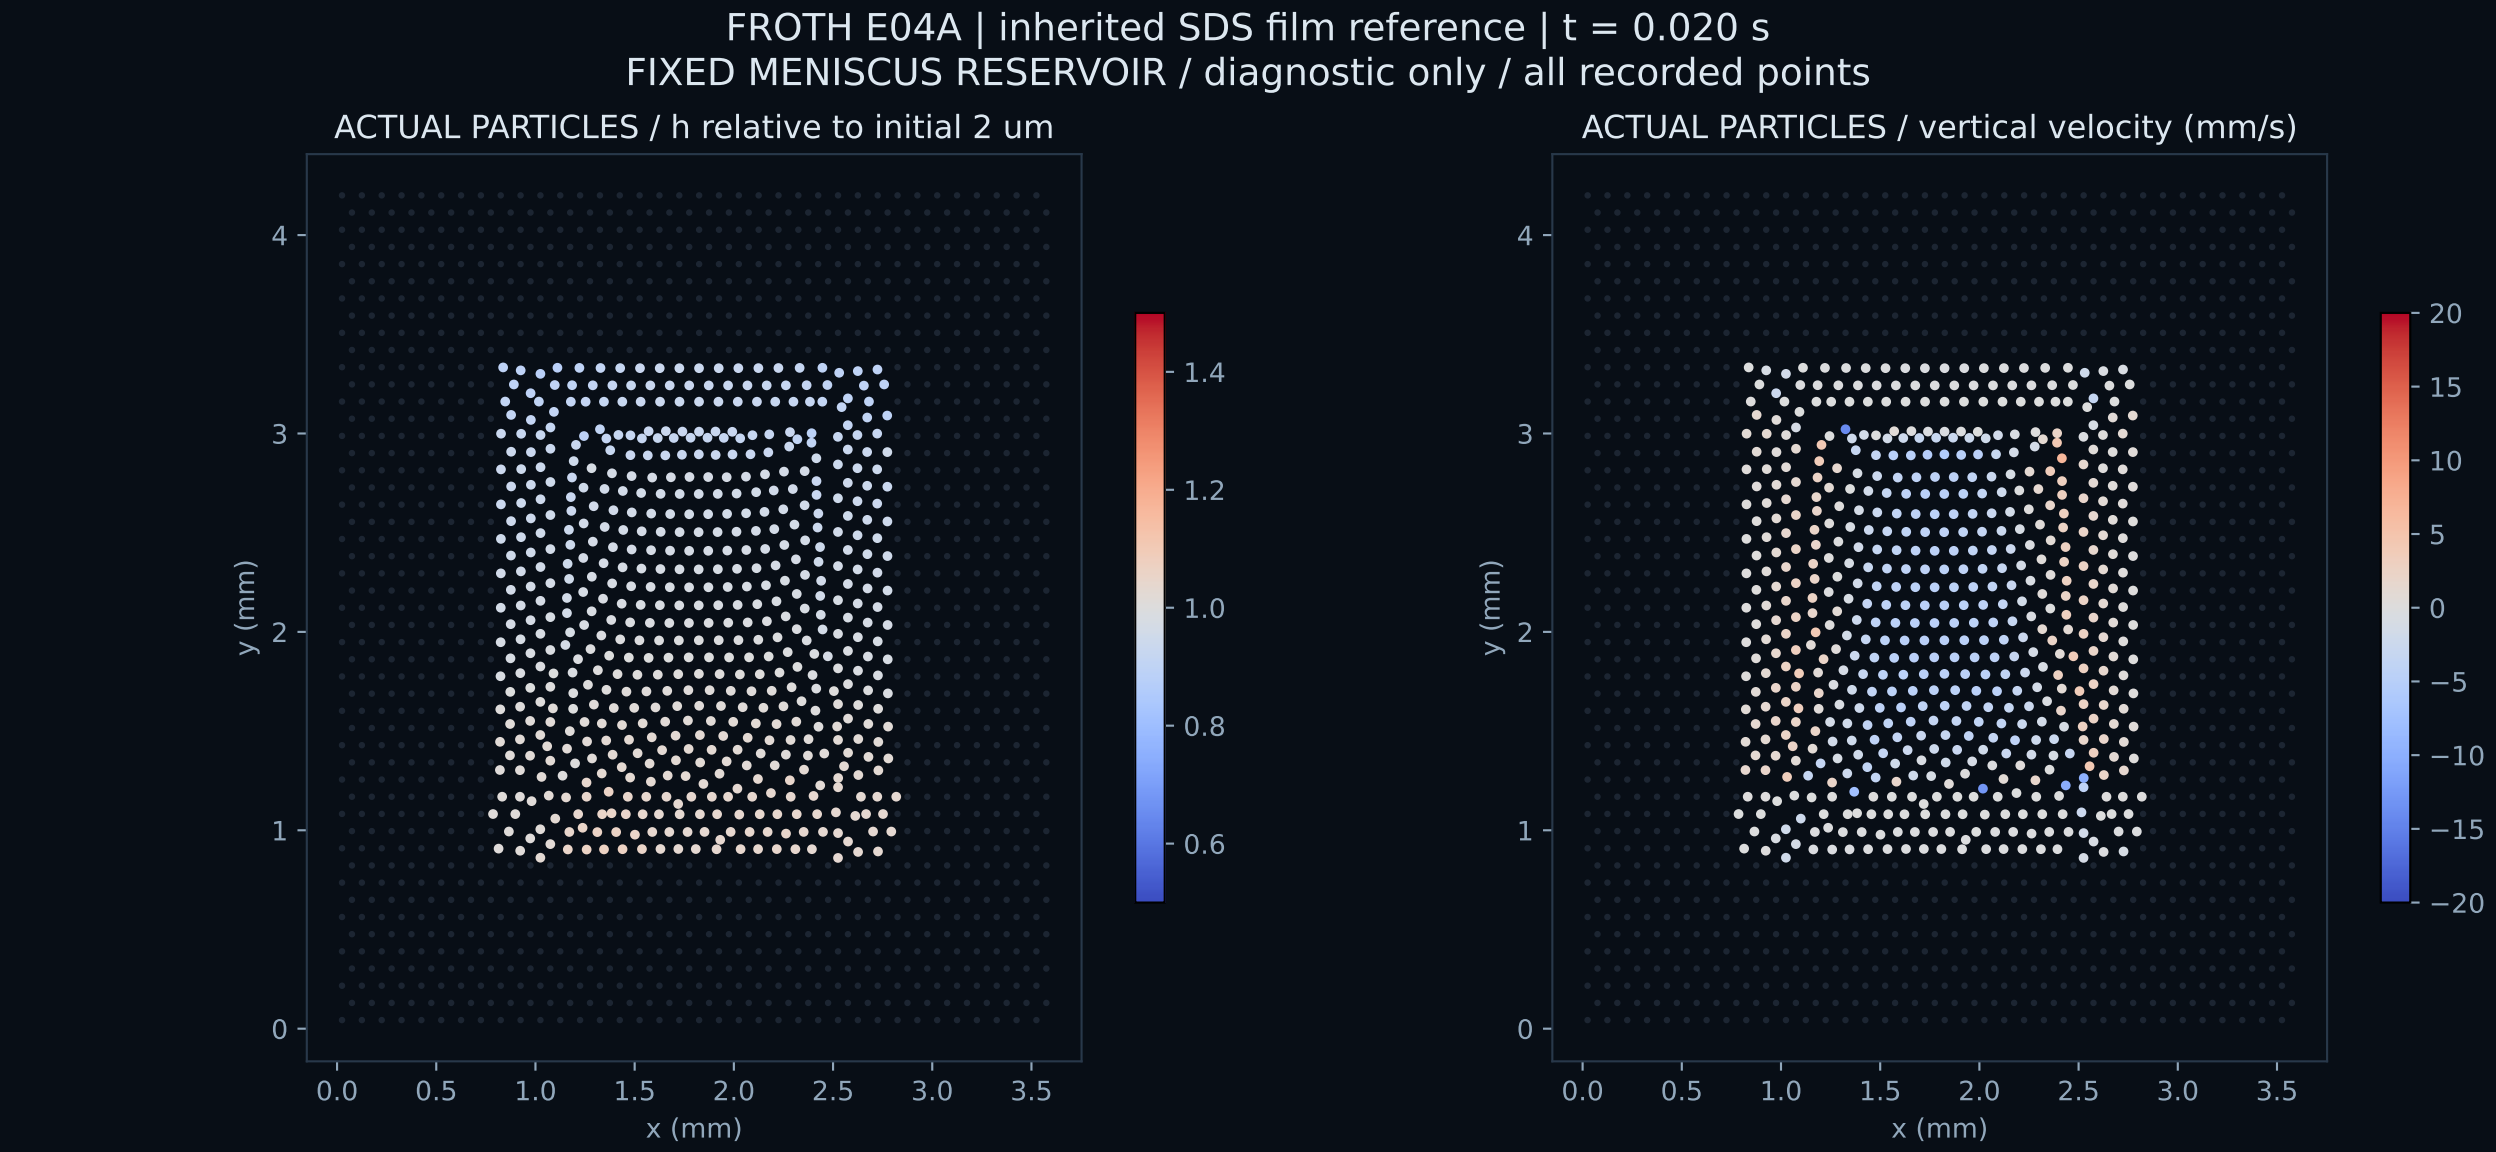
FROTH E04A | inherited SDS film reference | t = 0.020 s
FIXED MENISCUS RESERVOIR / diagnostic only / all recorded points
ACTUAL PARTICLES / h relative to initial 2 um
ACTUAL PARTICLES / vertical velocity (mm/s)
y (mm)
x (mm)
0
1
2
3
4
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
1.4
1.2
1.0
0.8
0.6
20
15
10
5
0
−5
−10
−15
−20