

SEAL



THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNTIL THE SEAL AND SIGNATURE OF THE RESPONSIBLE REGISTRANT APPEARS ON THE DRAWING, AND PROPER PERMITS AND RELATED FEES ARE TRANSMITTED BY THE OWNER, OWNER'S AGENT OR CONTRACTOR TO THE AUTHORITY HAVING JURISDICTION.

CONSULTANT

CLIENT

Brian Mulloy

PROJECT

1588 Elm St.
Detroit, MI 48216

REVISIONS


06-26-2020 PERMIT

TITLE


HVAC FLOOR PLANS

SHEET



M2

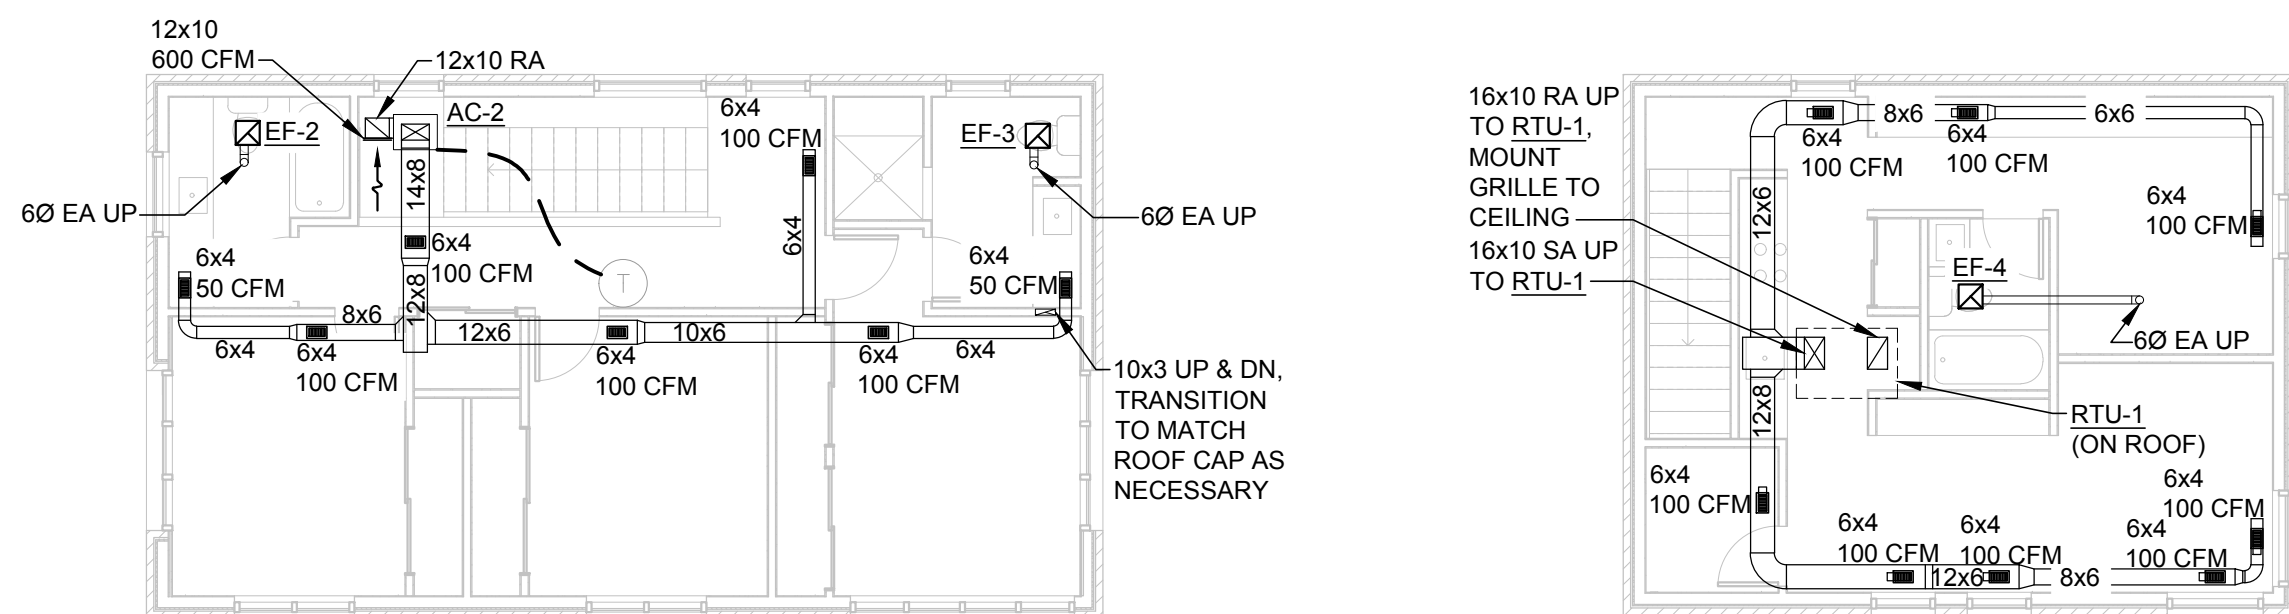


3 SECOND FLOOR HVAC PLAN
SCALE: 1/8" = 1'-0"

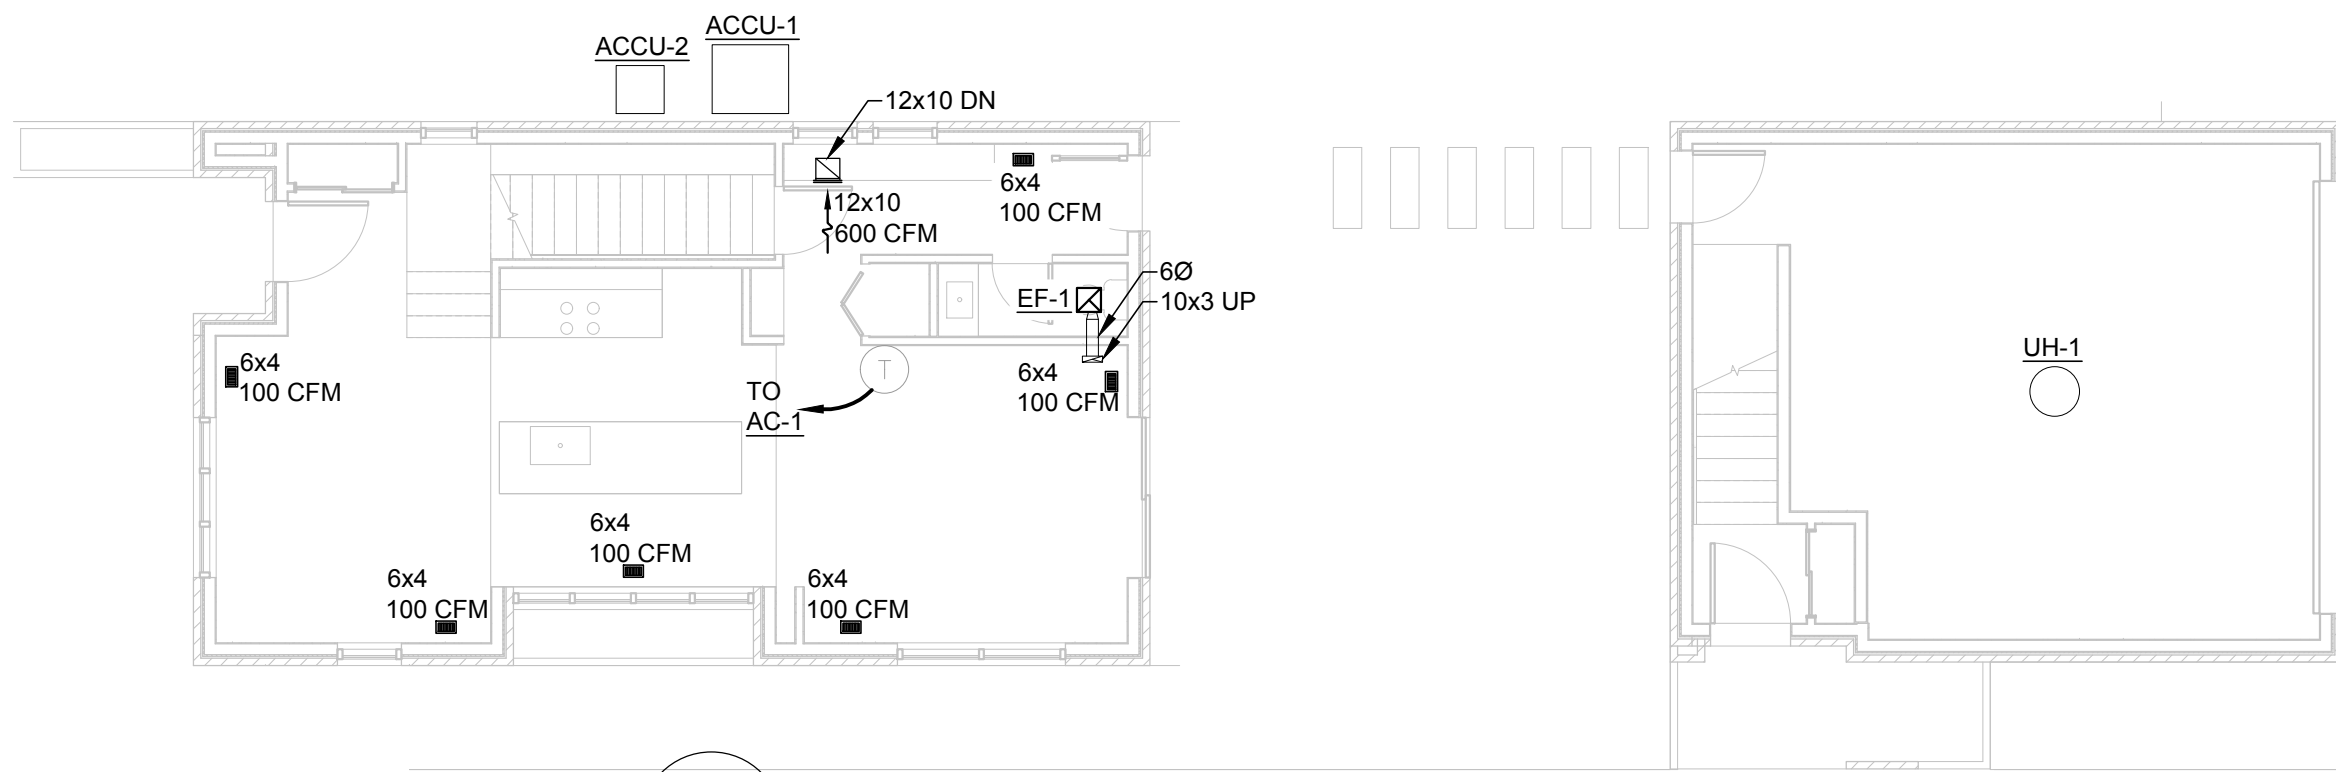


2 FIRST FLOOR HVAC PLAN
SCALE: 1/8" = 1'-0"

LEGEND			
	THERMOSTAT CONTROL		
	SMOKE DETECTOR		
	TEMPERATURE SENSOR		
	SUPPLY DUCT IN SECTION		
	RETURN DUCT IN SECTION		
	EXHAUST DUCT IN SECTION		
	VOLUME CONTROL DAMPER		
	FIRE DAMPER		
	FIRE/SMOKE DAMPER		
	CEILING SUPPLY DIFFUSER		
	CEILING RETURN GRILLE		
	CEILING EXHAUST GRILLE		
	NOTES BY SYMBOL		
CFM	CUBIC FEET PER MINUTE	NG	NECK
DN	DOWN	AF	ABOVE FINISHED FLOOR
CD	CONDENSATE DRAIN	EXH	EXHAUST
SA	SUPPLY AIR	REQD	REQUIRED
RA	RETURN AIR	DMPR	DAMPER
FD	FIRE DAMPER	VD	VOLUME DAMPER
WVT	CONSTANT VOLUME BOX	NG	NATURAL GAS
EG	EXHAUST GRILLE	EG	EXHAUST GRILLE
SD	SUPPLY DIFFUSER	SG	SUPPLY GRILLE
CUH	CABINET UNIT HEATER	UH	UNIT HEATER

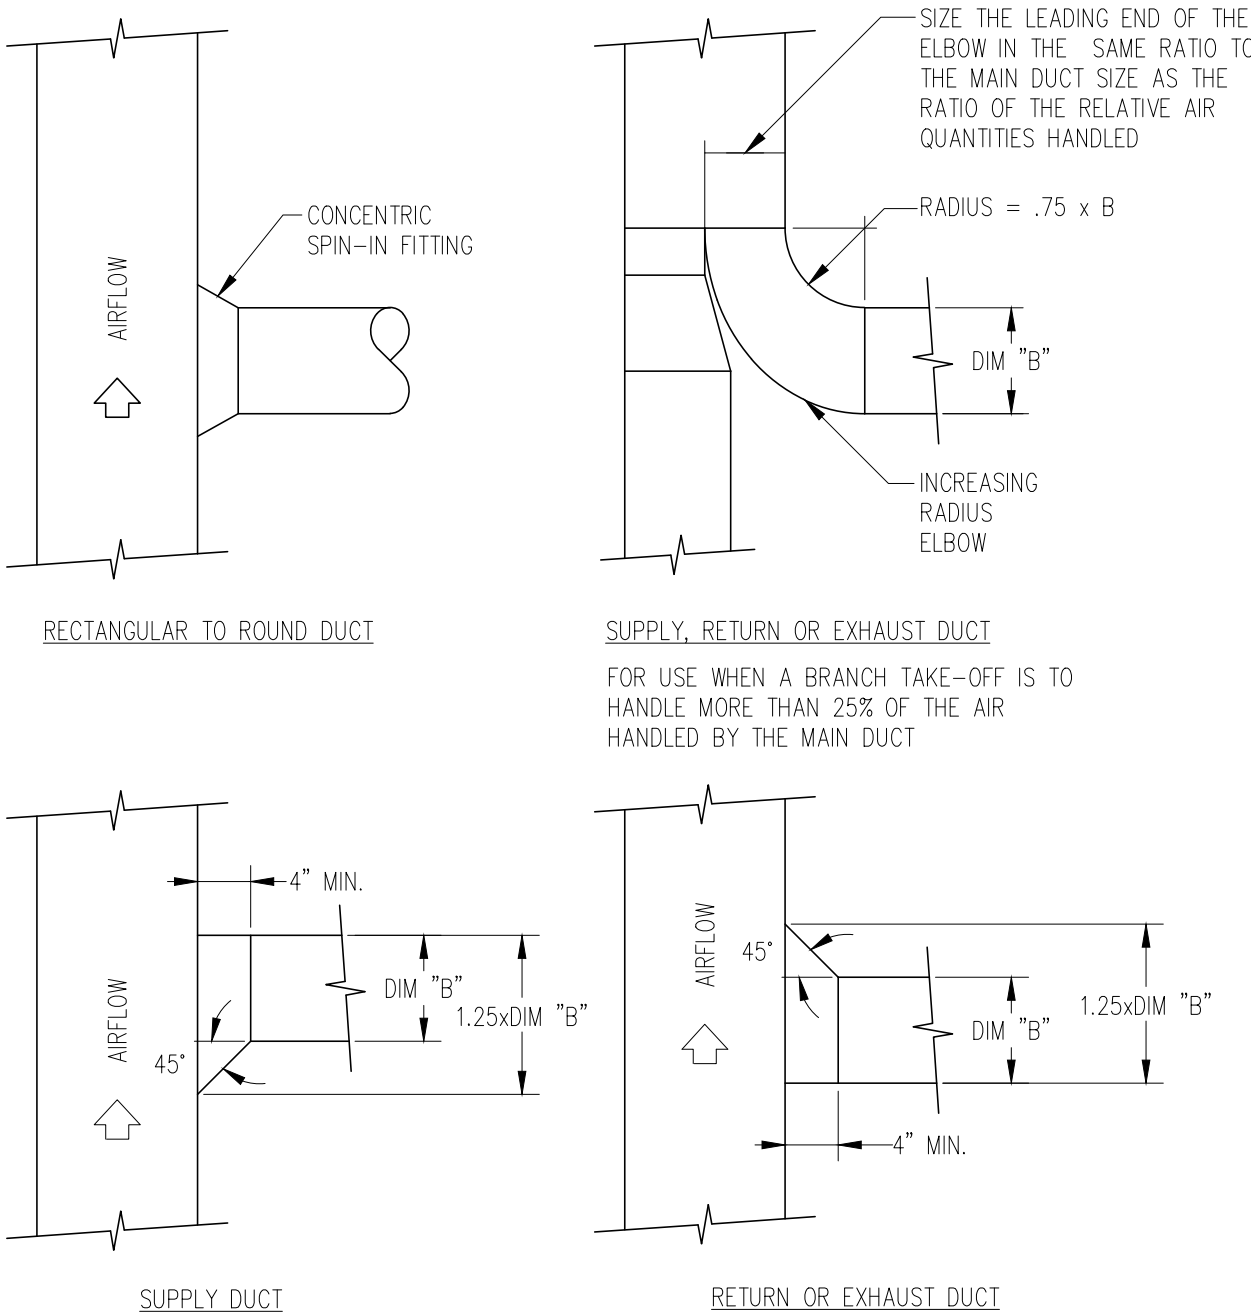

4 RECTANGULAR BRANCH TAKE-OFF DETAILS

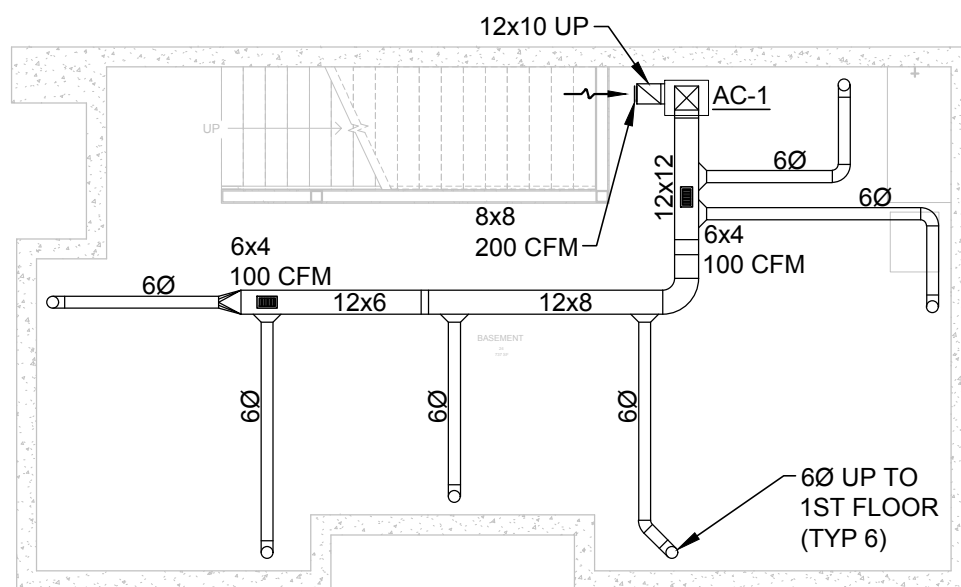

1 BASEMENT HVAC PLAN
SCALE: 1/8" = 1'-0"

GENERAL MECHANICAL NOTES	
1	GENERAL MECHANICAL NOTES APPLY TO ALL MECHANICAL DRAWINGS.
2	THESE DRAWINGS ARE DIAGRAMMATIC & INDICATE THE GENERAL INTENT OF THE WORK. PROVIDE COMPLETE PIPING SYSTEMS PER SPECIFICATIONS, AND PER APPLICABLE CODES INCLUDING ALL NECESSARY OFFSETS, AND FITTINGS WHICH ARE REQUIRED DUE TO SPACE CONSTRAINTS OR OTHER REASONS.
3	CONTRACTOR SHALL COORDINATE HIS WORK WITH ALL OTHER TRADES. VERIFY ALL CLEARANCES PRIOR TO THE FABRICATION OF ANY WORK.
4	THE CONTRACTOR SHALL PROVIDE ALL MISCELLANEOUS SUPPORTING STEEL, ETC. FOR PROPER INSTALLATION OF ALL MECHANICAL SYSTEMS.
5	COORDINATE FLOOR, WALL, AND ROOF PENETRATIONS WITH ARCHITECTURAL TRADES.
6	PLUMBING VENT PIPING THRU THE ROOF OR WALL SHALL BE LOCATED 10' FROM ANY FRESH AIR INTAKE LOCATION AND A MINIMUM OF 18" CLEAR FROM THE INSIDE FACE OF PARAPET.
7	COORDINATE AND PROVIDE ACCESS DOORS IN HARD CEILING AREAS FOR ACCESS TO EXHAUST DAMPERS, ETC. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING TYPES.
8	BALEST DISCHARGE SHALL BE LOCATED A MINIMUM OF 10'-0" FROM ANY DOOR OR OPENING WINDOW.
9	CONTRACTOR TO PROVIDE EXHAUST TERMINATIONS PER THE RECOMMENDATION OF THE FAN MANUFACTURER.
10	ENGINEER OF RECORD SHALL RECEIVE SUBMITTALS FOR ALL HVAC EQUIPMENT. HVAC EQUIPMENT SHALL NOT BE INSTALLED WITHOUT APPROVAL.