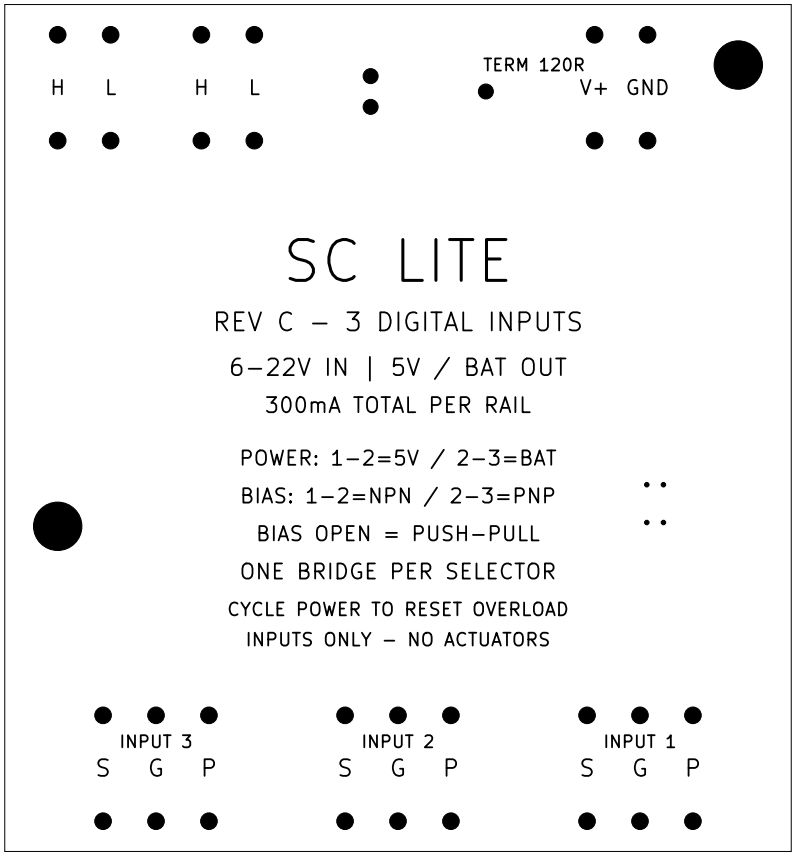

H
L
H
L
TERM 120R
V+
GND
SC LITE
REV C – 3 DIGITAL INPUTS
6–22V IN | 5V / BAT OUT
300mA TOTAL PER RAIL
POWER: 1–2=5V / 2–3=BAT
BIAS: 1–2=NPN / 2–3=PNP
BIAS OPEN = PUSH–PULL
ONE BRIDGE PER SELECTOR
CYCLE POWER TO RESET OVERLOAD
INPUTS ONLY – NO ACTUATORS
INPUT 3
S G P
INPUT 2
S G P
INPUT 1
S G P