


PROJECT NAME AND LOCATION

ADRA INDUSTRIAL CITY - SYRIA

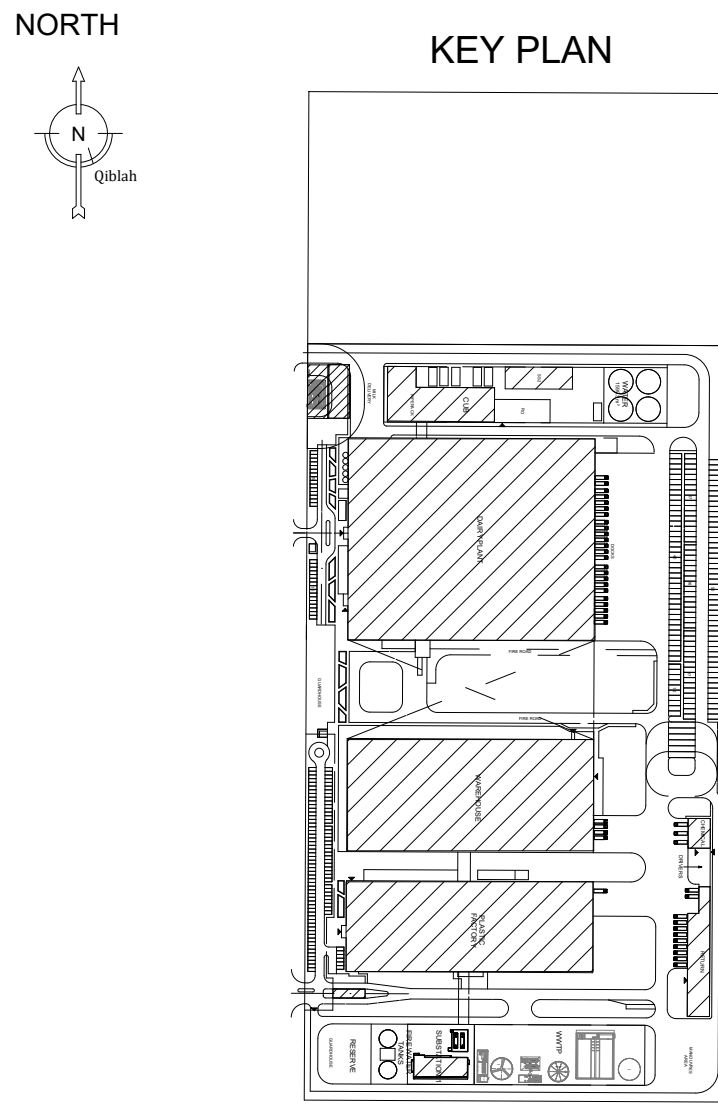

- GENERAL NOTES:
- ALL STRUCTURAL DRAWINGS MUST BE THOROUGHLY REVIEWED AND COORDINATED WITH THE DRAWINGS OF ALL OTHER RELEVANT DISCIPLINES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
 - THE FOLLOWING ARE THE ADOPTED CURC CHARACTERISTIC STRENGTH OF REINFORCED CONCRETE:
 - 2.1 PILES & FOUNDATION 40MPa
 - 2.2 SUBSTRUCTURE FLOORS/TANKS 40MPa
 - 2.3 COLUMNS & CONES / SHEAR WALLS 40MPa
 - 2.4 SLABS AND BEAMS 30MPa
 - STEEL REINFORCEMENT IS HIGH GRADE STEEL INDICATED BY (TL) WITH A MINIMUM YIELD STRESS OF 460 MPa, WITH MIN ULT TENSILE STRENGTH 560 MPa & MIN ELONGATION 12%.
 - ALL BEAMS OR ALL BEAM PORTIONS HAVE WIDTH GREATER THAN 350 MM SHOULD HAVE 4 BRANCHES STIRRUPS. MAX. TOLERANCE PROVIDED FOR NONSTRUCTURAL ELEMENTS NOT LIKELY TO BE DAMAGED BY LARGE DEFLECTIONS DUE TO LONG TERM DEFLECTION EQUALS TO SPAN/400.
 - FOR SLABS: BOTTOM REINFORCEMENT TO BE SPICED WITH FULL TENSION LAP SPLICE AT COLUMNS LOCATIONS, WHEREAS, TOP REINFORCEMENT TO BE SPICED WITH FULL TENSION LAP SPLICE AT MID SPAN.

- GENERAL NOTES FOR STEEL WORKS:
- ALL DIMENSIONS ARE IN MM UNLESS NOTED OTHERWISE.
 - ANCHOR BOLT HAS BEEN DESIGNED WITH F558 GRADE A308, HOT DIP GALVANIZED OR EQUIVALENT.
 - BUILT UP SECTIONS ARE GRADE S355 (EN 10210-1).
 - HOT ROLLED SECTIONS ARE GRADE S275 (EN 10210-1).
 - COLD FORMED SECTIONS ARE GRADE S355 (EN 10210-1).
 - PRIMARY CONNECTION BOLTS SHALL BE FULLY THREADED HOT DIP GALVANIZED.
 - RODS WITH ASK OR EQUIVALENT.
 - ALL HIGH STRENGTH BOLTS ARE GRADE 8.8 & 10.9 TO BE USED IN MAIN CONNECTIONS.
 - BOLTS GR. 4.8 & 8.8 TO BE USED IN SECONDARY CONNECTIONS.
 - FILLET WELD SHOULD BE MINIMUM 5mm U.G.O.
 - ALL FIXING ACCESSORIES FOR LOUVER SHEETING SHALL BE OF GALVANIZED STEEL.
 - ALL STEEL FINISHES TO BE AS PER PROJECT SPECIFICATIONS.
 - ALL STEEL MEMBERS OR FINISHES TO MEET THE CRITERIA FOR A 50-YEAR DESIGN LIFE.

- LEGEND:
- PLAN CONCRETE MACHINE PAD
 - CONT. COLUMN
 - TERMINATED COLUMN
 - PLANTED COLUMN
- FFL : FINISH FLOOR LEVEL
T.O.C : TOP OF CONCRETE
THK : THICKNESS
K : KNEE BRACING
RF : RIGID FRAME
PF : PORTAL FRAME

- DESIGN LOADS:
- A. DEAD LOADS:
- 1. ROOF:
 - 1.1 ROOF PANEL - SINGLE PANEL: 7 K/M²
 - 1.2 SANDWICH PANEL DECK: 3 K/M²
 - 1.3 BUILDING ROOF PANELING / SANDWICH PANELS: 1.5 K/M²
 - 1.4 BRACING DOWN WEIGHT: 1.5 K/M²
 - 1.5 PULLING DOWN WEIGHT: 1.5 K/M²
 - 1.6 COLLATERAL LOADS: 10 K/M²
 - 2. LIVE LOADS: 100 K/M²
- B. WIND LOADS:
- 1. ULTIMATE WIND SPEED: 120 KPH
 - 2. RISK CATEGORY: II
 - 3. BUILDING RISK CATEGORY: II
 - 4. EXPOSURE CATEGORY: I-C
 - 5. BUILDING CLOSURE: ENCLOSED
 - 6. THERMAL LOAD: +30 C & -30 C
- MEZZANINE LOADS:
- 1. DEAD LOADS: 5 K/M²
 - 2. COLLATERAL LOADS: 5 K/M²
 - 3. PARTITION LOADS AS PER ARCHITECTURAL DRAWINGS
 - 4. OFFICES AREA: 3 K/M²
 - 5. OFFICES CORRIDOR AREA: 5 K/M²
 - 6. UTILITY CORRIDOR AREA: 10 K/M²
 - 7. STORAGE AREA: 10 K/M²
- PIPE RACK LOADS: (ON RAFTERS)
- 1. LIVE LOADS: 10 K/M²
 - 2. SERVICE CEILING LOADS: (ON RAFTERS)
 - 3. DEAD LOADS: 0.33 K/M²
 - 4. LIVE LOADS: 1 K/M² (U.L.O.)
 - 5. LIVE LOADS @ GRIDS 3 TO 7 BETWEEN GRIDS C & D @ GRIDS 3 TO 7 BETWEEN GRIDS A & B: 2 K/M²

NO	ISSUED FOR APPROVAL	JUL 2026	KH.HI	ES.HS	WA.WA
ISSUE	DESCRIPTION	DATE	DRAWN	CHECKED	QA/QC
	ISSUED FOR SCHEMATIC				

OWNER

LEAD CONSULTANT

SR AL-SHOUMUKH TOWERS
(TOWER A) 13th FLOOR
OFFICE 146 BIN MANNAN
TEL: (974) 4220377 / 88 99
FAX: (974) 4220377
P.O. BOX 1876, DOHA-QATAR
www.alshoumukh.com

DESIGN AND BUILD CONTRACTOR

PROJECT DESCRIPTION

DRAWING TITLE

FOUNDATION PLAN

DRAWING NO.:	ST-MF-102-00	PART
DRAWN BY:	KH.HI	ES.HS
CHECKED BY:	ES.HS	SD
VERIFIED BY:	AB.BR	M.O.SA
SCALE:	1:300 @A1	PROJECT NO.:
FILE NAME:	ST-MF-102-00	457

