


Safely disarmed throughout

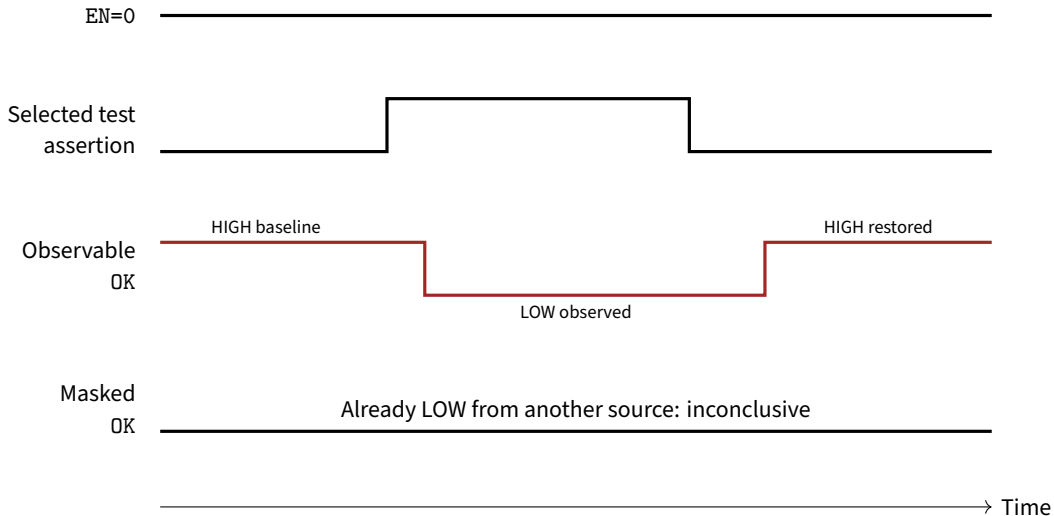

Schematic timing only. Assertion delay and release/recovery behavior are ICD-defined.
Do not bypass real faults. Restore an observable baseline before the next contribution test.