


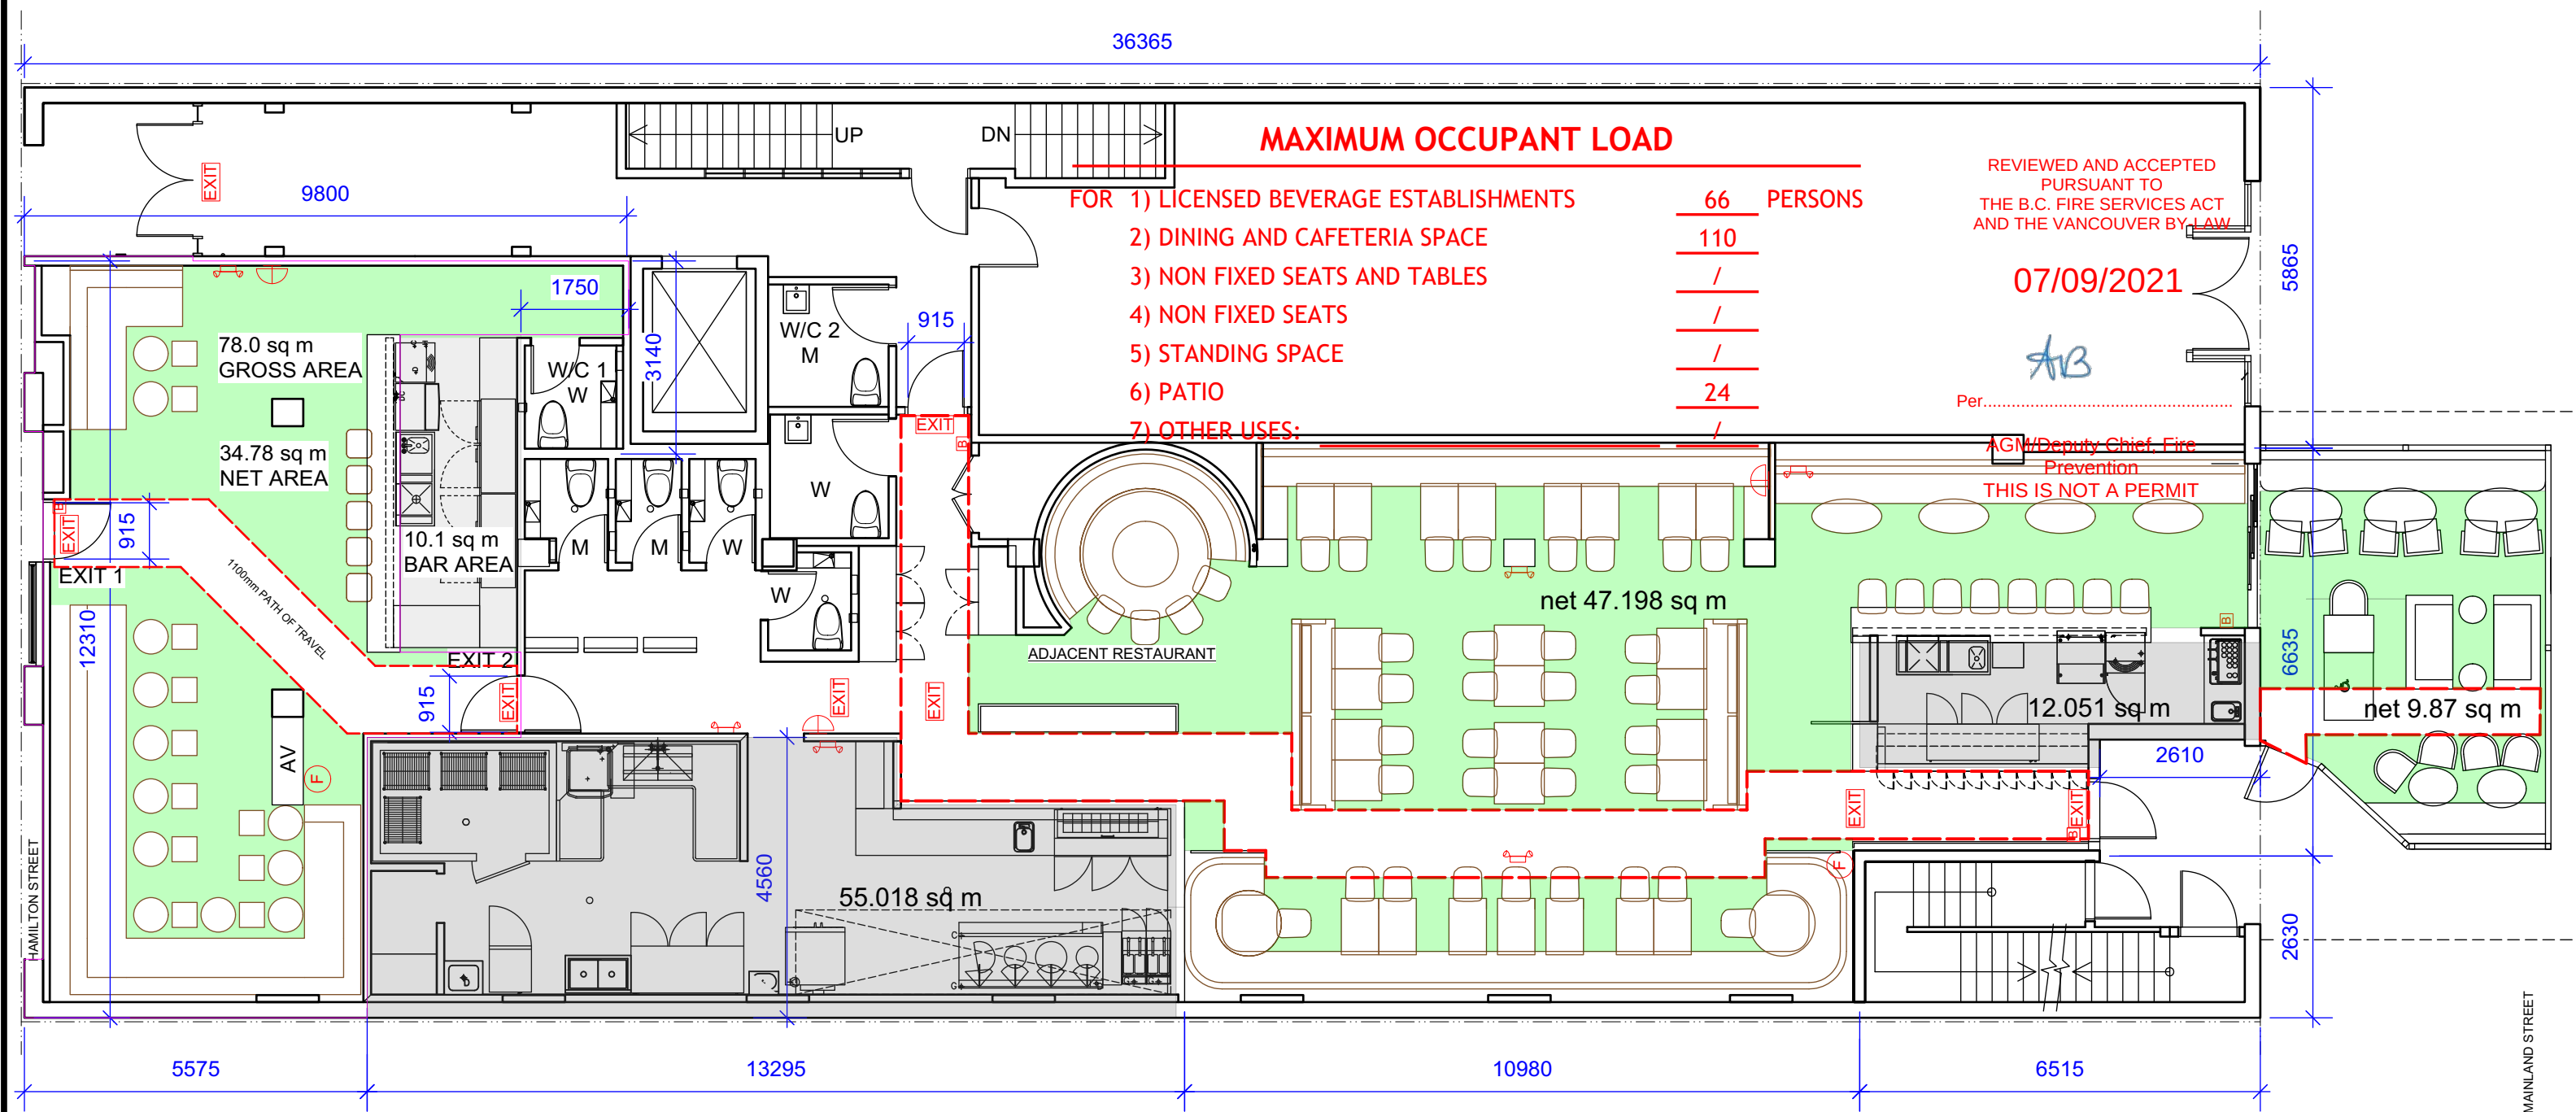

MAXIMUM OCCUPANT LOAD		
FOR		
1) LICENSED BEVERAGE ESTABLISHMENTS	66	PERSONS
2) DINING AND CAFETERIA SPACE	110	
3) NON FIXED SEATS AND TABLES	/	
4) NON FIXED SEATS	/	
5) STANDING SPACE	/	
6) PATIO	24	
7) OTHER USES:	/	

REVIEWED AND ACCEPTED
PURSUANT TO
THE B.C. FIRE SERVICES ACT
AND THE VANCOUVER BY-LAW

07/09/2021

Per.....
AGM/Deputy Chief, Fire
Prevention
THIS IS NOT A PERMIT

CRITERIA #1 – FIRE ALARM -YES
CRITERIA #2 –
BUILDING DESIGN OCCUPANT LOAD (VBBL)
GROSS AREA 78.0m² / 1.2m² = 65
STAFF AREA 10.1m² / 9.3m² = 1
OCCUPANT LOAD = 66

WASHROOMS: 3M 4W = 200

CRITERIA #3 –
DENSITY AND NET FLOOR SPACE (VFBL)
NET 34.78m² / 0.4m² = 87

CRITERIA #4 - EXIT CAPACITY
EXITS: DOOR 1 @ 915mm / 6.1mm = 149
DOOR 2 @ 915mm / 6.1mm = 149
2 X 149 = 298

CRITERIA #2 –
BUILDING DESIGN OCCUPANT LOAD (VBBL)
GROSS AREA 173.98m² / 1.2m² = 145
STAFF AREA 67.07m² / 9.3m² = 7
OCCUPANT LOAD = 152

CRITERIA #3 –
DENSITY AND NET FLOOR SPACE (VFBL)
NET 47.20m² / 0.4m² = 118

CRITERIA #4 - EXIT CAPACITY
EXITS: DOOR 1 @ 915mm / 6.1mm = 149
DOOR 2 @ 915mm / 6.1mm = 149
DOOR 3 @ 915mm / 6.1mm = 149
3 X 149 = 447

PATIO CRITERIA #2 –
BUILDING DESIGN OCCUPANT LOAD (VBBL)
GROSS AREA 28.68m² / 1.2m² = 24

CRITERIA #3 –
DENSITY AND NET FLOOR SPACE (VFBL)
NET 9.87m² / 0.4m² = 24

CRITERIA #4 - EXIT CAPACITY
EXITS: DOOR 1 @ 915mm / 6.1mm = 149

A printed paper version of this stamped drawing to be posted on premise along with occupant load certificate