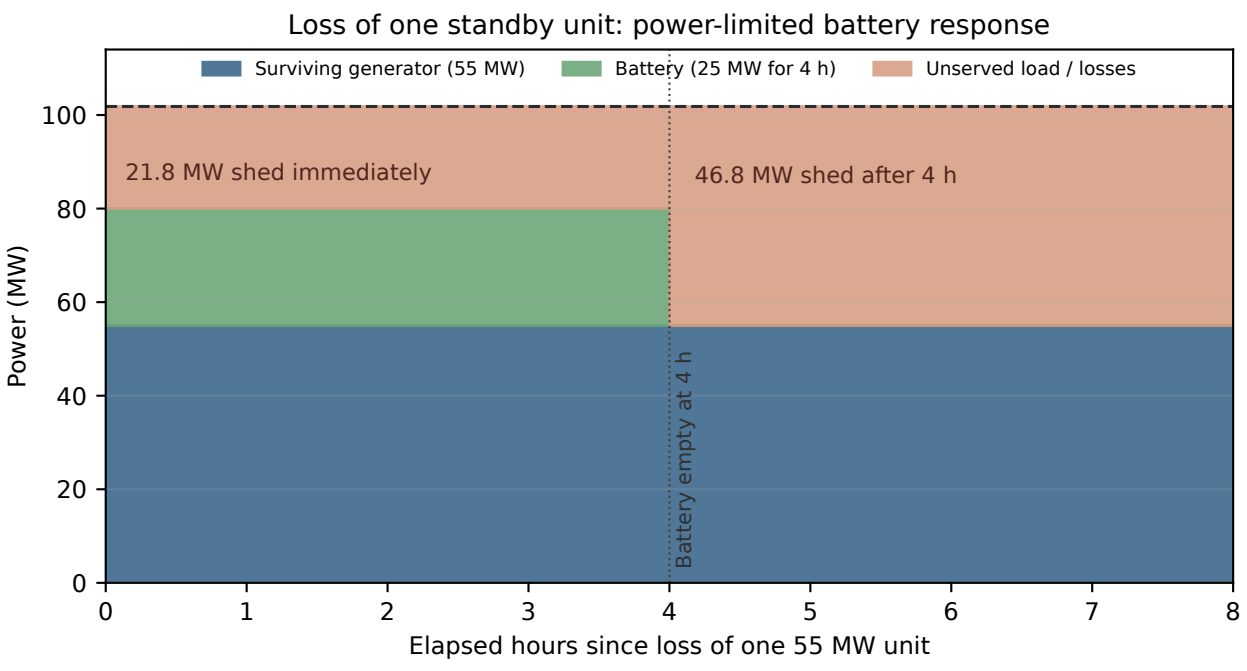
Loss of one standby unit: power-limited battery response
Surviving generator (55 MW)
Battery (25 MW for 4 h)
Unserved load / losses
21.8 MW shed immediately
46.8 MW shed after 4 h
Battery empty at 4 h
Power (MW)
0
20
40
60
80
100
0
1
2
3
4
5
6
7
8
Elapsed hours since loss of one 55 MW unit