

WATER HAMMER ARRESTOR SCHEDULE						
MARK	FIXTURE UNIT RATING	I.P.S.	J.R. SMITH MODEL NO.	WADE MODEL NO.	ZURN MODEL NO.	NOTES
WHA-A	1-11	3/4"	5005	5	100	--
WHA-B	12-32	1"	5010	10	200	--
WHA-C	33-60	1"	5020	20	300	--
WHA-D	61-113	1"	5030	50	400	--
WHA-E	114-154	1"	5040	75	500	--
WHA-F	155-330	1"	5050	100	600	--

PLUMBING SYMBOL SCHEDULE			
● BALL VALVE	CO-	CLEANOUT	
⌋ GAS COCK	EW-	ELECTRIC WATER COOLER	
→ PIPING DROP	EW-	ELECTRIC WATER HEATER	
→ INLINE PIPE DROP	FD-	FLOOR DRAIN	
● PIPING RISE	L-	LAVATORY	
→ PIPE BREAK	MS-	MOP SINK BASIN	
→ WALL CLEANOUT/END FERRULE CLEANOUT	SA	SHOCK ABSORBER	
⌋ GATE VALVE	TMV-	THERMOSTATIC MIXING VALVE	
⌋ SHOCK ABSORBER (SA)	U-	URINAL	
○ CLEANOUT	VTR-	VENT THROUGH ROOF	
○ FLOOR DRAIN	WB-	WALL BOX	
→ WALL HYDRANT/HOSE BIBB	WC-	WATER CLOSET	
→ SAN	WH-	WALL HYDRANT	
→ GW	7"	SUFFIX INDICATES HANDICAP ACCESSIBLE	
→ G	A.F.F.	ABOVE FINISHED FLOOR	
→ V	A.F.G.	ABOVE FINISHED GRADE	
→ CW	SCW	SOFT COLD WATER	
→ HW	CW	RAW (NON-SOFTENED) COLD WATER	
→ HWR	BWV	BACKWATER VALVE	

PLUMBING FIXTURE SCHEDULE			ROUGH-IN SCHEDULE					REMARKS
MARK	MANUFACTURER & MODEL NO.	TRIM	CW	HW	WASTE	VENT	MTG. HT.	
WC-1	AMERICAN STANDARD MODEL NO. 2257101.020	FLOOR HUNG, SLOAN MODEL #111-1.6X1 FLUSH VALVE, BEMIS MODEL #295SSGT SEAT LESS COVER AND ZURN MODEL #21201	1"	--	4"	2"		
UR-1	AMERICAN STANDARD MODEL NO. 6550001.020	0.125 GPF ULTRA HIGH EFFICIENCY URINAL SYSTEM, SLOAN MODEL #186-1X1 FLUSH VALVE	3/4"	--	2"	2"		
L-1	AMERICAN STANDARD MODEL #047025.020	DELTA MODEL #501-DST FAUCET.	1/2"	1/2"	1 1/2"	1 1/2"		
TP-1	TRAP SEAL ZURN, MODEL #21072		-	-	-	-		


FLOOR DRAIN AND MISCELLANEOUS SCHEDULE			REMARKS
SYMBOL	MANUFACT. MODEL #	DESCRIPTION	
FD-1	ZURN, MODEL #EZ1-PV3		SIZE AS SHOWN ON DRAWINGS, SLAB ON GRADE RM FLUSH WITH CONCRETE IN UNFINISHED FLOORS, RAISE RM THICKNESS OF FLOOR TILE IN TILED FLOORS
FD-2	SIoux CHIEF, MODEL #822-3PNR		SIZE AS SHOWN ON DRAWINGS, SLAB ON GRADE RM FLUSH WITH CONCRETE IN UNFINISHED FLOORS, RAISE RM THICKNESS OF FLOOR TILE IN TILED FLOORS
CO-1	ZURN, MODEL #Z-1400-BZ	FLOOR CLEAN OUT	
FPWH-1	WOODFORD, MODEL #65P	SELF-DRAINING, NON-FREEZE, ANTI-SIPHON WALL HYDRANT WITH HOSE CONNECTION AND INTEGRAL VACUUM BREAKER.	
SP-1	CHAMPION PUMP, MODEL #CPES-12H	PROVIDE WITH BASIN.	1/2 HP, 115-140, 8.5 FLA

PLUMBING EQUIPMENT SCHEDULE							ELECTRICAL DATA					REMARKS
MARK	DESCRIPTION	MANUFACTURER / MODEL NO.	CAPACITY	MECHANICAL REMARKS	HP	KW	VOLTS	AMPS	PHASE			
WH-1	GAS WATER HEATER	AO SMITH MODEL #3PVT-50	50 GALLON STORAGE 45 GPH RECOVERY @ 90°F TEMP RISE		-	-	120	5.0	1	-		
PET-1	PRESSURIZED EXPANSION TANK	WATTS, MODEL #PLT-5	2.1 GALLON		-	-	-	-	-	-		
RPZ-1	REDUCED PRESSURE ZONE BACK FLOW PREVENTER	ZURN, MODEL #Z5ASTR, 3"		PROVIDE AIR GAP FITTING & I.D. WASTE TO FLOOR THRU AIR GAP.	-	-	-	-	-	-		
TMV-1	THERMOSTATIC MIXING VALVE	ZURN, MODEL #ZW1017XLHT			-	-	-	-	-	-		
RCP-1	RECIRCULATING PUMP	GRUNDFOS MODEL #51.96.51			-	-	115	-	1	-		

The presence of a Citizens Water of Westfield, LLC and/or Citizens Wastewater of Westfield, LLC review and approval stamp on these plans does not relieve the Developer or his Contractor from compliance with the requirements of the "Citizens Energy Group Construction Standards and Specifications, latest edition." This review only designates that general conformance with design and specifications have occurred. Field changes may become necessary to comply with the Citizens Water of Westfield, LLC and/or Citizens Wastewater of Westfield, LLC Specifications & Details.

Date: 4/22/25
Revised: 6/24/25
By: TWO
By: TWO

citizens
westfield

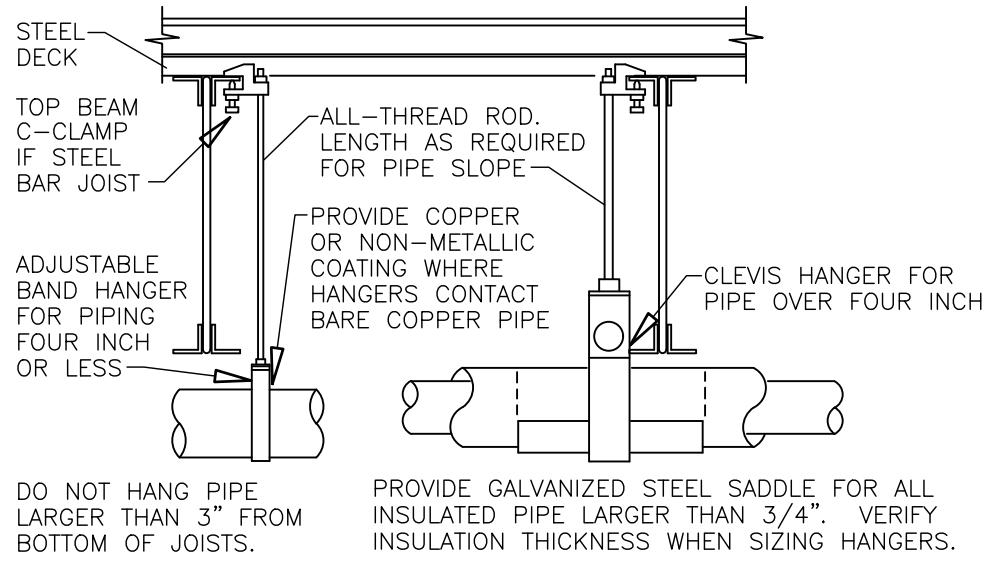


DO NOT HANG PIPE LARGER THAN 3" FROM BOTTOM OF JOISTS.

PROVIDE GALVANIZED STEEL SADDLE FOR ALL INSULATED PIPE LARGER THAN 3/4". VERIFY INSULATION THICKNESS WHEN SIZING HANGERS.

PROVIDE UPPER ATTACHMENT AS REQUIRED FOR CASES NOT SHOWN HERE. DO NOT INSTALL HANGER INSIDE INSULATION OR OTHERWISE PENETRATE VAPOR BARRIER. DO NOT HANG ONE PIPE FROM ANOTHER EXCEPT IN CHASES. TRAPEZE HANGERS MAY BE USED FOR MULTIPLE PARALLEL PIPES. HANGER SIZING FOR PIPE SIZE: COPPER: 4"-12" 3"-11" 2"-1/2"-10" 2"-9" 1-1/2"-8" 1-1/4"-7" 1"-6" 3/4"-6" 1/2"-5" CAST IRON: 10" 1-1/2"-9" 1"-7" 3/4"-6" 1/2"-5" LOCATE HANGERS AS CLOSE AS POSSIBLE TO TURNS AND TEES OF PIPE. PROVIDE SUPPLEMENTARY STEEL STRUTS BETWEEN JOISTS IF REQUIRED. LOCATE HANGERS TO TAKE LOAD OFF OF EQUIPMENT CONNECTIONS. ANCHOR WATER PIPE AGAINST SWAYING DUE TO CHANGES IN WATER VELOCITY. PROVIDE SEISMIC BRACING IF AS REQUIRED BY LOCAL AUTHORITIES. CHAINS OR PERFORATED STRAP IRON OR STEEL IS NOT ACCEPTABLE. REFER TO CODES FOR FURTHER INFORMATION.


PIPE SUPPORT DETAILS

NOT TO SCALE

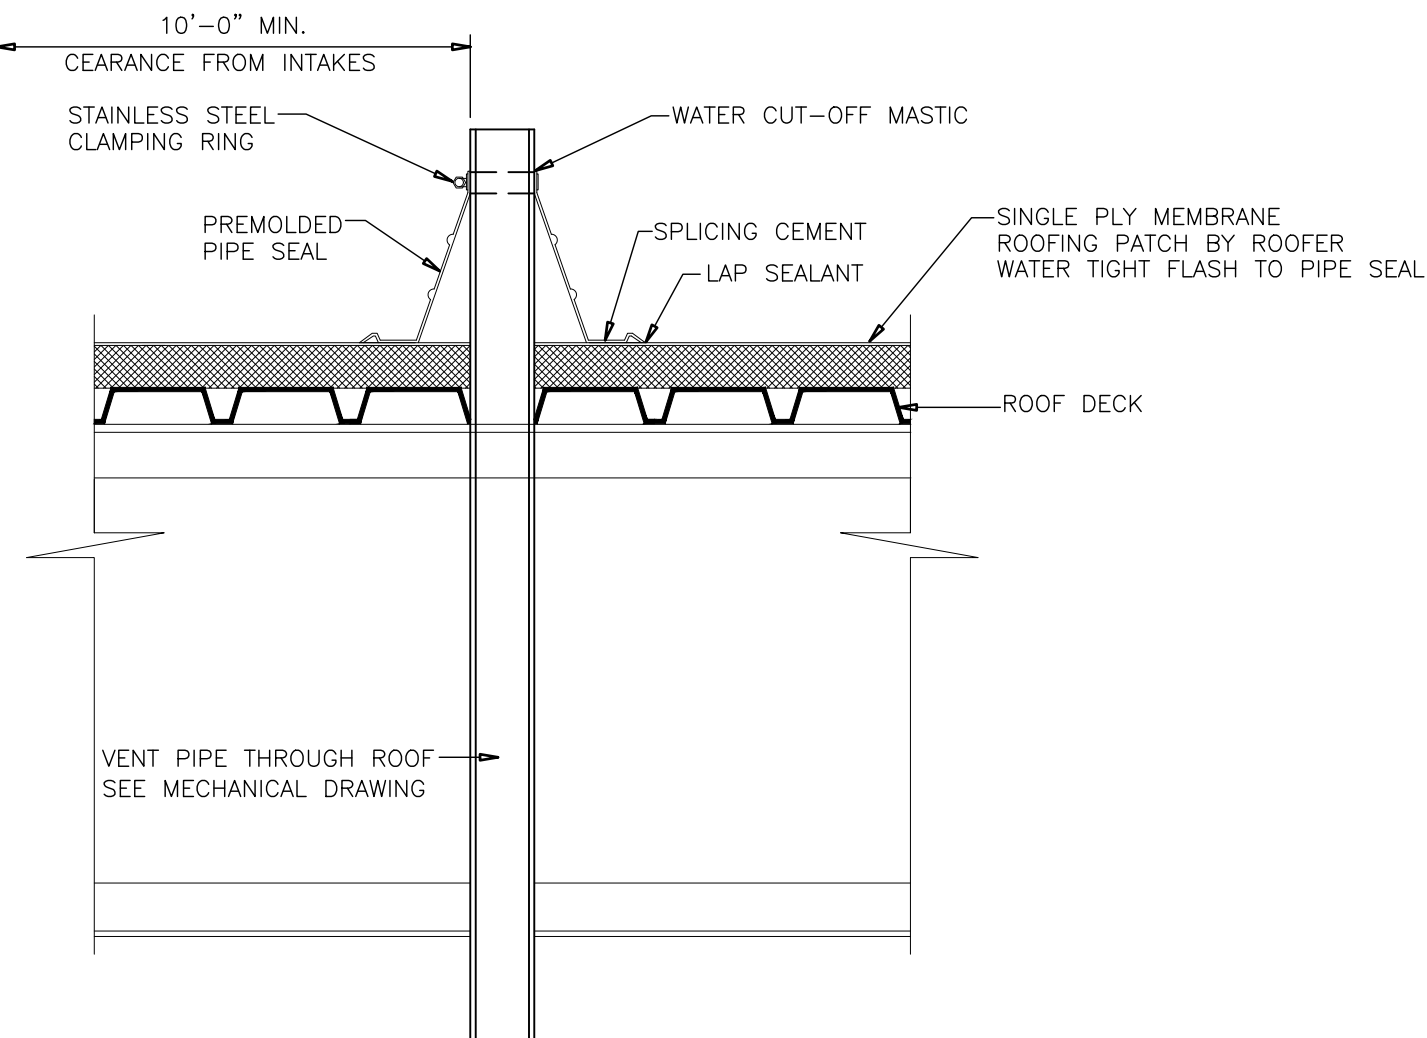


VENT PIPE THRU ROOF DETAIL

NOT TO SCALE

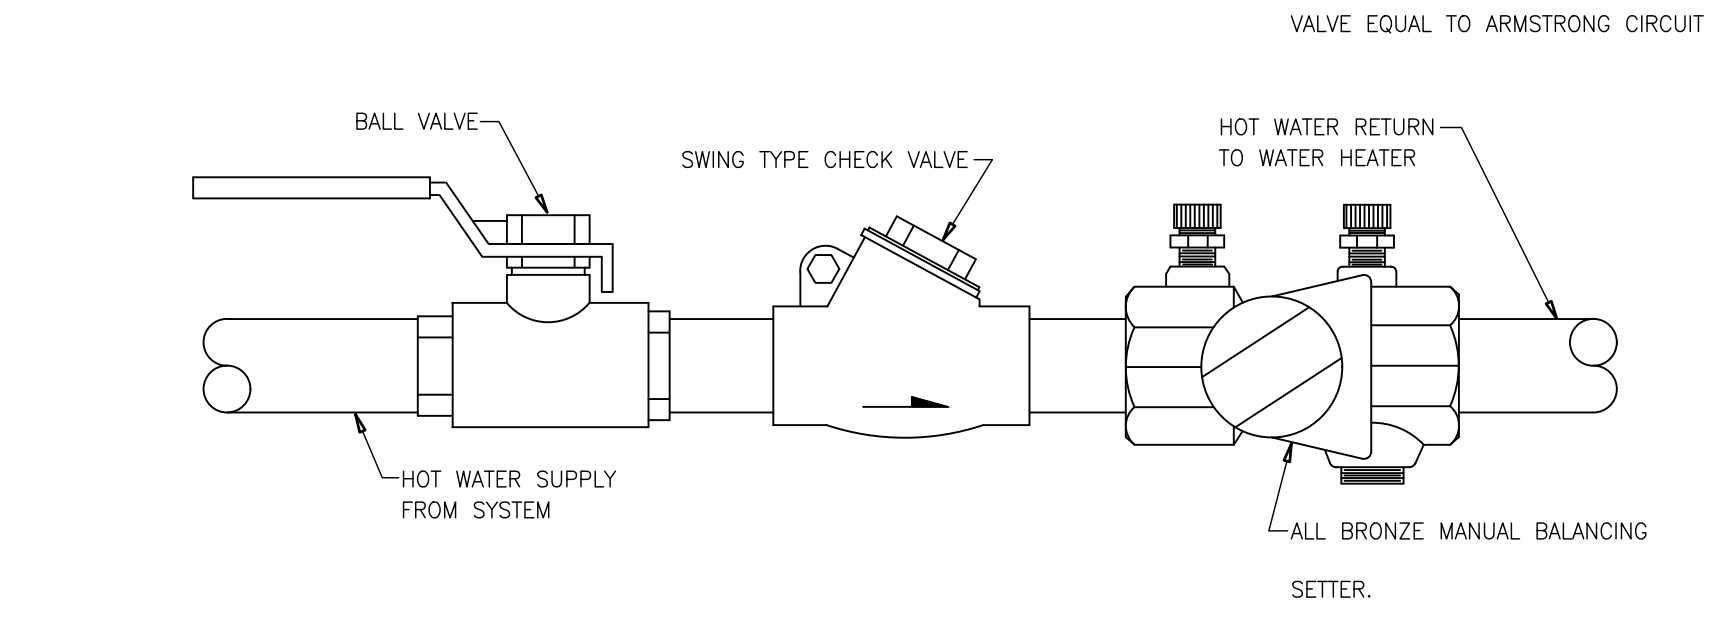


HOT WATER RETURN BALANCING STATION

NOT TO SCALE

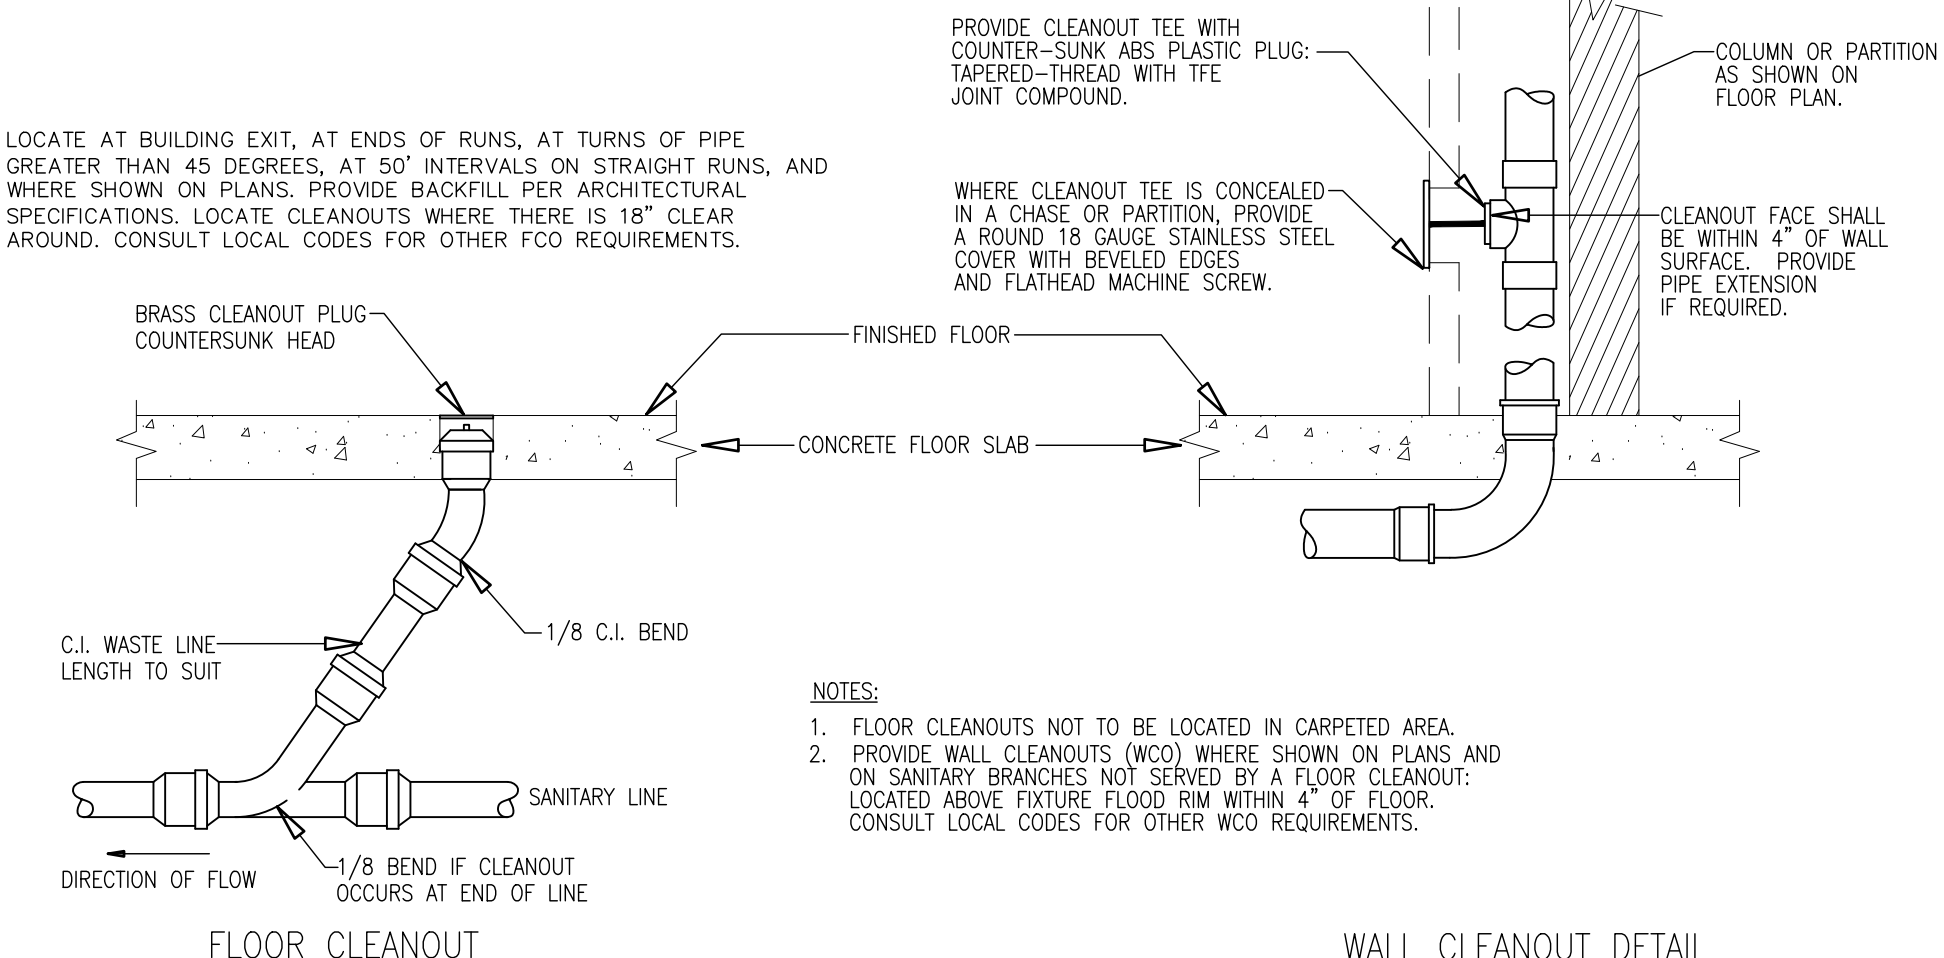

SANITARY CLEANOUT DETAILS

NOT TO SCALE

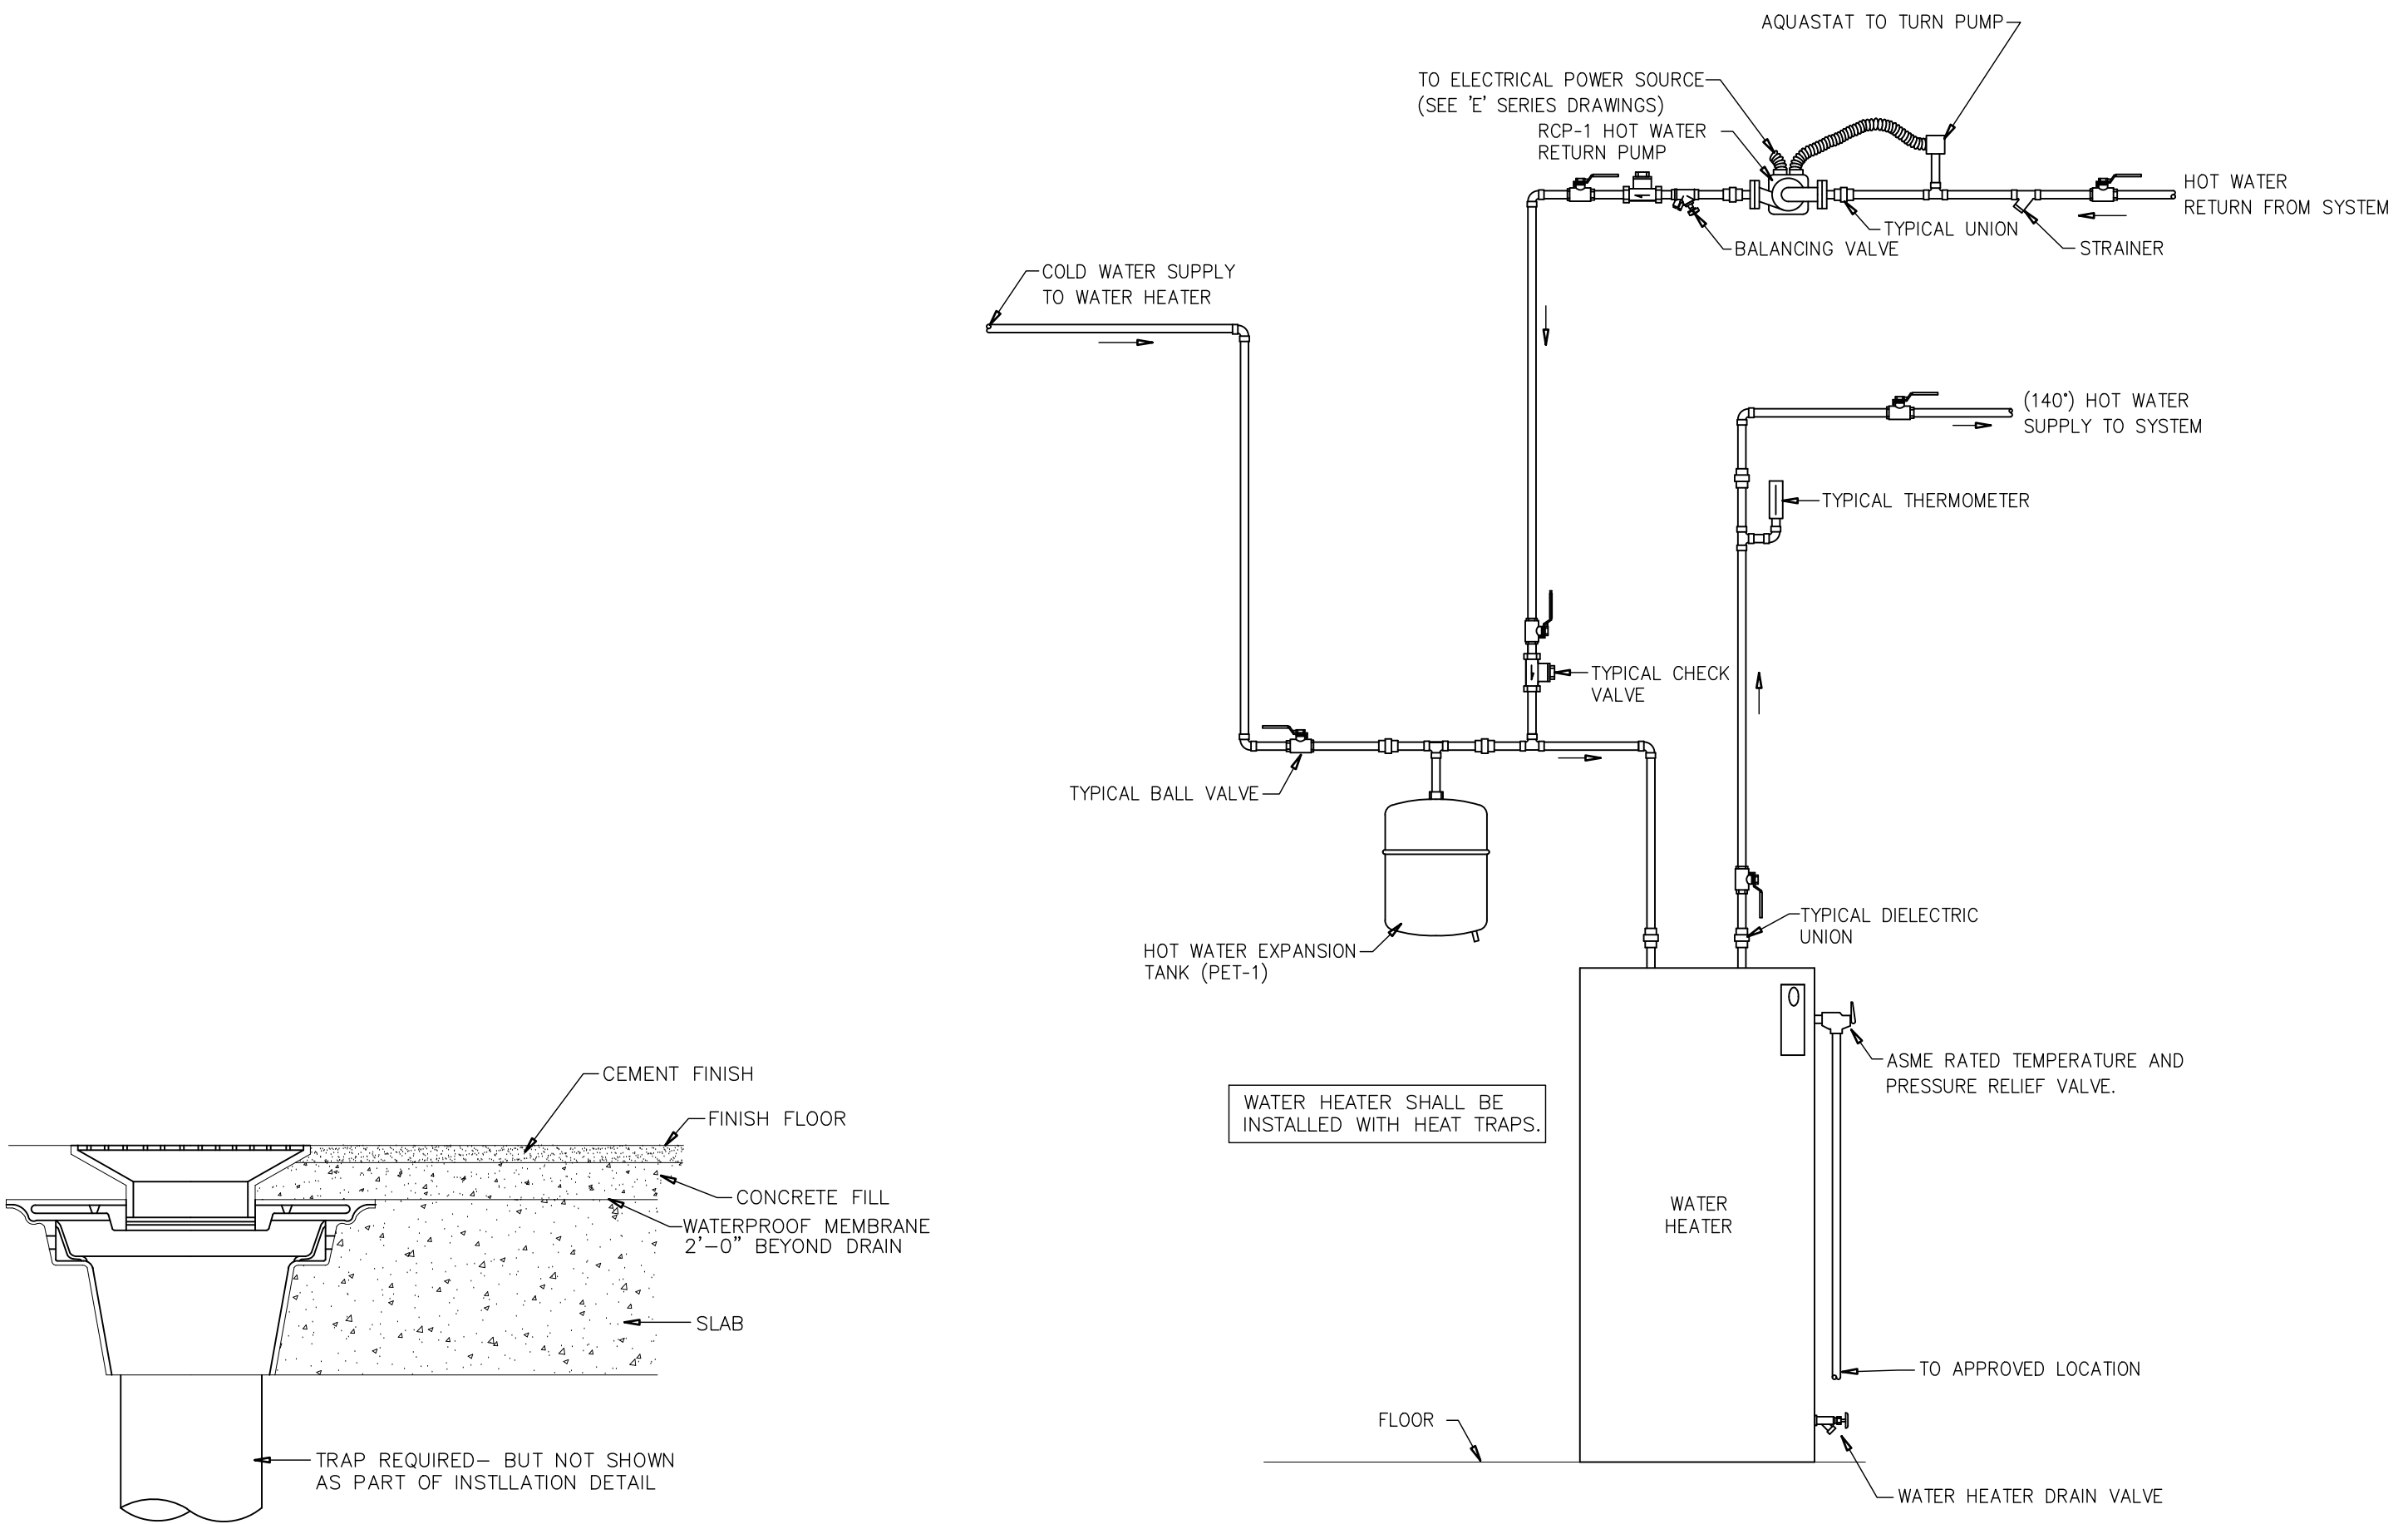


FLOOR DRAIN DETAIL

NOT TO SCALE

WATER HEATER PIPING DETAIL

NOT TO SCALE

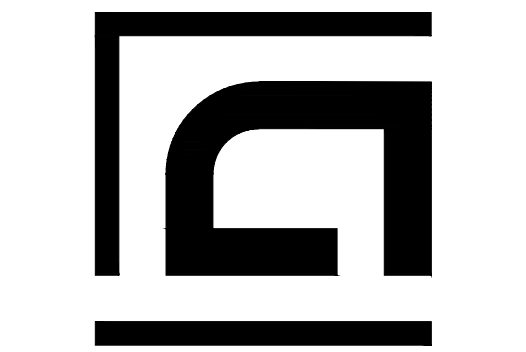

STUDIO AXIS

618 Studio
618 East Market Street
Indianapolis, Indiana 46202
+1 (317) 264-8162

WWW.STUDIOAXIS.COM

ALLEATO
GROUP
Your partner from the ground up.

CLIENT

ALLEATO GROUP
Client Contact
Client Address 1
Client Address 2
Client Phone

CIVIL ENGINEER

C1 Name
C1 Contact
C1 Address 1
C1 Address 2
C1 Phone

STRUCTURAL ENGINEER

C2 Name
C2 Contact
C2 Address 1
C2 Address 2
C2 Phone

MEP ENGINEER

C3 Name
C3 Contact
C3 Address 1
C3 Address 2
C3 Phone

LANDSCAPE ARCHITECT

C4 Name
C4 Contact
C4 Address 1
C4 Address 2
C4 Phone

CONSULTANT 5

C5 Name
C5 Contact
C5 Address 1
C5 Address 2
C5 Phone

PROJECT NUMBER: 2024057
DRAWN: AUTHOR CHECKED: CHECKER
DESIGN DEVELOPMENT 02/17/2025
REVISIONS
DESCRIPTION DATE

ALLEATO GROUP

WESTFIELD
COLLECTIVE

WESTFIELD, IN 46074

PLUMBING
DETAILS

P-401