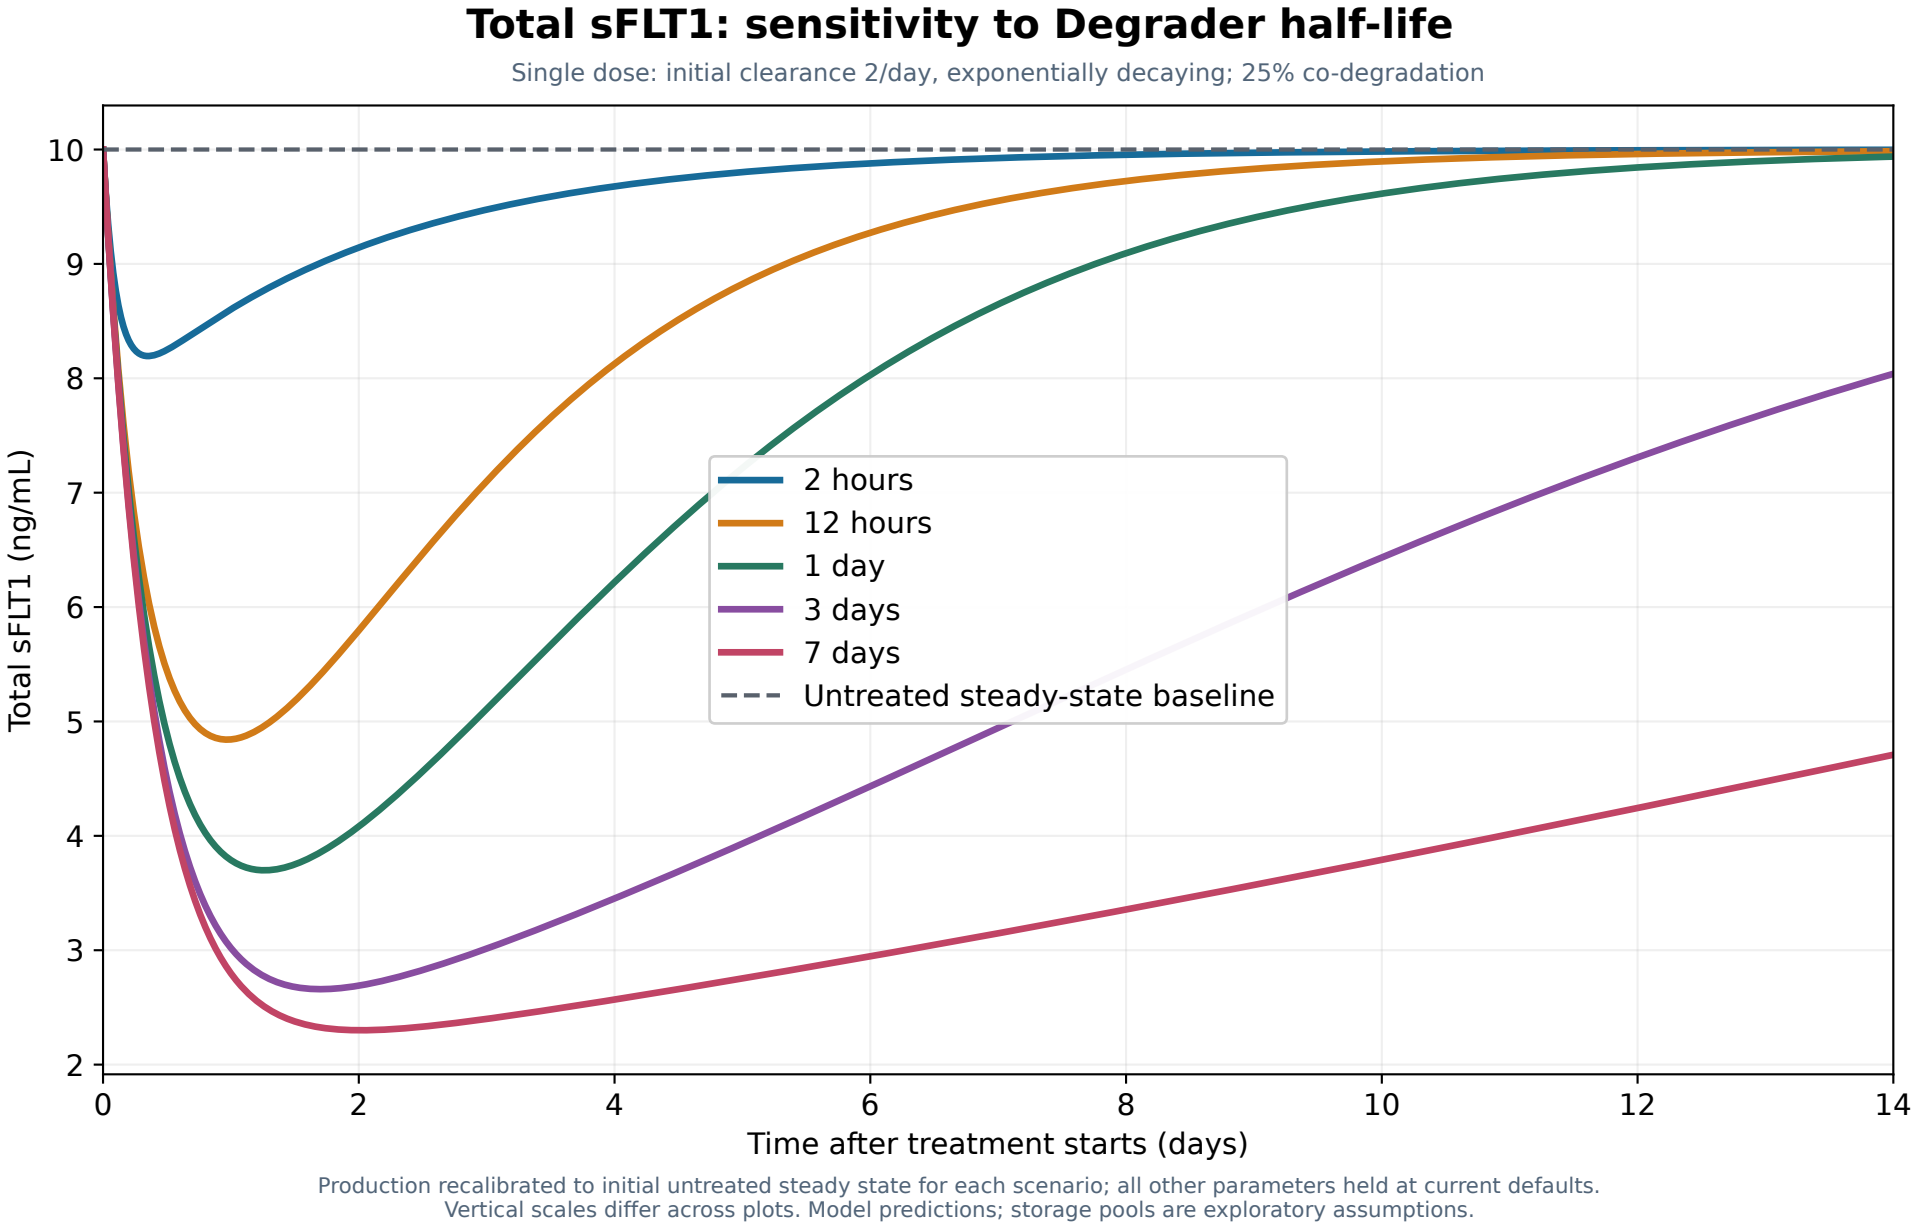
Total sFLT1: sensitivity to Degrader half-life
Single dose: initial clearance 2/day, exponentially decaying; 25% co-degradation
Total sFLT1 (ng/mL)
Time after treatment starts (days)
2 hours
12 hours
1 day
3 days
7 days
Untreated steady-state baseline
Production recalibrated to initial untreated steady state for each scenario; all other parameters held at current defaults.
Vertical scales differ across plots. Model predictions; storage pools are exploratory assumptions.