


1. LUBE OIL RESERVOIR VENT. OIL MIST SEPARATOR INSTALLED OFF-SKID.
2. FLAME ARRESTER INCLUDES FLAME FILTER AND LOCATED AT END OF PIPE.
3. LL SET POINT IS OVERRIDDEN AT START-UP.
4. OIL CHANGE BY USING TEMPORARY ARRANGEMENT WITH HOSES.
5. DELETED.
6. DELETED.
7. HIGH POINT VENT AND LOW POINT DRAIN TO BE FINALIZED BY PIPING AS PER PIPING LAYOUT.
8. ATMOSPHERIC VENT.
9. MANUAL DRAIN PRIOR TO EACH START-UP: PUSH BUTTON WITH PERMISSIVE FOR START-UP SEQUENCE.
10. PROVISION FOR FUTURE HOT GAS BYPASS LINE.
11. STRAINER TO BE REMOVED AFTER COMMISSIONING.
12. FROM SEAL GAS SYSTEM RUPTURE DISCS.
13. MAX BACK-PRESSURE 0.005 BARG.
14. UPSTREAM STRAIGHT RUN MIN. 10xD. DOWNSTREAM STRAIGHT RUN MIN. 5xD.
15. BOTTOM ENTRY FOR SUCTION AND DISCHARGE NOZZLES.
16. SAFETY CRITICAL HEAT TRACING - HYDRATE MITIGATION (25 DEG).
17. THIS P&ID CONTAINS DCN-KP-0273.1/0904-1.

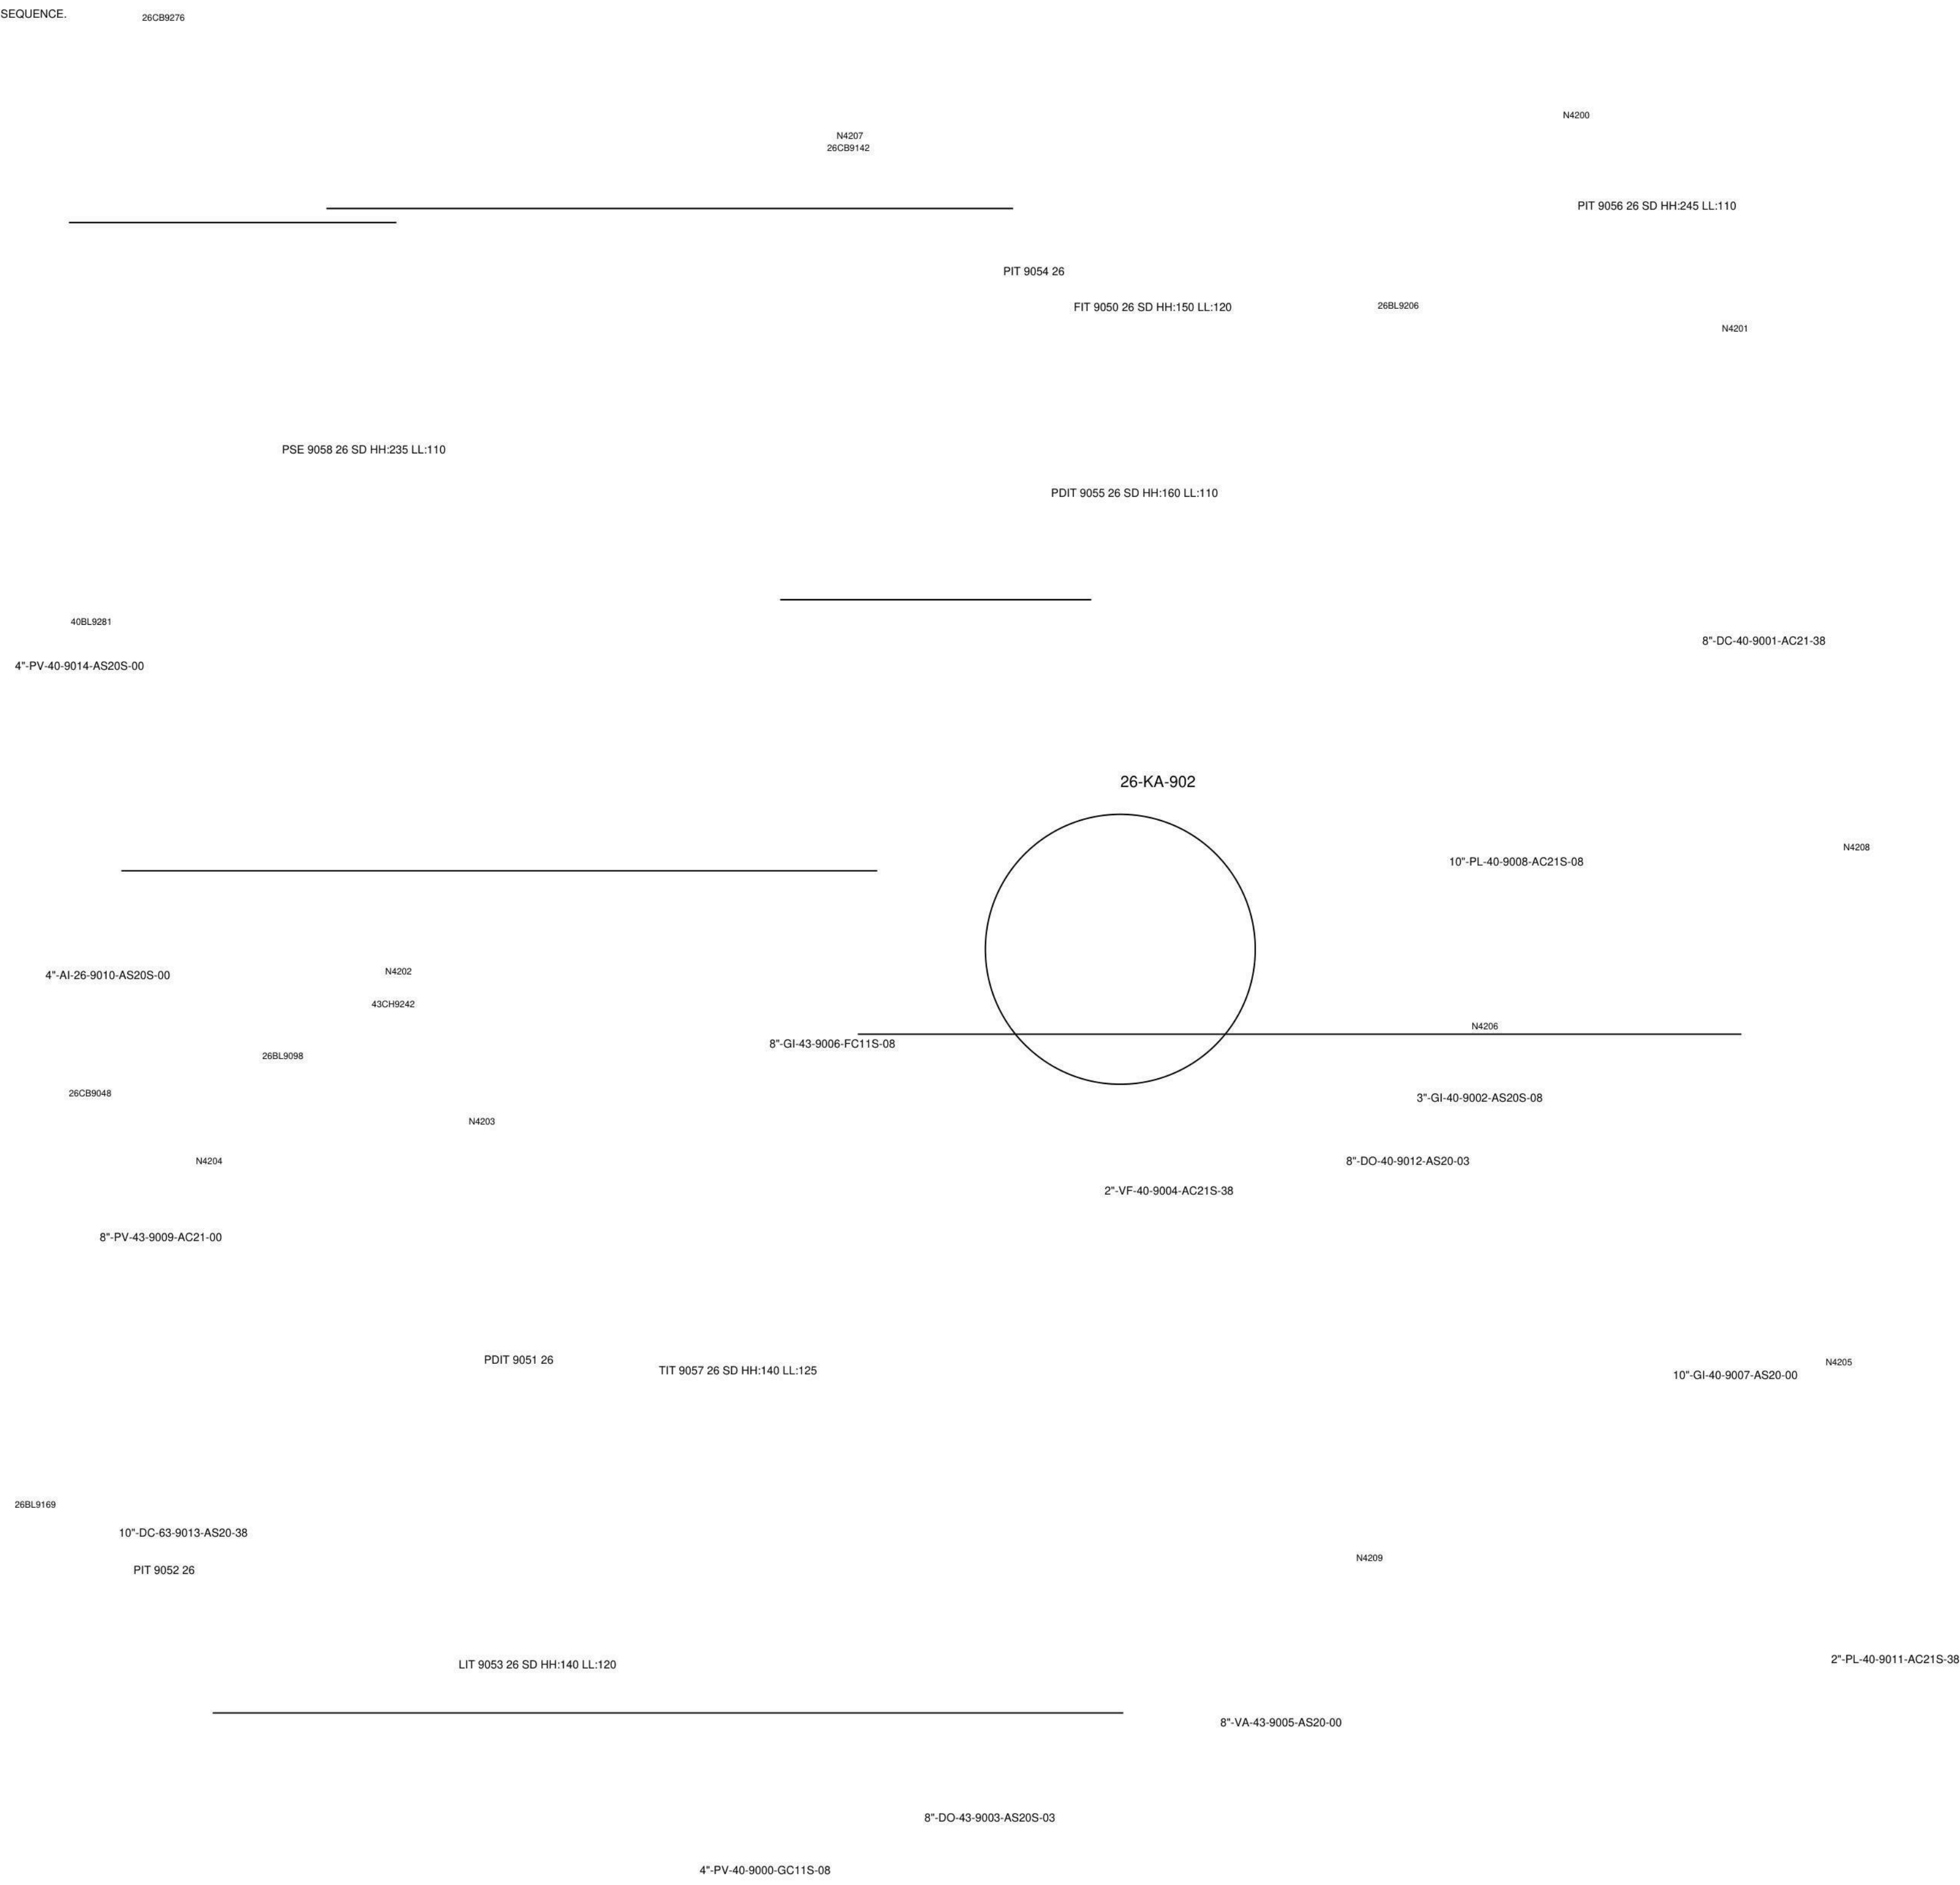

TAG NUMBER 26-KA-902
DUTY kW 1835
FLOW RATE kg/h 40210
DISCHARGE / SUCTION DESIGN PRESS. (MAX) Barg FV / 286 / FV / 286
VENDOR MAN ENERGY SOLUTIONS

B 2026-06-30 REVISED AS PER DCN
A 2026-01-15 ISSUED FOR DESIGN

2026-01-15
SHEET 1 OF 1
REV B
26-KA-902
3RD STAGE HP GAS LIFT COMPRESSOR
0D204-PID-26-902-001