Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution pursuant to section 47 of the Copyright Designs and Patent Act 1988 unless that Act provides a relevant exception to copyright this must not be copied without the prior permission of the copyright owner.

Information is given as a guide only and it's accuracy cannot be guaranteed.

PLEASE NOTE: This plan ONLY shows assets owned by National Grid Electricity Distribution (NGED). Electricity assets owned by National Grid Electricity Transmission (NGET) and IDNO's (Independent Network Operators) MAY be present in this area.

SERVICE SIZE ASSUMED TO BE 300CNE
THE SERVICE FOR THE PROPERTY 'SCHOOL HOUSE' IS ASSUMED TO BE FED FROM LEG 4 IF THIS IS NOT THE CASE FURTHER WORKS MAY BE REQUIRED

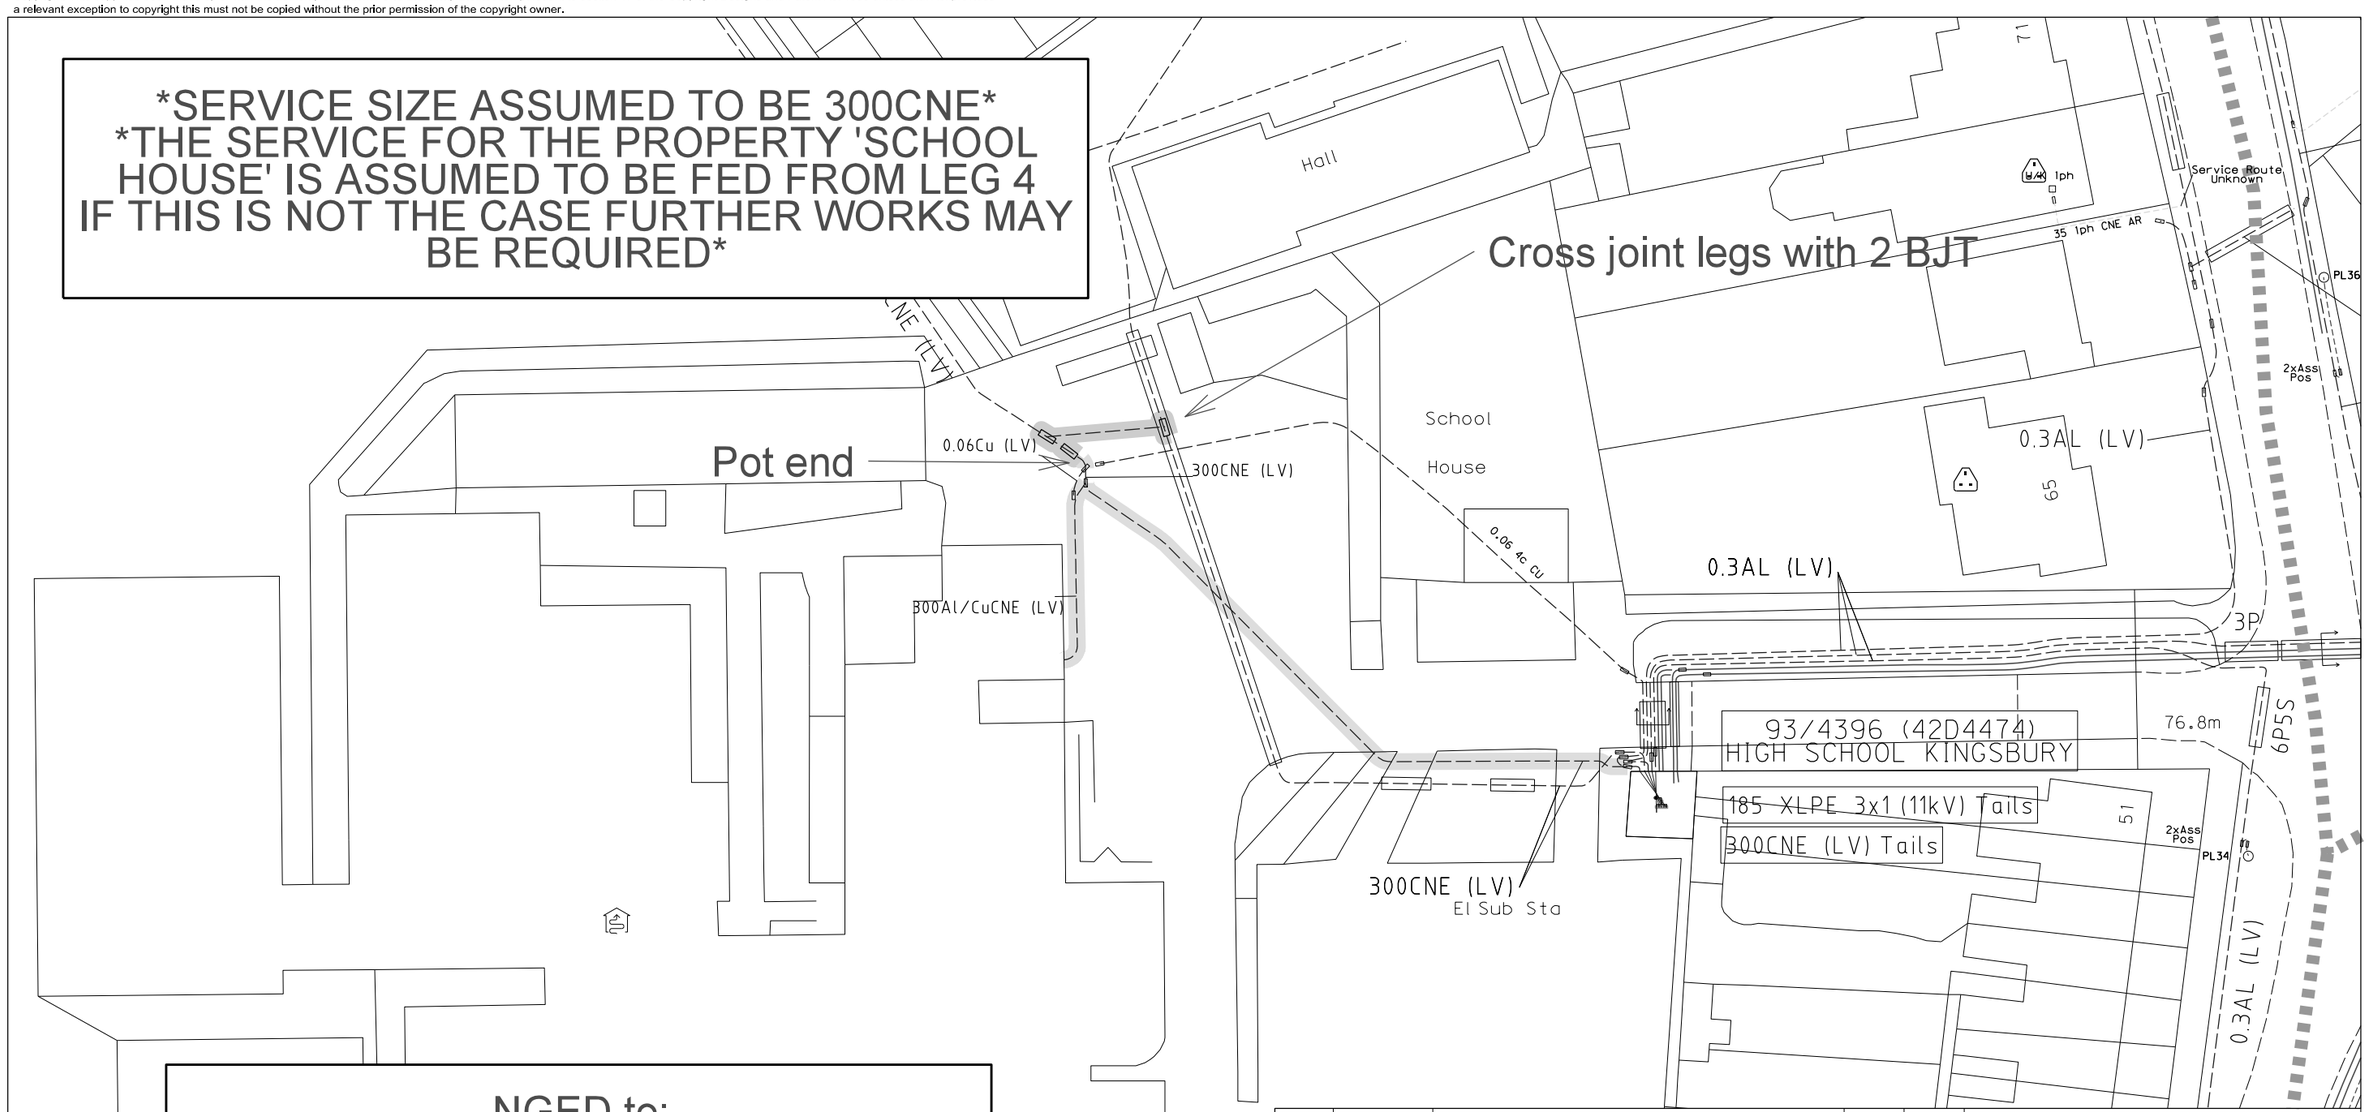

NGED to;

Complete all excavation and reinstatement.

Joint legs 4 & 5 together with approx 15m of 300cne. Pot end Leg 5 after service joint for school.

Install new combined CT metering unit -600/5.

X - 421525.841,296471.965

REV.	DATE	SCHEME PROGRESS BLOCK	DRN	CHK'D
·	· 02/01/25	· 274kVA supply	· LLP	·
·	·	·	·	·
·	·	·	·	·
·	·	·	·	·
·	·	·	·	·
·	·	·	·	·

UNDERGROUND CABLES
132KV | 33KV | 11KV
L.V. | SERVICE | STREET LTG.
HV EARTH | LV EARTH | EARTH ELECTRODE

SERVICES CABLE SIZES AS SHOWN

OVERHEAD LINES
132KV | 33KV
11KV | L.V.
SERVICE | STREET LTG.

PYLON | POLE | STAY

DUCT & ALKATHENE TUBE

HOUSE METER POSITIONS - EXTERNAL
INTERNAL

SURF TELECOMS S — S

PILOT CABLES P — P

PROPOSALS | ALTERATIONS | DISMANTLED

TRAFFIC SENSITIVE AREA YES/NO

nationalgrid Electricity Distribution

TITLE
· Kingsbury School
· Tamworth Road
· Kingsbury B78 2LF

DEVELOPER.
BUILDER.
ARCHITECT Drg. No.

O.S. MAP.

SCALE 1:500 @ A3

PARISH.

11kV DIAG.

LV. DIAG.

PLAN No. 5349663

Enq No. 5349663 | 1 of 1

Based upon the Ordnance Surveys map with the permission of the Controller of His Majesty's Stationery Office. Crown Copyright Reserved. National Grid Electricity Distribution, Avonbank, Feeder Road, Bristol, BS2 0TB. License No. 100022432.
CARE SHOULD BE EXERCISED TO ENSURE THE PRECISE POSITION OF THE NGED APPARATUS IF WORK IS TO BE EXECUTED IN ITS VICINITY. If In doubt, contact your local NGED office.