DESIGN STANDARD.

FIRE ALARM CATEGORY - L2

WIRING METHOD.

2 CORE & EARTH 1.5mm² SOFT SKIN FIRE ALARM CABLE CLIPPED DIRECT TO THE BUILDING STRUCTURE.

MOUNTING HEIGHTS.

ALL MEASUREMENTS IN mm TO TOP EDGE

FIRE ALARM CALL POINTS 1200
FIRE ALARM SOUNDER / BEACONS 2200
FIRE ALARM CONTROL PANEL 1800

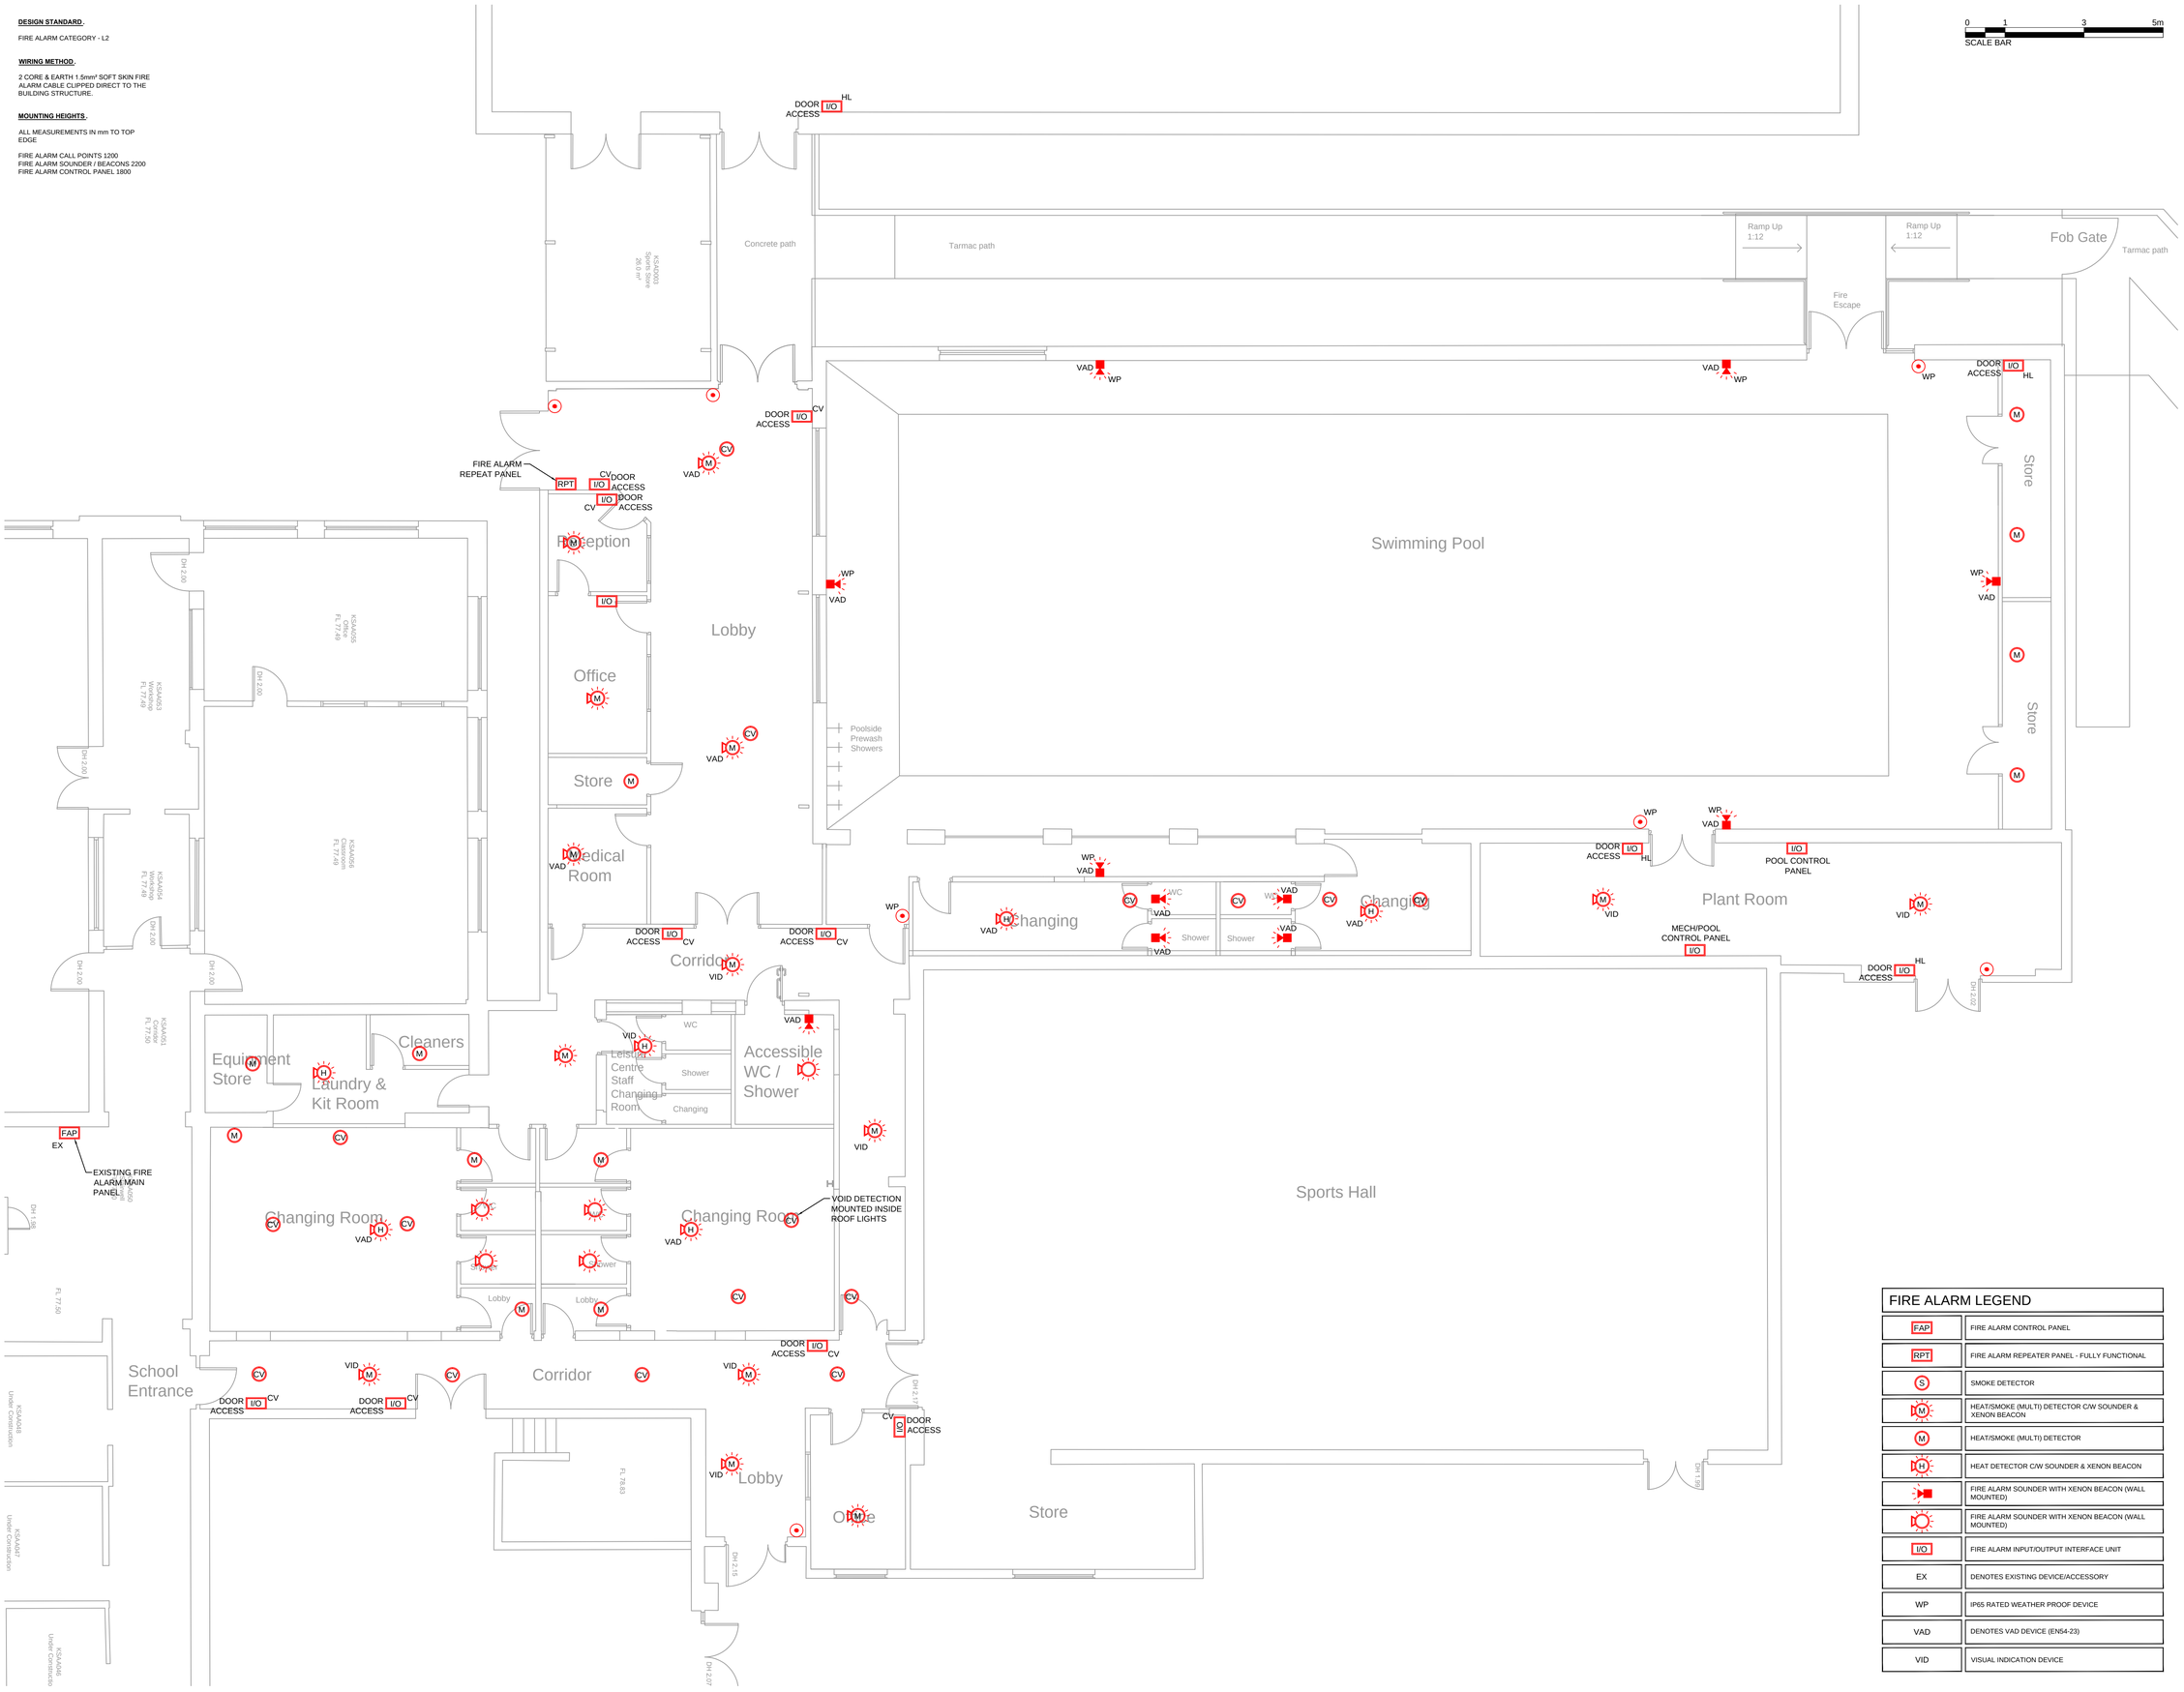

NOTES

ORIGINAL A1

DO NOT SCALE FROM THIS DRAWING.
IF IN DOUBT ASK.

AS FITTED DRAWING

FIRE ALARM LEGEND

FAP	FIRE ALARM CONTROL PANEL
RPT	FIRE ALARM REPEATER PANEL - FULLY FUNCTIONAL
S	SMOKE DETECTOR
M	HEAT/SMOKE (MULTI) DETECTOR C/W SOUNDER & XENON BEACON
M	HEAT/SMOKE (MULTI) DETECTOR
H	HEAT DETECTOR C/W SOUNDER & XENON BEACON
	FIRE ALARM SOUNDER WITH XENON BEACON (WALL MOUNTED)
	FIRE ALARM SOUNDER WITH XENON BEACON (WALL MOUNTED)
I/O	FIRE ALARM INPUT/OUTPUT INTERFACE UNIT
EX	DENOTES EXISTING DEVICE/ACCESSORY
WP	IP65 RATED WEATHER PROOF DEVICE
VAD	DENOTES VAD DEVICE (EN54-23)
VID	VISUAL INDICATION DEVICE

Originator

Tec Electrical Services Ltd

Client

gleeds

Project

KINGSBURY SCHOOL SWIMMING POOL REFURBISHMENT

Title

FIRE ALARM LAYOUT

Design	Drawn	Date
TEC	TEC	FEB '26

Scale

1:75 @ A1

Background Drawing

NTBS4235 Kingsbury School 01-10-25

Drawing No. E500

Rev AF

Status

AS FITTED