
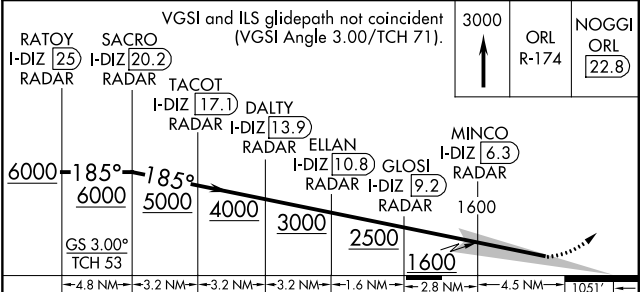


LOC/DME I-DIZ 111.75 Chan 54 (Y)	APP CRS 185°	Rwy Ldg 10000 TDZE 90 Apt Elev 96
--	------------------------	--

ILS RWY 17R (CAT II)
ORLANDO INTL (MCO)

RADAR required for procedure entry. DME or RADAR required.		ALS F-2 	MISSED APPROACH: Climb to 3000 on ORL VORTAC R-174 to NOGGI/ ORL 22.8 DME and hold.

D-ATIS 121.25	ORLANDO APP CON 124.8 307.0	ORLANDO TOWER 118.45 253.5 (17L/35R, 17R/35L) 124.3 253.5 (18L/36R, 18R/36L)	GND CON 126.4 (E) 121.8 (W)
-------------------------	---------------------------------------	--	---

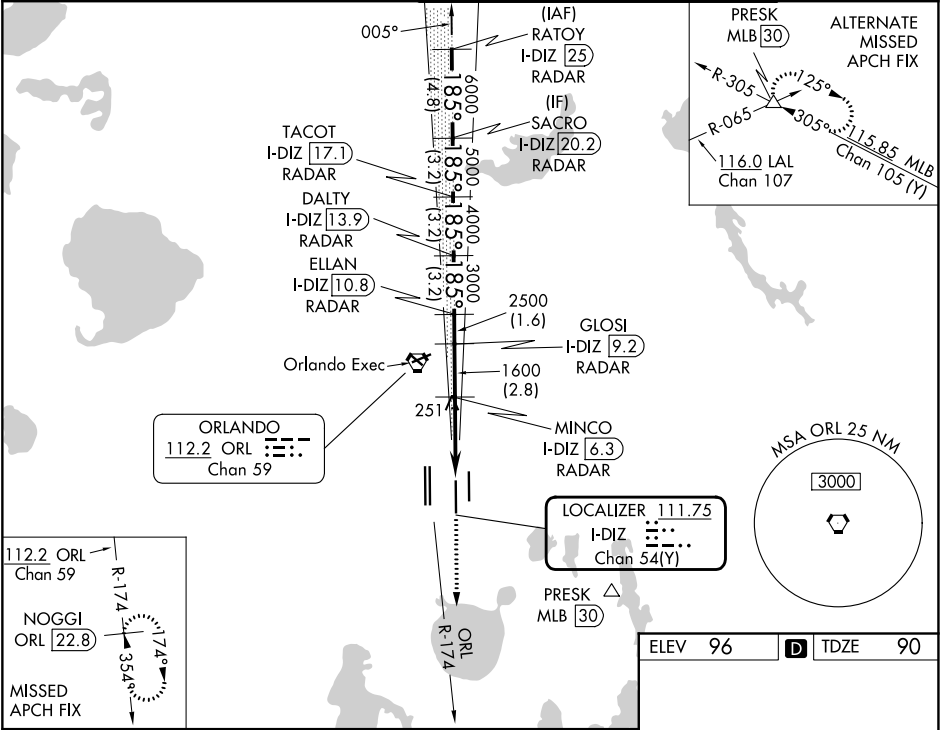

CATEGORY	A	B	C	D
S-ILS 17R	RA 104/12 100 DA 190			
CATEGORY II ILS - SPECIAL AIRCREW & AIRCRAFT CERTIFICATION REQUIRED				

ELEV 96	D	TDZE 90
---------	---	---------

