



Rung for Real, Almost Never

A Cross-Portfolio Taxonomy of Genuine Fire-Alarm Call-Point Triggers

Torun Ezeigwe · Renke Sabel — School of Continuous Improvement

Background

Every break-glass call point in a building portfolio is tested on a fixed monthly schedule. Little is known about how often, once installed, one is ever triggered for the reason it exists — and what, in practice, actually does the triggering.

Aims


- Establish how many of a large portfolio's call points have ever logged a non-test activation
- Build a typology of the genuine triggers that do occur, against scheduled tests and false alarms
- Test whether call-point age predicts genuine-trigger likelihood

Methods

- 214 call points across 41 commercial and residential buildings; activation logs audited, 2020–2026
- Activations classified scheduled test / false alarm / genuine trigger by two independent coders ($\kappa = 0.86$)
- Genuine triggers typologised inductively; call-point age modelled as a predictor

Results

Of 3,142 logged activations, 96.4% are scheduled tests. The remaining 113 resolve into four recurring trigger types, with no association between call-point age and trigger type.

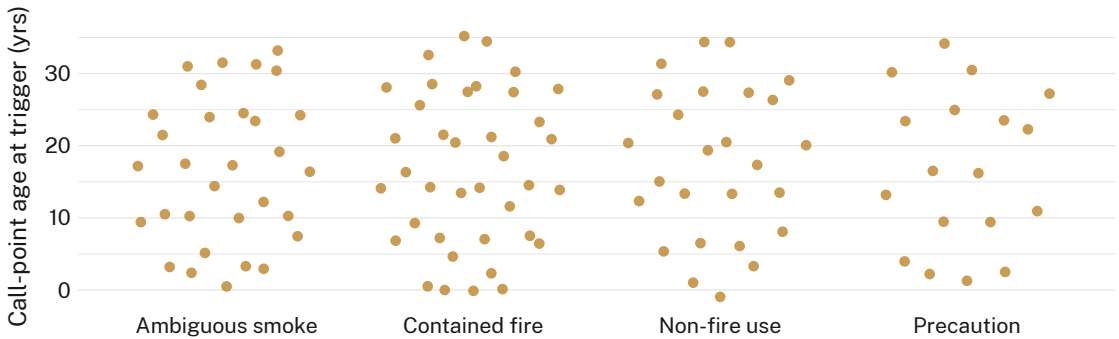

113 genuine activations logged across 41 buildings, 2020–2026, cluster into four trigger types; call-point age at time of trigger spans 0–34 years with no visible clustering by type.

Discussion & conclusions

A compliance record built almost entirely from its own scheduled tests reads as complete without describing readiness. The four-type typology clusters around ordinary hazards, not the fire scenario the mechanism was installed for. Next: audit whether portfolios with higher test-completion rates also report faster response once a genuine trigger occurs.

References

1. Festag, S. (2022). The False Alarm Situation in Different Countries. In *False Alarm Study: Increase Fire Safety by Understanding False Alarms*, 11–39. doi:10.37307/b.978-3-503-20969-9.04
2. Spearpoint, M., Lovreglio, R., & Gwynne, S. (2021). The response of sleeping adults to smoke alarm signals in the Evacuation Decision Model. *Fire Safety Journal*, 123, 103379. doi:10.1016/j.firesaf.2021.103379
3. Boyce, K., McConnell, N., & Shields, J. (2017). Evacuation response behaviour in unannounced evacuation of licensed premises. *Fire and Materials*, 41(5), 454–466. doi:10.1002/fam.2430
4. Lovreglio, R., & Kuligowski, E. (2022). A pre-evacuation study using data from evacuation drills and false alarm evacuations in a university library. *Fire Safety Journal*, 131, 103595. doi:10.1016/j.firesaf.2022.103595

Activation logs de-identified at building level; no occupant or reporting-party details retained. Supported by an Adaptive Metrics Lab seed allocation.

Contact: torun.ezeigwe@slop.university · Office of Research Outputs

🐦 @slop.university · #slopU



“Break glass in case of fire. Almost nobody ever has.”

3.6% of six years of logged activations were not a scheduled test.