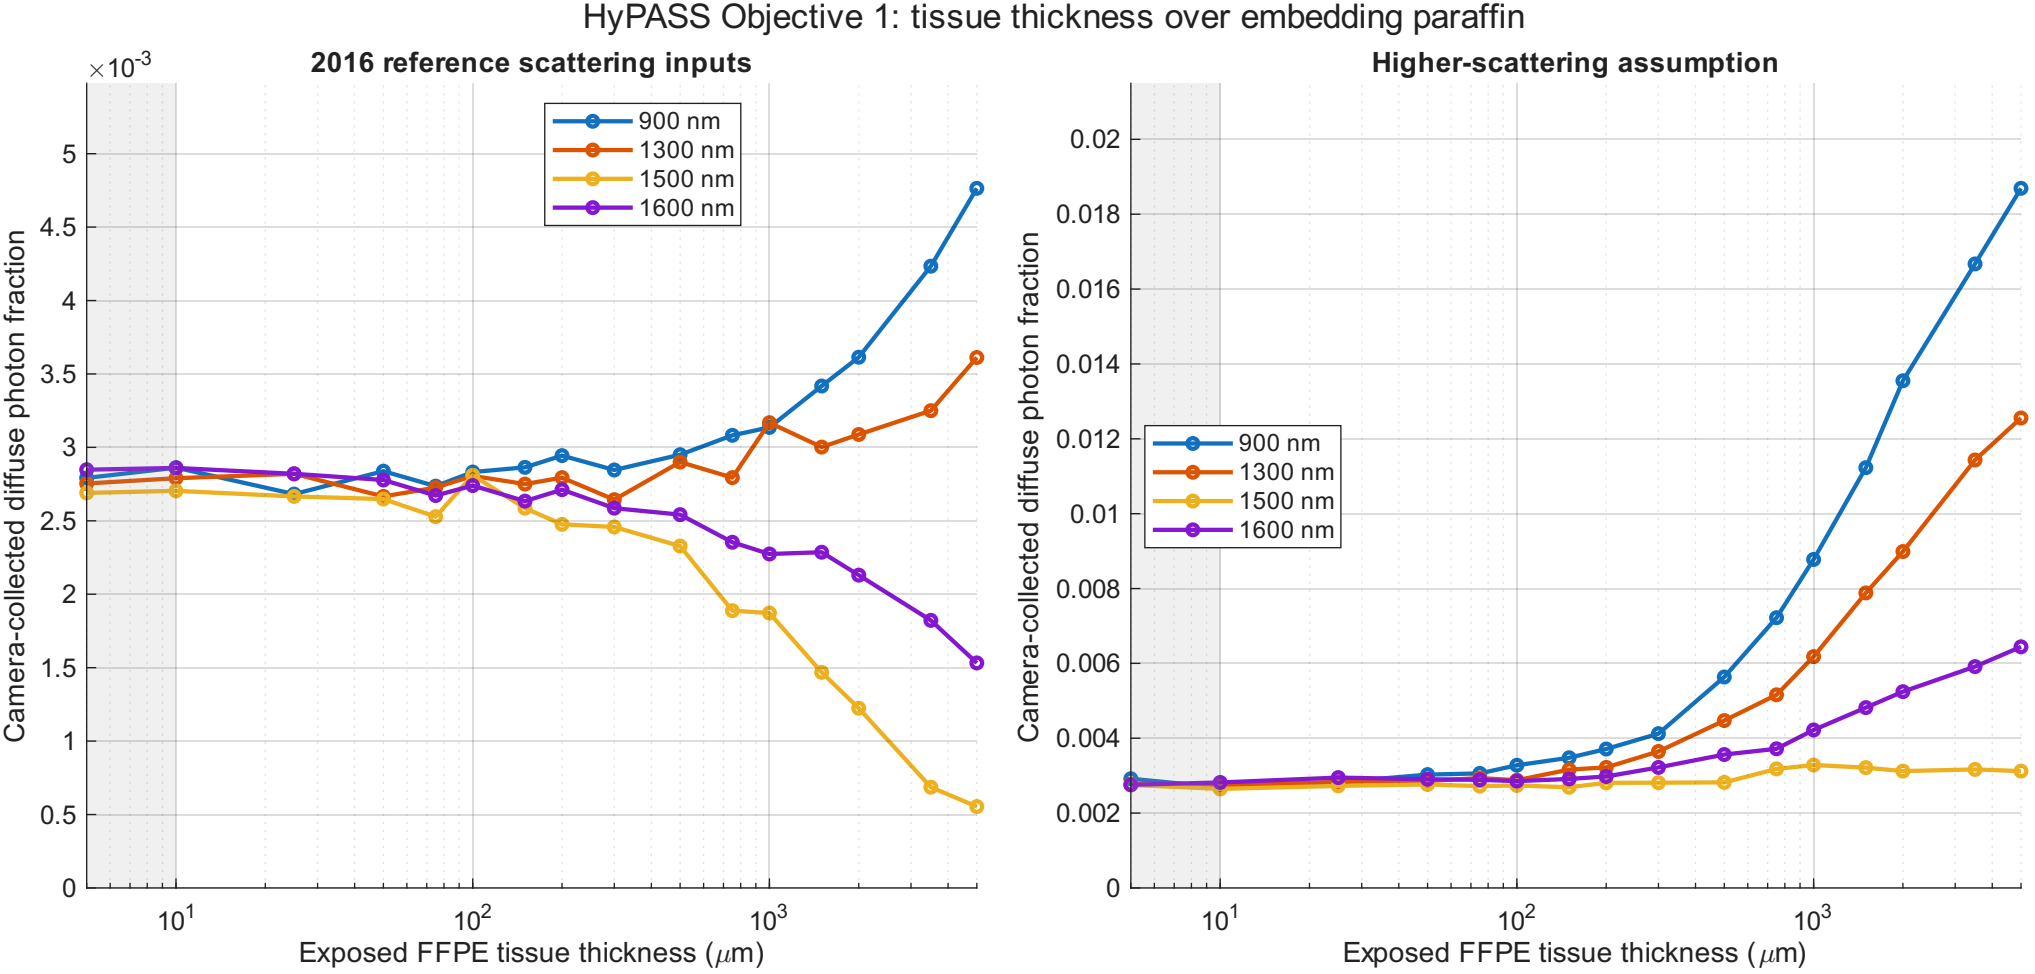

HyPASS Objective 1: tissue thickness over embedding paraffin
2016 reference scattering inputs
Higher-scattering assumption
×10-3
Camera-collected diffuse photon fraction
Exposed FFPE tissue thickness (μm)
900 nm
1300 nm
1500 nm
1600 nm
0
0.5
1
1.5
2
2.5
3
3.5
4
4.5
5
0.002
0.004
0.006
0.008
0.01
0.012
0.014
0.016
0.018
0.02
10^1
10^2
10^3