



2 MECHANICAL PLAN - PLAN 1

A1-111 SCALE: 1/4" = 1'-0"

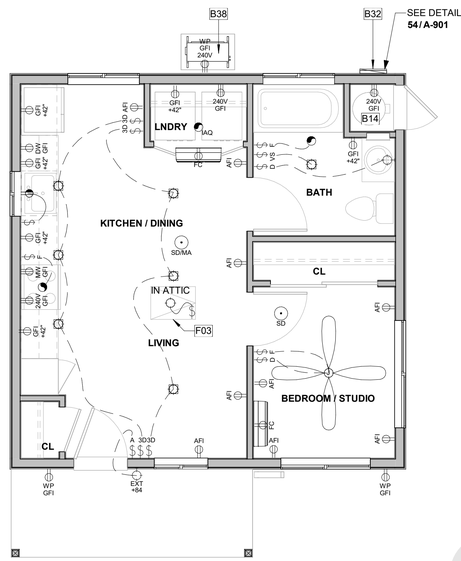

1 ELECTRICAL PLAN - PLAN 1

A1-111 SCALE: 1/4" = 1'-0"

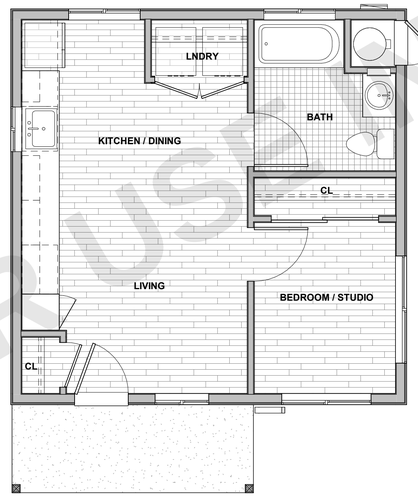

3 FINISH PLAN - PLAN 1

A1-111 SCALE: 1/4" = 1'-0"

KEYNOTES

A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR, STAINLESS STEEL.

A04 24" WIDE FRONT CONTROL UNDERCOUNTER DISHWASHER.

A05 REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).

A07 WASHING MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX.

A08 CLOTHES DRYER LOCATION W/ RECESSED DRYER VENT BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR VERTICALLY THROUGH ROOF. (CMC SECTION 504.4.2.1)

B14 40 GALLON TANK WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. SEE DETAIL: 14/A-901 FOR ANCHORING. SEE SHEET A-931 FOR MORE INFORMATION.

B32 ELECTRICAL PANEL. SEE COVER SHEET FOR PANEL OPTION AND MAXIMUM AMPERAGE.

B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE. PROVIDE PROTECTION PER CPC 507.25 & CMC 305.1.1, SEE GENERAL MEP NOTES 7 & 8 ON SHEET A-111 FOR MORE INFO. SEE DETAIL 53/A-902.

B41 FAN COIL @ 80" A.F.F. TO BOTTOM OF UNIT. PROVIDE DEDICATED WALL OUTLET, INSTALL PER MANUFACTERER'S SPECIFICATIONS, REFER TO PLANS FOR LOCATION OF OUTDOOR CONDENSING UNIT. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.

F03 22" X 30" MINIMUM ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC. THERE IS NO HVAC EQUIPMENT (SUCH AS FURNACE, HEAT PUMP, OR FAU) IN THE ATTIC. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1."

FLOOR FINISH LEGEND

EXTERIOR CONCRETE

LUXURY VINYL PLANK (LVP)

CERAMIC TILE (CT)

LEGEND

- ELECTRICAL SWITCH
- 3D ELECTRICAL SWITCH-THREE WAY-DIMMER
- VS ELECTRICAL SWITCH-VACANCY SENSOR
- D ELECTRICAL SWITCH-DIMMER
- F ELECTRICAL SWITCH-FAN
- A ASTRONOMICAL TIME OR MOTION SENSOR SWITCH (AT LEAST 1 REQ.)
- EXHAUST FAN
- IAQ INDOOR AIR QUALITY FAN
- P PENDANT LIGHT HIGH-EFFICACY
- WALL MOUNTED HIGH-EFFICACY LIGHT
- x84 EXT EXTERIOR WALL MOUNTED HIGH-EFFICACY LIGHT W/ PHOTO SENSOR
- RECESSED HIGH- EFFICACY DOWNLIGHT
- VP RECESSED HIGH- EFFICACY DOWNLIGHT-VAPOR PROOF

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

- SD SMOKE DETECTOR/ALARM
- SD/MA COMBINATION SMOKE/CARBON MONOXIDE
- J ELECTRICAL JUNCTION BOX

CEILING FAN OPTIONAL (PRE WIRE FOR CEILING FAN ONLY)

ELECTRICAL WIRING

- AFI DUPLEX OUTLET ARC-FAULT CIRCUIT INTERRUPTER
- GFI 240V DUPLEX OUTLET 240 VOLTS
- GFI DUPLEX OUTLET GROUND FAULT INTERRUPTER
- GFI WP DUPLEX OUTLET WATERPROOF GROUND FAULT INTERRUPTER
- DUPLEX OUTLET AFCI-HALF HOT
- GFI MW DUPLEX OUTLET MICROWAVE GROUND FAULT INTERRUPTER
- GFI DW DUPLEX OUTLET DISH WASHER GROUND FAULT INTERRUPTER
- H DUPLEX OUTLET RANGE HOOD
- CW COLD WATER STUB OUT
- HW HOT WATER STUB OUT
- HB WATER HOSE BIBB
- SOV HB WATER HOSE BIBB WITH SHUT OF VALVE
- FC FAN COIL UNIT +80" TO BOTTOM OF UNIT PROVIDE DEDICATED OUTLET

22"X30" MIN. ATTIC ACCESS PANEL (WHERE REQ.)

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

VENTILATION SUMMARIES

1) LOCAL EXHAUST VENTILATION — **REFER TO T-24 FOR IAQ VENTILATION**

BATHROOM	OPTION A	OPTION B
BATHROOM FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

KITCHEN	OPTION A	OPTION B
KITCHEN FAN FLOW (cfm)	280 CFM	280 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	7"	9"
MAX. ALLOWABLE DUCT LENGTH (ft)	20'	20'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

2) WHOLE BUILDING VENTILATION

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B	OPTION A	OPTION B
BUILDING FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE.		
THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY.		

WHOLE DWELLING UNIT MECHANICAL VENTILATION
PER SECTION 150.0(O)(C)(ii) [ASHRAE 62.2:4.1.2]
1 BED - MINIMUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
Qtot = 0.03Afloor + 7.5(Nbr + 1) **.03(484 SF) + 7.5 (2) = 29.52 CFM** < 50 CFM

NOTE: KITCHEN RANGE HOOD (CEC 20222) PER TABLE 150.0-G ARIFLOW RATES (CFM) AND ASTM E3087 <750 = 85% CE OR 280 CFM

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE PER SECTION 150.0(O)(C)(ii)
a. 1. (Equation 150.0-C) Q50 = Vdu (x) 2 ACH50 / 60minutes
a. 2. (Equation 150.0-D) Q50 = Vdu (x) Verified ACH50 / 60minutes
b. (Equation 150.0-E) Qtot = 0.052 (x) Q50 x wsf x [H/Hr]^z [ASHRAE 62.2:4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii) [ASHRAE 62.2:4.1.2]
(Equation 150.0-F) **Qfan = Qtot (-) ϕ (Qinf (x) Aext)**

ELECTRICAL NOTES

1. CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
2. ELECTRICAL SYSTEM GROUND TO BE PROVIDED PER NEC ARTICLE 250-81.
3. ALL MATERIALS TO BE U.L. LABELED.
4. METER: "SQUARE D", 120 VOLT/ 240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
5. ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE. 100 AMP.
6. CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
7. ALL LUMINARIES SHALL COMPLY WITH 2022 CEC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE REQUIREMENTS SHEET G-101.
8. ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC Art. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
9. ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. *(2022 CEC 210.11(C))*
10. THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
11. CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
12. ALL LUMINARIES, LAMPHOLDERS, AND RETROFIT KITS SHALL BE LISTED *(2022 CEC 410.6)*.
13. ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
14. ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10, AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMENTS AS PERMITTED IN CEC 406.4(D)(2)(A).
15. HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HID LIGHTING CONTAIN ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
16. BALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAT 20 kHz.
17. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTEED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
18. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARAMS SHALL BE INTERCONNECTEED.
19. EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS *(2022 CEnC 150.0(k)2G)*.
20. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUTS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
21. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUIT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY RECEPTACLE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

GENERAL MEP NOTES

1. REFER TO ELECTRICAL NOTES ON SHEET G-101.
2. REFER TO MECHANICAL NOTES ON SHEET G-101.
3. REFER TO PLUMBING NOTES ON SHEET G-101.
4. REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
5. EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET.
6. ENVIRONMENTAL AIR DUCT EXHAUST SHALL TERMINATE NOT LESS THAN 3 FT FROM WALL OPENINGS. ***CMC 502.2.2.1.***
7. *APPLIANCES NOT LISTED FOR OUTDOOR INSTALLATION BUT INSTALLED OUTDOORS SHALL BE PROVIDED WITH PROTECTION TO THE DEGREE THAT THE ENVIRONMENT REQUIRES. APPLIANCES LISTED FOR OUTDOOR INSTALLATION SHALL BE PERMITTED TO BE INSTALLED WITHOUT PROTECTION IN ACCORDANCE WITH THE PROVISIONS OF ITS LISTING AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER* **CPC 507.25 PROTECTION OF OUTDOOR APPLIANCES.**
8. APPLIANCES INSTALLED IN GARAGES, WAREHOUSES, OR OTHER AREAS SUBJECT TO MECHANICAL DAMAGE SHALL BE AT LEAST 18" ABOVE THE FLOOR AND GUARDED AGAINST SUCH DAMAGE BY BEING INSTALLED BEHIND PROTECTIVE BARRIERS OR BY BEING ELEVATED OR LOCATED OUT OF THE NORMAL PATH OF VEHICLES PER **CMC 305.1.1 PHYSICAL DAMAGE.**
9. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL HAVE A CLEARANCE OF AT LEAST FIVE (5) FEET FROM THE OUTLET OF ANY DRYER VENT. ***CENC2022 150.0 (H) 3.***
10. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL BE EQUIPPED WITH LIQUID LINE DRIERS IF REQUIRED, AS SPECIFIC BY MANUFACTURER'S INSTRUCTIONS. ***CENC2022 150.0 (H) 3.*** **SEE DETAIL 53/A-902.**
11. ASSEMBLIES AT EXTERIOR WINDOW AND DOOR HEADERS IN 2X6 EXTERIOR WALLS SHALL BE R-5 MINIMUM PER **2022 SINGLE-FAMILY RESIDENTIAL MANDATORY REQUIREMENTS**

PLUMBING NOTES

1. WATER HEATER
REFER TO T-24 ENERGY REPORT FOR REQUIRED PRODUCT. SEE SHEET A-930 FOR PRODUCT REFERENCE SHEETS.

WATER HEATER SHALL FOLLOW FIRST HOUR RATINGS REQUIRED IN TABLE ***PER 2022 CPC*** **TABLE 501.1(2)**.

A. ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. *(2022 CPC 609.12.1)*
- PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. *(2022 CPC 609.12.2)*
- PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. *(2022 CPC 609.12.2)*

EXCEPTIONS:
1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. *(2022 CPC 609.12.2)*
2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. *(2022 CPC 609.12.2)*

B. PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
C. COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
D. CLEARANCES PER MANUFACTURE REQUIREMENTS.

FOR USE IN THE CITY OF ESCONDIDO

11/20/2024 11:40:26 AM
Autodesk Docs://3174-01 Escondido ADU/3174_01_PP24_Escondido_CD.rvt

CITY OF ESCONDIDO
INCORPORATED 1888

ESCONDIDO
City of Choice

THESE PLANS ARE PROVIDED BY THE CITY OF ESCONDIDO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

AGENCY

CITY OF ESCONDIDO
https://www.escondido.gov/

ESCONDIDO CITY HALL
201 NORTH BROADWAY
ESCONDIDO CA, 92025


(760) 839-4880

ESCONDIDO PRE-APPROVED ADU
CITY OF ESCONDIDO
FINISH, MECHANICAL, & ELECTRICAL PLANS

PUBLIC SET


DATE
10/08/2024

SHEET
A1-111

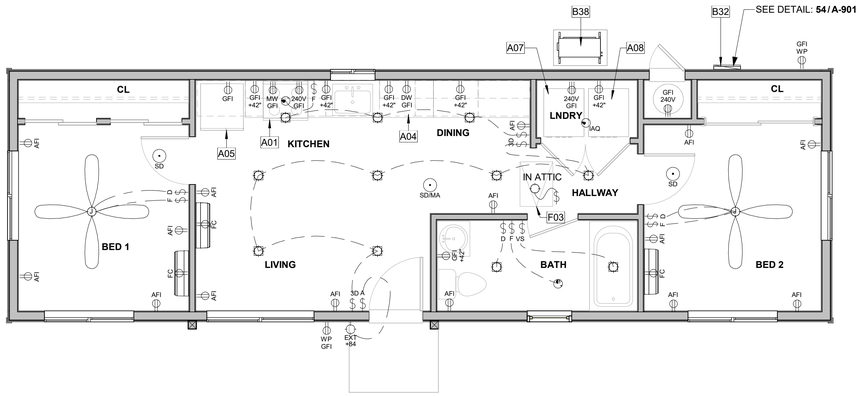


1 ELECTRICAL PLAN - PLAN 2

A2-111 SCALE: 1/4" = 1'-0"

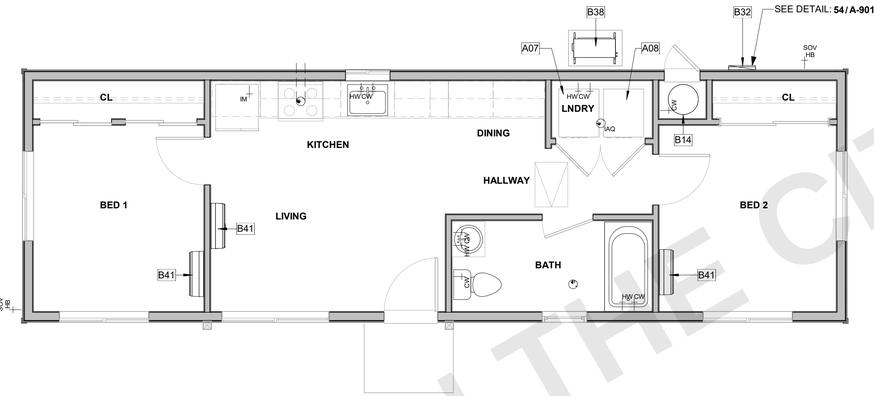

2 MECHANICAL PLAN - PLAN 2

A2-111 SCALE: 1/4" = 1'-0"

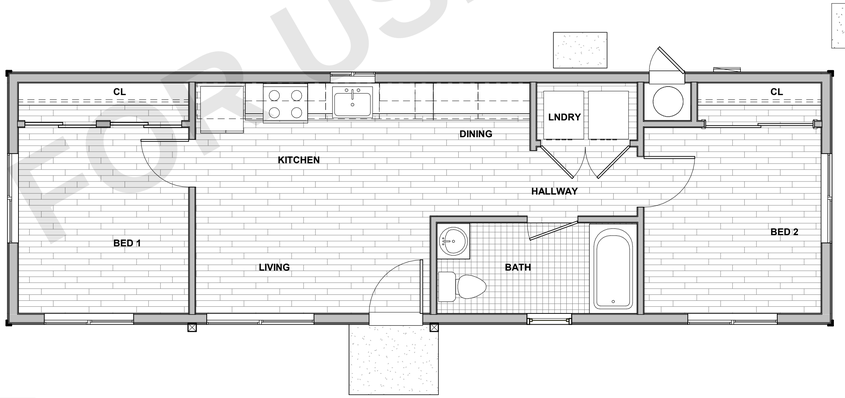

3 FINISH PLAN - PLAN 2

A2-111 SCALE: 1/4" = 1'-0"

FLOOR FINISH LEGEND

- EXTERIOR CONCRETE
- LUXURY VINYL PLANK (LVP)
- CERAMIC TILE (CT)

VENTILATION SUMMARIES

1) LOCAL EXHAUST VENTILATION — REFER TO T-24 FOR IAQ VENTILATION

BATHROOM	OPTION A	OPTION B
BATHROOM FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.

KITCHEN	OPTION A	OPTION B
KITCHEN FAN FLOW (cfm)	280 CFM	280 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	7"	9"
MAX. ALLOWABLE DUCT LENGTH (ft)	20'	20'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.

2) WHOLE BUILDING VENTILATION

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B	OPTION A	OPTION B
BUILDING FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE.
THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY.

WHOLE DWELLING UNIT MECHANICAL VENTILATION
PER SECTION 150.0(O)(C)(i) [ASHRAE 62.2:4.1.2]
2-BED - MINIUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
Qtot = 0.03Afloor + 7.5(Nbr + 1) **.03(640 SF) + 7.5 (3) = 41.7 CFM** < 50 CFM

NOTE: KITCHEN RANGE HOOD (CEC 20222) PER TABLE 150.0-G ARIFLOW RATES (CFM) AND ASTM E3087 <750 = 85% CE OR 280 CFM

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE PER SECTION 150.0(O)(C)(ii)
a. 1. (Equation 150.0-C) Q50 = Vdu (x) 2 ACH50 / 60minutes
a. 2. (Equation 150.0-D) Q50 = Vdu (x) Verified ACH50 / 60minutes
b. (Equation 150.0-E) Qtot = 0.052 (x) Q50 x wsf x [H/Hr]^z [ASHRAE 62.2:4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii) [ASHRAE 62.2:4.1.2]
(Equation 150.0-F) **Qfan = Qtot (-) ϕ (Qinf (x) Aext)**

KEYNOTES

A01	30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR, STAINLESS STEEL.
A04	24" WIDE FRONT CONTROL UNDERCOUNTER DISHWASHER.
A05	REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).
A07	WASHING MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX.
A08	CLOTHES DRYER LOCATION W/ RECESSED DRYER VENT BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR VERTICALLY THROUGH ROOF. (CMC SECTION 504.4.2.1)
B14	40 GALLON TANK WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. SEE DETAIL: 14/A-901 FOR ANCHORING. SEE SHEET A-931 FOR MORE INFORMATION.
B32	ELECTRICAL PANEL. SEE COVER SHEET FOR PANEL OPTION AND MAXIMUM AMPERAGE.
B38	MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE. PROVIDE PROTECTION PER CPC 507.25 & CMC 305.1.1, SEE GENERAL MEP NOTES 7 & 8 ON SHEET A-111 FOR MORE INFO. SEE DETAIL 53/A-902.
B41	FAN COIL @ 80" A.F.F. TO BOTTOM OF UNIT, PROVIDE DEDICATED WALL OUTLET, INSTALL PER MANUFACTERER'S SPECIFICATIONS, REFER TO PLANS FOR LOCATION OF OUTDOOR CONDENSING UNIT. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.
F03	22" X 30" MINIMUM ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC. THERE IS NO HVAC EQUIPMENT (SUCH AS FURNACE, HEAT PUMP, OR FAU) IN THE ATTIC. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1."

LEGEND

- ELECTRICAL SWITCH
- ELECTRICAL SWITCH-THREE WAY-DIMMER
- ELECTRICAL SWITCH-VACANCY SENSOR
- ELECTRICAL SWITCH-DIMMER
- ELECTRICAL SWITCH-FAN
- ASTRONOMICAL TIME OR MOTION SENSOR SWITCH (AT LEAST 1 REQ.)
- EXHAUST FAN
- INDOOR AIR QUALITY FAN
- PENDANT LIGHT HIGH-EFFICACY
- WALL MOUNTED HIGH-EFFICACY LIGHT
- EXTERIOR WALL MOUNTED HIGH-EFFICACY LIGHT W/ PHOTO SENSOR
- RECESSED HIGH- EFFICACY DOWNLIGHT
- RECESSED HIGH- EFFICACY DOWNLIGHT-VAPOR PROOF

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

- SMOKE DETECTOR/ALARM
- COMBINATION SMOKE/CARBON MONOXIDE
- ELECTRICAL JUNCTION BOX

CEILING FAN OPTIONAL (PRE WIRE FOR CEILING FAN ONLY)

ELECTRICAL WIRING

- DUPLEX OUTLET ARC-FAULT CIRCUIT INTERRUPTER
- DUPLEX OUTLET 240 VOLTS
- DUPLEX OUTLET GROUND FAULT INTERRUPTER
- DUPLEX OUTLET WATERPROOF GROUND FAULT INTERRUPTER
- DUPLEX OUTLET AFCI-HALF HOT
- DUPLEX OUTLET MICROWAVE GROUND FAULT INTERRUPTER
- DUPLEX OUTLET DISH WASHER GROUND FAULT INTERRUPTER
- DUPLEX OUTLET RANGE HOOD
- COLD WATER STUB OUT
- HOT WATER STUB OUT
- WATER HOSE BIBB
- WATER HOSE BIBB WITH SHUT OF VALVE

FAN COIL UNIT +80" TO BOTTOM OF UNIT PROVIDE DEDICATED OUTLET

22"X30" MIN. ATTIC ACCESS PANEL (WHERE REQ.)

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

ELECTRICAL NOTES

1. CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
2. ELECTRICAL SYSTEM GROUND TO BE PROVIDED PER NEC ARTICLE 250-81.
3. ALL MATERIALS TO BE U.L. LABELED.
4. METER: "SQUARE D", 120 VOLT/ 240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
5. ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE. 100 AMP.
6. CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
7. ALL LUMINARIES SHALL COMPLY WITH 2022 CEC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE REQUIREMENTS SHEET G-101.
8. ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC Art. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
9. ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. (2022 CEC 210.11(C))
10. THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
11. CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
12. ALL LUMINARIES, LAMPHOLDERS, AND RETROFIT KITS SHALL BE LISTED (2022 CEC 410.6).
13. ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
14. ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10. AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMENTS AS PERMITTED IN CEC 406.4(D)(2)(A).
15. HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HID LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
16. BALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAT 20 kHz.
17. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTEED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
18. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARAMS SHALL BE INTERCONNECTEED.
19. EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS *(2022 CEnC 150.0(k)2G).*
20. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUTS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
21. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY RECEPTACLE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

GENERAL MEP NOTES

1. REFER TO ELECTRICAL NOTES ON SHEET G-101.
2. REFER TO MECHANICAL NOTES ON SHEET G-101.
3. REFER TO PLUMBING NOTES ON SHEET G-101.
4. REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
5. EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET.
6. ENVIRONMENTAL AIR DUCT EXHAUST SHALL TERMINATE NOT LESS THAN 3 FT FROM WALL OPENINGS. ***CMC 502.2.2.1.***
7. *APPLIANCES NOT LISTED FOR OUTDOOR INSTALLATION BUT INSTALLED OUTDOORS SHALL BE PROVIDED WITH PROTECTION TO THE DEGREE THAT THE ENVIRONMENT REQUIRES. APPLIANCES LISTED FOR OUTDOOR INSTALLATION SHALL BE PERMITTED TO BE INSTALLED WITHOUT PROTECTION IN ACCORDANCE WITH THE PROVISIONS OF ITS LISTING AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER* **CPC 507.25 PROTECTION OF OUTDOOR APPLIANCES.**
8. APPLIANCES INSTALLED IN GARAGES, WAREHOUSES, OR OTHER AREAS SUBJECT TO MECHANICAL DAMAGE SHALL BE AT LEAST 18" ABOVE THE FLOOR AND GUARDED AGAINST SUCH DAMAGE BY BEING INSTALLED BEHIND PROTECTIVE BARRIERS OR BY BEING ELEVATED OR LOCATED OUT OF THE NORMAL PATH OF VEHICLES PER **CMC 305.1.1 PHYSICAL DAMAGE.**
9. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL HAVE A CLEARANCE OF AT LEAST FIVE (5) FEET FROM THE OUTLET OF ANY DRYER VENT. ***CENC2022 150.0 (H) 3.***
10. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL BE EQUIPPED WITH LIQUID LINE DRIERS IF REQUIRED, AS SPECIFIC BY MANUFACTURER'S INSTRUCTIONS. ***CENC2022 150.0 (H) 3.*** **SEE DETAIL 53/A-902.**
11. ASSEMBLIES AT EXTERIOR WINDOW AND DOOR HEADERS IN 2X6 EXTERIOR WALLS SHALL BE R-5 MINIMUM PER **2022 SINGLE-FAMILY RESIDENTIAL MANDATORY REQUIREMENTS**

PLUMBING NOTES

1. WATER HEATER
REFER TO T-24 ENERGY REPORT FOR REQUIRED PRODUCT. SEE SHEET A-930 FOR PRODUCT REFERENCE SHEETS.

WATER HEATER SHALL FOLLOW FIRST HOUR RATINGS REQUIRED IN TABLE ***PER 2022 CPC*** **TABLE 501.1(2)**.

A. ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. *(2022 CPC 609.12.1)*
- PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. *(2022 CPC 609.12.2)*
- PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. *(2022 CPC 609.12.2)*

EXCEPTIONS:
1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. *(2022 CPC 609.12.2)*
2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. *(2022 CPC 609.12.2)*

B. PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
C. COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
D. CLEARANCES PER MANUFACTURE REQUIREMENTS.

CITY OF ESCONDIO
INCORPORATED 1888

ESCONDIDO
City of Choice

THESE PLANS ARE PROVIDED BY THE CITY OF ESCONDIDO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

AGENCY
CITY OF ESCONDIDO
https://www.escondido.gov/

ESCONDIDO CITY HALL
201 NORTH BROADWAY
ESCONDIDO CA, 92025

(760) 839-4880

ESCONDIDO PRE-APPROVED ADU
CITY OF ESCONDIDO
FINISH, MECHANICAL, & ELECTRICAL PLANS


PUBLIC SET

DATE
10/08/2024

SHEET
A2-111


FOR USE IN THE CITY OF ESCONDIDO

11/20/2024 11:42:45 AM
Autodesk Docs://3174-01 Escondido ADU/3174_01_PP24_Escondido_CD.rvt

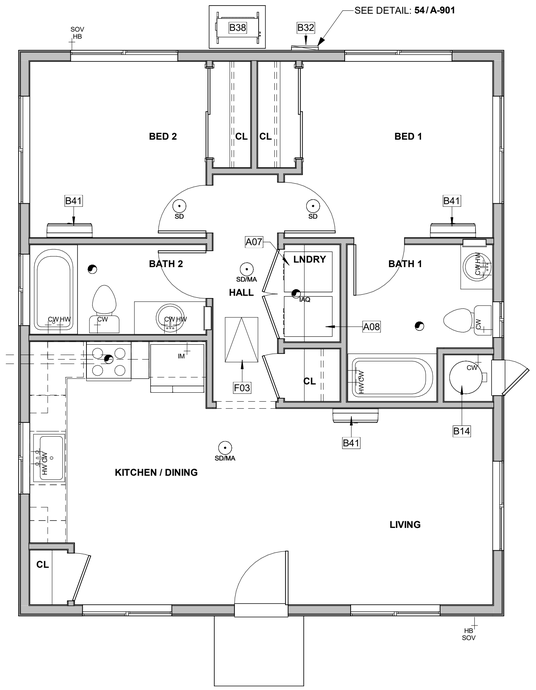


2 MECHANICAL PLAN - PLAN 3

A3-111 SCALE: 1/4" = 1'-0"

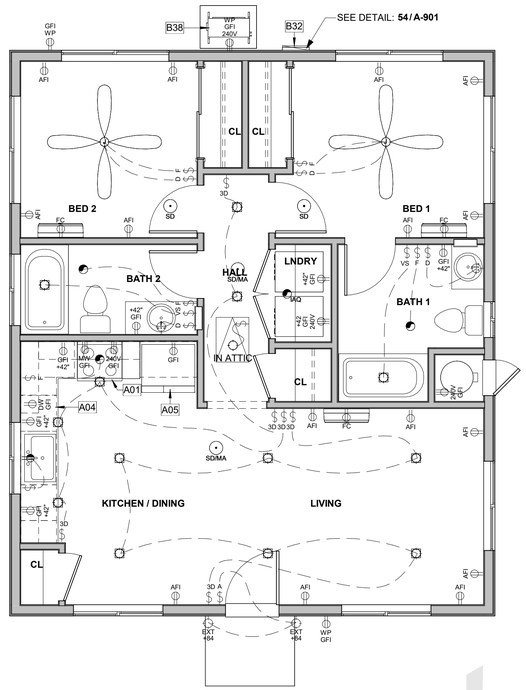

1 ELECTRICAL PLAN - PLAN 3

A3-111 SCALE: 1/4" = 1'-0"

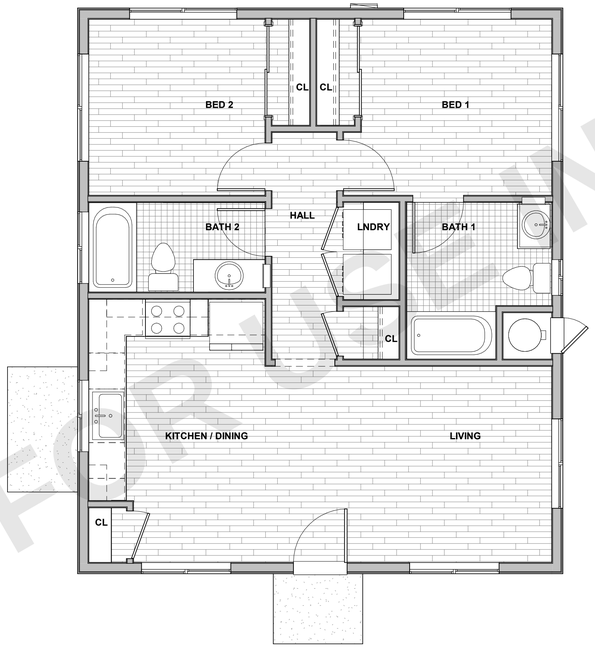

3 FINISH PLAN - PLAN 3

A3-111 SCALE: 1/4" = 1'-0"

KEYNOTES

- A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR, STAINLESS STEEL.
- A04 24" WIDE FRONT CONTROL UNDERCOUNTER DISHWASHER.
- A05 REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).
- A07 WASHING MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX.
- A08 CLOTHES DRYER LOCATION W/ RECESSED DRYER VENT BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR VERTICALLY THROUGH ROOF. (CMC SECTION 504.4.2.1)
- B14 40 GALLON TANK WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. SEE DETAIL: 14/A-901 FOR ANCHORING. SEE SHEET A-931 FOR MORE INFORMATION.
- B32 ELECTRICAL PANEL. SEE COVER SHEET FOR PANEL OPTION AND MAXIMUM AMPERAGE.
- B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE. PROVIDE PROTECTION PER CPC 507.25 & CMC 305.1.1, SEE GENERAL MEP NOTES 7 & 8 ON SHEET A-111 FOR MORE INFO. SEE DETAIL 53/A-902.
- B41 FAN COIL @ 80" A.F.F. TO BOTTOM OF UNIT, PROVIDE DEDICATED WALL OUTLET, INSTALL PER MANUFACTERER'S SPECIFICATIONS, REFER TO PLANS FOR LOCATION OF OUTDOOR CONDENSING UNIT. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.
- F03 22" X 30" MINIMUM ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC. THERE IS NO HVAC EQUIPMENT (SUCH AS FURNACE, HEAT PUMP, OR FAU) IN THE ATTIC. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1."

FLOOR FINISH LEGEND

- EXTERIOR CONCRETE
- LUXURY VINYL PLANK (LVP)
- CERAMIC TILE (CT)

LEGEND

- ELECTRICAL SWITCH
- 3B ELECTRICAL SWITCH-THREE WAY-DIMMER
- VS ELECTRICAL SWITCH-VACANCY SENSOR
- D ELECTRICAL SWITCH-DIMMER
- F ELECTRICAL SWITCH-FAN
- A ASTRONOMICAL TIME OR MOTION SENSOR SWITCH (AT LEAST 1 REQ.)
- EXHAUST FAN
- IAQ INDOOR AIR QUALITY FAN
- P PENDANT LIGHT HIGH-EFFICACY
- WALL MOUNTED HIGH-EFFICACY LIGHT
- x84 EXT EXTERIOR WALL MOUNTED HIGH-EFFICACY LIGHT W/ PHOTO SENSOR
- RECESSED HIGH- EFFICACY DOWNLIGHT
- VP RECESSED HIGH- EFFICACY DOWNLIGHT-VAPOR PROOF

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

- SD SMOKE DETECTOR/ALARM
- SD/MA COMBINATION SMOKE/CARBON MONOXIDE
- J ELECTRICAL JUNCTION BOX

CEILING FAN OPTIONAL (PRE WIRE FOR CEILING FAN ONLY)

ELECTRICAL WIRING

- AFI DUPLEX OUTLET ARC-FAULT CIRCUIT INTERRUPTER
- GFI 240V DUPLEX OUTLET 240 VOLTS
- GFI DUPLEX OUTLET GROUND FAULT INTERRUPTER
- GFI WP DUPLEX OUTLET WATERPROOF GROUND FAULT INTERRUPTER
- DUPLEX OUTLET AFCI-HALF HOT
- GFI MW DUPLEX OUTLET MICROWAVE GROUND FAULT INTERRUPTER
- GFI DW DUPLEX OUTLET DISH WASHER GROUND FAULT INTERRUPTER
- H DUPLEX OUTLET RANGE HOOD
- CW COLD WATER STUB OUT
- HW HOT WATER STUB OUT
- HB WATER HOSE BIBB
- SOV HB WATER HOSE BIBB WITH SHUT OF VALVE
- FC FAN COIL UNIT +80" TO BOTTOM OF UNIT PROVIDE DEDICATED OUTLET

22"X30" MIN. ATTIC ACCESS PANEL (WHERE REQ.)

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

VENTILATION SUMMARIES

1) LOCAL EXHAUST VENTILATION — REFER TO T-24 FOR IAQ VENTILATION

BATHROOM	OPTION A	OPTION B
BATHROOM FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.

KITCHEN	OPTION A	OPTION B
KITCHEN FAN FLOW (cfm)	280 CFM	280 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	7"	9"
MAX. ALLOWABLE DUCT LENGTH (ft)	20'	20'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.

2) WHOLE BUILDING VENTILATION

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B	OPTION A	OPTION B
BUILDING FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'

THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE.
THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY.

WHOLE DWELLING UNIT MECHANICAL VENTILATION
PER SECTION 150.0(O)(C)(i) [ASHRAE 62.2:4.1.2]
2 BED - MINIUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
Qtot = 0.03Afloor + 7.5(Nbr + 1) **.03(850 SF) + 7.5 (3) = 48 CFM** < 50 CFM

NOTE: KITCHEN RANGE HOOD (CEC 20222) PER TABLE 150.0-G ARIFLOW RATES (CFM) AND ASTM E3087 <750 = 85% CE OR 280 CFM

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE PER SECTION 150.0(O)(C)(ii)
a. 1. (Equation 150.0-C) Q50 = Vdu (x) 2 ACH50 / 60minutes
a. 2. (Equation 150.0-D) Q50 = Vdu (x) Verified ACH50 / 60minutes
b. (Equation 150.0-E) Qtot = 0.052 (x) Q50 x wsf x [H/Hr]^z [ASHRAE 62.2:4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii) [ASHRAE 62.2:4.1.2]
(Equation 150.0-F) **Qfan = Qtot (-) ϕ (Qinf (x) Aext)**

ELECTRICAL NOTES

1. CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
2. ELECTRICAL SYSTEM GROUND TO BE PROVIDED PER NEC ARTICLE 250-81.
3. ALL MATERIALS TO BE U.L. LABELED.
4. METER: "SQUARE D", 120 VOLT/ 240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
5. ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE. 100 AMP.
6. CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
7. ALL LUMINARIES SHALL COMPLY WITH 2022 CEC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE REQUIREMENTS SHEET G-101.
8. ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC Art. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
9. ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. *(2022 CEC 210.11(C))*
10. THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
11. CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
12. ALL LUMINARIES, LAMPHOLDERS, AND RETROFIT KITS SHALL BE LISTED (2022 CEC 410.6).
13. ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
14. ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10, AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMENTS AS PERMITTED IN CEC 406.4(D)(2)(A).
15. HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HID LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
16. BALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAT 20 kHz
17. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTEED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
18. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARAMS SHALL BE INTERCONNECTEED.
19. EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS *(2022 CEnC 150.0(k)2G).*
20. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUITS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
21. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY RECEPTACLE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

GENERAL MEP NOTES

1. REFER TO ELECTRICAL NOTES ON SHEET G-101.
2. REFER TO MECHANICAL NOTES ON SHEET G-101.
3. REFER TO PLUMBING NOTES ON SHEET G-101.
4. REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
5. EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET.
6. ENVIRONMENTAL AIR DUCT EXHAUST SHALL TERMINATE NOT LESS THAN 3 FT FROM WALL OPENINGS. ***CMC 502.2.2.1.***
7. *APPLIANCES NOT LISTED FOR OUTDOOR INSTALLATION BUT INSTALLED OUTDOORS SHALL BE PROVIDED WITH PROTECTION TO THE DEGREE THAT THE ENVIRONMENT REQUIRES. APPLIANCES LISTED FOR OUTDOOR INSTALLATION SHALL BE PERMITTED TO BE INSTALLED WITHOUT PROTECTION IN ACCORDANCE WITH THE PROVISIONS OF ITS LISTING AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER* **CPC 507.25 PROTECTION OF OUTDOOR APPLIANCES.**
8. APPLIANCES INSTALLED IN GARAGES, WAREHOUSES, OR OTHER AREAS SUBJECT TO MECHANICAL DAMAGE SHALL BE AT LEAST 18" ABOVE THE FLOOR AND GUARDED AGAINST SUCH DAMAGE BY BEING INSTALLED BEHIND PROTECTIVE BARRIERS OR BY BEING ELEVATED OR LOCATED OUT OF THE NORMAL PATH OF VEHICLES PER **CMC 305.1.1 PHYSICAL DAMAGE.**
9. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL HAVE A CLEARANCE OF AT LEAST FIVE (5) FEET FROM THE OUTLET OF ANY DRYER VENT. ***CENC2022 150.0 (H) 3.***
10. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL BE EQUIPPED WITH LIQUID LINE DRIERS IF REQUIRED, AS SPECIFIC BY MANUFACTURER'S INSTRUCTIONS. ***CENC2022 150.0 (H) 3.*** **SEE DETAIL 53/A-902.**
11. ASSEMBLIES AT EXTERIOR WINDOW AND DOOR HEADERS IN 2X6 EXTERIOR WALLS SHALL BE R-5 MINIMUM PER **2022 SINGLE-FAMILY RESIDENTIAL MANDATORY REQUIREMENTS**

PLUMBING NOTES

1. WATER HEATER
REFER TO T-24 ENERGY REPORT FOR REQUIRED PRODUCT. SEE SHEET A-930 FOR PRODUCT REFERENCE SHEETS.

WATER HEATER SHALL FOLLOW FIRST HOUR RATINGS REQUIRED IN TABLE ***PER 2022 CPC*** **TABLE 501.1(2)**.

A. ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. *(2022 CPC 609.12.1)*
- PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. *(2022 CPC 609.12.2)*
- PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. *(2022 CPC 609.12.2)*

EXCEPTIONS:
1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. *(2022 CPC 609.12.2)*
2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. *(2022 CPC 609.12.2)*

B. PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
C. COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
D. CLEARANCES PER MANUFACTURE REQUIREMENTS.

CITY OF ESCONDIDO
INCORPORATED 1888

ESCONDIDO
City of Choice

THESE PLANS ARE PROVIDED BY THE CITY OF ESCONDIDO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

AGENCY

CITY OF ESCONDIDO
https://www.escondido.gov/

ESCONDIDO CITY HALL
201 NORTH BROADWAY
ESCONDIDO CA, 92025

(760) 839-4880

ESCONDIDO PRE-APPROVED ADU
CITY OF ESCONDIDO
FINISH, MECHANICAL, & ELECTRICAL PLANS


PUBLIC SET

DATE
10/08/2024

SHEET
A3-111


FOR USE IN THE CITY OF ESCONDIDO

11/20/2024 11:44:36 AM
Autodesk Docs://3174-01 Escondido ADU/3174_01_PP24_Escondido_CD.rvt

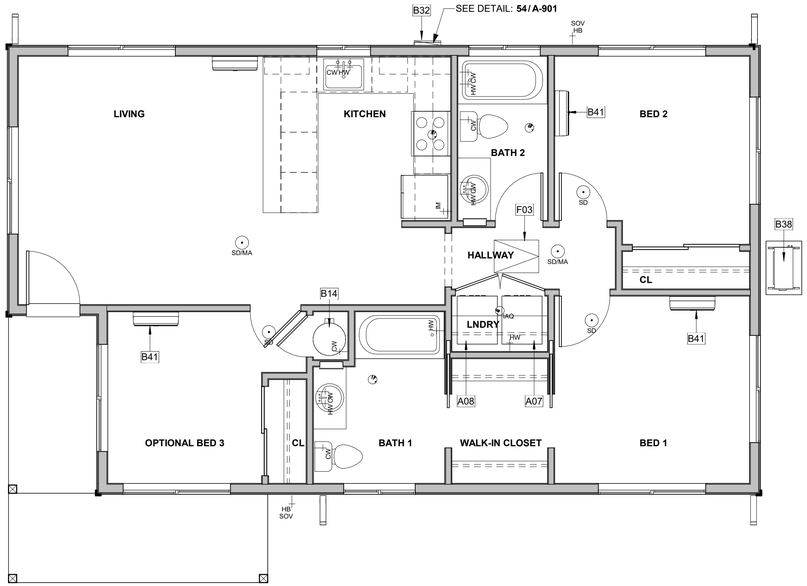


2 MECHNICAL PLAN - PLAN 4

A4-111 SCALE: 1/4" = 1'-0"

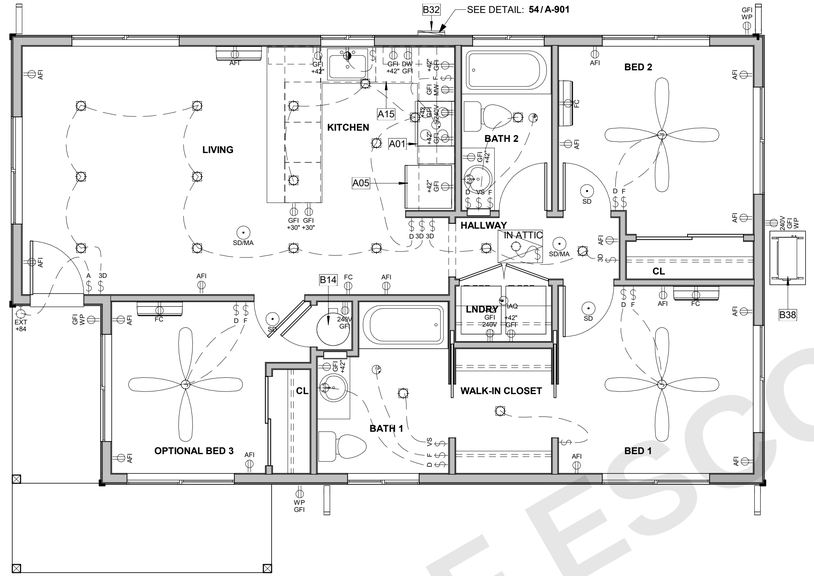

1 ELECTRICAL PLAN - PLAN 4

A4-111 SCALE: 1/4" = 1'-0"

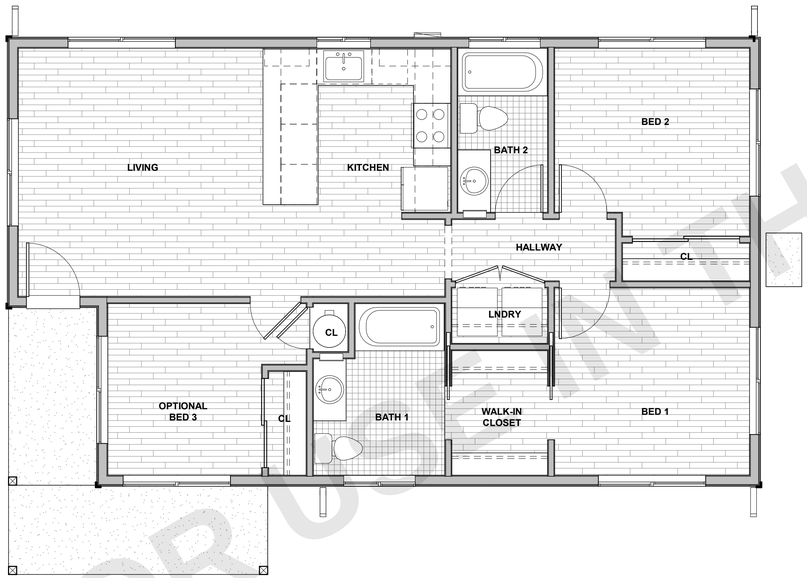

3 FINISH PLAN - PLAN 4

A4-111 SCALE: 1/4" = 1'-0"

KEYNOTES

A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR, STAINLESS STEEL.

A05 REFRIGERATOR LOCATION. PROVIDE 42" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).

A07 WASHING MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX.

A08 CLOTHES DRYER LOCATION W/ RECESSED DRYER VENT BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR VERTICALLY THROUGH ROOF. (CMC SECTION 504.4.2.1)

A15 WASHING MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX.

B14 40 GALLON TANK WATER HEATER. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. SEE DETAIL: 14/A-901 FOR ANCHORING. SEE SHEET A-931 FOR MORE INFORMATION.

B32 ELECTRICAL PANEL. SEE COVER SHEET FOR PANEL OPTION AND MAXIMUM AMPERAGE.

B38 MULTI-ZONE HEAT PUMP CONDENSER UNIT. REFER TO PLANS FOR LOCATION OF INDOOR FAN COIL UNITS. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION. PROVIDE CONCRETE PAD MIN. 6" LARGER THAN UNIT IN EACH DIRECTION, 3" MIN. ABOVE GRADE. PROVIDE PROTECTION PER CPC 507.25 & CMC 305.1.1, SEE GENERAL MEP NOTES 7 & 8 ON SHEET A-111 FOR MORE INFO. SEE DETAIL 53/A-902.

B41 FAN COIL @ 80" A.F.F. TO BOTTOM OF UNIT. PROVIDE DEDICATED WALL OUTLET, INSTALL PER MANUFACTERER'S SPECIFICATIONS, REFER TO PLANS FOR LOCATION OF OUTDOOR CONDENSING UNIT. REFER TO TITLE 24 FOR ADDITIONAL INFORMATION.

F03 22" X 30" MINIMUM ATTIC ACCESS. PROVIDED SWITCH AND OUTLET AT ATTIC. THERE IS NO HVAC EQUIPMENT (SUCH AS FURNACE, HEAT PUMP, OR FAU) IN THE ATTIC. PERMANENTLY ATTACH R-38 OR GREATER INSULATION TO ATTIC ACCESS DOOR USING ADHESIVE OR MECHANICAL FASTENERS CEnC 150.0 (a)1. PROVIDE GASKETED ATTIC ACCESS TO PREVENT AIR LEAKAGE CEnC 150.0 (a)1."

LEGEND

- ELECTRICAL SWITCH
- 3D ELECTRICAL SWITCH-THREE WAY-DIMMER
- VS ELECTRICAL SWITCH-VACANCY SENSOR
- D ELECTRICAL SWITCH-DIMMER
- F ELECTRICAL SWITCH-FAN
- A ASTRONOMICAL TIME OR MOTION SENSOR SWITCH (AT LEAST 1 REQ.)
- EXHAUST FAN
- IAQ INDOOR AIR QUALITY FAN
- P PENDANT LIGHT HIGH-EFFICACY
- WALL MOUNTED HIGH-EFFICACY LIGHT
- +84 EXT EXTERIOR WALL MOUNTED HIGH-EFFICACY LIGHT W/ PHOTO SENSOR
- RECESSED HIGH- EFFICACY DOWNLIGHT
- VP RECESSED HIGH- EFFICACY DOWNLIGHT-VAPOR PROOF

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

- SD SMOKE DETECTOR/ALARM
- SD/MA COMBINATION SMOKE/CARBON MONOXIDE
- J ELECTRICAL JUNCTION BOX

CEILING FAN OPTIONAL (PRE WIRE FOR CEILING FAN ONLY)

ELECTRICAL WIRING

- AFI DUPLEX OUTLET ARC-FAULT CIRCUIT INTERRUPTER
- GFI 240V DUPLEX OUTLET 240 VOLTS
- GFI DUPLEX OUTLET GROUND FAULT INTERRUPTER
- GFI WP DUPLEX OUTLET WATERPROOF GROUND FAULT INTERRUPTER
- DUPLEX OUTLET AFCI-HALF HOT
- GFI MW DUPLEX OUTLET MICROWAVE GROUND FAULT INTERRUPTER
- GFI DW DUPLEX OUTLET DISH WASHER GROUND FAULT INTERRUPTER
- H DUPLEX OUTLET RANGE HOOD
- CW COLD WATER STUB OUT
- HW HOT WATER STUB OUT
- HB WATER HOSE BIBB
- SOV HB WATER HOSE BIBB WITH SHUT OF VALVE
- FC FAN COIL UNIT +80" TO BOTTOM OF UNIT PROVIDE DEDICATED OUTLET

22"X30" MIN. ATTIC ACCESS PANEL (WHERE REQ.)

NOTE: IONIZATION SMOKE DETECTOR 10' MINIMUM FROM STOVE, ALL OTHERS 20'MIN CLEARANCE

FLOOR FINISH LEGEND

EXTERIOR CONCRETE

LUXURY VINYL PLANK (LVP)

CERAMIC TILE (CT)

VENTILATION SUMMARIES

1) LOCAL EXHAUST VENTILATION — REFER TO T-24 FOR IAQ VENTILATION

BATHROOM	OPTION A	OPTION B
BATHROOM FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

KITCHEN	OPTION A	OPTION B
KITCHEN FAN FLOW (cfm)	280 CFM	280 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	7"	9"
MAX. ALLOWABLE DUCT LENGTH (ft)	20'	20'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 3 SONES.		

2) WHOLE BUILDING VENTILATION

PER ASHRAE STANDARD 62.2, CEC EQUATION 150.0-B	OPTION A	OPTION B
BUILDING FAN FLOW (cfm)	50 CFM	50 CFM
DUCT TYPE	FLEX DUCT	SMOOTH DUCT
DUCT SIZE (in)	4"	4"
MAX. ALLOWABLE DUCT LENGTH (ft)	70'	105'
THIS EXHAUST FAN IS REQUIRED TO BE RATED FOR SOUND AT A MAX. OF 1 SONE.		
THIS EXHAUST FAN IS REQUIRED TO OPERATE CONTINUOUSLY TO ENSURE CONTINUOUSLY TO ENSURE INDOOR AIR QUALITY.		

WHOLE DWELLING UNIT MECHANICAL VENTILATION
PER SECTION 150.0(O)(C)(ii) [ASHRAE 62.2:4.1.2]
3 BED - MINIUM CUBIC FEET PER MINUTE (CFM) (Equation 150.0-B)
Qtot = 0.03Afloor + 7.5(Nbr + 1) **.03(1000 SF) + 7.5 (4) = 60 CFM** < 50 CFM

NOTE: KITCHEN RANGE HOOD (CEC 20222) PER TABLE 150.0-G ARIFLOW RATES (CFM) AND ASTM E3087 <750 = 85% CE OR 280 CFM

EFFECTIVE ANNUAL AVERAGE INFILTRATION RATE PER SECTION 150.0(O)(C)(ii)
a. 1. (Equation 150.0-C) Q50 = Vdu (x) 2 ACH50 / 60minutes
a. 2. (Equation 150.0-D) Q50 = Vdu (x) Verified ACH50 / 60minutes
b. (Equation 150.0-E) Qtot = 0.052 (x) Q50 x wsf x [H/Hr]^z [ASHRAE 62.2:4.1.2.1]

REQUIRED MECHANICAL VENTILATION RATE PER 150.0(O)(C)(iii) [ASHRAE 62.2:4.1.2]
(Equation 150.0-F) **Qfan = Qtot (-) ϕ (Qinf (x) Aext)**

GENERAL MEP NOTES

1. REFER TO ELECTRICAL NOTES ON SHEET G-101.
2. REFER TO MECHANICAL NOTES ON SHEET G-101.
3. REFER TO PLUMBING NOTES ON SHEET G-101.
4. REFER TO TITLE 24 COMPLIANCE NOTES ON SHEET G-101.
5. EXTERNALLY MOUNTED HEATING/COOLING UNITS SHALL BE SCREENED IF THEY ARE VISIBLE FROM A PUBLIC STREET.
6. ENVIRONMENTAL AIR DUCT EXHAUST SHALL TERMINATE NOT LESS THAN 3 FT FROM WALL OPENINGS. ***CMC 502.2.2.1.***
7. *APPLIANCES NOT LISTED FOR OUTDOOR INSTALLATION BUT INSTALLED OUTDOORS SHALL BE PROVIDED WITH PROTECTION TO THE DEGREE THAT THE ENVIRONMENT REQUIRES. APPLIANCES LISTED FOR OUTDOOR INSTALLATION SHALL BE PERMITTED TO BE INSTALLED WITHOUT PROTECTION IN ACCORDANCE WITH THE PROVISIONS OF ITS LISTING AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PER* **CPC 507.25 PROTECTION OF OUTDOOR APPLIANCES.**
8. APPLIANCES INSTALLED IN GARAGES, WAREHOUSES, OR OTHER AREAS SUBJECT TO MECHANICAL DAMAGE SHALL BE AT LEAST 18" ABOVE THE FLOOR AND GUARDED AGAINST SUCH DAMAGE BY BEING INSTALLED BEHIND PROTECTIVE BARRIERS OR BY BEING ELEVATED OR LOCATED OUT OF THE NORMAL PATH OF VEHICLES PER **CMC 305.1.1 PHYSICAL DAMAGE.**
9. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL HAVE A CLEARANCE OF AT LEAST FIVE (5) FEET FROM THE OUTLET OF ANY DRYER VENT. ***CENC2022 150.0 (H) 3.***
10. INSTALLED AIR CONDITIONER AND HEAT PUMP SYSTEMS SHALL BE EQUIPPED WITH LIQUID LINE DRIERS IF REQUIRED, AS SPECIFIC BY MANUFACTURER'S INSTRUCTIONS. ***CENC2022 150.0 (H) 3.*** **SEE DETAIL 53/A-902.**
11. ASSEMBLIES AT EXTERIOR WINDOW AND DOOR HEADERS IN 2X6 EXTERIOR WALLS SHALL BE R-5 MINIMUM PER **2022 SINGLE-FAMILY RESIDENTIAL MANDATORY REQUIREMENTS**

ELECTRICAL NOTES

1. CONFORM WITH CURRENT CEC, NFPA, MFR'S, AND LOCAL REQUIREMENTS.
2. ELECTRICAL SYSTEM GROUND TO BE PROVIDED PER NEC ARTICLE 250-81.
3. ALL MATERIALS TO BE U.L. LABELED.
4. METER: "SQUARE D", 120 VOLT/ 240 VOLT, 1 AND 3 WIRE GROUND OR EQUAL.
5. ELECTRICAL SUB PANEL: FLUSH MOUNT, 30" CLEARANCE. 100 AMP.
6. CONDUCTORS: TW, THW, COPPER, MINIMUM 14 AT LIGHTING, 12 AT OTHER CIRCUITS.
7. ALL LUMINARIES SHALL COMPLY WITH 2022 CEC SECTION 150.0 (K) AND TABLE 150.0-A AS REFERENCED IN ENERGY NOTES, LUMINAIRE REQUIREMENTS SHEET G-101.
8. ALL ELECTRICAL OUTLETS INSTALLED IN BATHROOMS, GARAGES, BASEMENTS, CRAWL SPACES, OUTDOORS, KITCHEN COUNTERS, AND AT WET BAR SINKS SHALL HAVE GROUND-FAULT CIRCUIT-INTERRUPTER PROTECTION IN COMPLIANCE WITH NEC Art. 210-8, CONSISTING OF 125 VOLT, SINGLE-PHASE, 15- AND 20- AMPERE RECEPTACLES.
9. ALL BATHROOM RECEPTACLE OUTLETS SHALL BE SUPPLIED BY A MINIMUM OF ONE 120-VOLT, 20-AMPERE BRANCH CIRCUIT. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS. THIS DEDICATED CIRCUIT MAY SERVE MORE THAN ONE BATHROOM. (2022 CEC 210.11(C))
10. THERMOSTAT SHALL BE A PROGRAMMABLE TYPE, HONEYWELL TH8320 OR EQUAL.
11. CEILING-SUSPENDED (PADDLE) FANS SHALL BE SUPPORTED INDEPENDENTLY OF AN OUTLET BOX OR BY LISTED OUTLET BOX OR OUTLET BOX SYSTEMS IDENTIFIED FOR THE USE AND INSTALLED IN ACCORDANCE WITH 2022 CEC 314.27(C) (2022 CEC 422.18).
12. ALL LUMINARIES, LAMPHOLDERS, AND RETROFIT KITS SHALL BE LISTED (2022 CEC 410.6).
13. ALL 120-VOLT, SINGLE PHASE 15- AND 20- AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, LIVING ROOMS, DINING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. (2022 CEC 210-12(A)).
14. ALL NON-LOCKING TYPE 125-VOLT, 15 AND 20 AMPERE RECEPTACLES IN A DWELLING UNIT SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES. EXCEPTIONS: (1) RECEPTACLES MORE THAN 5'6" ABOVE THE FLOOR, (2) RECEPTACLES PART OF A LUMINAIRE OR APPLIANCE, (3) A SINGLE RECEPTACLE OR A DUPLEX RECEPTACLE FOR TWO APPLIANCES THAT ARE NOT EASILY MOVED AND LOCATED WITHIN DEDICATED SPACE AND ARE CHORD-AND-PLUG CONNECTED AS PER CEC 400.10, AND (4) NON-GROUNDING RECEPTACLES USED FOR REPLACEMENTS AS PERMITTED IN CEC 406.4(D)(2)(A).
15. HIGH EFFICACY LUMINAIRES OTHER THAN OUTDOOR HID LIGHTING CONTAIN ONLY ONLY HIGH EFFICACY LAMPS AS OUTLINED IN TABLE 150-C OF THE RESIDENTIAL ENERGY CODE AND NOT CONTAIN A MEDIUM SCREW BASE SOCKET.
16. BALLAST FOR LAMPS 13 WATTS OR GREATER SHALL BE ELECTRONIC AND HAVE AN OUTPUT FREQUENCY NO LESS THAT 20 kHz.
17. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL SMOKE DETECTORS SHALL BE INTERCONNECTEED. ALL SMOKE DETECTORS SHALL MAINTAIN A MINIMUM 3 FOOT CLEARANCE TO HVAC SUPPLY OR RETURN AIR REGISTERS.
18. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING AND PROVIDED WITH A BATTERY BACK-UP. ALL CARBON MONOXIDE ALARAMS SHALL BE INTERCONNECTEED.
19. EXHAUST FANS WILL BE CONTROLLED BY A HUMIDISTAT PER THE GREEN BUILDING STANDARDS CODE SECTION 4.506. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTS *(2022 CEnC 150.0(k)2G).*
20. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, TWO OR MORE 20-AMPERE SMALL-APPLIANCE BRANCH CIRCUITS SHALL BE PROVIDED FOR ALL RECEPTACLE OUTLETS IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREA PER 2022 CEC, ARTICLE 210.11 (C)(1). THE CIRCUTS SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 210.52(B).
21. IN ADDITION TO THE NUMBER OF BRANCH CIRCUITS REQUIRED BY OTHER PARTS OF THE CODE, AT LEAST ONE ADDITIONAL 20-AMPERE BRANCH CIRCUIT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY RECEPTACLE OUTLET(S) REQUIRED BY 2022 CEC, ARTICLE 210.52 (F). THIS CIRCUT SHALL HAVE NO OTHER OUTLETS PER 2022 CEC, ARTICLE 201.11(C)(2).

PLUMBING NOTES

1. WATER HEATER
REFER TO T-24 ENERGY REPORT FOR REQUIRED PRODUCT. SEE SHEET A-930 FOR PRODUCT REFERENCE SHEETS.

WATER HEATER SHALL FOLLOW FIRST HOUR RATINGS REQUIRED IN TABLE ***PER 2022 CPC*** **TABLE 501.1(2)**.

A. ALL DOMESTIC HOT WATER PIPING SHALL BE INSULATED. *(2022 CPC 609.12.1)*
- PIPES UP TO 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN DIAMETER OF PIPE. *(2022 CPC 609.12.2)*
- PIPES GREATER THAN 2 INCHES IN DIAMETER: INSULATION WALL THICKNESS NOT LESS THAN 2 INCHES. *(2022 CPC 609.12.2)*

EXCEPTIONS:
1. PIPING THAT PENETRATES FRAMING MEMBERS SHALL NOT BE REQUIRED TO HAVE PIPE INSULATION FOR THE DISTANCE OF THE FRAMING PENETRATION. *(2022 CPC 609.12.2)*
2. HOT WATER PIPING BETWEEN THE FIXTURE CONTROL VALVE OR SUPPLY STOP AND THE FIXTURE OR APPLIANCE SHALL NOT BE REQUIRED TO BE INSULATED. *(2022 CPC 609.12.2)*

B. PROVIDE A TEMPERATURE AND PRESSURE RELIEF VALVE WITH A FULL SIZE DRAIN OF GALVANIZED STEEL OR HARD DRAWN COPPER TO THE OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE PROTRUDING 6" MINIMUM @ 2' MAX. ABOVE GRADE POINTING DOWNWARD TO THE TERMINATION - UNTHREADED.
C. COMBUSTION AIR PER MANUFACTURE REQUIREMENTS.
D. CLEARANCES PER MANUFACTURE REQUIREMENTS.

FOR USE WITH CITY OF ESCONDIDO

CITY OF ESCONDIDO
INCORPORATED 1888

ESCONDIDO
City of Choice

THESE PLANS ARE PROVIDED BY THE CITY OF ESCONDIDO AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED. IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONTRUCT THESE PLANS WITHOUT FURTHER DETAILS, IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

AGENCY

CITY OF ESCONDIDO
https://www.escondido.gov/

ESCONDIDO CITY HALL
201 NORTH BROADWAY
ESCONDIDO CA, 92025

(760) 839-4880

ESCONDIDO PRE-APPROVED ADU
CITY OF ESCONDIDO

FINISH, MECHANICAL, & ELECTRICAL PLANS

PUBLIC SET

DATE
10/08/2024

SHEET
A4-111

11/20/2024 11:51:34 AM
Autodesk Docs://3174-01 Escondido ADU/3174_01_PP24_Escondido_CD.rvt