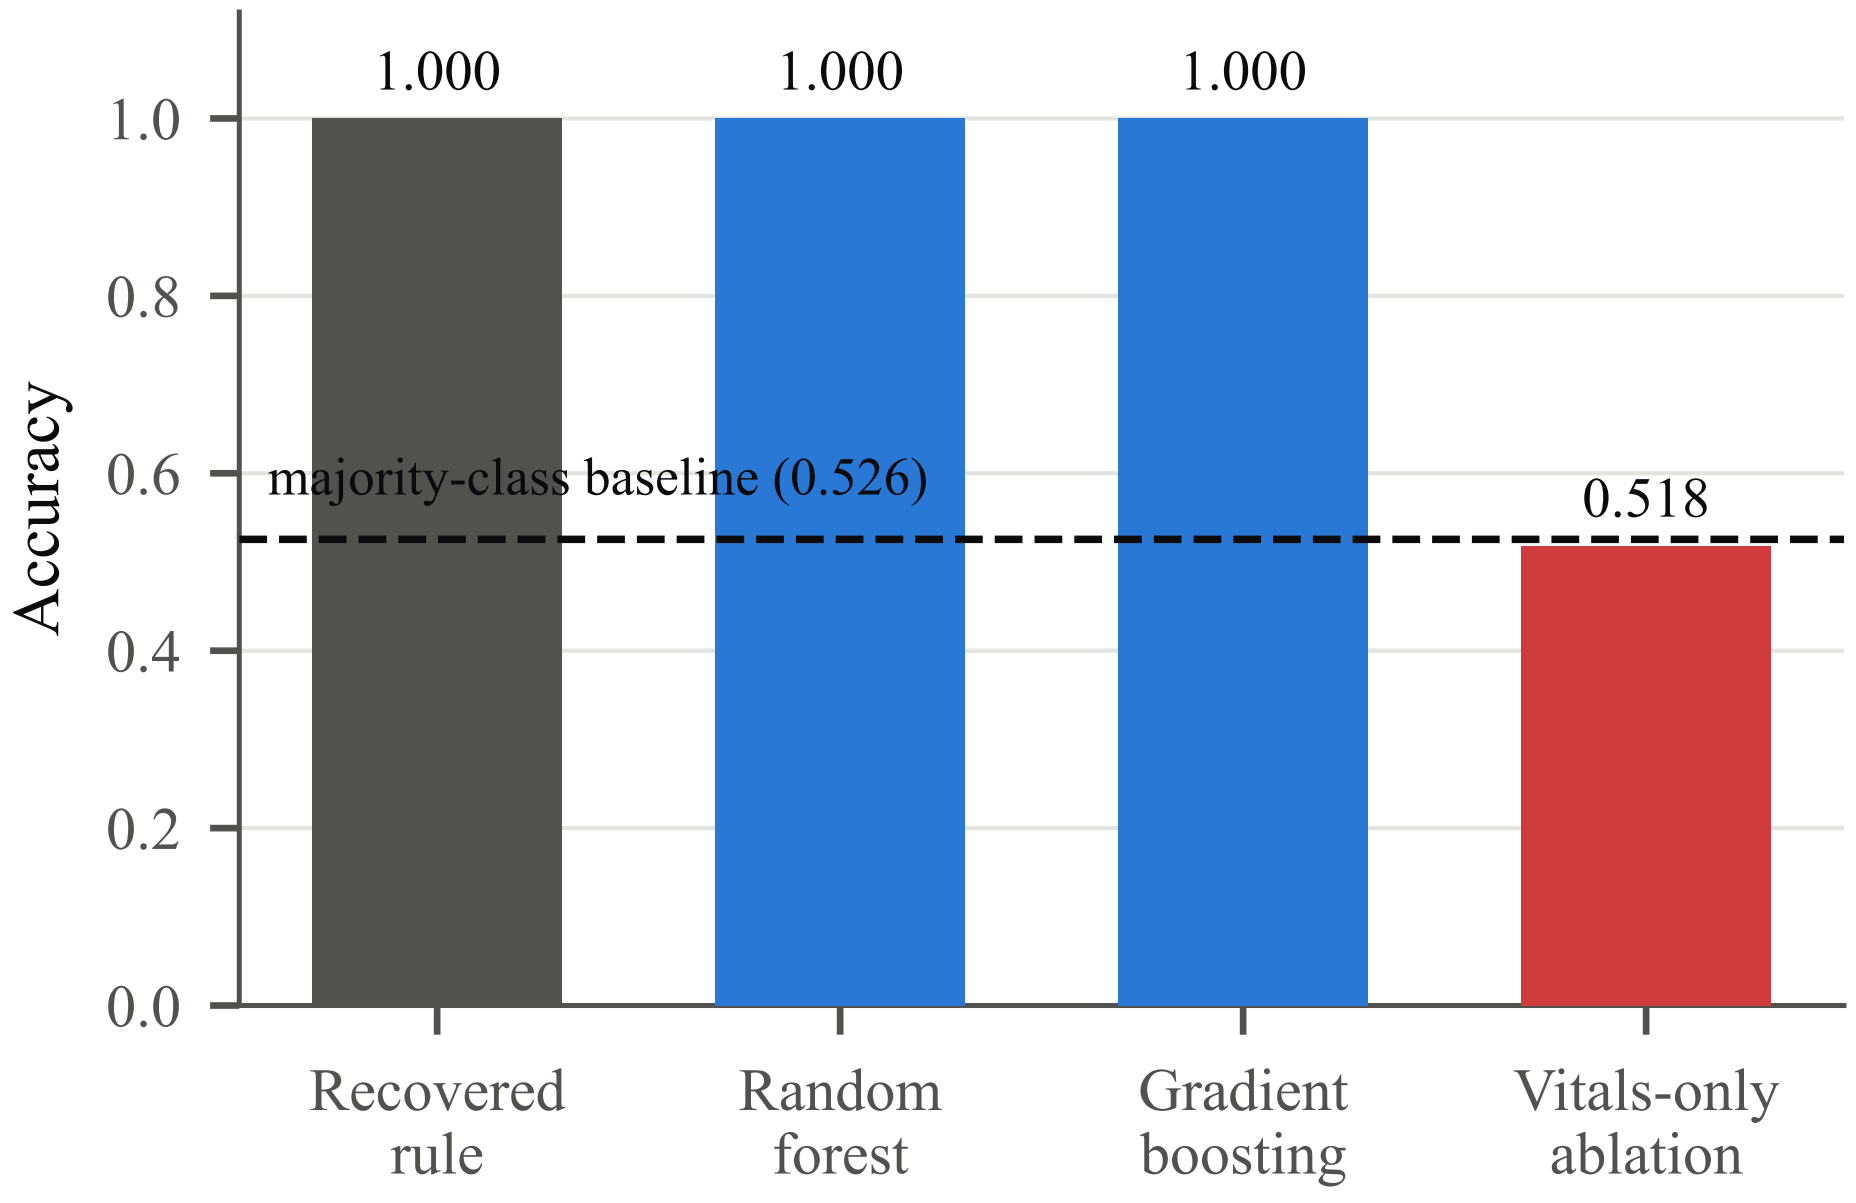
1.000
1.000
1.000
1.0
0.8
0.6
0.4
0.2
0.0
Accuracy
majority-class baseline (0.526)
0.518
Recovered rule
Random forest
Gradient boosting
Vitals-only ablation