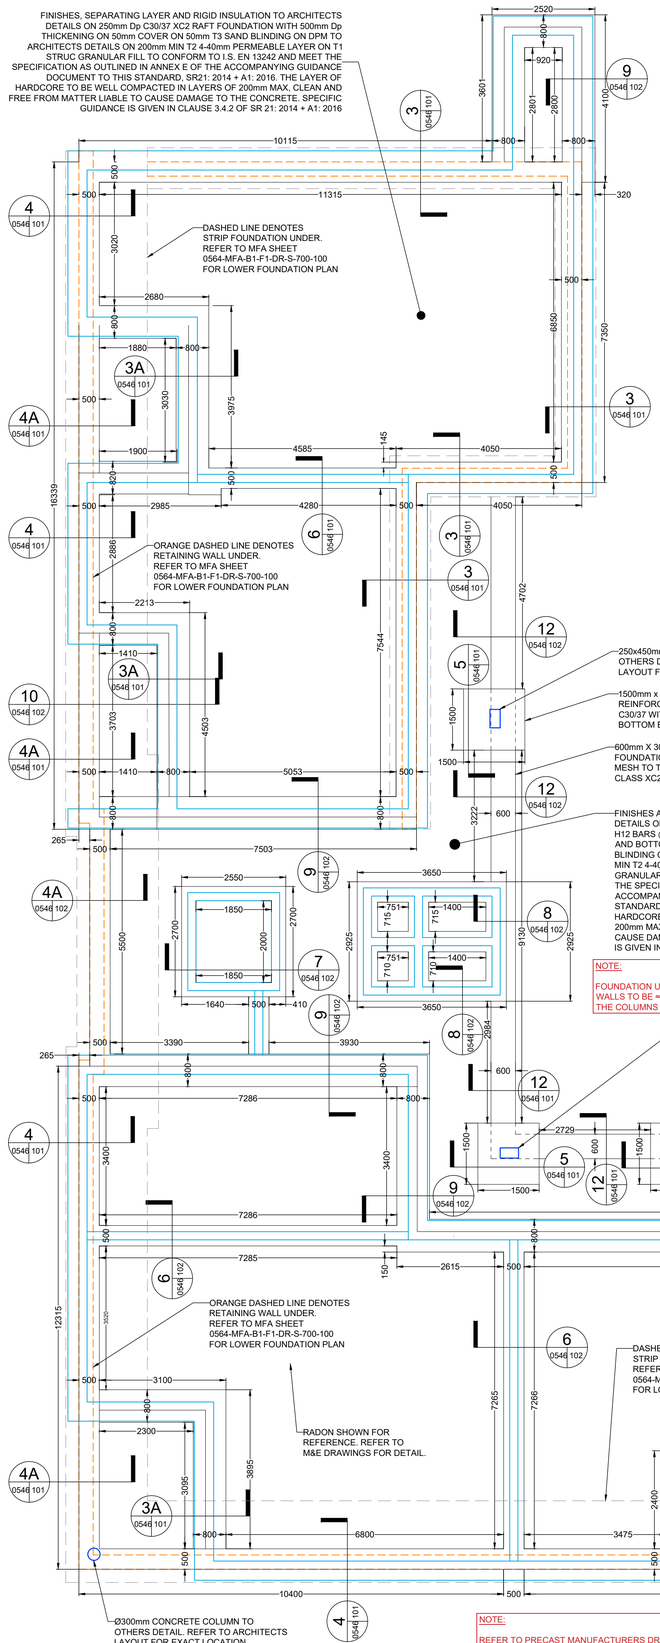

UPPER FOUNDATION PLAN - RAFT & SLAB

SCALE 1:75 @ A1

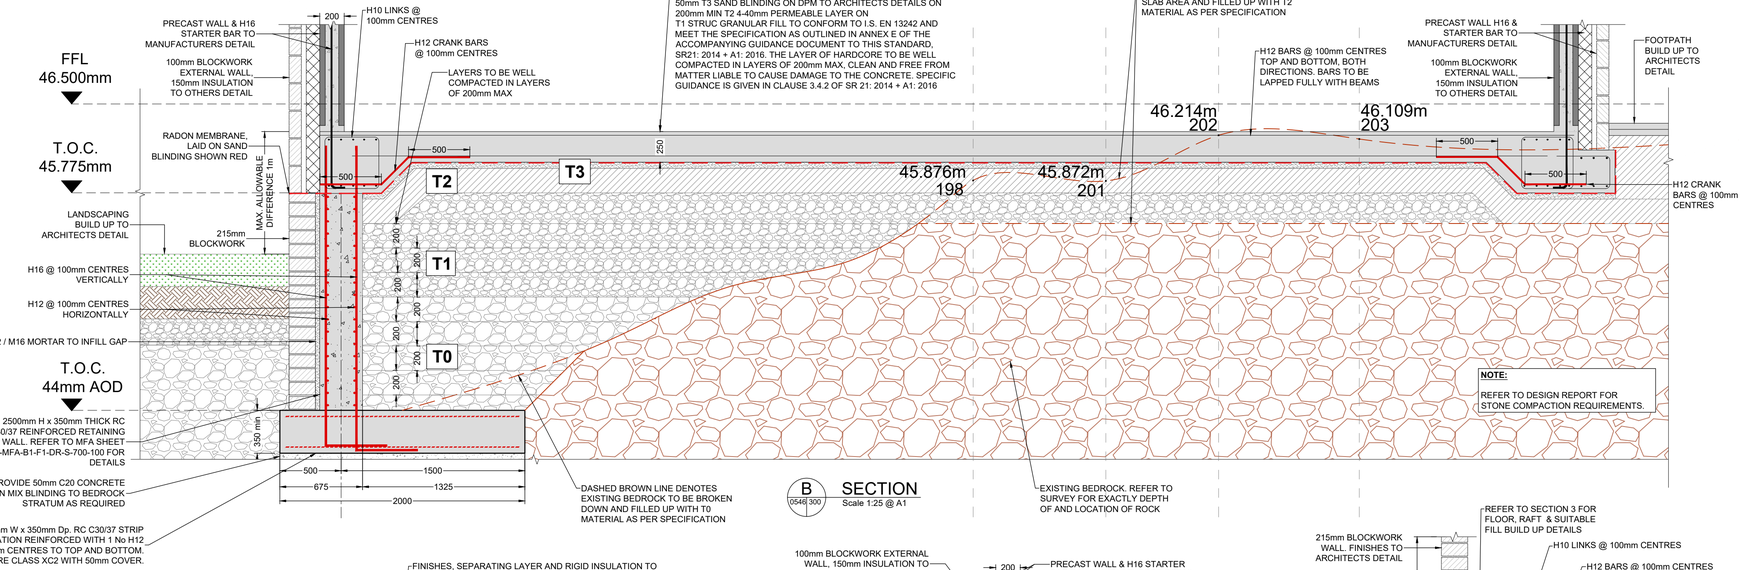

B 0546 300 SECTION Scale 1:25 @ A1

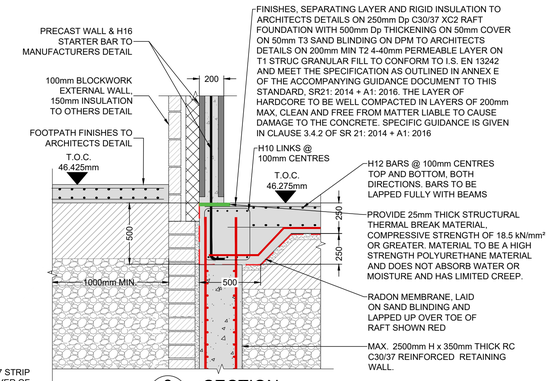

3 0546 101 SECTION Scale 1:25 @ A1

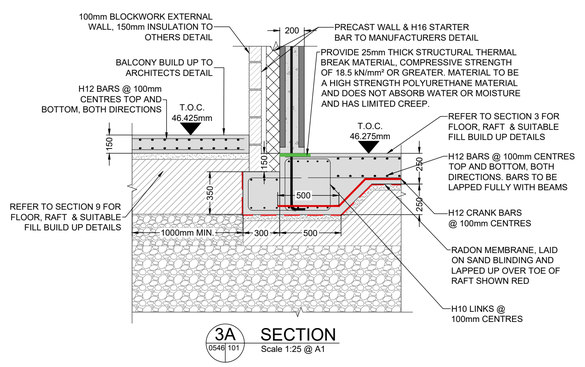

3A 0546 101 SECTION Scale 1:25 @ A1

INTERNAL BALCONY DETAIL

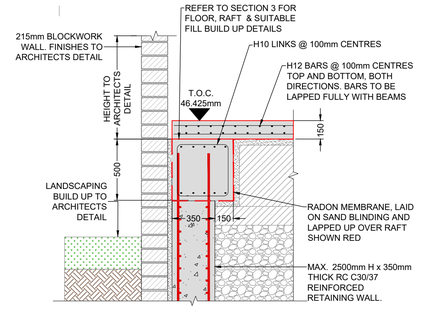

4A 0546 101 SECTION Scale 1:25 @ A1

EXTERNAL BALCONY & LIFT AREA DETAIL

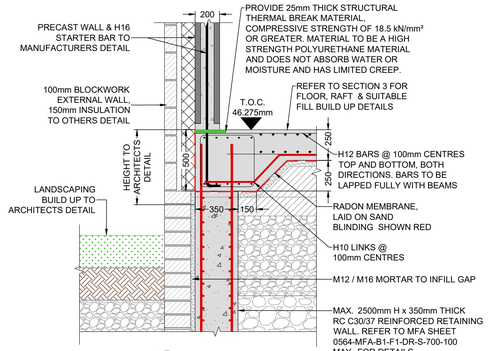

4 0546 101 SECTION Scale 1:25 @ A1

EXTERNAL WALL DETAIL INCL. GROUND SUPPORTED FLOOR.

PLATE LOAD TESTING NOTE:

5 NO. PLTS WILL BE CARRIED OUT ON THE FOLLOWING LAYERS IN ORDER TO VERIFY THE FORMATION PROPERTIES USED IN THE DESIGN:

- FORMATION LEVEL,
- AFTER PLACING AND COMPACTING THE FIRST 600-750mm OF FILL,
- AT A MAXIMUM OF 1M VERTICAL INTERVALS,
- TOP OF COMPACTED SR21 STONE

TESTS SHALL BE CARRIED OUT TO A MAXIMUM PRESSURE OF 500KPA.

THE PLTS WILL BE CARRIED OUT IN ACCORDANCE WITH BS 1377-09, AND SHALL INCLUDE THE FOLLOWING AS A MINIMUM:

- MINIMUM PLATE SIZE 450MM DIAMETER
- SAND BEDDING OF THE PLATE
- RELOAD CYCLE AS SET OUT IN BS1377-09
- RELOAD CYCLE AS FOLLOWS:

1. 0 >> 500 KPA
2. 500 >> 0 KPA
3. 0 >> 500 KPA
4. 500 >> 0 KPA

WITH LOADING TO BE APPLIED IN 5NO. INCREMENTS OF 100KPA EACH

- MINIMUM JACKING FORCE = 8T
- LOAD V DEFLECTION GRAPH
- MODULUS OF SUBGRADE REACTION
- EQUIVALENT CBR.

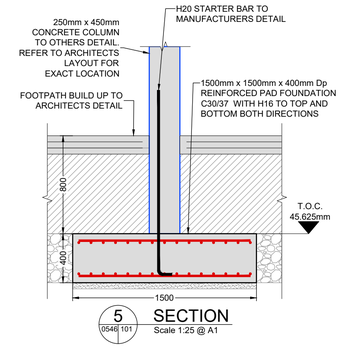

5 0546 101 SECTION Scale 1:25 @ A1

TYP. CONCRETE COLUMN DETAIL

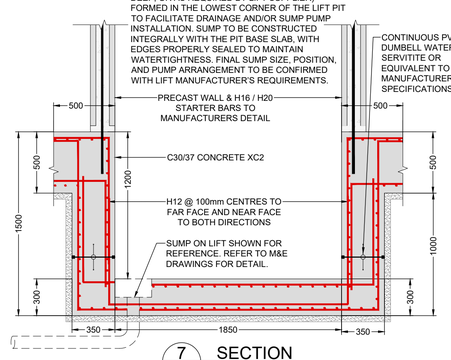

7 0546 102 SECTION Scale 1:25 @ A1