

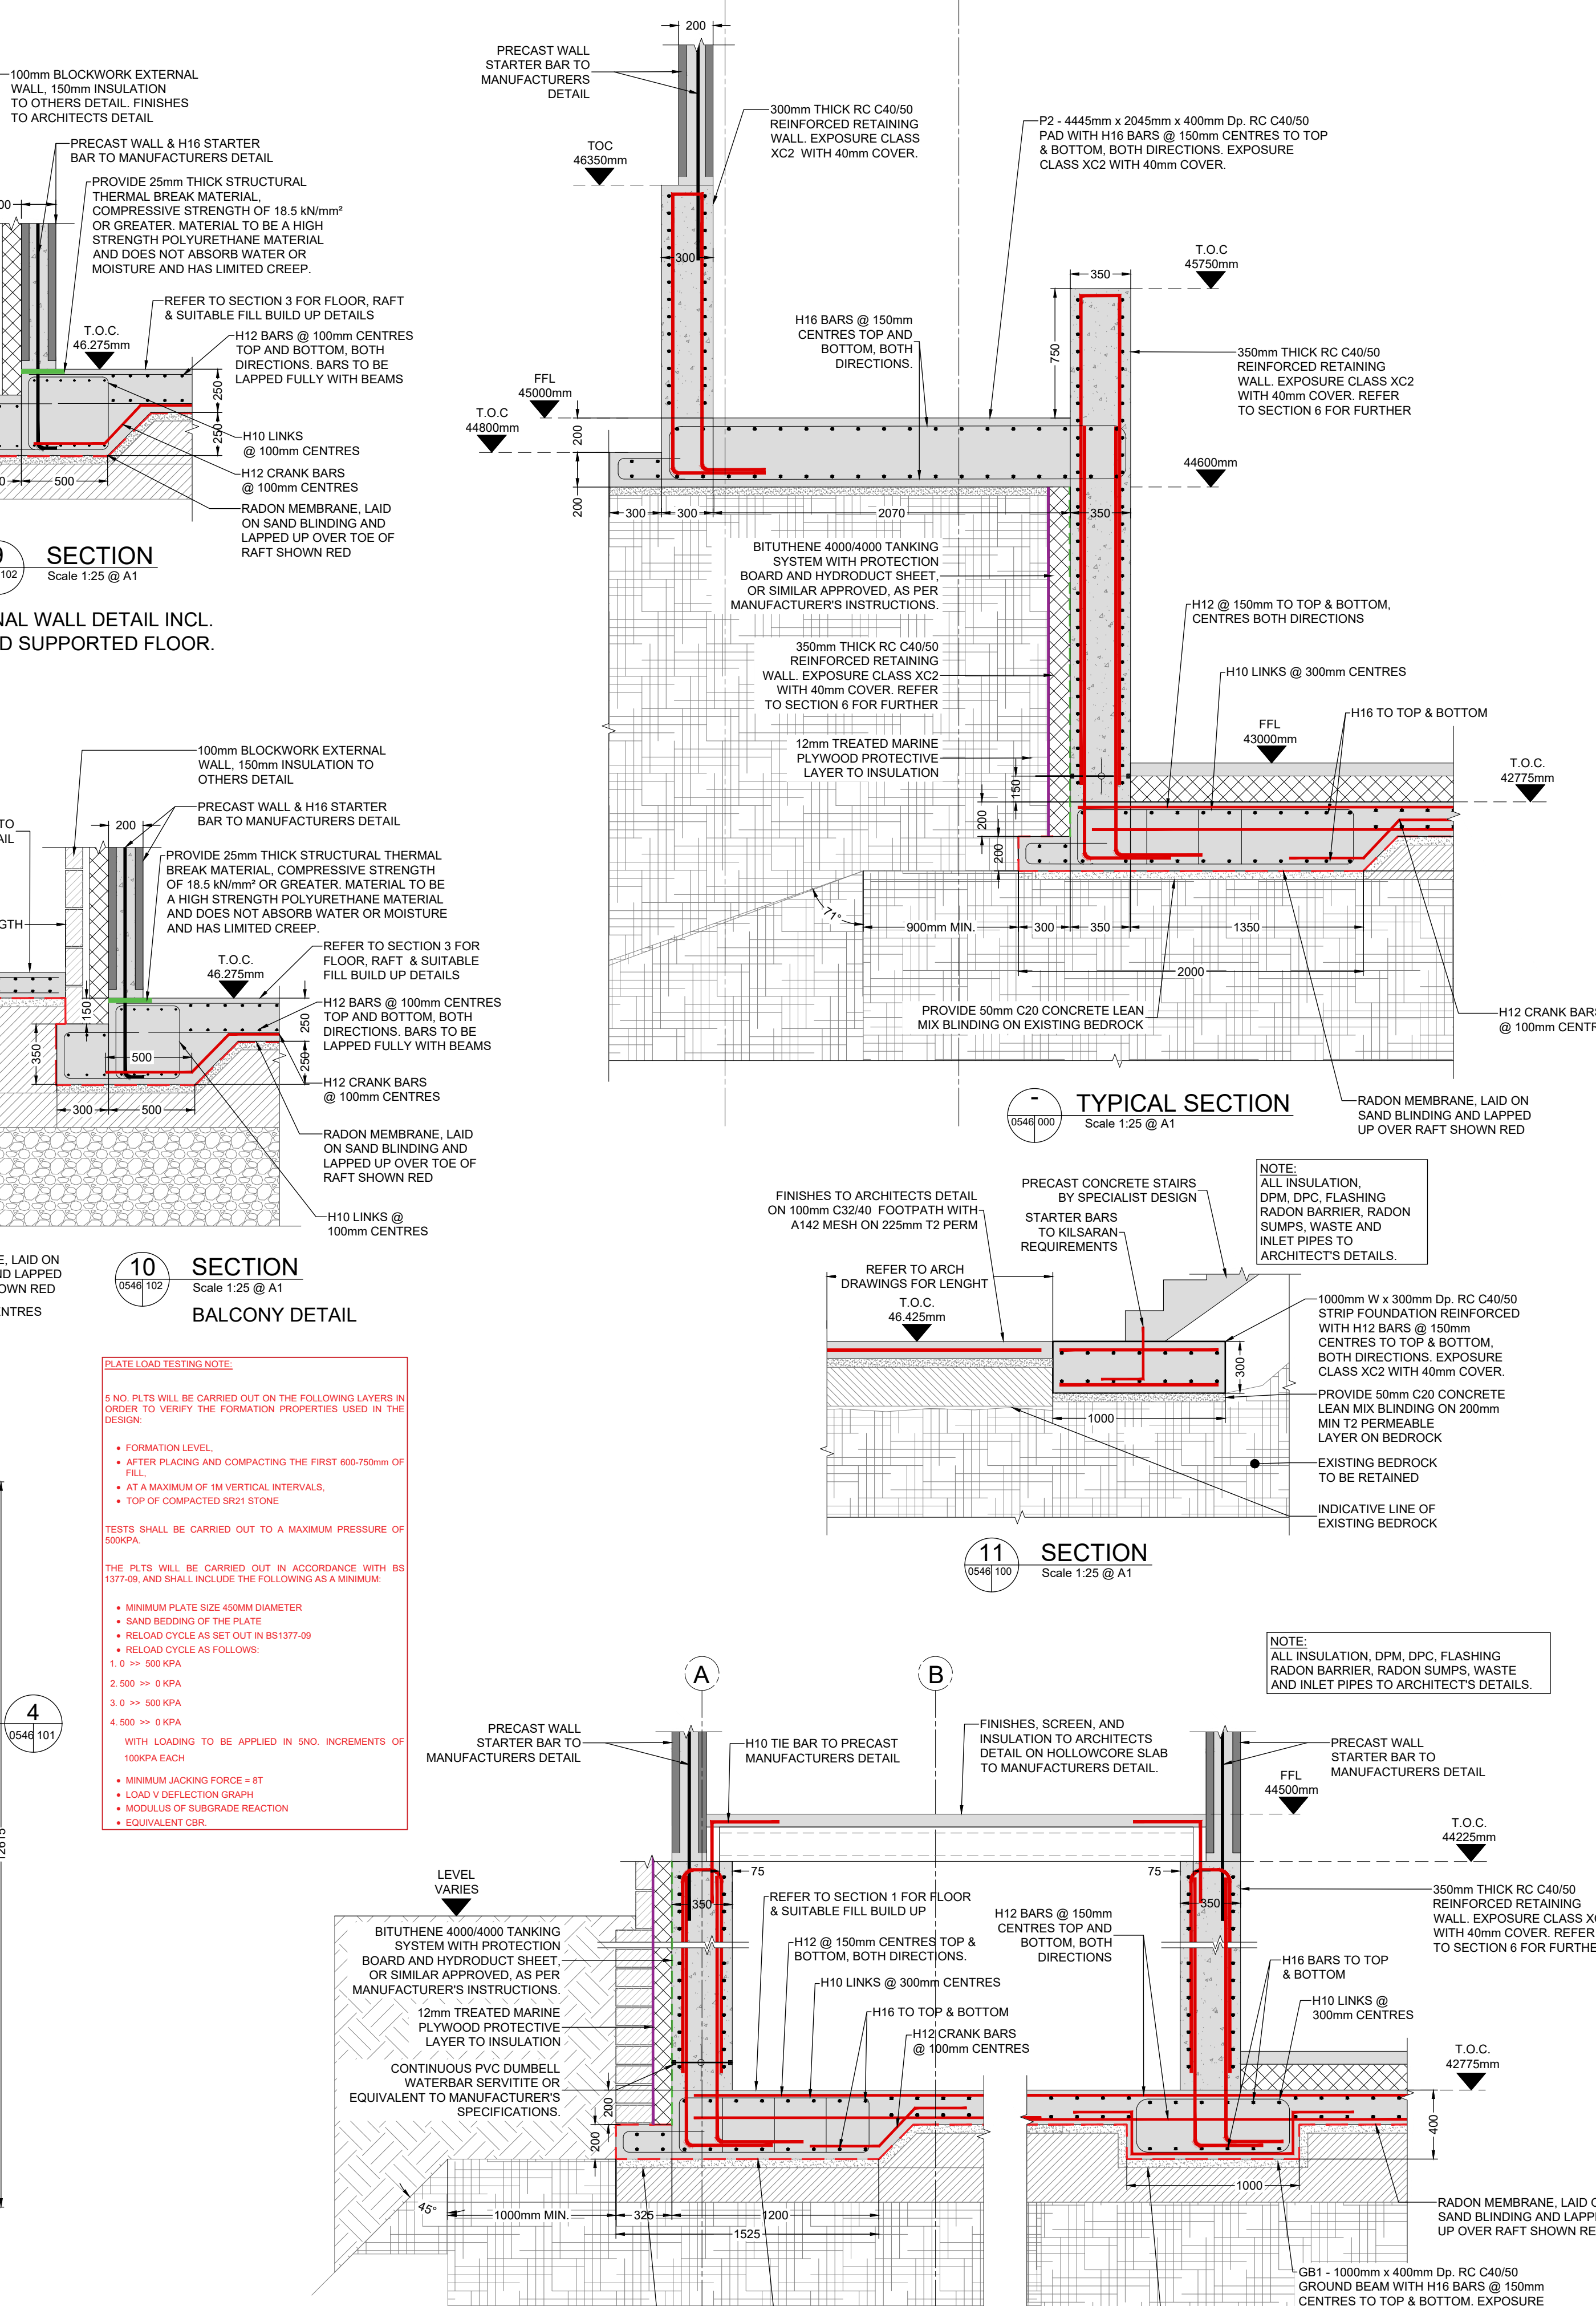
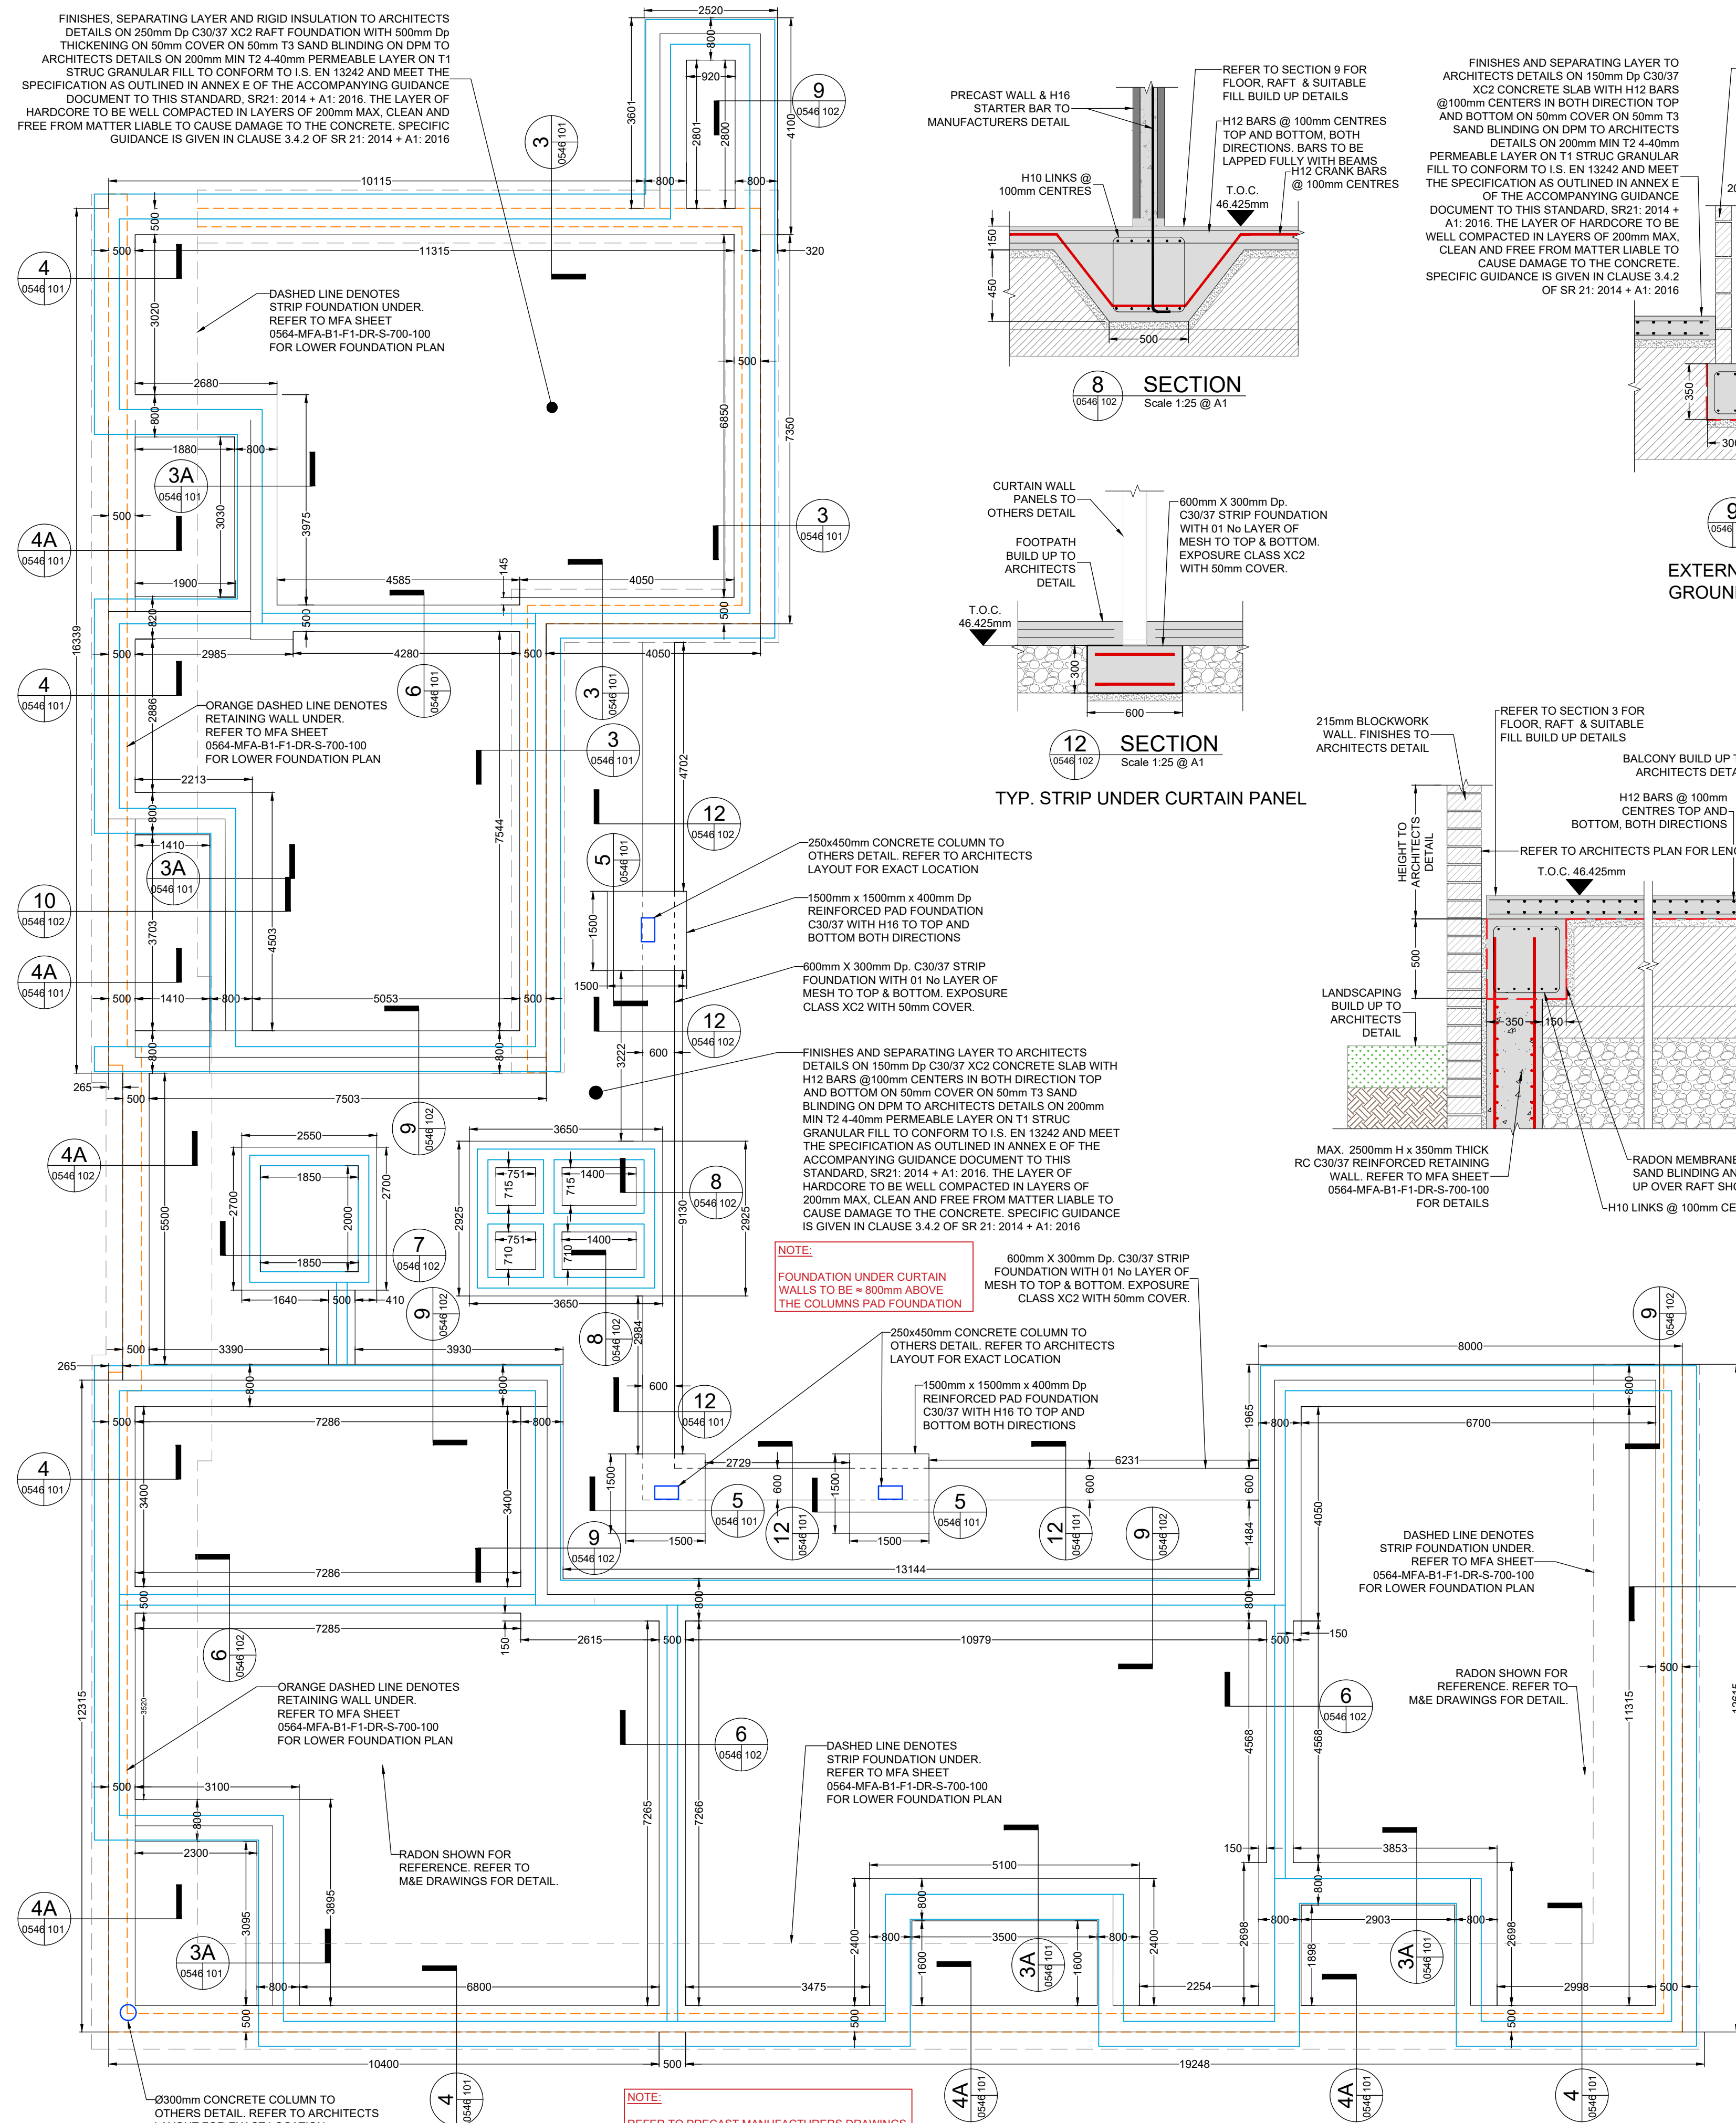


PLATE LOAD TESTING NOTE:

5. NO. PLTS WILL BE CARRIED OUT ON THE FOLLOWING LAYERS IN ORDER TO VERIFY THE FORMATION PROPERTIES USED IN THE DESIGN:

- FORMATION LEVEL
- AFTER PLACING AND COMPACTING THE FIRST 800-750mm OF FILL
- AT A MAXIMUM OF 1M VERTICAL INTERVALS
- TOP OF COMPACTED SR21 STONE

TESTS SHALL BE CARRIED OUT TO A MAXIMUM PRESSURE OF 500KPA.

THE PLTS WILL BE CARRIED OUT IN ACCORDANCE WITH BS 1377-99, AND SHALL INCLUDE THE FOLLOWING AS A MINIMUM:

- MINIMUM PLATE SIZE 450MM DIAMETER
- SAND BEDDING OF THE PLATE
- RELOAD CYCLE AS SET OUT IN BS1377-99
- RELOAD CYCLE AS FOLLOWS:

1. 0 >> 500 KPA
2. 500 >> 0 KPA
3. 0 >> 500 KPA
4. 500 >> 0 KPA

WITH LOADING TO BE APPLIED IN SNO. INCREMENTS OF 100KPA EACH

- MINIMUM JACKING FORCE = 8T
- LOAD V DEFLECTION GRAPH
- MODULUS OF SUBGRADE REACTION
- EQUIVALENT CBR

