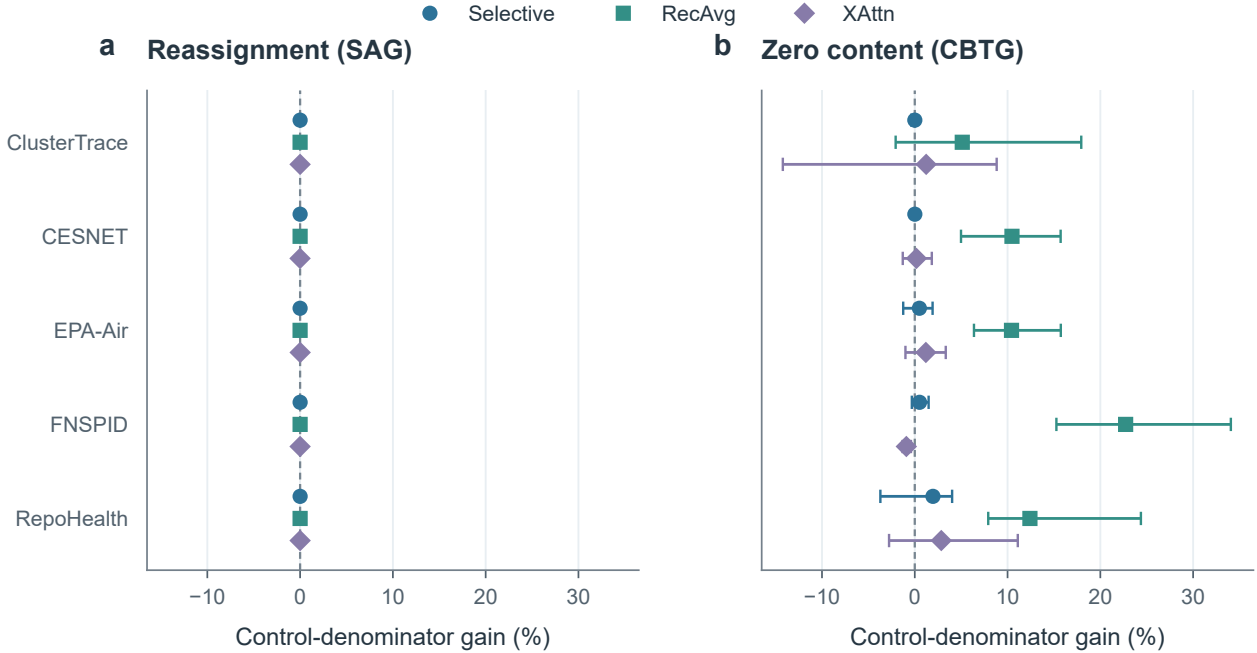

Selective
RecAvg
XAttn
a
Reassignment (SAG)
b
Zero content (CBTG)
ClusterTrace
CESNET
EPA-Air
FNSPID
RepoHealth
−10
0
10
20
30
Control-denominator gain (%)
Positive gain: altered input raises loss. Both panels use the same scale.