


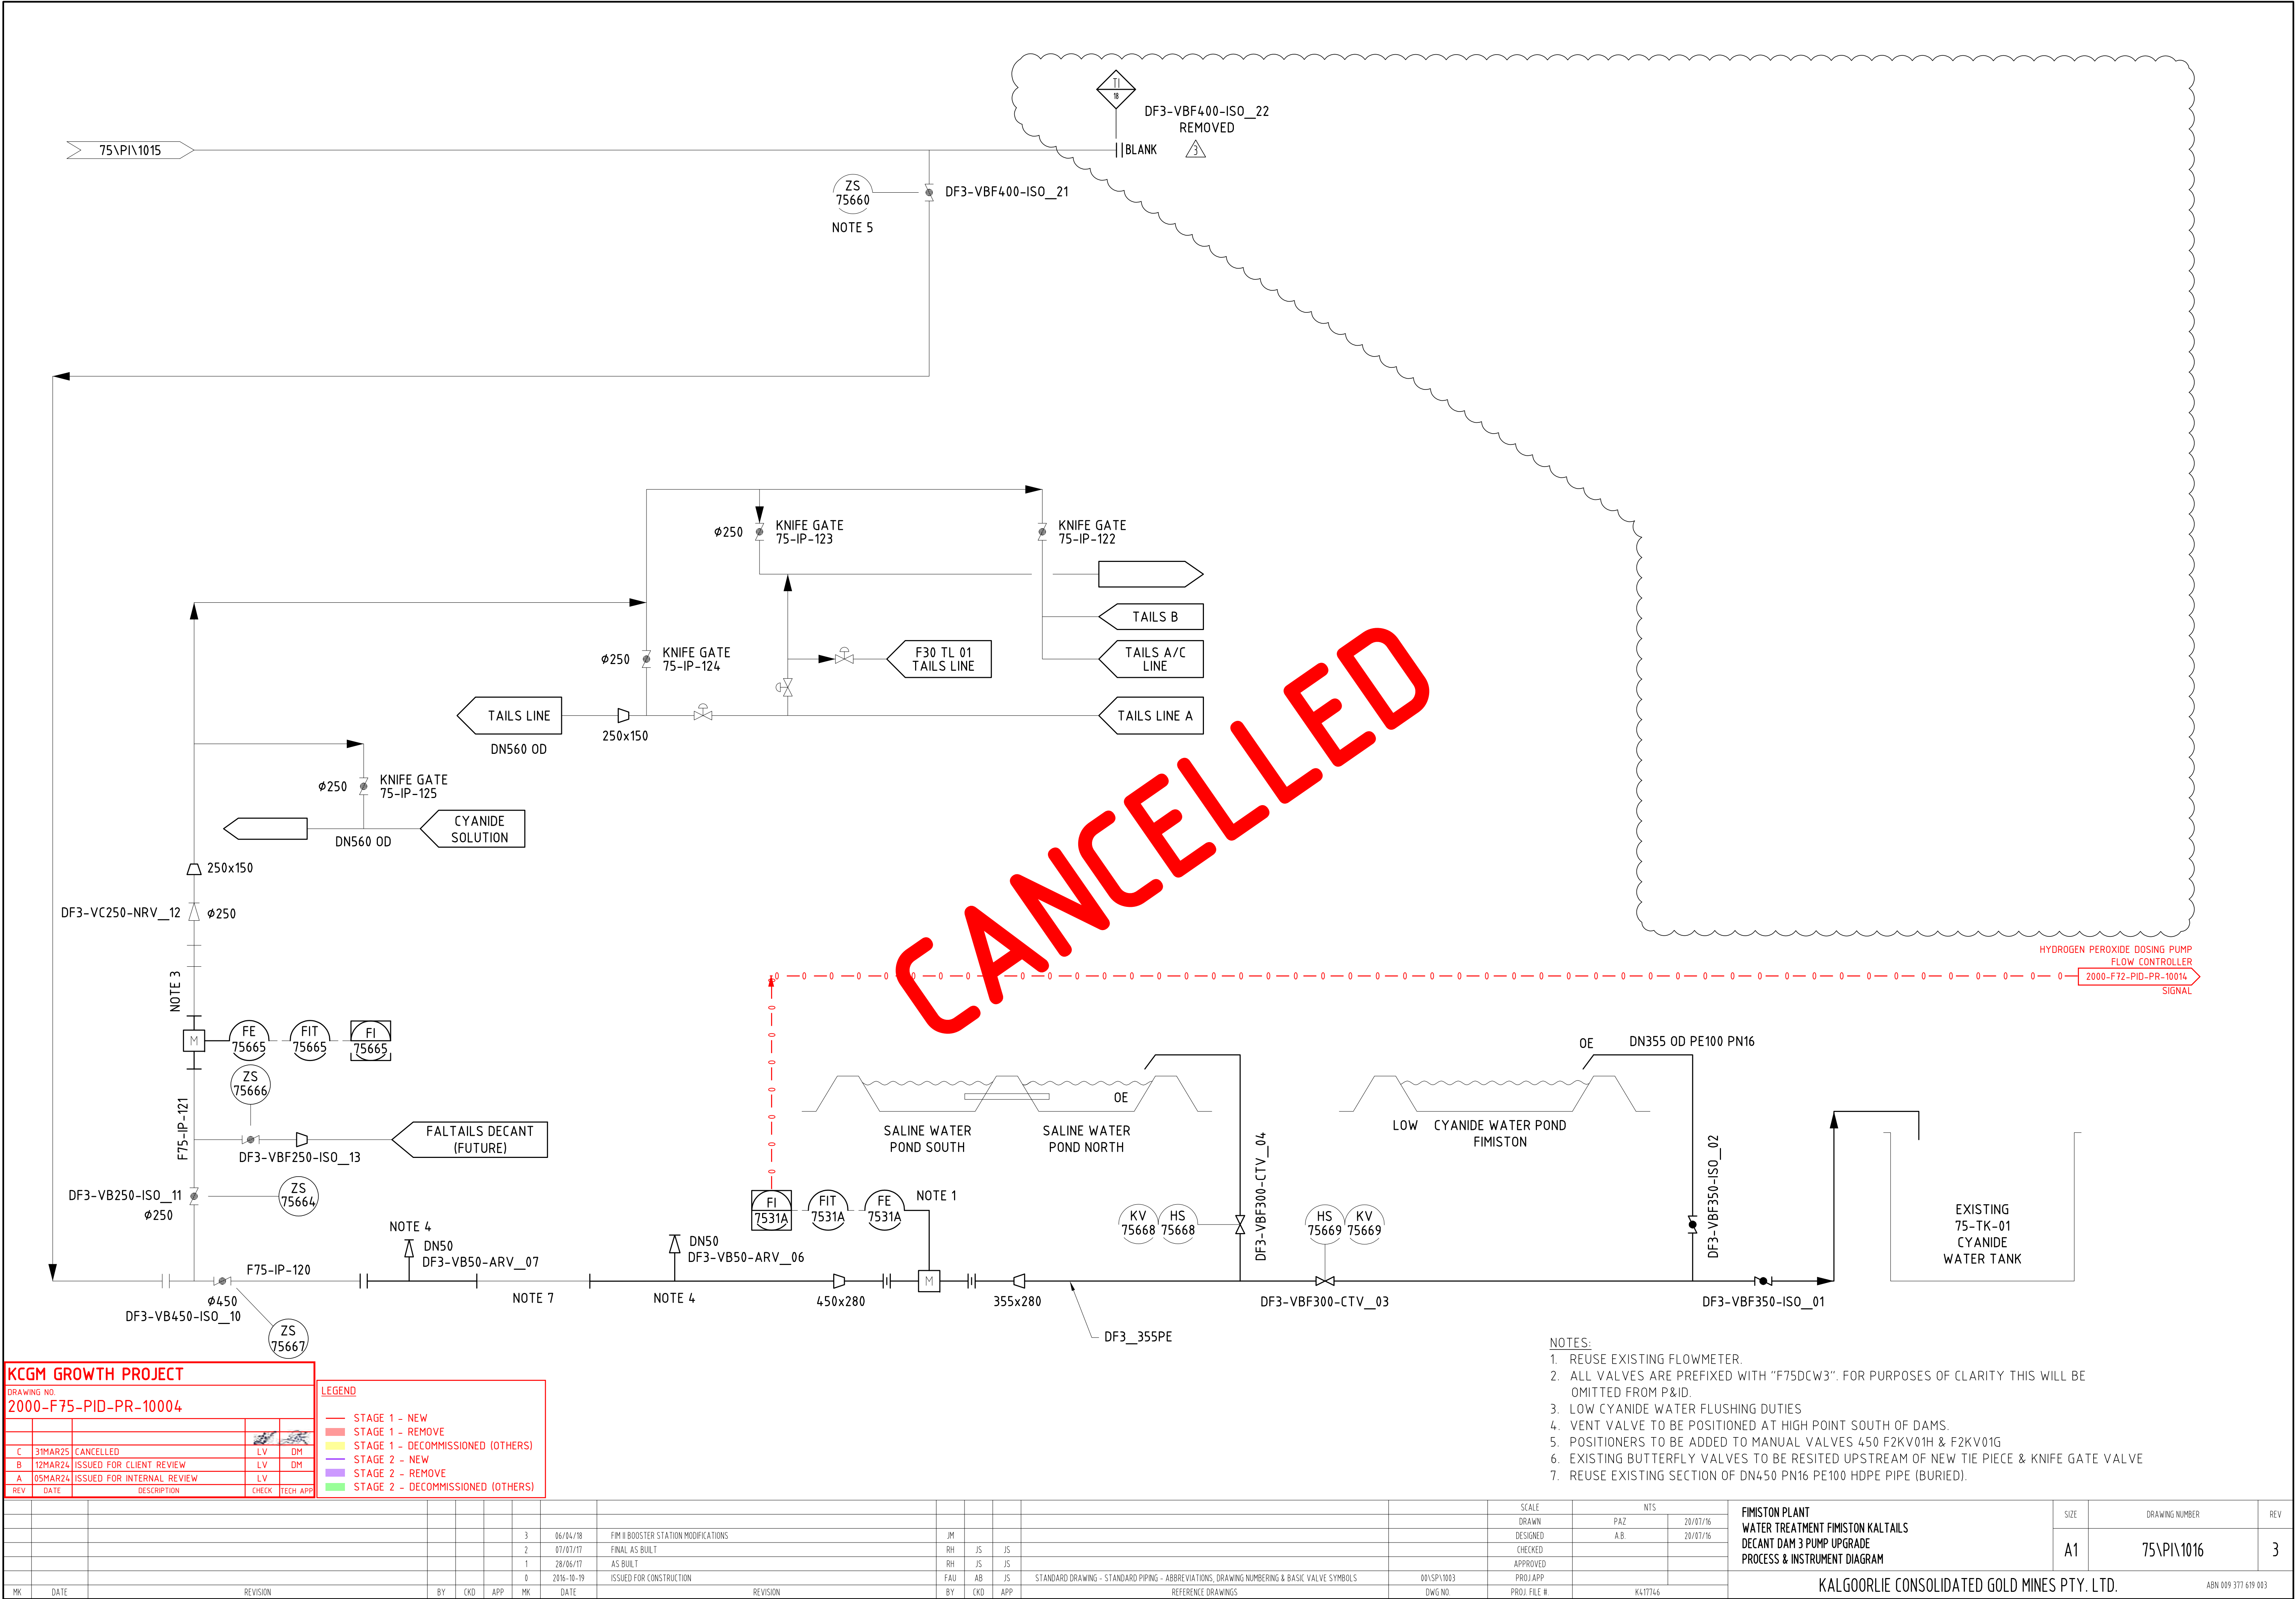

KCGM GROWTH PROJECT					
DRAWING NO. 2000-F75-PID-PR-10004					
REV	DATE	DESCRIPTION	CHECK	TECH APP	
C	31MAR25	CANCELLED	LV	DM	
B	12MAR24	ISSUED FOR CLIENT REVIEW	LV	DM	
A	05MAR24	ISSUED FOR INTERNAL REVIEW	LV		

LEGEND						NOTES:						FIMISTON PLANT WATER TREATMENT FIMISTON KALTALS DECANT DAM 3 PUMP UPGRADE PROCESS & INSTRUMENT DIAGRAM				KALGOORLIE CONSOLIDATED GOLD MINES PTY. LTD.			
— STAGE 1 - NEW						1. REUSE EXISTING FLOWMETER.						SIZE				DRAWING NUMBER			
— STAGE 1 - REMOVE						2. ALL VALVES ARE PREFIXED WITH "F75DCW3". FOR PURPOSES OF CLARITY THIS WILL BE OMITTED FROM P&ID.						A1				75\PI\1016			
— STAGE 1 - DECOMMISSIONED (OTHERS)						3. LOW CYANIDE WATER FLUSHING DUTIES													
— STAGE 2 - NEW						4. VENT VALVE TO BE POSITIONED AT HIGH POINT SOUTH OF DAMS.													
— STAGE 2 - REMOVE						5. POSITIONERS TO BE ADDED TO MANUAL VALVES 450 F2KV01H & F2KV01G													
— STAGE 2 - DECOMMISSIONED (OTHERS)						6. EXISTING BUTTERFLY VALVES TO BE RESITED UPSTREAM OF NEW TIE PIECE & KNIFE GATE VALVE													
						7. REUSE EXISTING SECTION OF DN450 PN16 PE100 HDPE PIPE (BURIED).													