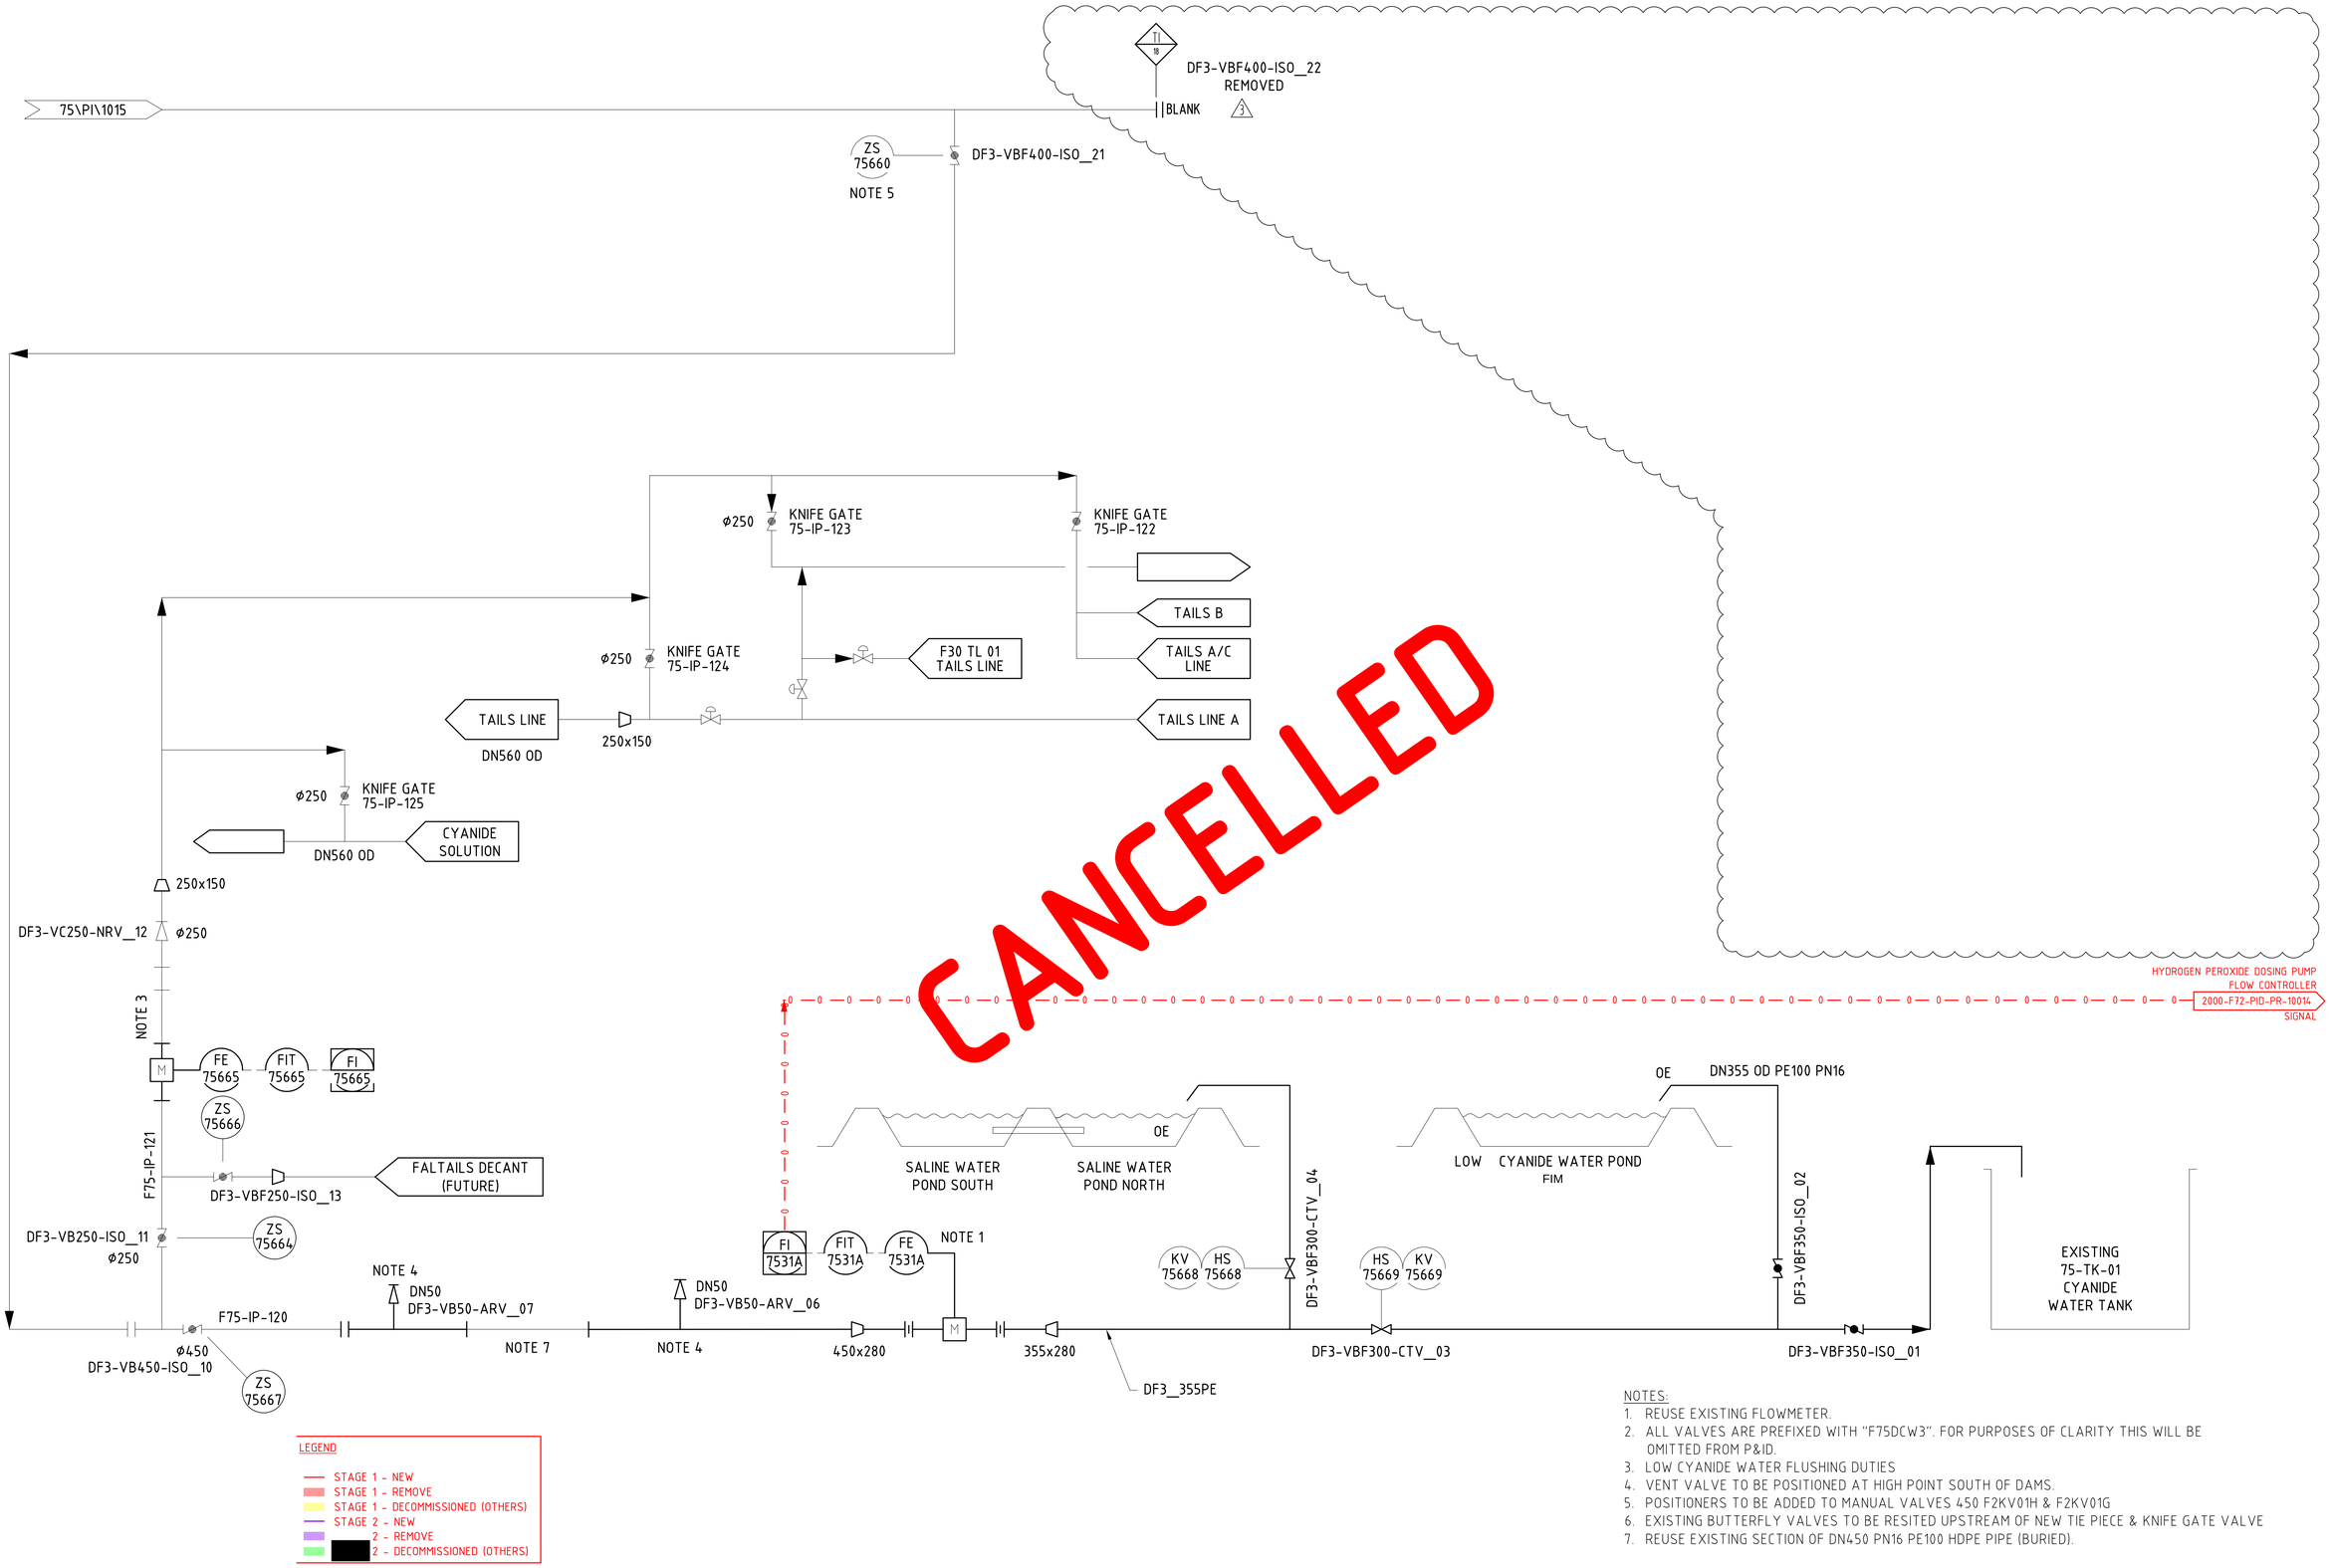



LEGEND

- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- 2 - REMOVE
- 2 - DECOMMISSIONED (OTHERS)

NOTES:

1. REUSE EXISTING FLOWMETER.
2. ALL VALVES ARE PREFIXED WITH "F75DCW3". FOR PURPOSES OF CLARITY THIS WILL BE OMITTED FROM P&ID.
3. LOW CYANIDE WATER FLUSHING DUTIES
4. VENT VALVE TO BE POSITIONED AT HIGH POINT SOUTH OF DAMS.
5. POSITIONERS TO BE ADDED TO MANUAL VALVES 450 F2KV01H & F2KV01G
6. EXISTING BUTTERFLY VALVES TO BE RESITED UPSTREAM OF NEW TIE PIECE & KNIFE GATE VALVE
7. REUSE EXISTING SECTION OF DN450 PN16 PE100 HDPE PIPE (BURIED).